



# Aereco BXC-EC Demand Controlled Extract Unit Instruction Manual

[Home](#) » [AERECO](#) » Aereco BXC-EC Demand Controlled Extract Unit Instruction Manual 




## Contents

- [1 Aereco BXC-EC Demand Controlled Extract Unit Instruction Manual](#)
  - [1.1 Pressure measurement](#)
  - [1.2 Airflow setting](#)
- [2 Documents / Resources](#)
  - [2.1 References](#)
- [3 Related Posts](#)

## Aereco BXC-EC Demand Controlled Extract Unit Instruction Manual

BXC\_EC









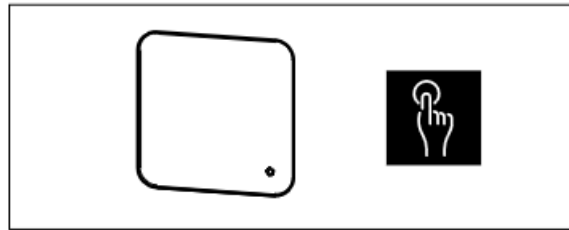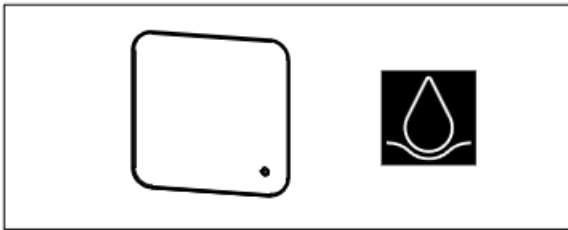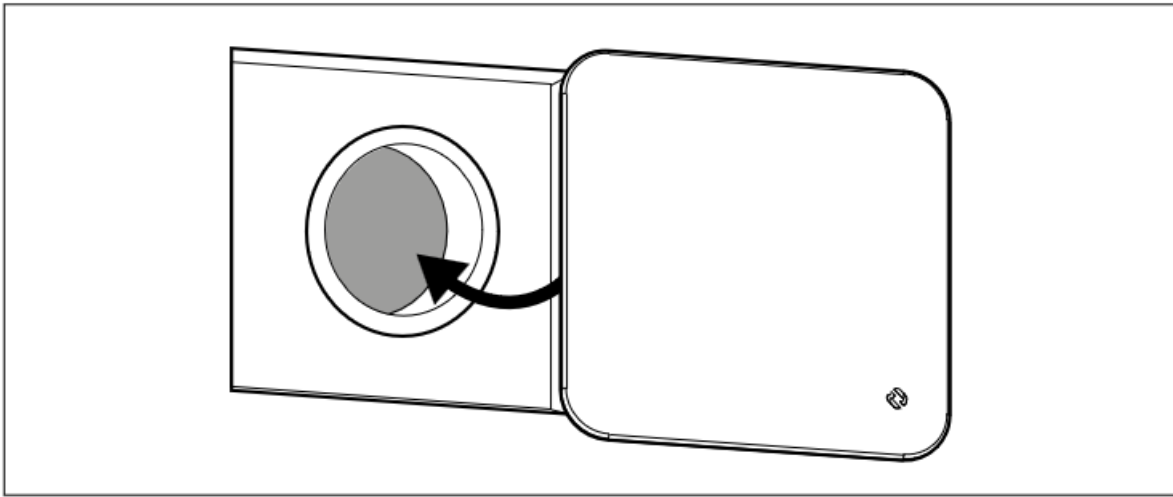



62 rue de Lamirault  
Collégien  
77615 MARNE LA VALLEE CEDEX 3  
FRANCE  
[www.aereco.com](http://www.aereco.com)

7496\_A\_NOT\_POS\_BXE\_C



**Pressure measurement**

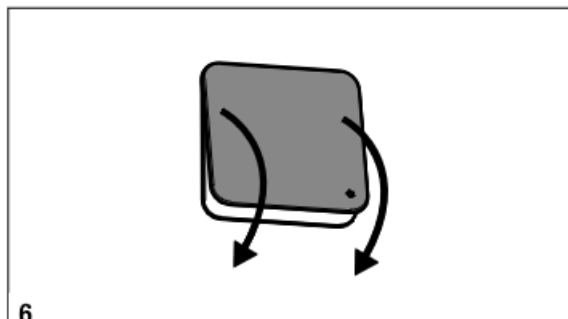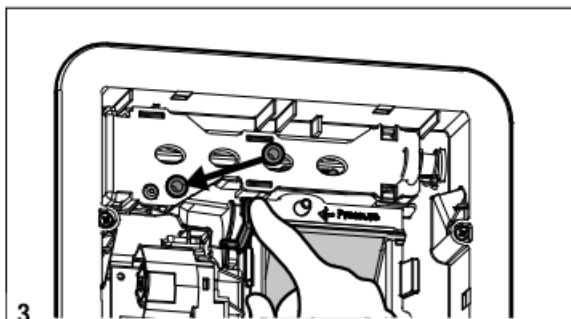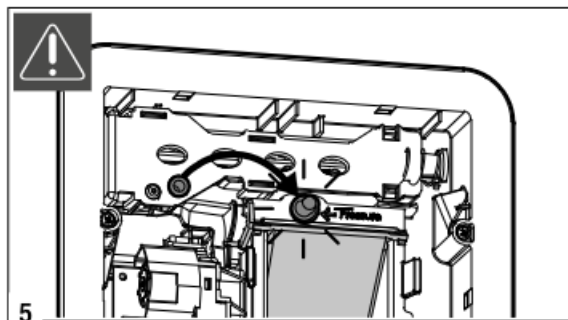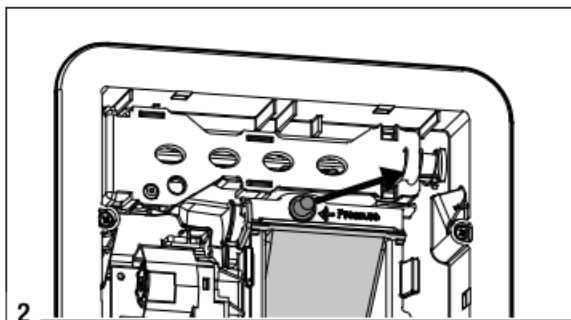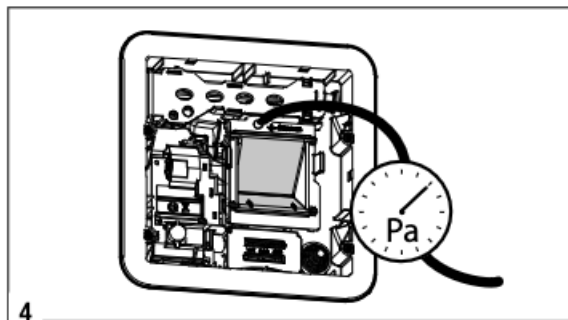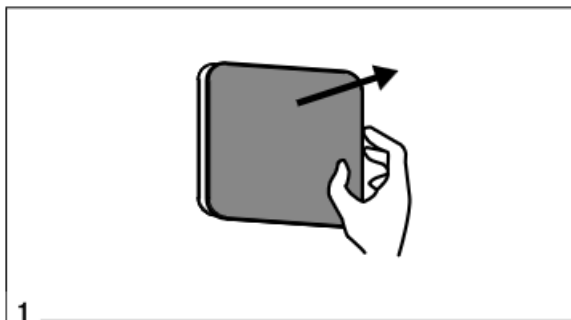



## Airflow setting

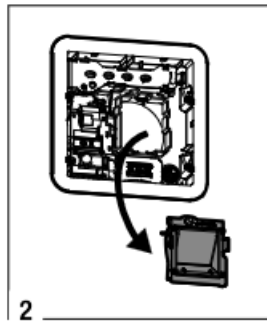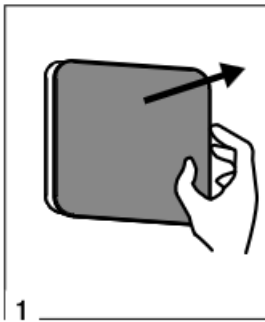








| Ø 100 mm |                                |                                |
|----------|--------------------------------|--------------------------------|
| Position | Min airflow<br>(m³/h) @ 100 Pa | Max airflow<br>(m³/h) @ 100 Pa |
| 0        | 12                             | 80                             |
| 1        | 18                             | 90                             |
| 2        | 24                             | 100                            |
| 3        | 30                             | 110                            |
| 4        | 36                             | 120                            |
| 5        | 42                             | 130                            |












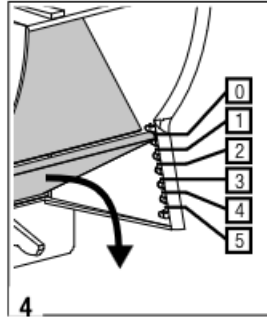
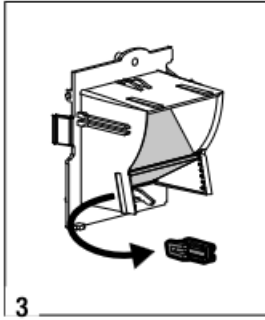


| Ø 125 mm |                                |                                |
|----------|--------------------------------|--------------------------------|
| Position | Min airflow (m³/h) @<br>100 Pa | Max airflow<br>(m³/h) @ 100 Pa |
| 0        | 12                             | 70                             |
| 1        | 18                             | 80                             |
| 2        | 24                             | 90                             |
| 3        | 30                             | 100                            |
| 4        | 36                             | 110                            |
| 5        | 42                             | 120                            |

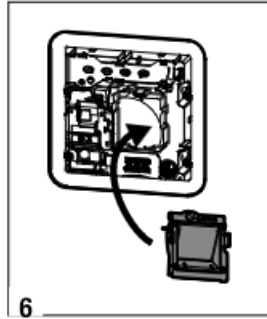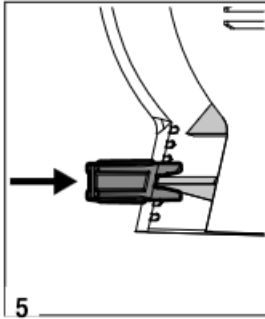

| Ø 100 mm |                                |                                |
|----------|--------------------------------|--------------------------------|
| Position | Min airflow<br>(m³/h) @ 100 Pa | Max airflow<br>(m³/h) @ 100 Pa |
| 0        | 12                             | 70                             |
| 1        | 18                             | 76                             |
| 2        | 24                             | 82                             |
| 3        | 30                             | 88                             |
| 4        | 36                             | 94                             |
| 5        | 42                             | 100                            |

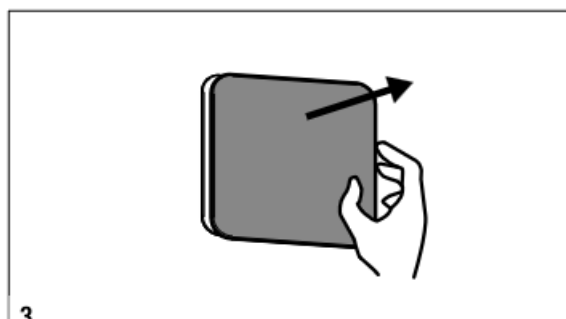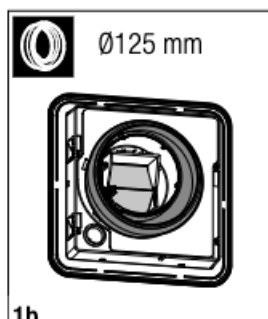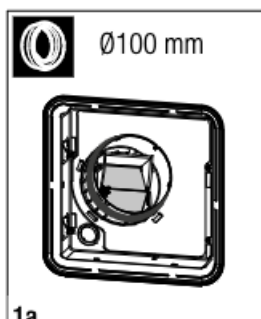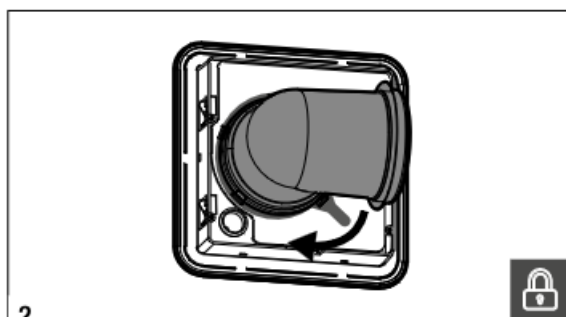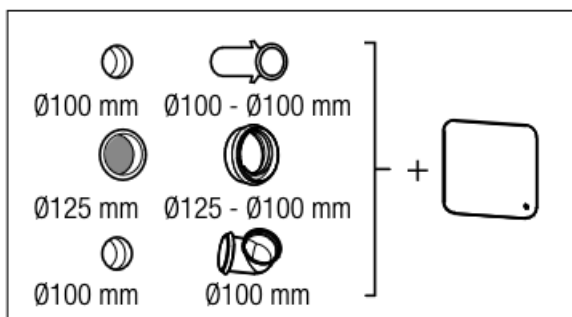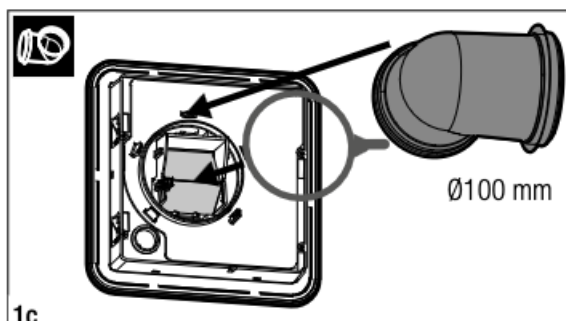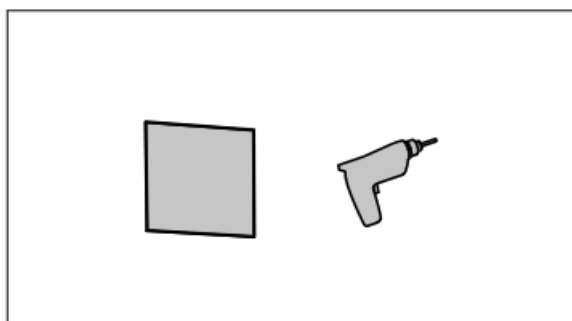

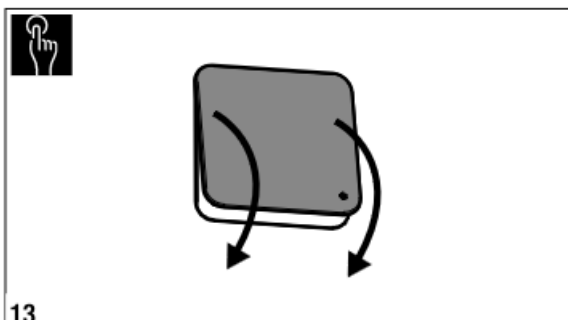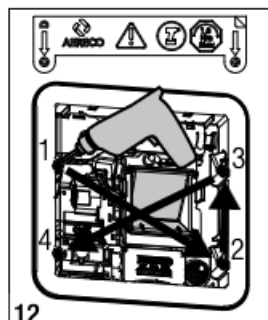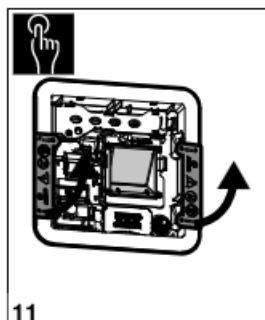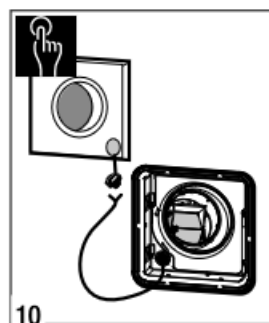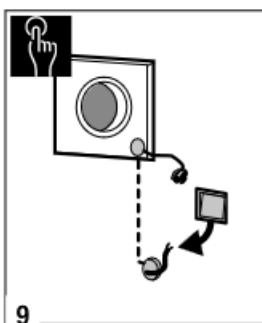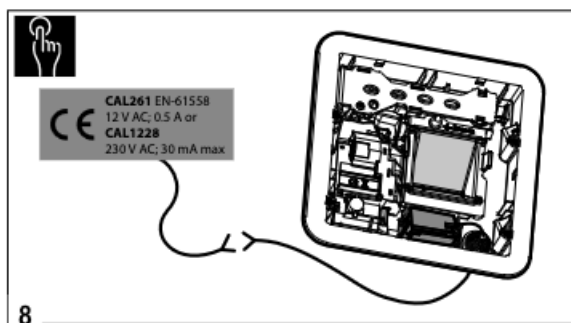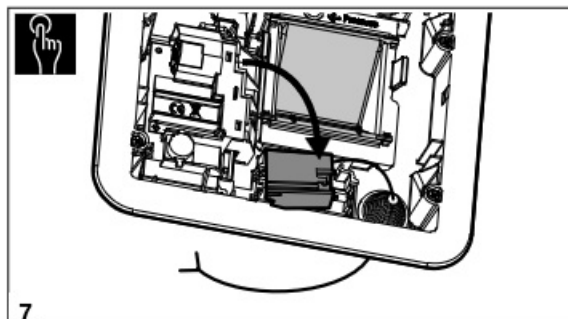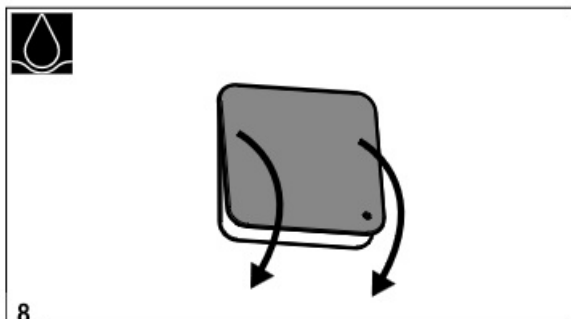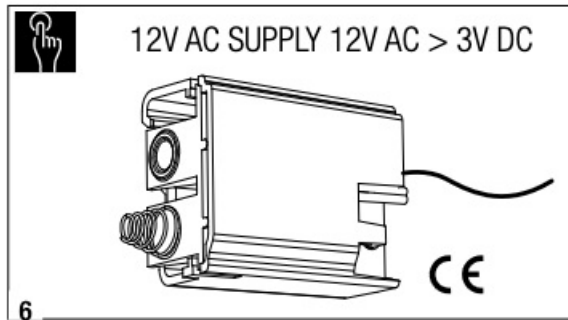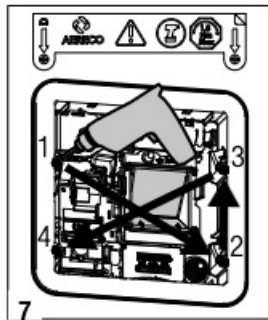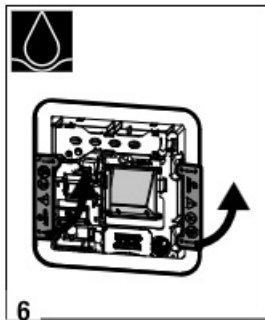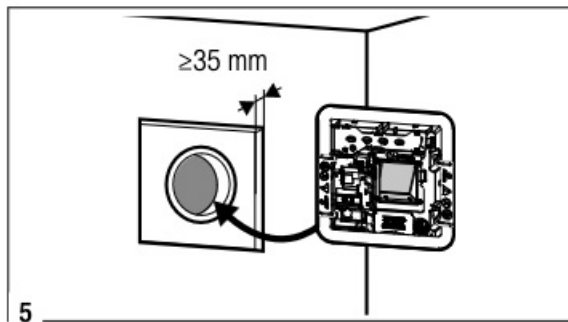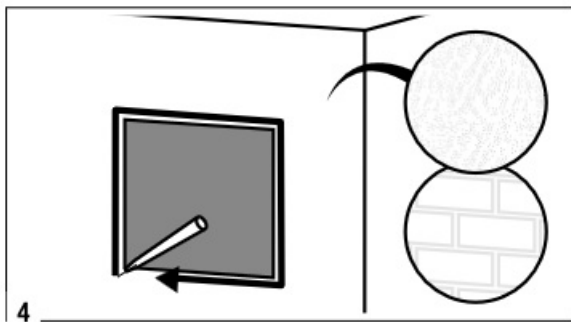

## Documents / Resources



[Aereco BXC-EC Demand Controlled Extract Unit](#) [pdf] Instruction Manual  
BXC-EC Demand Controlled Extract Unit, BXC-EC, Demand Controlled Extract Unit, Controlled Extract Unit, Extract Unit

## References

-  [Demand controlled ventilation | Aereco](#)

Manuals+.