

Allen-Bradley 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules Instruction Manual

Allen-Bradley 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules Instruction Manual



Contents


- 1 Summary of Changes
- 2 Environment and Enclosure
- 3 Prevent Electrostatic Discharge
- 4 North American Hazardous Location Approval
- 5 Additional Resources
- 6 Overview
 - 6.1 Module Overview
- 7 Module Description
- 8 Mount the Module
- 9 DIN Rail Mounting
- 10 Panel Mounting
- 11 System Assembly
- 12 Specifications
- 13 Input Specifications
- 14 Input Specifications (Continued)
- 15 Output Specifications
- 16 Environmental Specifications
- 17 Environmental Specifications (Continued)
- 18 Certifications
- 19 Rockwell Automation Support
- 20 Waste Electrical and Electronic Equipment (WEEE)
- 21 Documents / Resources
 - 21.1 References

Summary of Changes

This publication contains the following new or updated information. This list includes substantive updates only and is not intended to reflect all changes. Translated versions are not always available for each revision.

Topic	Page
Updated template	Throughout
Updated Environment and Enclosure	2
Updated Attentions	3
Added Micro870 controller to Overview	4
Updated Environmental Specifications	9
Updated Certification	9

Environment and Enclosure

 **ATTENTION:** This equipment is intended for use in a Pollution Degree 2 industrial environment, in overvoltage Category II applications (as defined in EN/IEC 60664-1), at altitudes up to 2000 m (6562 ft) without derating. This equipment is not intended for use in residential environments and may not provide adequate protection to radio communication services in such environments. This equipment is supplied as open-type equipment for indoor use. It must be mounted within an enclosure that is suitably designed for those specific environmental conditions that will be present and appropriately designed to prevent personal injury resulting from accessibility to live parts. The enclosure must have suitable flame-retardant properties to prevent or minimize the spread of flame, complying with a flame spread rating of 5VA or be approved for the application if nonmetallic.

The interior of the enclosure must be accessible only by the use of a tool. Subsequent sections of this publication may contain more information regarding specific enclosure type ratings that are required to comply with certain product safety certifications.

In addition to this publication, see the following:

- Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1, for more installation requirements.
- NEMA Standard 250 and EN/IEC 60529, as applicable, for explanations of the degrees of protection provided by enclosures.

Prevent Electrostatic Discharge



ATTENTION: This equipment is sensitive to electrostatic discharge, which can cause internal damage and affect normal operation. Follow these guidelines when you handle this equipment:

- Touch a grounded object to discharge potential static.
- Wear an approved grounding wriststrap.
- Do not touch connectors or pins on component boards.
- Do not touch circuit components inside the equipment.
- Use a static-safe workstation, if available.
- Store the equipment in appropriate static-safe packaging when not in use

North American Hazardous Location Approval

The following information applies when operating this equipment in hazardous locations:

Products marked “CL I, DIV 2, GP A, B, C, D” are suitable for use in Class I Division 2 Groups A, B, C, D, Hazardous Locations and nonhazardous locations only. Each product is supplied with markings on the rating nameplate indicating the hazardous location temperature code. When combining products within a system, the most adverse temperature code (lowest “T” number) may be used to help determine the overall temperature code of the system. Combinations of equipment in your system are subject to investigation by the local Authority Having Jurisdiction at the time of installation.



WARNING: EXPLOSION HAZARD

- Do not disconnect equipment unless power has been removed or the area is known to be nonhazardous. Do not disconnect connections to this equipment unless power has been removed or the area is known to be nonhazardous. Secure any external connections that mate to this equipment by using screws, sliding latches, threaded connectors, or other means provided with this product.
- Substitution of components may impair suitability for Class I, Division 2.



ATTENTION

- This product is grounded through the DIN rail to chassis ground. Use zinc-plated chromatepassivated steel

DIN rail to assure proper grounding. The use of other DIN rail materials (for example, aluminum or plastic) that can corrode, oxidize, or are poor conductors, can result in improper or intermittent grounding. Secure DIN rail to mounting surface approximately every 200 mm (7.8 in.) and use end-anchors appropriately. Be sure to ground the DIN rail properly. Refer to Industrial Automation Wiring and Grounding Guidelines, Rockwell Automation publication 1770-4.1, for more information.

To comply with UL restrictions, this equipment must be powered from a source compliant with the following: Class 2 or Limited Voltage/Current.

- To comply with the CE Low Voltage Directive (LVD), all connected I/O must be powered from a source compliant with the following: Safety Extra Low Voltage (SELV) or Protected Extra Low Voltage (PELV).
- Failure to connect a bus terminator module to the last expansion I/O module will result in a controller hard fault.
- Do not wire more than 2 conductors on any terminal



WARNING

- When you connect or disconnect the Removable Terminal Block (RTB) with field side power applied, an electrical arc can occur. This could cause an explosion in hazardous location installations. Be sure that power is removed or the area is nonhazardous before proceeding.
- If you connect or disconnect wiring while the field-side power is on, an electric arc can occur. This could cause an explosion in hazardous location installations. Be sure that power is removed or the area is nonhazardous before proceeding.
- If you insert or remove the module while backplane power is on, an electric arc can occur. This could cause an explosion in hazardous location installations. The module does not support “Removal and Insertion Under Power” (RIUP) capability. Do not connect or disconnect the module while power is applied. Be sure power is removed before proceeding.
- Do not unscrew the RTB hold down screws and remove the RTB while power is on. This could cause an explosion in hazardous location installations. Be sure that power is removed before proceeding.
- Do not connect directly to line voltage. Line voltage must be supplied by a suitable, approved isolating transformer or power supply having short circuit capacity not exceeding 100 VA maximum or equivalent.
- When used in a Class I, Division 2, hazardous location, this equipment must be mounted in a suitable enclosure with proper wiring method that complies with the governing electrical codes.

Additional Resources

Resource	Description
Micro830, Micro850, and Micro870 Programmable Controllers User Manual, publication 2080-UM002	A more detailed description of how to install and use our Micro830, Micro850, and Micro870 programmable controllers.
Micro800 Bus Terminator Installation Instructions, publication 2085-IN002	Information on installing the bus terminator module.
Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1	More information on proper wiring and grounding techniques.


You can view or download publications at rok.auto/literature.

Overview


The Micro800™ expansion I/O is a modular I/O that complements and extends the capabilities of Micro850® and Micro870® controllers. These expansion I/O modules interface with the controllers using an I/O expansion port.

Module Overview


Front view

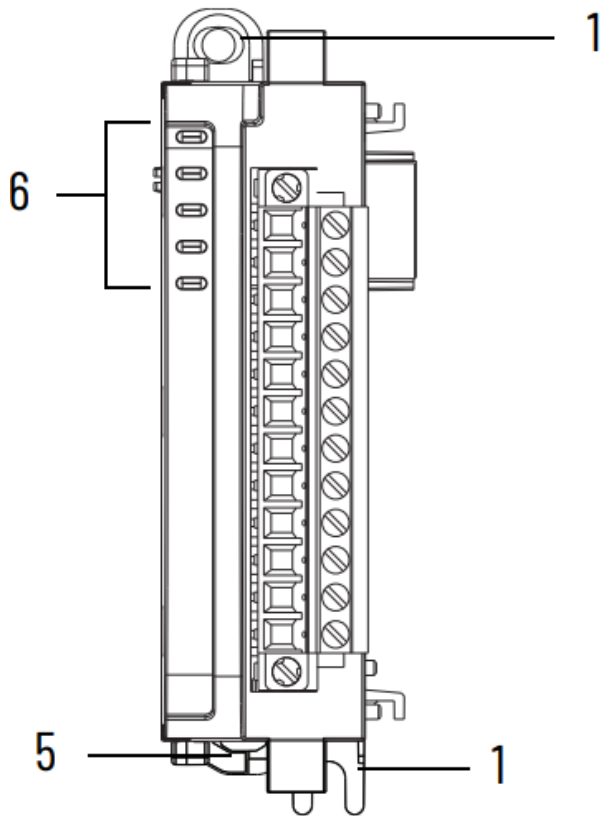

Front view

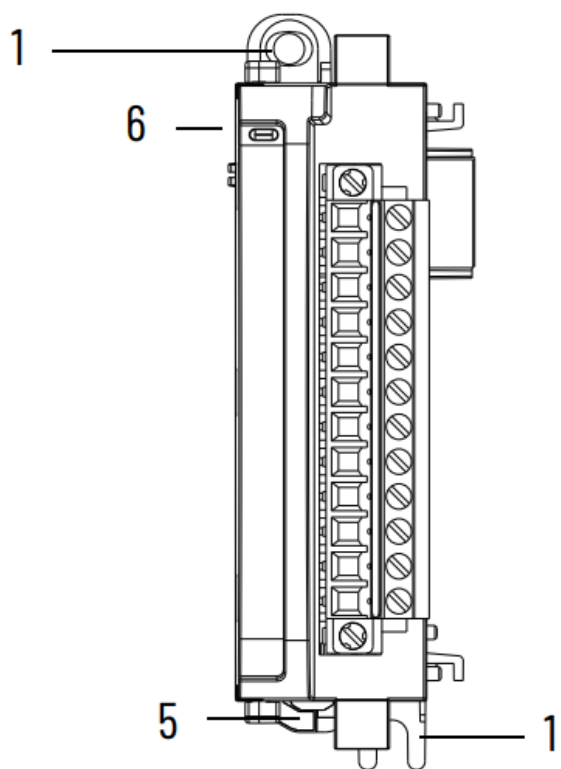


Right top view

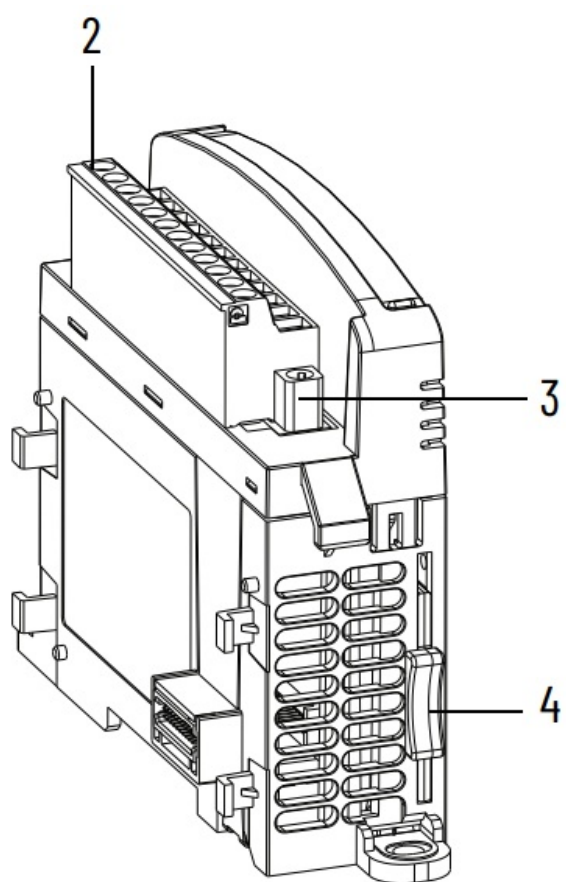


2085-IF8, 2085-IF8K

Front view

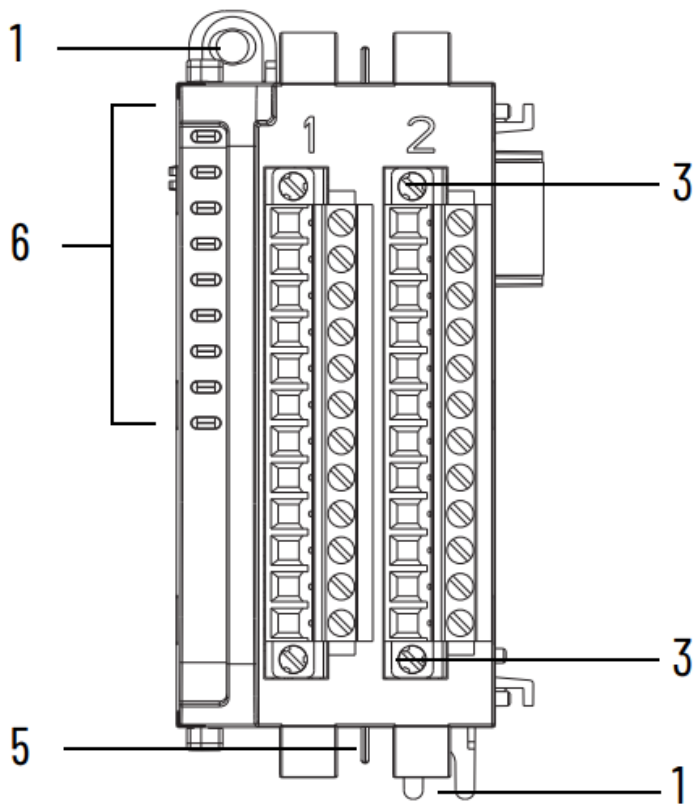

Right top view

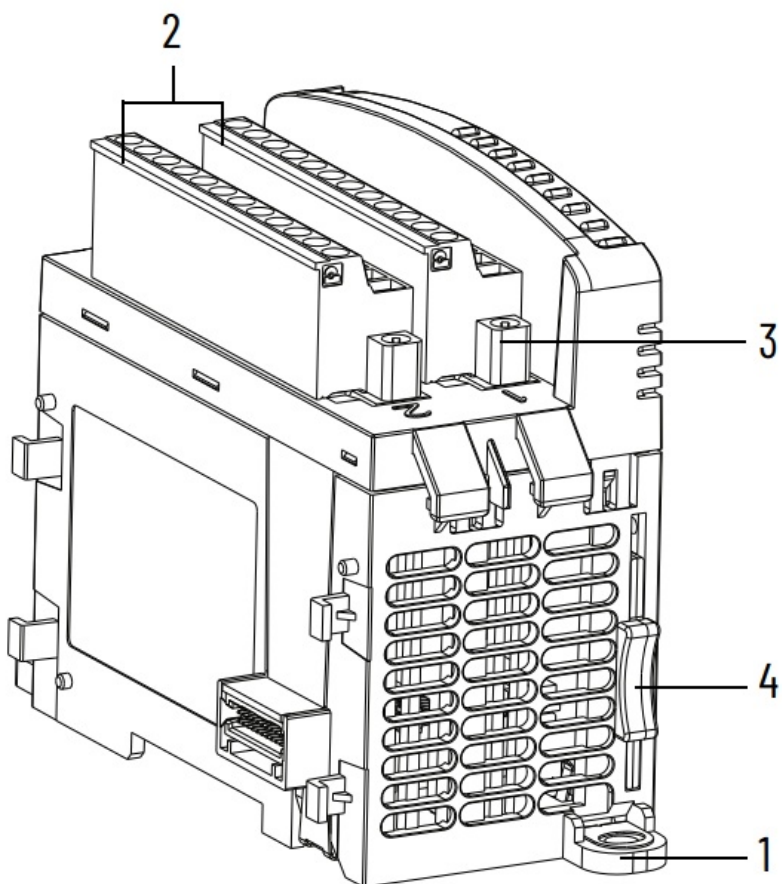

Module Description

	Description		Description
1	Mounting screw hole / mounting foot	4	Module interconnect latch
2	Removable Terminal Block (RTB)	5	DIN rail mounting latch
3	RTB hold down screws	6	I/O status indicator



This equipment is sensitive to electrostatic discharge (ESD). Follow ESD prevention guidelines when handling this equipment.


Mount the Module

For more information on proper grounding guidelines, see the Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1.

Module Spacing

Maintain spacing from objects such as enclosure walls, wireways, and adjacent equipment. Allow 50.8 mm (2 in.) of space on all sides for adequate ventilation, as shown.

Mounting Dimensions and DIN Rail Mounting

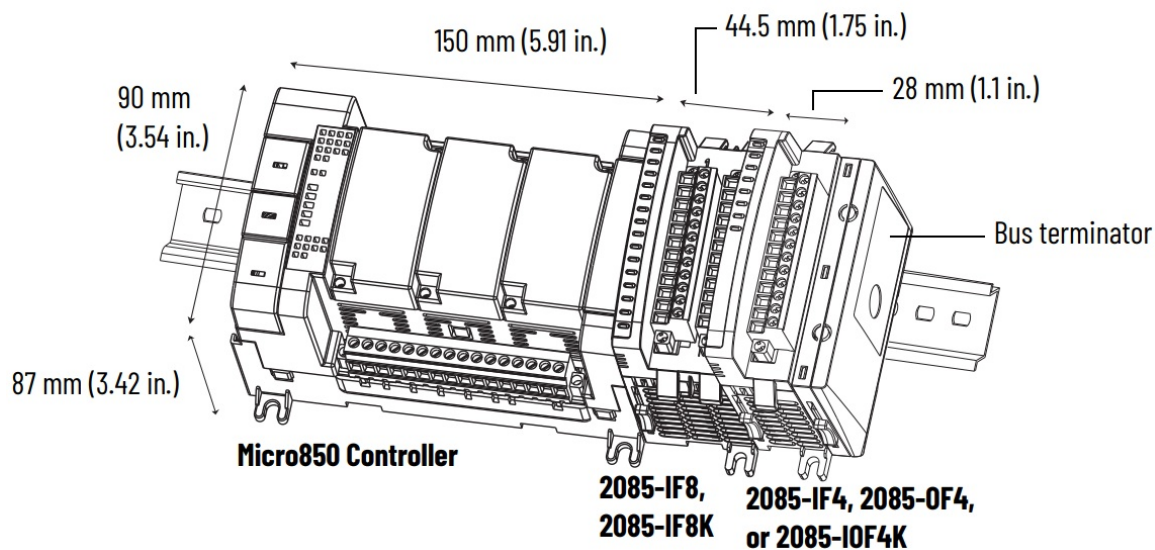

Mounting dimensions do not include mounting feet or DIN rail latches.

DIN Rail Mounting

The module can be mounted using the following DIN rails: 35 x 7.5 x 1 mm (EN 50022 – 35 x 7.5).



For environments with greater vibration and shock concerns, use the panel mounting method, instead of DIN rail mounting.

Before mounting the module on a DIN rail, use a flat-blade screwdriver in the DIN rail latch and pry it downwards until it is in the unlatched position.

1. Hook the top of the DIN rail mounting area of the controller onto the DIN rail, and then press the bottom until the controller snaps onto the DIN rail.

2. Push the DIN rail latch back into the latched position.

Use DIN rail end anchors (Allen-Bradley® part number 1492-EA35 or 1492-EAHJ35) for vibration or shock environments.

Panel Mounting

The preferred mounting method is to use two M4 (#8) per module. Hole spacing tolerance: ± 0.4 mm (0.016 in.). For mounting dimensions, see the Micro830®, Micro850, and Micro870 Programmable Controllers User Manual, publication 2080-UM002.

Follow these steps to install your module using mounting screws.

1. Place the module next to the controller against the panel where you are mounting it. Make sure that the controller and module are spaced properly.
2. Mark drilling holes through the mounting screw holes and mounting feet then remove the module.
3. Drill the holes at the markings, then replace the module and mount it. Leave the protective debris strip in place until you are finished wiring the module and any other devices.

System Assembly

The Micro800 expansion I/O module is attached to the controller or another I/O module by means of interconnecting latches and hooks, as well as the bus connector. The controller and expansion I/O modules must terminate with a 2085-ECR Bus Terminator module. Be sure to lock the module interconnect latches and tighten the RTB hold down screws before applying power to the module.

For installation of the 2085-ECR module, see the Micro800 Bus Terminator Module Installation Instructions, publication 2085-IN002.


Field Wiring Connections

In solid-state control systems, grounding and wire routing helps limit the effects of noise due to electromagnetic interference (EMI).


Wire the Module

Included with your 2085-IF4, 2085-OF4, or 2085-OF4K module is a single 12-pin Removable Terminal Blocks (RTB). Included with your 2085-IF8 or 2085-IF8K module are two 12-pin RTB. Basic wiring of your module is shown below.


Basic Wiring to the Module

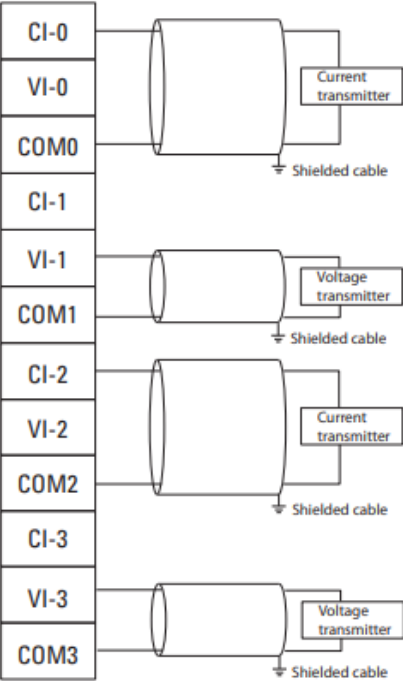

2085-OF4, 2085-OF4K

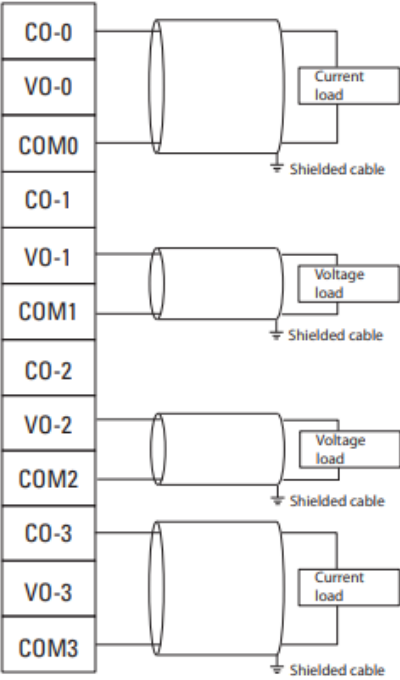

2085-IF8, 2085-IF8K

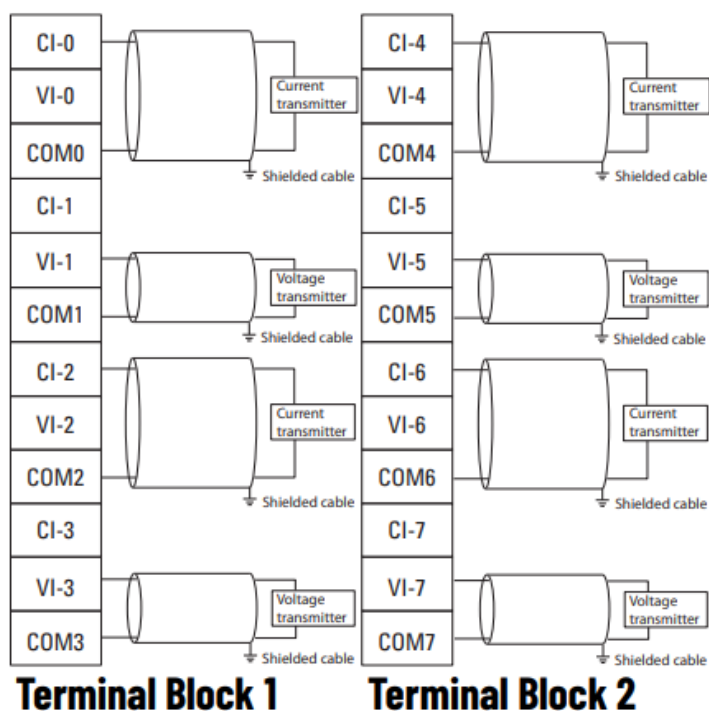

Specifications

General Specifications

Attribute	2085-IF4	2085-OF4, 2085-OF4K	2085-IF8, 2085-IF8K
Number of I/O	4		8
Dimensions HxWxD	28 x 90 x 87 mm(1.1 x 3.54 x 3.42 in.)		44.5 x 90 x 87 mm (1.75 x 3.54 x 3.42 in.)
Shipping weight, approx.	140 g (4.93 oz)	200 g (7.05 oz)	270 g (9.52 oz)
Bus current draw, max	5V DC, 100 mA24V DC, 50 mA	5V DC, 160 mA24V DC, 120 mA	5V DC, 110 mA24V DC, 50 mA
Wire size			
Wiring category(1)	2 – on signal ports		
Wire type	Shielded		
Terminal screw torque	0.5...0.6 N•m (4.4...5.3 lb•in)(2)		
Power dissipation, total	1.7 W	3.7 W	1.75 W
Enclosure type rating	None (open-style)		
Status indicators	1 green health indicator 4 red error indicator	1 green health indicator	1 green health indicator 8 red error indicators
Isolation voltage	50V (continuous), Reinforced Insulation Type, channel to system. Type tested @ 720V DC for 60 s		
North American temp code	T4A		T5

1. Use this Conductor Category information for planning conductor routing. See Industrial Automation Wiring and Grounding Guidelines, publication 1770-4.1.
2. RTB hold down screws should be tightened by hand. They should not be tightened using a power tool.

Input Specifications

Attribute	2085-IF4	2085-IF8, 2085-IF8K
Number of inputs	4	8
Resolution Voltage Current	14 bits (13 bits plus sign bit) 1.28 mV/cnt unipolar; 1.28 mV/cnt bipolar 1.28 μ A/cnt	
Data format	Left justified, 16 bit 2's complement	
Conversion type	SAR	
Update rate	<2 ms per enabled channel without 50 Hz/60 Hz rejection, <8 ms for all channel 8 ms with 50 Hz/60 Hz rejection	
Step response time up to 63%	4...60 ms without 50Hz/60 Hz rejection – depends on number of enabled channel and filter setting 600 ms with 50 Hz/60 Hz rejection	
Input current terminal, user configurable	4...20 mA (default) 0...20 mA	
Input voltage terminal, user configurable	\pm 10V 0...10V	
Input impedance	Voltage terminal >1 M Ω Current terminal <100 Ω	
Absolute accuracy	\pm 0.10% Full Scale @ 25 °C	
Accuracy drift with temp	Voltage terminal – 0.00428 % Full Scale/ °C Current terminal – 0.00407 % Full Scale/ °C	

Input Specifications (Continued)

Attribute	2085-IF4	2085-IF8, 2085-IF8K
Calibration required	Factory calibrated. No customer calibration supported.	
Overload, max	30V continuous or 32 mA continuous, one channel at a time.	
Channel diagnostics	Over and under range or open circuit condition by bit reporting	

Output Specifications

Attribute	2085-OF4, 2085-OF4K
Number of outputs	4
Resolution Voltage Current	12 bits unipolar; 11 bits plus sign bipolar 2.56 mV/cnt unipolar; 5.13 mV/cnt bipolar 5.13 μ A/cnt
Data format	Left justified, 16-bit 2's complement
Step response time up to 63%	2 ms
Conversion rate, max	2 ms per channel
Output current terminal, user configurable	0 mA output until module is configured 4...20 mA (default) 0...20 mA
Output voltage terminal, user configurable	± 10 V 0...10V
Current load on voltage output, max	3 mA
Absolute accuracy Voltage terminal Current terminal	0.133% Full Scale @ 25 °C or better 0.425 % Full Scale @ 25 °C or better
Accuracy drift with temp	Voltage terminal – 0.0045% Full Scale/ °C Current terminal – 0.0069% Full Scale/ °C
Resistive load on mA output	15...500 Ω @ 24V DC

Environmental Specifications

Attribute	Value
Temperature, operating	IEC 60068-2-1 (Test Ad, Operating Cold), IEC 60068-2-2 (Test Bd, Operating Dry Heat), IEC 60068-2-14 (Test Nb, Operating Thermal Shock): -20...+65 °C (-4...+149 °F)
Temperature, surrounding air, max	65 °C (149 °F)
Temperature, nonoperating	IEC 60068-2-1 (Test Ab, Unpackaged Nonoperating Cold), IEC 60068-2-2 (Test Bb, Unpackaged Nonoperating Dry Heat), IEC 60068-2-14 (Test Na, Unpackaged Nonoperating Thermal Shock): -40...+85 °C (-40...+185 °F)
Relative humidity	IEC 60068-2-30 (Test Db, Unpackaged Damp Heat): 5...95% noncondensing
Vibration	IEC 60068-2-6 (Test Fc, Operating): 2 g @ 10...500 Hz
Shock, operating	IEC 60068-2-27 (Test Ea, Unpackaged Shock): 25 g
Shock, nonoperating	IEC 60068-2-27 (Test Ea, Unpackaged Shock): 25 g – for DIN rail mount 35 g – for panel mount
Emissions	IEC 61000-6-4
ESD immunity	IEC 61000-4-2: 6 kV contact discharges 8 kV air discharges

Environmental Specifications (Continued)

Attribute	Value
Radiated RF immunity	IEC 61000-4-3:10V/m with 1 kHz sine-wave 80% AM from 80...6000 MHz
EFT/B immunity	IEC 61000-4-4:±2 kV @ 5 kHz on signal ports±2 kV @ 100 kHz on signal ports
Surge transient immunity	IEC 61000-4-5:±1 kV line-line(DM) and ±2 kV line-earth(CM) on signal ports
Conducted RF immunity	IEC 61000-4-6:10V rms with 1 kHz sine-wave 80% AM from 150 kHz...80 MHz

Certifications

Certification (when product is marked)(1)	Value
c-UL-us	UL Listed Industrial Control Equipment, certified for US and Canada. See UL File E322657.UL Listed for Class I, Division 2 Group A,B,C,D Hazardous Locations, certified for U.S. and Canada. See UL File E334470
CE	European Union 2014/30/EU EMC Directive, compliant with: EN 61326-1; Meas./Control/Lab., Industrial Requirements EN 61000-6-2; Industrial ImmunityEN 61000-6-4; Industrial EmissionsEN 61131-2; Programmable Controllers (Clause 8, Zone A & B) European Union 2011/65/EU RoHS, compliant with:EN IEC 63000; Technical documentation
RCM	Australian Radiocommunications Act, compliant with: EN 61000-6-4; Industrial Emissions
KC	Korean Registration of Broadcasting and Communications Equipment, compliant with: Article 58-2 of Radio Waves Act, Clause 3
EAC	Russian Customs Union TR CU 020/2011 EMC Technical Regulation Russian Customs Union TR CU 004/2011 LV Technical Regulation
Morocco	Arrêté ministériel n° 6404-15 du 29 ramadan 1436
UKCA	2016 No. 1091 – Electromagnetic Compatibility Regulations 2016 No. 1101 – Electrical Equipment (Safety) Regulations2012 No. 3032 – Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment Regulations

Rockwell Automation Support

Use these resources to access support information.

Technical Support Center	Find help with how-to videos, FAQs, chat, user forums, and product notification updates.	rok.auto/support
Knowledgebase	Access Knowledgebase articles.	rok.auto/knowledgebase
Local Technical Support Phone Numbers	Locate the telephone number for your country.	rok.auto/phonesupport
Literature Library	Find installation instructions, manuals, brochures, and technical data publications.	rok.auto/literature
Product Compatibility and Download Center (PCDC)	Download firmware, associated files (such as AOP, EDS, and DTM), and access product release notes.	rok.auto/pcdc

Documentation Feedback

our comments help us serve your documentation needs better. If you have any suggestions on how to improve our content, complete the form at rok.auto/docfeedback.

Waste Electrical and Electronic Equipment (WEEE)



At the end of life, this equipment should be collected separately from any unsorted municipal waste.

Rockwell Automation maintains current product environmental compliance information on its website at rok.auto/pec.

Rockwell Otomasyon Ticaret A.Ş. Kar Plaza İş Merkezi E Blok Kat:6 34752, İçerenköy, İstanbul, Tel: +90 (216) 5698400 EEE Yönetmeliğine Uygundur

Connect with us.




Customer Support











Allen-Bradley, expanding human possibility, FactoryTalk, Micro800, Micro830, Micro850, Micro870, Rockwell Automation, and TechConnect are trademarks of Rockwell Automation, Inc. Trademarks not belonging to Rockwell Automation are property of their respective companies.

Publication 2085-IN006E-EN-P – August 2022 | Supersedes Publication 2085-IN006D-EN-P – December 2019
Copyright © 2022 Rockwell Automation, Inc. All rights reserved. Printed in Singapore.

Documents / Resources

 <p>Installation Instructions</p> <p>Micro800 4-channel and 8-channel Analog Voltage/Current Input and Output Modules</p> <p>2085-IF4, 2085-IF8, 2085-IF8K, 2085-OF4, 2085-OF4K, 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, 2085-IF4, Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, Voltage-Current Input and Output Modules, Input and Output Modules, Modules, Analog Voltage-Current Input and Output Modules</p> <p>Summary of Changes</p> <p>2085-IF4, 2085-IF8, 2085-IF8K, 2085-OF4, 2085-OF4K, 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, 2085-IF4, Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, Voltage-Current Input and Output Modules, Input and Output Modules, Modules, Analog Voltage-Current Input and Output Modules</p> <p>2085-IF4, 2085-IF8, 2085-IF8K, 2085-OF4, 2085-OF4K, 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, 2085-IF4, Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, Voltage-Current Input and Output Modules, Input and Output Modules, Modules, Analog Voltage-Current Input and Output Modules</p>	<p><u>Allen-Bradley 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules [pdf] Instruction Manual</u></p> <p>2085-IF4, 2085-IF8, 2085-IF8K, 2085-OF4, 2085-OF4K, 2085-IF4 Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, 2085-IF4, Micro800 4-Channel and 8-Channel Analog Voltage-Current Input and Output Modules, Voltage-Current Input and Output Modules, Input and Output Modules, Modules, Analog Voltage-Current Input and Output Modules</p>
--	---

References

-  [Product Certifications | Rockwell Automation](#)
-  [Publication Feedback Form | Rockwell Automation](#)
-  [Rockwell Automation Tech Support ... 24 x 7 around the globe!](#)
-  [Literature Library | Rockwell Automation](#)
-  [Product Compatibility & Download Center from Rockwell Automation](#)
-  [Product Environmental Compliance | Rockwell Automation](#)
-  [Phone/Onsite Support](#)
-  [Support | Rockwell Automation](#)
-  [Rockwell Automation \(@rokautomation\) • Instagram photos and videos](#)
-  [Select a Region | Rockwell Automation](#)