

Altronix AL300ULM M Series Multi-Output Access Control Power Supply Instruction Manual

[Home](#) » [Altronix](#) » Altronix AL300ULM M Series Multi-Output Access Control Power Supply Instruction Manual



Contents

- [1 Altronix AL300ULM M Series Multi-Output Access Control Power Supply Overview](#)
- [2 Specifications:](#)
- [3 Installation Instructions:](#)
- [4 Maintenance:](#)
- [5 Terminal Identification Tables:](#)
- [6 LED Diagnostics:](#)
- [7 AL1024ULM Battery Size Calculation Worksheet.](#)
- [8 Appendix A – UL Listed Compatible Devices](#)
- [9 Documents / Resources](#)
 - [9.1 References](#)
- [10 Related Posts](#)









Altronix AL300ULM M Series Multi-Output Access Control Power Supply



Overview

Altronix M Series multi-output access control power supply/chargers are specifically designed for use with access control systems and accessories. These units convert a 115VAC, 60Hz input into five (5) individually protected 12VDC or 24VDC outputs (see specifications). Each output will route power to a variety of access control hardware devices including Mag Locks, Electric Strikes, Magnetic Door Holders, etc. These outputs will operate in both Fail-Safe and Fail-Secure modes. Controlled trigger input is achieved through normally open [NO] or normally closed [NC] supervised input or the polarity reversal from an FACP (Fire Alarm Control Panel). A form "C" dry output relay enables HVAC Shutdown, Elevator Recall or may be used to trigger auxiliary devices.

M Series Power Supply Configuration Reference Chart:

Altronix Model Number	12VDC Total Output Current (A)	24VDC Total Output Current (A)	PTC Protected Outputs (Auto-resettable)	Class 2 Rated Power-Limited	115VAC, 60Hz Input (current draw/A)	Power Supply Board Input Fuse Rating	Power Supply Board Battery Fuse Rating	Agency Listings	UL Listings
AL300ULM	2.5	2.5	5	✓	3.5A	5A/250V	15A/32V	<div>SECURITY LISTED</div> <div> LISTED</div> <div>ME A Approved</div> <div>NYC Dept. of Buildings</div> <div></div> <div>California State Fire Marshal</div>	<div>UL294* Access Control System Unit.</div> <div>UL603 Burglar Alarms Systems.</div> <div>UL1069 Hospital Signaling and Nurse Call Equipment.</div> <div>UL1481 Power Supplies for Fire Protective Signaling Systems</div> <div>“Signal Equipment” Evaluated to CSA 22.2 N205-M1983</div>
AL400ULM	4	3			3.5A	5A/250V	15A/32V		
AL600ULM	6	6			3.5A	5A/250V	—		
AL1012ULM	10	—			2.6A	5A/250V	15A/32V	<div>SECURITY LISTED</div> <div> LISTED</div> <div>ME A Approved</div> <div>NYC Dept. of Buildings</div> <div></div> <div>California State Fire Marshal</div>	<div>UL294* Access Control System Unit.</div> <div>“Signal Equipment” Evaluated to CSA 22.2 N205-M1983</div>
AL1024ULM	—	10	4.2A	5A/250V	15A/32V	<div>SECURITY LISTED</div> <div> LISTED</div> <div>ME A Approved</div> <div>NYC Dept. of Buildings</div> <div></div> <div>California State Fire Marshal</div>	<div>UL294* Access Control System Unit.</div> <div>UL1481 Power Supplies for Fire Protective Signaling Systems</div> <div>“Signal Equipment” Evaluated to CSA 22.2 N205-M1983</div>		

Altronix Model Number	*ANSI/UL 294 7th Ed. Access Control Performance Levels			
	Destructive Attack	Endurance Test	Line Security	Stand-by Power
AL300ULM	I	IV	I	IV
AL400ULM	I	IV	I	IV
AL600ULM	I	IV	I	IV
AL1012ULM	I	I	I	I
AL1024ULM	I	IV	I	12AH – II, 65AH – IV

Specifications:

Input:

- Power input 115VAC, 60Hz (see M Series Power Supply Configuration Reference Chart, pg. 2).
- Fire Alarm Panel or Access Control System trigger inputs. [NO] or [NC] supervised trigger input and polarity reversal trigger input (4mA draw from FACP).

Output:

- Five (5) individual power-limited Class 2 outputs (auto-resettable).

- The current limit is 2A @ 12VDC or 24VDC per output (12VDC only for AL1012ULM, 24VDC only for AL1024ULM).
- Burglar Alarm Applications (UL 603) (AL300ULM and AL400ULM only):
- 12VDC = 10VDC-13.2VDC.
- 24VDC = 20VDC-26.4VDC.
- Filtered and electronically regulated outputs.
- Thermal and short circuit protection with auto reset.
- Overload protection.
- Output relay energizes when unit is triggered (form "C" contact rated 1A @ 28VDC).

Visual Indicators:

- DC output LED indicator.
- LEDs indicate condition of power outputs.
- Power and input trigger LEDs.

Battery Backup:

- Built-in charger for sealed lead acid orgel type batteries.
- Automatic switch over to stand-by battery when AC fails.
- Zero voltage drop when switching over to battery backup.
- AL300ULM, AL400ULM, AL600ULM, and AL1012ULM (Power Supply Board) maximum charge current 0.7A.
- AL1024ULM (Power Supply Board) maximum charge current 3.6A.
- AL300ULM, AL400ULM, and AL600ULM enclosures accommodate up to two (2) 12VDC/7AH batteries.
- AL1012ULM should be fitted with one (1) 12VDC/12AH battery.
- AL1024ULM should be fitted with two (2) 12VDC/12AH batteries.

Supervision:

- AC fail supervision (form "C" contact).
- Low battery supervision (form "C" contact).
- Battery presence supervision (form "C" contact).
- Power fail supervision relay (form "C" contact rated 1A @ 28VDC).

Installation Instructions:

Wiring methods shall be in accordance with the National Electrical Code/NFPA 70/NFPA 72/ANSI, and with all local codes and authorities having jurisdiction. Product is intended for indoor use only.

1. Mount unit in the desired location. Mark and predrill holes in the wall to line up with the top two keyholes in the enclosure. Install two upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two upper screws; level and secure. Mark the position of the lower two holes. Remove the enclosure. Drill the lower holes and install three fasteners. Place the enclosure's upper keyholes over the two upper screws. Install the two lower screws and make sure to tighten all screws

(Enclosure Dimensions, pg. 15, 16). Secure enclosure to earth ground. It is recommended to first review the following tables for screw terminals, switch selection and LED status indications. This will greatly facilitate installation hook-up. Carefully review: Output Voltage & Stand-by Specifications (pg. 5) Terminal Identification Table (pg. 10) LED Diagnostics (pg. 11) Typical Application Diagrams (pgs. 12 & 13)

2. Set output voltage: AL300ULM, AL400ULM (Fig. 1c, pg. 5) and AL600ULM (Fig. 2c, pg. 6): set desired DC output voltage by setting switch SW1 to the appropriate position on the power supply board. AL1012ULM is 12VDC only. AL1024ULM is 24VDC only (Output Voltage and Stand-by Specification Charts, pg. 5).
3. Secure green lead to earth ground. Connect AC power (115VAC, 60Hz) to the terminals marked [L, G, N] on power supply board (Figs. 1 – 4, pgs. 6 – 9). Green “AC” LED on power supply board will turn on. This light can be seen through the LED lens on the door of the enclosure. Use 18 AWG or larger for all power connections (Battery, DC output, AC input). Use 22 AWG to 18 AWG for power-limited circuits (AC Fail/Low Battery reporting).
4. Measure output voltage before connecting devices. This helps avoiding potential damage. Keep power-limited wiring separate from non power-limited wiring (115VAC, 60Hz Input, Battery Wires). Minimum 0.25” spacing must be provided.

CAUTION: Do not touch exposed metal parts. Shut branch circuit power before installing or servicing equipment. There are no user serviceable parts inside. Refer installation and servicing to qualified service personnel. For Fire Alarm applications the outputs are “Special Applications” only, see list (refer to Appendix A, pg. 13).

5. Connect Fail-Secure type locking hardware (e.g. door strikes and electronic dead bolts) positive leads to terminals marked [1] through [5] [POS. (+) DC OUTPUT (ALARM)] on MOM5 board and the negative leads to terminals marked [NEG 1] through [NEG 5] on MOM5 board (Figs. 1 – 4, pgs. 6 – 9).
6. Connect Fail-Safe type locking hardware (e.g. mag locks, door strikes and door holders) positive leads to terminals marked [6] through [10] [POS. (+) DC OUTPUT (STAND-BY)] on MOM5 board and negative leads to terminals marked [NEG 1] through [NEG 5] on MOM5 board (Figs. 1 – 4, pgs. 6 – 9).
7. To trigger the unit from a FACP connect signaling circuit of FACP to terminals marked [– INPUT +] on MOM5 board (Figs. 1 – 4, pgs. 6 – 9). Polarity is shown in alarm condition. For latching fire alarm interface see Fig. 7, pg. 12; Figs 8 & 9, pg. 13. Note: A 2.2K EOL must be installed across terminals marked [TRIGGER] on MOM5 board or the unit will remain in an alarm condition.
8. To trigger the unit using a supervised dry contact connect the 2.2K resistor in series for a [NC] trigger input and in parallel for [NO] trigger input (Fig. 5, pg. 12).
9. Connect auxiliary devices triggered by the unit to the terminals marked [DRY OUTPUT NO & C] on MOM5 board for normally open output or terminals marked [DRY OUTPUT NC & C] on MOM5 board for normally closed output (Figs. 1 – 4, pgs. 6 – 9). Note: This relay will energize when the unit is triggered.
10. For Access Control applications batteries are optional. When batteries are not used, a loss of AC will result in the loss of output voltage. Batteries must be lead acid or gel type if used. Connect one (1) 12VDC battery to terminals marked [+ BAT] on power supply board for 12VDC operation (Figs. 1 – 4, pgs. 6 – 9). Use two (2) 12VDC batteries connected in series for 24VDC operation. (Battery leads included).
11. Connect supervisory trouble reporting devices to outputs marked [AC FAIL, LOW BAT] and [Power Fail] supervisory relay outputs marked [NO, C, NC] on power supply board (Figs. 1a – 4a, pgs. 6 – 9). Use 22 AWG to 18 AWG for AC Fail & Low Battery reporting. Note: When used in fire alarm, burglar alarm or access control applications, “AC Fail” relay should be utilized to visually indicate that AC power is on. To delay report for 6 hours cut “AC Delay” jumper (Figs. 1b – 4b, pgs. 6 – 9).
12. Please ensure that the cover is secured with the provided Key Lock.

Maintenance:

Unit should be tested at least once a year for the proper operation as follows: Output Voltage Test: Under normal load conditions the DC output voltage should be checked for proper voltage level (Output Voltage and Stand-by Specification Charts, pg. 4). Battery Test: Under normal load conditions check that the battery is fully charged, check specified voltage at the battery terminals and at the board terminals marked [– BAT +] to ensure that there is no break in the battery connection wires.

Note: AL300ULXB2, AL400ULXB2, AL600ULXB and AL1012ULXB (Power Supply Board) maximum charge current is 0.7A. AL1024ULXB2 (Power Supply Board) maximum charge current is 3.6A. Expected battery life is 5 years; however, it is recommended to change batteries within 4 years or less if necessary.

Output	Switch Position	4 hr. of Stand-by & 5 Minutes of Alarm	24 hr. of Stand-by & 5 Minutes of Alarm	60 hr. of Stand-by & 5 Minutes of Alarm
12VDC/40AH Battery	ON	Stand-by = 2.5A Alarm = 2.5A	Stand-by = 1.0A Alarm = 2.5A	Stand-by = 300mA Alarm = 2.5A
24VDC/12AH Battery	OFF	–	Stand-by = 200mA Alarm = 2.5A	–
24VDC/40AH Battery	OFF	Stand-by = 2.5A Alarm = 2.5A	Stand-by = 1.0A Alarm = 2.5A	Stand-by = 300mA Alarm = 2.5A


Output	Switch Position	4 hr. of Stand-by & 5 Minutes of Alarm	24 hr. of Stand-by & 5 Minutes of Alarm	60 hr. of Stand-by & 5 Minutes of Alarm
12VDC/40AH Battery	ON	Stand-by = 4.0A Alarm = 4.0A	Stand-by = 1.0A Alarm = 4.0A	Stand-by = 300mA Alarm = 4.0A
24VDC/12AH Battery	OFF	–	Stand-by = 200mA Alarm = 3.0A	–
24VDC/40AH Battery	OFF	Stand-by = 3.0A Alarm = 3.0A	Stand-by = 1.0A Alarm = 3.0A	Stand-by = 300mA Alarm = 3.0A

Output	Switch Position	4 hr. of Stand-by & 5 Minutes of Alarm	24 hr. of Stand-by & 5 Minutes of Alarm	60 hr. of Stand-by & 5 Minutes of Alarm
12VDC/40AH Battery	ON	Stand-by = 6.0A Alarm = 6.0A	Stand-by = 1.0A Alarm = 6.0A	Stand-by = 300mA Alarm = 6.0A
24VDC/12AH Battery	OFF	–	Stand-by = 200mA Alarm = 3.0A	–
24VDC/40AH Battery	OFF	Stand-by = 6.0A Alarm = 6.0A	Stand-by = 1.0A Alarm = 6.0A	Stand-by = 300mA Alarm = 6.0A

Output	
12VDC/12AH Battery	15 Minutes of Stand-by @ 10A

Output	15 min. of Stand-by & 5 min. of Alarm	4 hr. of Stand-by & 5 min. of Alarm	24 hr. of Stand-by & 5 min. of Alarm	60 hr. of Stand-by & 5 min. of Alarm
24VDC / 12AH Battery	Stand-By = 8A Alarm = 10A	Stand-By = 1.5A Alarm = 10A	Stand-By = 130mA Alarm = 10A	Stand-By = 30mA Alarm = 10A
Output	15 min. of Stand-by & 5 min. of Alarm	4 hr. of Stand-by & 5 min. of Alarm	24 hr. of Stand-by & 15 min. of Alarm	60 hr. of Stand-by & 15 min. of Alarm
24VDC / 65AH Battery	–	Stand-By = 7.9A Alarm = 10A	Stand-By = 1.4A Alarm = 10A	Stand-By = 430mA Alarm = 10A


CAUTION:

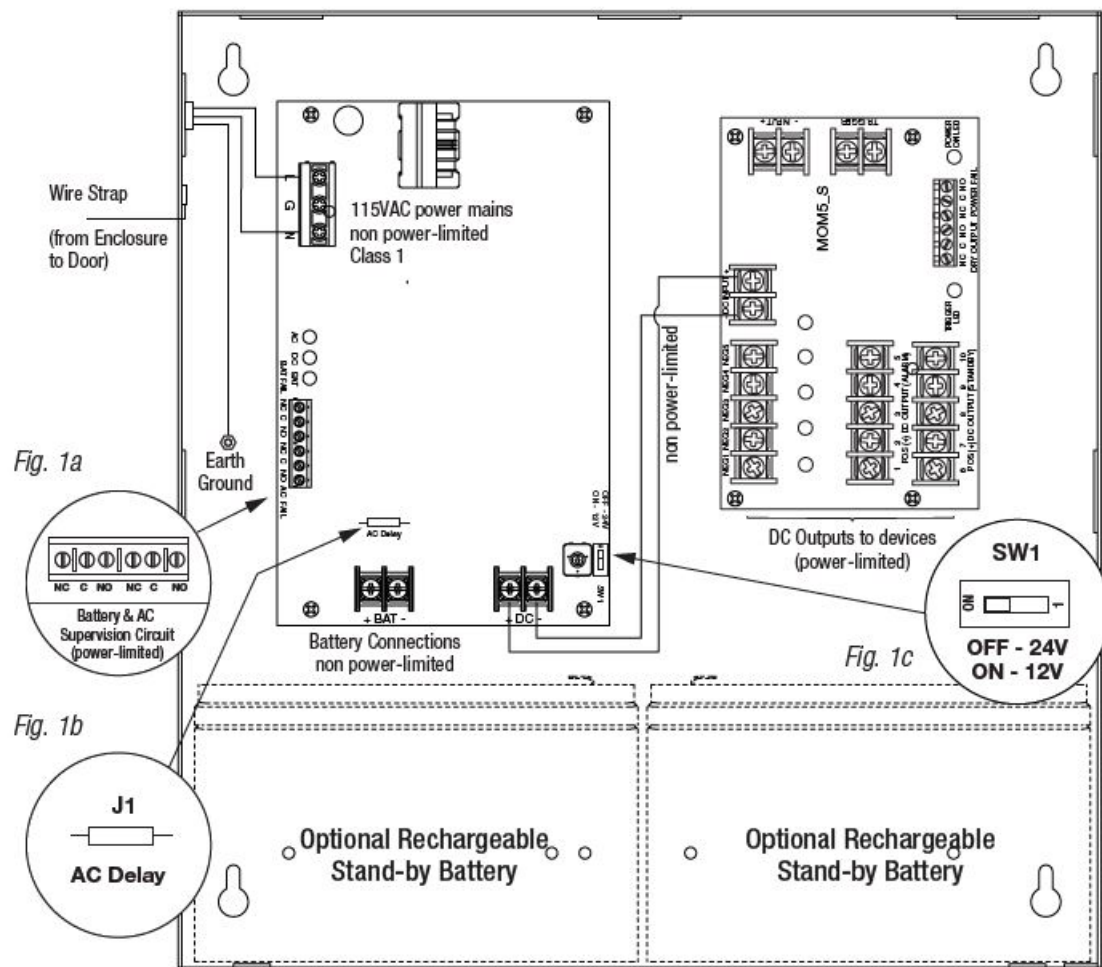

De-energize unit prior to servicing. For continued protection against risk of electric shock and fire hazard replace fuses with the same type and rating (see marking on the board). Do not expose to rain or moisture.


Keep power-limited wiring separate from non power-limited. Use minimum 0.25" spacing.

CAUTION:

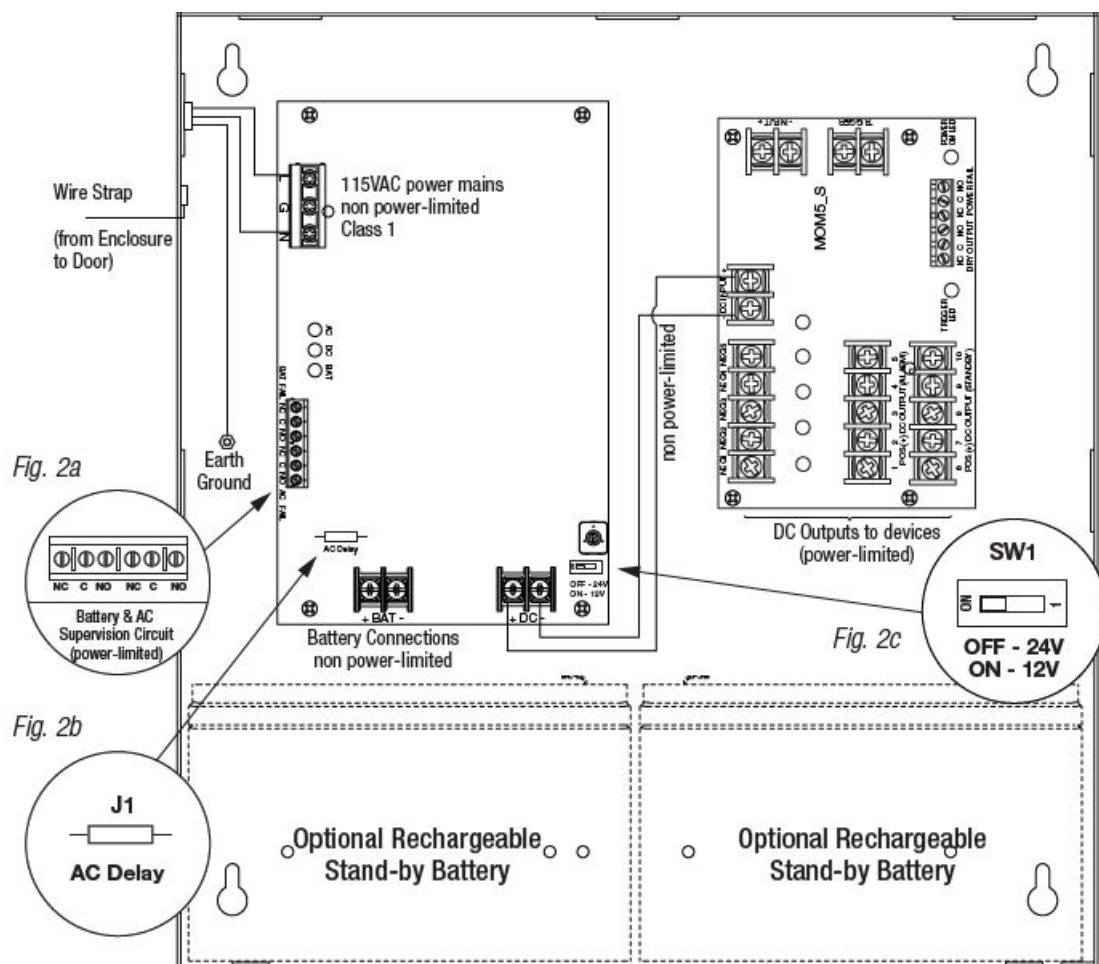

Optional rechargeable stand-by batteries must match the power supply output voltage setting.


CAUTION:

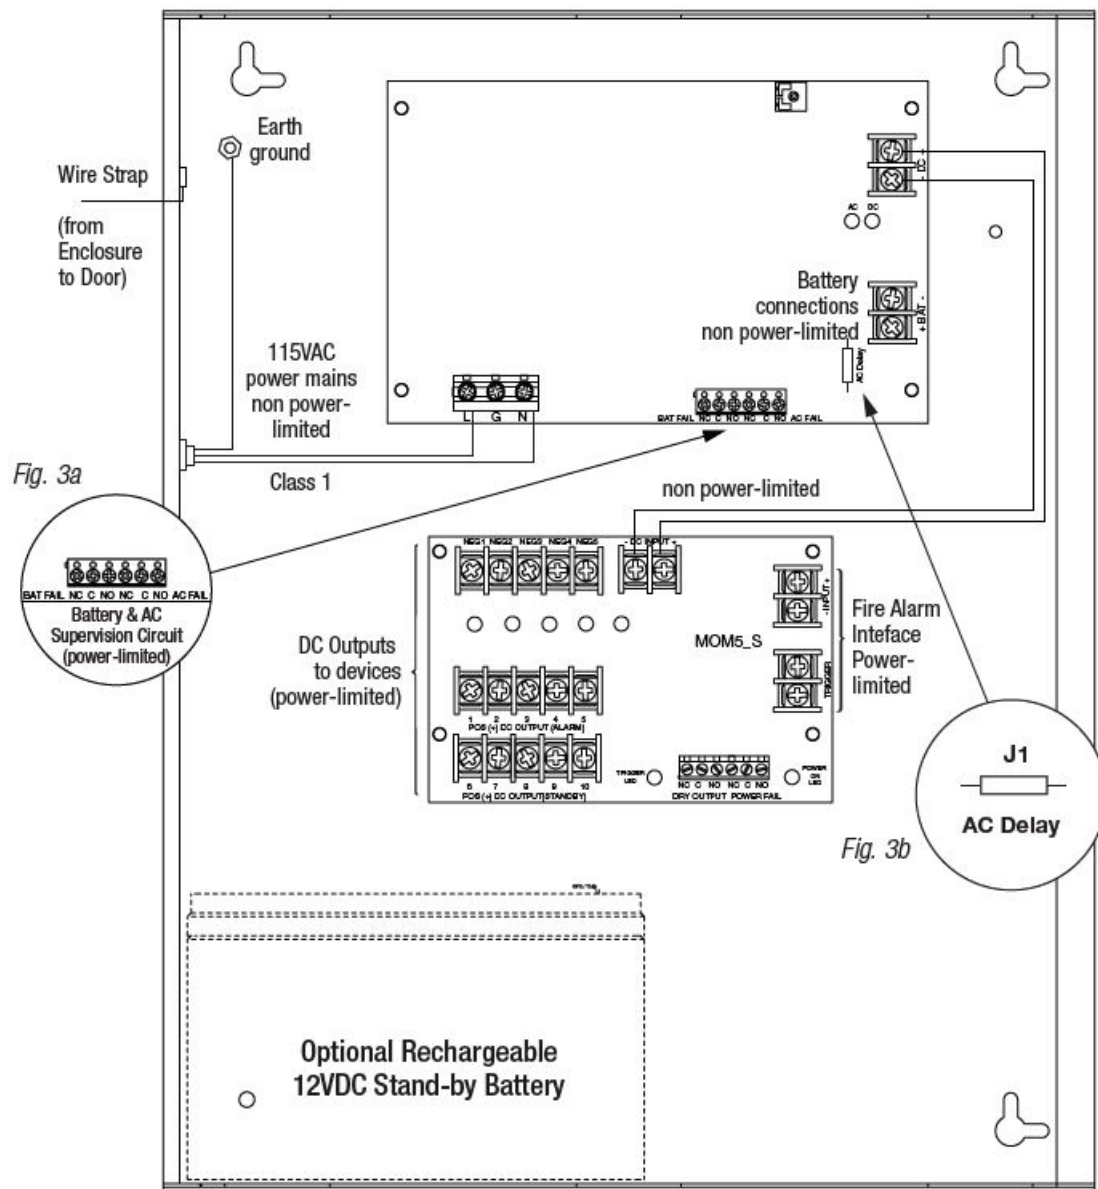

De-energize unit prior to servicing. For continued protection against risk of electric shock and fire hazard replace fuses with the same type and rating (see marking on the board). Do not expose to rain or moisture.

Keep power-limited wiring separate from non power-limited. Use minimum 0.25" spacing.

CAUTION:

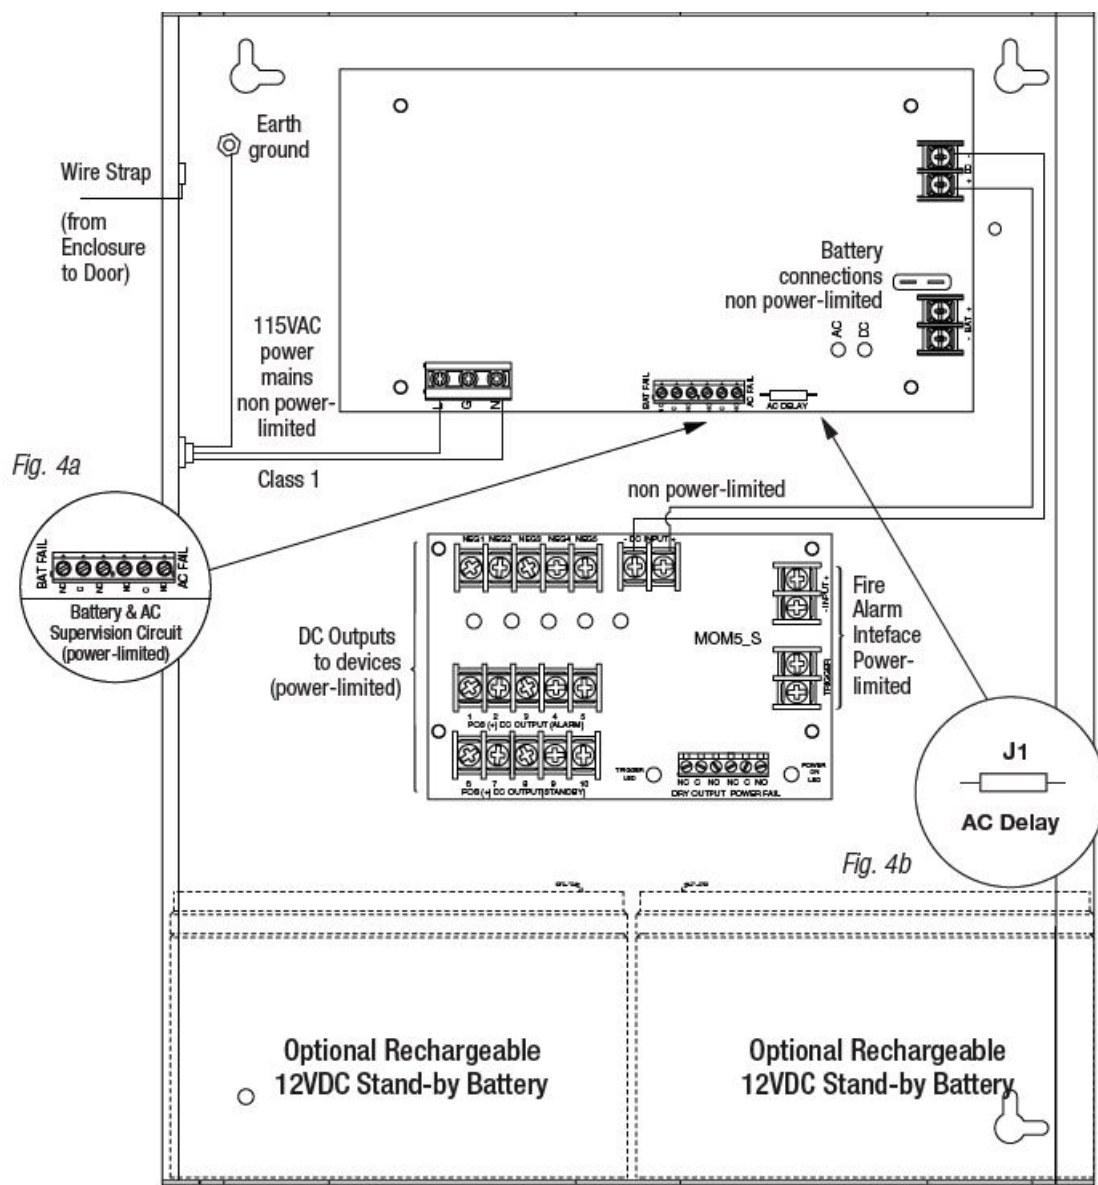

Optional rechargeable stand-by batteries must match the power supply output voltage setting.

De-energize unit prior to servicing. For continued protection against risk of electric shock and fire hazard replace fuses with the same type and rating. Do not expose to rain or moisture.

Keep power-limited wiring separate from non power-limited. Use minimum 0.25" spacing.

CAUTION:

Optional rechargeable stand-by batteries must match the power supply output voltage setting.

CAUTION:

De-energize unit prior to servicing. For continued protection against risk of electric shock and fire hazard replace fuses with the same type and rating (see marking on the board). Do not expose to rain or moisture.

Terminal Identification Tables:

Terminal Legend	Function/Description
L, G, N	Connect 115VAC 60Hz to these terminals: L to hot, N to neutral.
+ DC –	AL300ULM – 12VDC/24VDC @ 2.5A to MOM5 board (power-limited). AL400ULM – 12VDC @ 4A or 24VDC @ 3A to MOM5 board (power-limited). AL600ULM – 12VDC/24VDC @ 6A to MOM5 board (power-limited). AL1012ULM – 12VDC @ 10A to MOM5 board (power-limited). AL1024ULM – 24VDC @ 10A to MOM5 board (power-limited).
AC FAIL NC, C, NO	Indicates loss of AC power, e.g. connect to audible device or alarm panel. Relay normally energized when AC power is present. Contact rating 1A @ 28VDC. AC or brownout fail is reported within 1 minute of event. To delay reporting for up to 6 hrs., cut “AC delay” jumper and reset power to the unit.
BAT FAIL NC, C, NO	Indicates low battery condition, e.g. connect to alarm panel. Relay normally energized when DC power is present. Contact rating 1A @ 28VDC. A removed battery is reported within 5 minutes. Battery reconnection is reported within 1 minute. Low battery threshold: 12VDC output threshold set @ approximately 10.5VDC. 24VDC output threshold set @ approximately 21VDC.
– BAT +	Stand-by battery connections. AL300ULXB2, AL400ULXB2, AL600ULXB and AL1012ULXB (Power Supply Board) maximum charge current is 0.7A. AL1024ULXB2 (Power Supply Board) maximum charge current is 3.6A.

Terminal Legend	Function/Description
– DC INPUT +	12VDC or 24VDC from power supply.
TRIGGER	Dry normally open [NO] or normally closed [NC] supervised (2.2K EOL resistor) input trigger. A short or open circuit will transfer power from terminals marked [POS. (+) DC OUTPUT (STAND-BY)] to terminals marked [POS (+) DC OUTPUT (ALARM)].
– INPUT +	Wet (5-30VDC) input trigger. Applying voltage to these terminals in the polarity shown will transfer power from terminals marked [POS. (+) DC OUTPUT (STAND-BY)] to terminals marked [POS. (+) DC OUTPUT (ALARM)] (e.g. fire alarm control panel indications circuit).
NEG. 1 through NEG. 5	Supplies constant negative (–) voltage.
POS. (+) DC OUTPUT (ALARM) 1-5	Supplies positive (+) voltage when dry trigger input or fire alarm wet trigger input is applied.
POS. (+) DC OUTPUT (STAND-BY) 6-10	Supplies positive (+) voltage in normal condition. Power is removed when dry trigger input or fire alarm wet trigger input is applied.
NC, C, NO DRY OUTPUT	When the MOM5 is triggered the terminals marked [C and NO] will open and the terminals marked [C and NC] will close. This output is used to trigger auxiliary devices. (e.g. HVAC Shutdown, Elevator Recall etc.). Contact rating 1A @ 28VDC.
NC, C, NO POWER FAIL	Form “C” contacts used for reporting no voltage is present at [– DC INPUT +] terminals. Under normal conditions, terminals marked [NO and C] are open, [NC and C] are closed. A loss of power causes terminals marked [NO and C] to close and [NC and C] to open. Contact rating 1A @ 28VDC.

LED Diagnostics:

LED		Power Supply Status
Red (DC)	Green (AC)	
ON	ON	Normal operating condition.
ON	OFF	Loss of AC. Stand-by battery is supplying power.
OFF	ON	No DC output. Short circuit or thermal overload condition.
OFF	OFF	No DC output. Loss of AC. Discharged battery.

Red (Bat)	Battery Status
ON	Normal operating condition.
OFF	Battery fail/low battery.

LED	ON	OFF
Power (Green)	Normal operating condition.	Power failure.
Trigger (Green)	Input is triggered (alarm condition).	No input trigger (non-alarm condition).
Outputs (Red)	Output tripped due to a short circuit or overload condition.	Normal operation.

AL1024ULM Battery Size Calculation Worksheet.

A.	AL1024ULM internal current consumption		_____	
B.	Load current consumption	(stand-by) (stand-by)	_____	0.13A A
C.	Stand-by time required (hours)	(A+B)*C	_____	H AH
D.	Battery capacity required for stand-by		_____	
E.	AL1024ULM internal power consumption	(Alarm)	_____	0.13A
F.	Load current consumption	(Alarm)	_____	A
G.	Alarm duration (Hours, example: 15 Min = 0.25 Hour)	(Alarm)	_____	H
H.	Battery capacity required for Alarm	(E+F)*G	_____	AH0
I.	Total calculated battery capacity	D+H	_____	AH
J.	Battery capacity required	I*1.8 (safety factor)	_____	AH

Note: AL1024ULM power supply is designed to work with batteries up to 65AH. Please note, line [I] must not exceeds 36AH. You have to reduce either standby current consumption or standby time in order to comply with requirement.

To determine actual battery size please round line [J] to the nearest larger standard battery size.

Typical Application Diagrams:

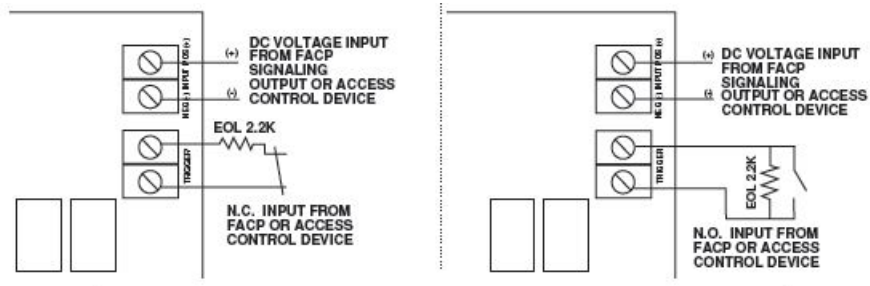


Fig. 6 - Two (2) or more MOM5 modules shown with wet and/or dry normally closed trigger inputs (Non-Latching):


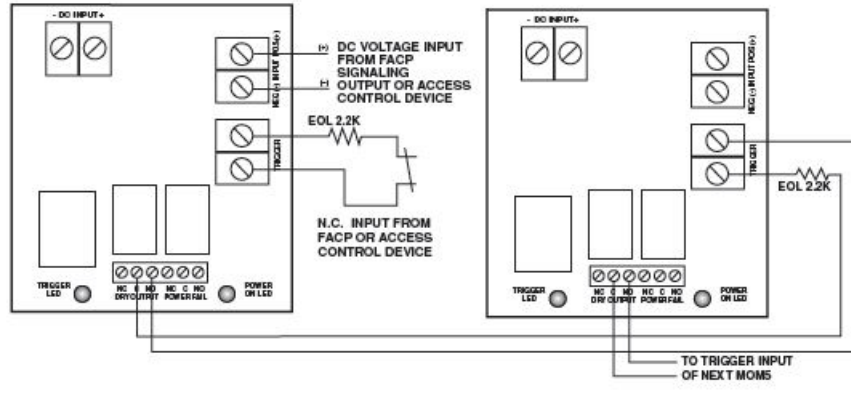


Fig. 7 - Two (2) or more MOM5 modules shown with wet and/or dry normally open trigger inputs (Non-Latching):

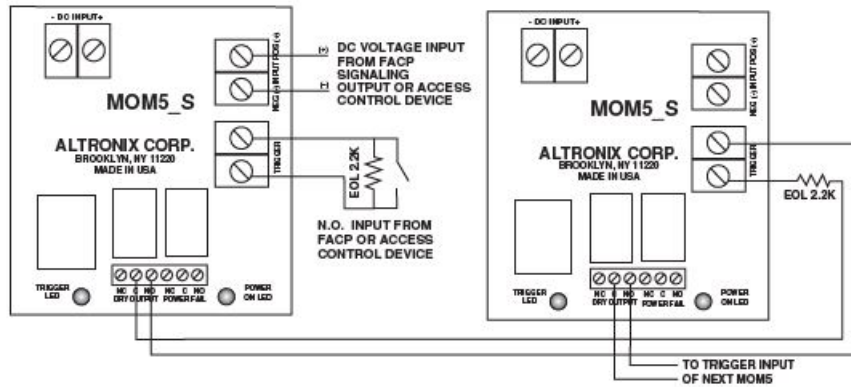

MOM5 module shown with wet and/or dry normally closed trigger inputs (Non-Latching): MOM5 module shown with wet and/or dry normally open trigger inputs (Non-Latching):

Typical Application Diagrams

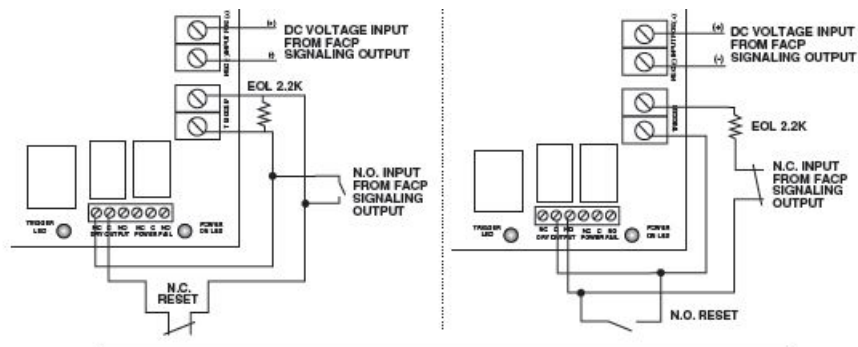


Fig. 9 - Two (2) MOM5 modules shown with wet and/or dry normally closed fire alarm trigger inputs (Latching with Manual Reset):


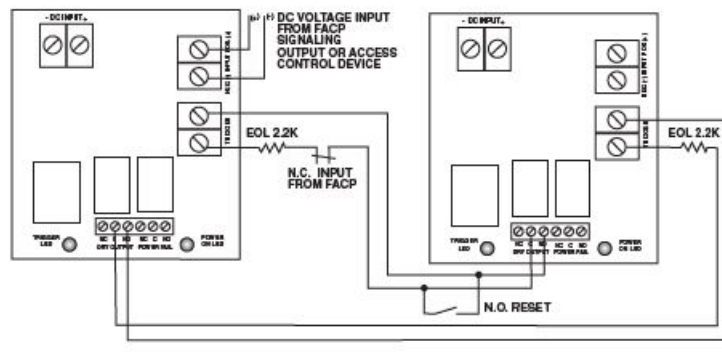


Fig. 10 - Two (2) MOM5 modules shown with wet and/or dry normally open fire alarm trigger inputs (Latching with Manual Reset):

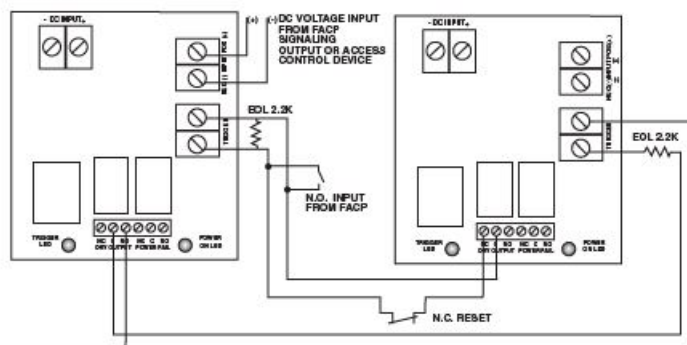

MOM5 module shown with with wet and/or dry normally open fire alarm trigger inputs (Latching with Manual Reset):

MOM5 module shown with with wet and/or dry normally closed fire alarm trigger inputs (Latching with Manual Reset):

Appendix A – UL Listed Compatible Devices

A.1 Four (4) Wire Smoke Detectors

Table A-1 below lists four (4) wire smoke detectors compatible with AL300ULM, AL400ULM, AL600ULM, AL1012ULM, and AL1024ULM output.


System Sensor Smoke Detector/Base	Detector Type	Max Stand-by Current (mA)	Alarm Current (mA)
B112LP	Base	0.12	36
B114LP	Base	*	*
B404B	Base	*	*

DH100ACDC	Photoelectric	0.15	0.70
DH100ACDCLP	Photoelectric	0.15	0.70
DH100ACDCLPW	Photoelectric	0.15	0.70
DH400ACDCI	Ionization Duct	25	95
DH400ACDCP	Photoelectric Duct	25	95
1112/24/D	Ionization	0.05	50
1424	Ionization	0.10	41
1451 (w/B402B Base)	Ionization	0.10	39
2112/24ATR	Photoelectric	0.50	60/70
2112/24AIR	Photoelectric	0.50	60/70
2112/24/D	Photoelectric	0.05	50
2112/24T/D	Photoelectric w/135o Thermal	0.05	50
2112/24TSRB	Photoelectric w/135o Thermal Supervisory Relay	15	45
2312/24TB	Photoelectric	0.12	50
2412 (12 volt)	Photoelectric	0.12	77
2424	Photoelectric	0.10	41
2451	Photoelectric	0.10	39
2451TH (with/B402B Base)	Photoelectric	0.10	39
2W-MOD	Loop Test/Maintenance Mod.	30	50
4W-B (12/24 volt)	Photoelectric I3	0.05	23
4WT-B (12/24 volt)	Photoelectric I3 w/Therm	0.05	23
4WTA-B (12/24 volt)	I3 Photo w/Therm/Sounder	0.05	35
4WTR-B (12/24 volt)	I3 Photo w/Therm/Relay	0.05	35
4WITAR-B (12/24 volt)	I3 Photo w/Isolated Therm/Sounder/Relay	0.05	50
2W-MOD2	I3 Loop Test/Maintenance Mod.	0.05	*
RRS-MOD	I3 Reversing Relay/Sync Module	0.05	*
6424	Projected Beam	10	28.4
Beam 1224(S)	Projected Beam	17	38.5


A.2 Relays

Table A-2 below lists relays compatible with AL300ULM, AL400ULM, AL600ULM, AL1012ULM, and AL1024ULM output.

Enclosure Dimensions (H x W x D) for:

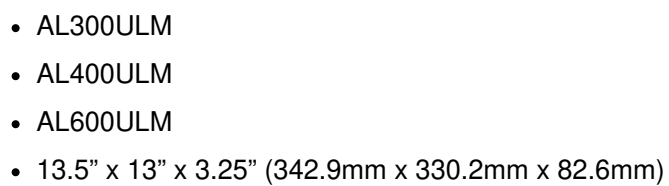

Enclosure Dimensions (H x W x D) for:

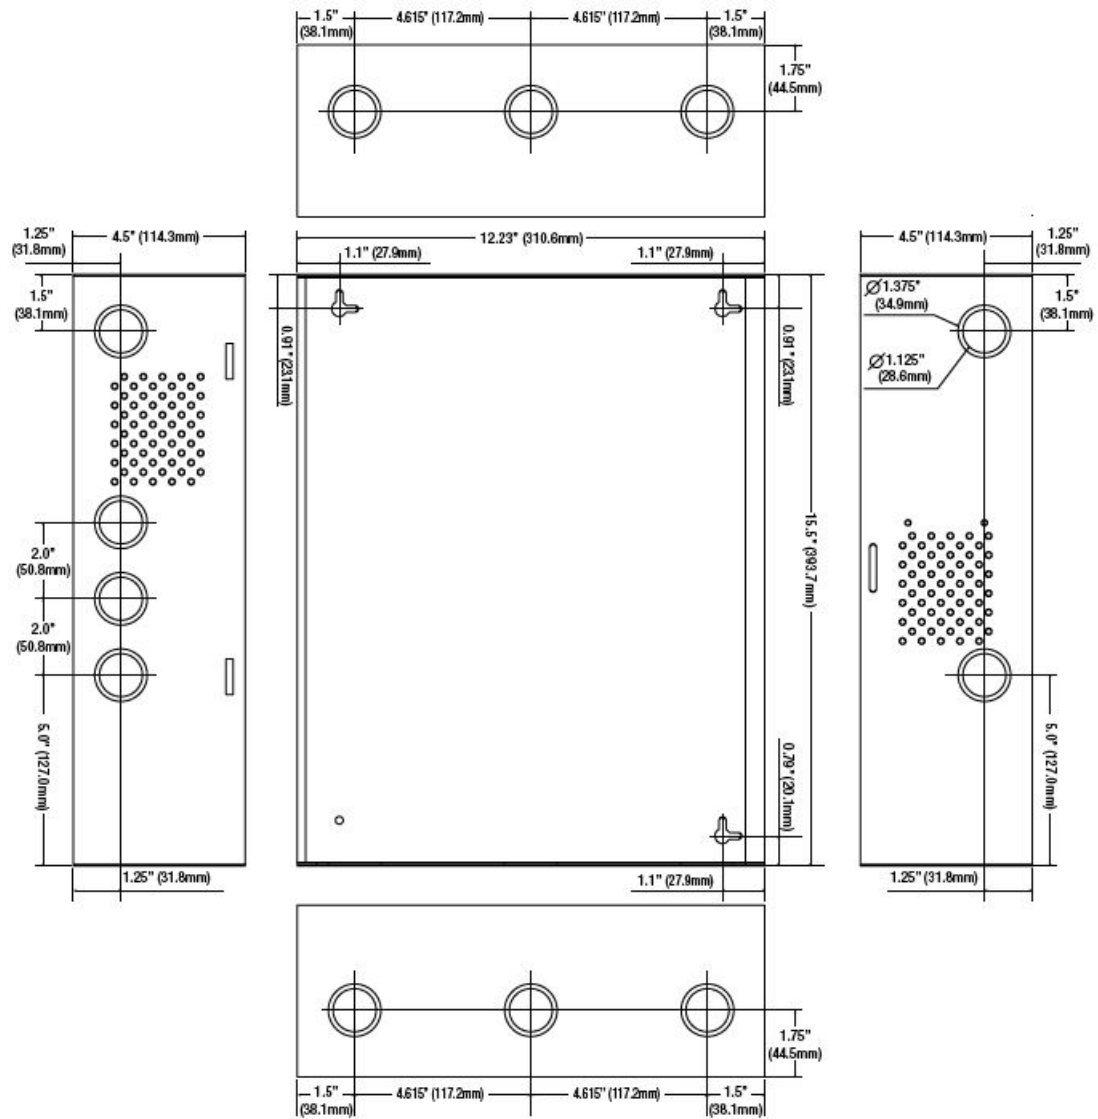

- AL300ULMX
- AL400ULMX
- AL600ULMX
- AL1012ULM
- AL1024ULM
- 15.5" x 12" x 4.5" (393.7mm x 304.8mm x 114.3mm)

Documents / Resources

