

APC BK500

APC BK500 500VA UPS Surge Protector User Manual

1. INTRODUCTION

Welcome to your new APC BK500 500VA UPS Surge Protector. This device provides reliable power protection for your electronic equipment, safeguarding against power outages, surges, and spikes. It features a 500VA/300W output capacity and includes both battery backup and surge-only outlets. Please read this manual thoroughly before installation and operation to ensure proper use and maximum longevity of your product.



This image illustrates the APC BK500 UPS unit positioned alongside a desktop computer setup, including a monitor and keyboard, demonstrating a typical use case for the device in a home or office environment.

2. IMPORTANT SAFETY INSTRUCTIONS

Please observe the following safety precautions to prevent injury or damage to the unit and connected equipment:

- Do not install the UPS in direct sunlight, near heat sources, or in areas with excessive dust or humidity.
- Connect the UPS to a grounded outlet only.
- Do not open the UPS casing. There are no user-serviceable parts inside. Refer all servicing to qualified

service personnel.

- Ensure proper ventilation around the UPS. Do not block ventilation openings.
- Disconnect the UPS from the power outlet before cleaning.
- The battery inside the UPS is not user-replaceable. Contact APC support for battery replacement.

3. PACKAGE CONTENTS

Verify that all items are present in your package:

- APC BK500 500VA UPS Unit
- Software CD
- Cord Management Straps
- USB Communication Cable
- User Manual (this document)

4. PRODUCT FEATURES

The APC BK500 UPS offers the following key features:

- **Battery-Protected and Surge-Only Outlets:** Provides backup power and surge protection for critical devices, and surge protection only for less critical devices.
- **Dataline Surge Protection:** Protects connected equipment from surges traveling over data lines (e.g., phone/fax lines).
- **Power Conditioning:** Guards against surges, spikes, lightning, and other power disturbances.
- **Audible Alarms:** Notifies you of changing utility power and UPS conditions.
- **Automatic Restart of Loads:** Automatically restarts connected equipment after UPS shutdown due to power depletion, once utility power returns.



This image displays the front panel of the APC BK500 UPS. Visible are the 'On Line', 'On Battery', 'Overload', and 'Replace Battery' indicator lights, along with the main power button. The 'Back-UPS CS 500' model name and APC logo are also present.



This image shows the rear panel of the APC BK500 UPS. It features multiple power outlets, clearly labeled for 'Battery Backup Plus Surge Protection' and 'Surge Protection Only'. Also visible are modem/phone/fax ports, a data port, and a push-to-reset circuit breaker button.

5. SETUP INSTRUCTIONS

1. **Unpack the UPS:** Carefully remove the UPS from its packaging. Inspect for any shipping damage.
2. **Connect to Power:** Plug the UPS power cord directly into a grounded 3-prong wall outlet. Do not use extension cords or surge protectors.

3. **Initial Charge:** Allow the UPS to charge for at least 10 hours before connecting any equipment. This ensures optimal battery runtime.
4. **Connect Equipment:**
 - For critical devices requiring battery backup and surge protection (e.g., computer, monitor), plug them into the outlets labeled "Battery Backup Plus Surge Protection".
 - For devices requiring only surge protection (e.g., printer, scanner), plug them into the outlets labeled "Surge Protection Only".
5. **Connect Data Lines (Optional):** If desired, connect your phone/fax line or network cable through the dataline surge protection ports on the rear of the UPS.
6. **Install Software (Optional):** Install the included power management software on your computer using the provided CD. This software allows for advanced monitoring and graceful shutdown of your computer during extended power outages.

6. OPERATING THE UPS

1. **Power On/Off:** Press the power button on the front panel to turn the UPS on or off.
2. **Indicator Lights:**
 - **On Line (Green):** The UPS is supplying utility power to connected equipment.
 - **On Battery (Yellow):** The UPS is supplying battery power to connected equipment.
 - **Overload (Red):** Connected equipment exceeds the UPS's capacity. Disconnect non-essential equipment.
 - **Replace Battery (Red):** The UPS battery needs replacement.
3. **Audible Alarms:**
 - **Four beeps every 30 seconds:** UPS is running on battery power.
 - **Continuous tone:** Low battery condition or UPS overload.
4. **Self-Test:** To perform a self-test, ensure the UPS is connected to utility power and press and hold the power button for a few seconds until the UPS beeps and the 'On Battery' light flashes. The UPS will return to 'On Line' mode after the test.

7. MAINTENANCE

- **Battery Replacement:** The battery in the APC BK500 is not user-serviceable. When the 'Replace Battery' indicator illuminates, contact APC customer support or a certified service provider for battery replacement. Using non-APC approved batteries may void your warranty and pose a safety risk.
- **Cleaning:** Disconnect the UPS from the power outlet before cleaning. Use a soft, dry cloth to wipe the exterior. Do not use liquid or aerosol cleaners.
- **Storage:** If storing the UPS for an extended period, charge it every three months to prevent battery degradation.

8. TROUBLESHOOTING

Problem	Possible Cause	Solution
---------	----------------	----------

Problem	Possible Cause	Solution
UPS will not turn on	UPS not connected to utility power; Battery not charged; UPS fault.	Ensure power cord is securely plugged in. Allow 10 hours for initial charge. If problem persists, contact support.
UPS beeps continuously	UPS is overloaded; Low battery.	Disconnect non-essential equipment from battery backup outlets. Allow battery to charge.
'Replace Battery' light is on	Battery has reached end of life.	Contact APC support for battery replacement.
No power to connected equipment	Circuit breaker tripped; UPS is off; Battery depleted.	Press the circuit breaker reset button on the rear panel. Turn on the UPS. Allow battery to charge.
Dataline protection not working	Incorrect connection.	Ensure input and output lines are correctly connected to the respective ports on the UPS.
UPS not providing expected runtime	Battery not fully charged; Battery nearing end of life; Overload.	Allow battery to fully charge. Consider battery replacement if old. Reduce connected load.

9. SPECIFICATIONS


- **Model:** BK500
- **Output Power Capacity:** 500VA / 300W
- **Input Voltage:** 120 Volts AC
- **Output Voltage:** 120 Volts
- **Form Factor:** Rack
- **Color:** WHITE
- **Item Weight:** 13.2 pounds
- **Manufacturer:** APC Products


10. WARRANTY AND SUPPORT

For warranty information, technical support, or service inquiries, please visit the official APC website or contact APC customer service. Keep your purchase receipt as proof of purchase.

Online Resources: www.apc.com

Related Documents - BK500


 The image shows the cover of the APC Back-UPS BX Series User Manual. It features the APC logo at the top, followed by the title 'User Manual Back-UPS BX Series (500VA to 2200VA)'. Below the title, there are several sections: 'IMPORTANT SAFETY INSTRUCTIONS' with a warning icon, 'DANGER' with a lightning bolt icon, 'WARNING' with a triangle icon, 'CAUTION' with a triangle icon, and 'NOTICE' with a triangle icon. At the bottom, there are 'Product Handling Guidelines' with icons for handling instructions.	APC Back-UPS BX Series User Manual: Installation, Operation, and Troubleshooting Comprehensive user manual for APC Back-UPS BX Series (500VA to 2200VA) from Schneider Electric, covering safety instructions, product description, operational features, installation, troubleshooting, service, and warranty information.
 The image shows the cover of the APC Back-UPS BR1000G-IN / BR1500G-IN Installation and Operation Manual. It features the APC logo at the top, followed by the title 'Installation and Operation Back-UPS® BR1000G-IN / BR1500G-IN'. Below the title, there are several sections: 'Safety and General Information' with a warning icon, 'Connect the Battery' with a battery icon, and 'Install PowerChute® Personal Edition Software' with a software icon.	APC Back-UPS BR1000G-IN / BR1500G-IN: Installation and Operation Manual Comprehensive guide for installing and operating the APC Back-UPS BR1000G-IN and BR1500G-IN Uninterruptible Power Supply (UPS), covering specifications, connections, features, troubleshooting, and service.
 The image shows the cover of the APC Back-UPS Pro BR1000G Installation and Operation Guide. It features the APC logo at the top, followed by the title 'Installation and Operation Back-UPS® Pro BR1000G'. Below the title, there are several sections: 'Safety and General Information' with a warning icon, 'Connect the Battery' with a battery icon, and 'Install PowerChute® Personal Edition Software' with a software icon.	APC Back-UPS Pro BR1000G Installation and Operation Guide Comprehensive guide for installing and operating the APC Back-UPS Pro BR1000G, covering setup, features, safety, troubleshooting, and specifications. Learn how to connect equipment, manage power saving, and understand warnings.
 The image shows the cover of the APC Back-UPS CS 350/500 User Manual. It features the APC logo at the top, followed by the title 'User Manual Back-UPS CS 350/500'. Below the title, there are several sections: 'IMPORTANT SAFETY INSTRUCTIONS' with a warning icon, 'DANGER' with a lightning bolt icon, 'WARNING' with a triangle icon, 'CAUTION' with a triangle icon, and 'NOTICE' with a triangle icon. At the bottom, there are 'Product Handling Guidelines' with icons for handling instructions.	APC Back-UPS CS 350/500 User Manual User manual for the APC Back-UPS CS 350/500 series, providing installation, operation, troubleshooting, and specifications for this uninterruptible power supply.
 The image shows the cover of the APC Back-UPS BN450MNW User Manual. It features the APC logo at the top, followed by the title 'User Manual Back-UPS BN450MNW'. Below the title, there are several sections: 'Safety and General Information' with a warning icon, 'DANGER' with a lightning bolt icon, 'WARNING' with a triangle icon, 'CAUTION' with a triangle icon, and 'NOTICE' with a triangle icon. At the bottom, there are 'Product Handling Guidelines' with icons for handling instructions.	APC Back-UPS BN450MNW User Manual: Installation, Operation, and Troubleshooting Comprehensive user manual for the APC Back-UPS BN450MNW, covering safety, installation, specifications, operation, status indicators, troubleshooting, and warranty information. Learn how to protect your equipment from power outages and surges.

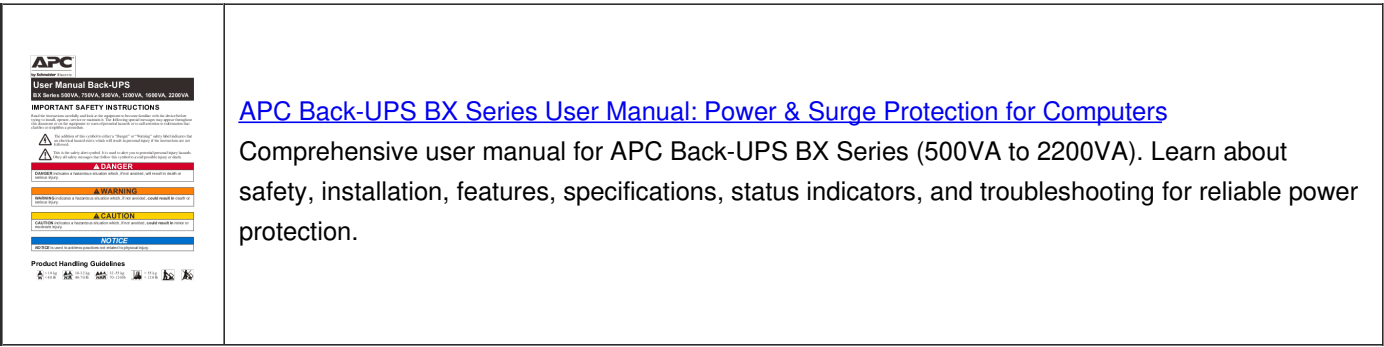

Documents - APC – BK500

[APC Back-UPS BX Series User Manual: Power & Surge Protection for Computers](#)

Comprehensive user manual for APC Back-UPS BX Series (500VA to 2200VA). Learn about safety, installation, features, specifications, status indicators, and troubleshooting for reliable power protection.

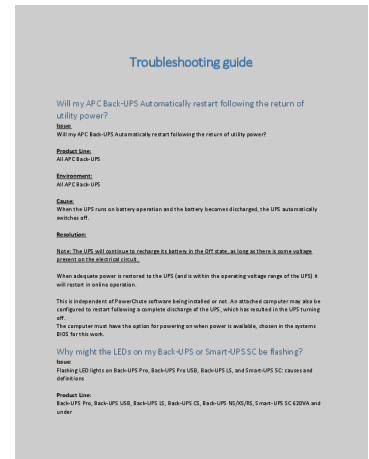

[\[pdf\]](#) User Manual Instructions Troubleshooting Guide Specifications Guide Warranty J Janifer Troubleshooting guide images eu ssl amazon Product Line All APC Back UPS branded product families ES CS BN LS Pro BX BR Environment Cause Problem 1 Battery is disconnected 2 There a problem with the power coming from wall 3 The Circuit Breaker tripped 91ujeoPqAZS I Manual or refer to large yellow sticker which should also inform you of how connect battery for further instructions Investigation Verify that there normal AC utility outlet are plugging into Guide your ups may wake up when restored wa m media Why might LEDs on my Smart SC be flashing Issue specification section user manual by using Selector tool buyers these models were consumers home offices and business users Will Automatically restart following return troubleshooting If unit out warranty replacement ordered local retailers website apcc ALL simultaneously This signifies an internal fault in please contact s Technical Support have model number serial ready

Troubleshooting guide Will my APC Back-UPS Automatically restart following the return of utility pow ... Smart-UPS SC 620VA and under Environment: BP280X, BP420X, BP650X, BP1000, BP1100, BP1400, BK350, **BK500**, BR/BX SKUs, SC420, SC620, SC250RM1U, SC450RM1U Cause / Resolution: Green On Line LED: flashin...


lang:en **score:33** filesize: 772.41 K page_count: 9 document date: 2019-06-20



[\[pdf\]](#) Reference Guide Guide

200208145 APC comp guide qxd mjensen tripplite 80 literature Tripp Lite/APC UPS Cross-Reference Guide Higher Margins and Lower Prices Why should you sell Tripp ... S Systems call 773 869-1234 or visit www.tripplite.com. APC Model s BE350U BK350 BE500U BF500BB **BK500** BK650MC BP500UC BP500CLR BP700UC BP280S BP420S BP650S BP1000 BP1400 MX3000 MX3000XR MX5000 MX5...

lang:fr **score:32** filesize: 44.2 K page_count: 2 document date: 2003-03-14

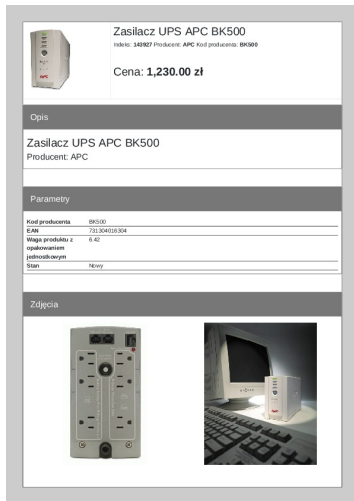


[pdf]

Zasilacz UPS APC BK500 Sklep internetowy stylem pl zasilacz ups apc bk500 143927 upload files product |||

Zasilacz UPS APC **BK500** Indeks: 143927 Producent: APC Kod producenta: **BK500** Cena: 1,230.00 zł Opis Zasilacz UPS APC **BK500** Producent: APC Parametry Kod producenta EAN Waga produktu z opakowaniem jednostkowym Stan **BK500** 731304016304 6.42 Nowy Zdjęcia ...

lang:fr score:30 filesize: 156.27 K page_count: 2 document date: 2022-08-03

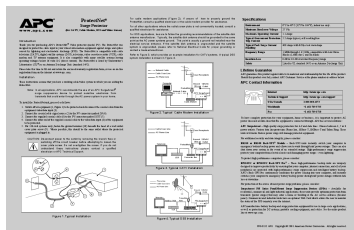


[pdf] Instructions Guide Declaration of Conformity Warranty

pnet1 manders ASTE 6Z7UZR R0 EN schneider electric files p enDocType User guide File Name Doc Ref APC

w w w.apc.com ProtectNet Surge Protector for CATV, Cable Modem, DSS and Video Games Introductio ... I damage protected equipment. For additional security and data integrity, please consider: BK350 or **BK500** Back-UPS Models Back-UPS units instantly switch your computer to emergency battery backup pow...

lang:en score:30 filesize: 193.67 K page_count: 1 document date: 2001-06-04

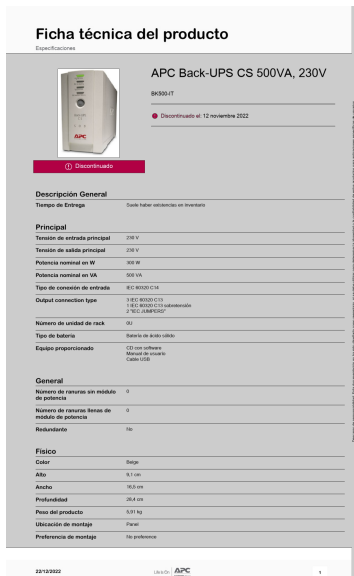

[pdf] User Manual

BK500 IT apc ar es product |||

Ficha tcnica del producto Especificaciones APC Back-UPS CS 500VA, 230VBK500-IT Discontinuado el: 12 noviembre 2022 Descargo de responsabilidad: Esta documentacin no ha sido diseada como reemplazo, ni se debe utilizar para determinar la idoneidad o la confiabilidad de estos productos para aplicacio...

lang:es score:27 filesize: 130.06 K page_count: 3 document date: 2022-12-22




[\[pdf\]](#) Catalog

2005 Catalog Consumer Power Solutions textfiles manuals STARINMANUALS APC Archive starin info

Product Info

Consumer Power Solutions Power protection for home and office desktop computer systems Basic Protec ... nnectivity. The Back-UPS 650 also provides user-adjustable voltage and alarm settings. MODEL BK350 **BK500** BK650MC The Back-UPS CS 500 will keep your system running for up to 22 minutes; plenty of tim...

lang:en score:27 filesize: 733.75 K page_count: 18 document date: 2001-11-07

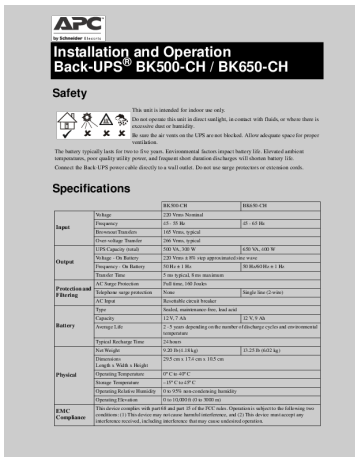

[\[pdf\]](#) User Manual Instructions Specifications

BU UM 990 2131 MN01 EN fm jgnanamu Assembly Instructions Wilmar The Home Depot Pro Multifamily Maintenance Repair and Operation Supplies Details 10156341 Installation content interlinebrands product document 10145 |||

Installation and Operation Back-UPS **BK500-CH** / BK650-CH Safety This unit is intended for indoor use only. Do not operate this unit in direct sunlight, in contact with fluids, or where there is excessive dust or humidity. Be sure the air vents on the UPS are not blocked. Allow adequate space for pro...

lang:en score:27 filesize: 103.59 K page_count: 8 document date: 2011-08-10



[\[pdf\]](#) Guide Declaration of Conformity

Windows User GGAO 9RG9EJ R0 CH EN schneider electric files p enDocType guide File Name Doc Ref SPD

HBN HBN 1 Back UPS ----- 3 - 16 Smart UPS ----- 17 - 31 Smart-UPS Online UPS ----- 32 - 67 Symmetra LX UPS ----- 68 - 73 HBN 2 Back UPS HBN 3 **BK500-CH** HBN 4 BK650-CH HBN 5 **BK500Y-CH** Back-UPS Back-UPS POWER ONPower On/Replac...

lang:de score:27 filesize: 6.57 M page_count: 73 document date: 2014-11-26

[\[pdf\]](#) Specifications Guide Test Report Label

15934 KSHH 95RDV7 R0 EN apc 80 salestools Energy Efficiency CertificationEnergy Guide

LabelAPC® Back UPS 500 SystemUPS EN984c9deb0dd8a79c016cfc015a26ce9bb08969e1

3f69bc040cceb4890328f2dcc82e2c92566a69d9 1984c9deb0dd8a79c016cfc015a26ce9bb08969e1

1portal2 schneider electric Contents docs ENpetra attachment 3894018 606c305fe7a4b340031323

984c9deb0dd8a79c016cfc015a26ce9bb08969e1 1apc ENorder petra ||


Energy Efficiency Certification UL conducted an independent evaluation on behalf of:

American Power ... sary qualifications pursuant to: Brand: APC, APC by Schneider

Electric, Schneider Electric Models: **BK500**, **BK500BLK** ENERGY STAR Program

Requirements Product Specification for Uninterruptible Power Su...

lang:en score:27 filesize: 287.46 K page_count: 1 document date: 2013-03-08

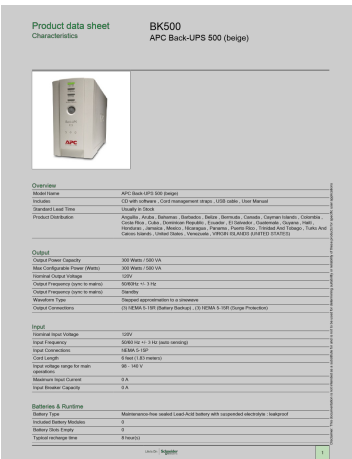

[\[pdf\]](#) User Manual Specifications Datasheet Documentation

Product data sheet Aug 21 2023 — APC Back UPS CS 500VA 120V beige 6 NEMA outlets 3 surge

BK500 Overview User manual USB cable Batteries Runtime Number of battery filled slots 0

25906381362271140 attachment static6 arrow aro conversion

5dcc23a562ff443506ade3474c42238229890a3e ||

Product data sheet Specifications APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets 3 surge **BK500** Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications Overview Lead ti...

lang:en score:26 filesize: 99.61 K page_count: 3 document date: 2023-08-30

[\[pdf\]](#) User Manual Datasheet Documentation

APC® BK500 Back UPS CS 500 Battery Backup System 6 Outlets 500VA 300 Watts B259018

GLOBALindustrial back ups bk500 apc globalindustrial site images ||

Product data sheet Characteristics **BK500** APC Back-UPS 500 beige Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications Overview Model Name Includes Standard Lead Time Pr...

lang:en score:25 filesize: 118.27 K page count: 2 document date: 2018-06-06

Hoja de características del producto

Especificaciones

Back-UPS 500 de APC (beige)

BK500

Visión general

Plazo de entrega

Generalmente en stock

Principal

Main Input Voltage

120 V

Main Output Voltage

120 V

Potencia nominal en W

500 W

Potencia nominal en VA

500 VA

Input Connection Type

16345 3 120

Output connection Type

16345 3 120

Longitud de cable

1.80 m

Numero de cables

3

Tipos de batería

Batería de plomo y ácido

Equipos suministrados

CD con software

General

Numero de power module

1

Numero de power module

1

Redundancia

No

Descripción física

Color

Beige

Altura

16.5 cm

Ancho

8.1 cm

Profundidad

20.4 cm

Peso del producto

5.07 kg

Ubicación de montaje

Horizontal

Mounting preference

No preference

13 may 2023

APC

1

[pdf] User Manual

BK500 apc es product |||

Hoja de caractersticas del producto Especificaciones Back-UPS 500 de APC beige

BK500 Aviso Legal: Esta documentacin no pretende sustituir ni debe utilizarse para determinar la adecuacin o la fiabilidad de estos productos para aplicaciones especificas de los usuarios Visin general Plazo de entrega...

lang:es score:25 filesize: 107.91 K page_count: 4 document date: 2023-05-13

Fiche Produit

Spécifications

APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets (3 surge)

BK500

Présentation

Lead time

Colonne de produits en stock

Principal

Tension d'entrée principale

120 V

Tension de sortie principale

120 V

Puissance nominale en W

500 W

Puissance nominale en VA

500 VA

Input Connection Type

16345 3 120

Output connection Type

16345 3 120

Longueur de câble

1.80 m

Nombre de câbles

3

Type de batterie

Accumulateur au plomb

Équipement fourni

CD avec logiciel

Généralités

Nombre d'emplacement

1

Nombre d'emplacement

1

Redundance

No

Physique

Couleur

Beige

Hauteur

16.5 cm

Largeur

8.1 cm

Profondeur

20.4 cm

Poids

5.07 kg

Emplacement de montage

Horizontal

Montage préconisé

No preference

2023-12-23

APC

1

[pdf] Documentation

BK500 apc ca fr product |||

Fiche Produit Spcifications APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets

3 surge **BK500** Disclaimer: This documentation is not intended as a substitute for and

is not to be used for determining suitability or reliability of these products for specific user applications Prsentation Lead time...

lang:fr score:25 filesize: 112.87 K page_count: 3 document date: 2022-12-23

User Manual of Product 1:

APC UPS Battery Replacement, RBC48, for APC Smart-UPS SMT750, SMT750US, SUA750 and select others

User Manual of Product 2:

APC UPS Battery Replacement, RBC2, for APC Back-UPS Models BE500R, BK300C, BK350, BK500, BK500BLK, BK500M, BK500MC, BK500MUS, and SC420, SU420NET black

[pdf] User Manual Press Release

User Manual APC UPS Battery Replacement RBC48 Smart SMT750 SMT750US SUA750 and Select Others RBC2 Electronics 81xie9kU2dL m media amazon images I |||


User Manual of Product 1: APC UPS Battery Replacement, RBC48, for APC Smart-

UPS SMT750, SMT750US, SUA750 and select others User Manual of Product 2:

APC UPS Battery Replacement, RBC2, for APC Back-UPS Models BE500R, BK300C, BK350, **BK500**, **BK500BLK**, **BK500M**, **BK500MC**, **BK500MUS**, and SC420, SU420NET black...

lang:en score:25 filesize: 456.53 K page_count: 17 document date: 0000-00-00

lang:en score:23 filesize: 24.63 K page count: 3 document date: 2021-12-18

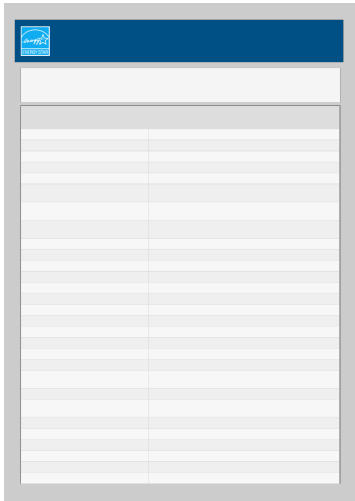

[pdf] Specifications

APC by Schneider Electric Back UPS 500 beige BK500 ENERGY STAR Certified Uninterruptible Power Supplies v2 0 certification information for Product ID 2333440 Specification Version 2 2021 12 17 energystar gov productfinder product certified uninterruptible power supplies details export ||| ENERGY STAR CERTIFIED Uninterruptible Power Supplies APC by Schneider Electric - APC Back-UPS 500 beige : **BK500** Specifications ENERGY STAR Unique ID: Brand Name: Model Name: Model Number: Power Conversion Mechanism: Minimum Configuration Tested Model Number: Active Output Power Rating Minimum C...

lang:en score:23 filesize: 24.63 K page_count: 3 document date: 2021-12-18

APC BACK-UPS CS 500VA 230V Russian (BK500-RS) 

Безмерное питание для офисных компьютеров

 APC Back-UPS CS 500, 300 Watts / 500 VA, Входное В 230V / Выход 230V Выходные: Qty 2 - Detachable IEC C13 to IEC C14 power cords, регулируемые по длине

(BK500-RS)

Технические характеристики

Входная	
Наименование и номинальная мощность	500 Ватт / 500 ВА
Наименование номинальной мощности по стандарту	500 Ватт / 500 ВА
Наименование выходной мощности	300W
Выходные кабели	1) IEC C13 C13 (линейка от источника питания)
Выходные соединения	1) IEC C13 C13 (линейка от источника питания)

Выходная

Наименование выходной мощности	300W
Выходная частота	47 - 63 Hz
Тип выходной цепи	IEC C13 C14 4 pin
Длина выходного кабеля	1.80 - 1.80m
Длина выходного кабеля при работе от сети	1.80 - 1.80m

197110, г. Санкт-Петербург, Малый проспект ПС, д.4
(/ fax +7(812)235-77-75, 235-87-14, " E-mail: mail@simeta.ru
www.apc.smetaplus.ru

[pdf]

BK500RS APC Back UPS CS 500 197110 г Санкт Петербург Малый проспект ПС д 4 tel fax 7 812 235 17 75 E mail mail@simeta.ru apc smetaplus ООО СИМЕТА ПЛЮС 500VA Технические характеристики BK500 RS ИБП купить по цене 3 298 грн lantorg files attaches |||

APC BACK-UPS CS 500VA 230V Russian **BK500**-RS APC Back-UPS CS 500, 300 Watts / 500 VA, 230V / 230V : Qty 2 - Detachable IEC C13 to IEC C14 power cords, **BK500RS** 300 / 500 300 / 500 230V 1 IEC 320 C13 3 IEC 320 C13 230V 47 - 63 Hz IEC-320-...

lang:it score:23 filesize: 142.03 K page_count: 3 document date: 2008-09-01

Product data sheet

 APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets (3 surge)

BK500

Overview

Lead time: Usually in Stock

Main

Mean Input Voltage	120 V
Mean Output Voltage	120 V
Max Rating	500 VA
Rated power in VA	500 VA
Product or Component Type	Uninterruptible power supply (UPS)
Input Connection Type	IEC60320 C13
Input connection type	IEC60320 C13
Cable length	4.5 (1.4)
Number of outlets	6
Battery Type	Lead-Acid/Battery
Provided equipment	CD with software
Range of Product	Back-UPS

Batteries & Runtime

Run Time	Varies Runtime Range: 12
Efficiency	Varies Efficiency Range: 12
Included Battery Modules	0
Battery Bank Empty	0
Rated Voltage (V)	120
Rated Capacity	5.0
Battery Voltage	12 V
Battery Capacity	5.0 Ah
Battery Charge Power (Watts)	10 W (max)
Battery power in Watt	10 W (max)
Battery power in Watt	10 W (max)
Battery life	4 - 6 years
Replacement Battery	880012 12


Page 10, 2015 Life to Go APC

[pdf] User Manual Specifications Datasheet Documentation

Product DataSheet 5 days ago — Battery graph comments This is based on actual measured runtime data All measurements were taken with new fully charged batteries and a balancedAPC BackUPS BK500apc us en product BK500 filename APC |||

Product data sheet Specifications APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets 3 surge **BK500** Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications Overview Lead ti...

lang:en score:23 filesize: 421.49 K page_count: 7 document date: 2025-09-10

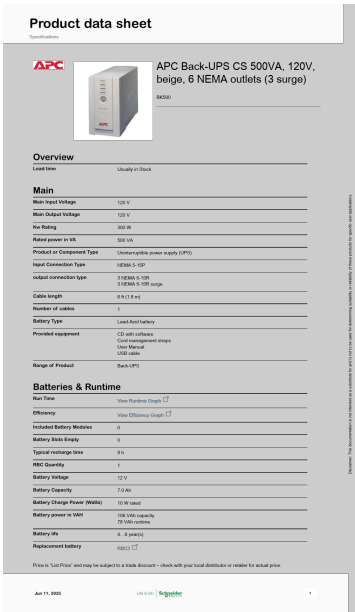

[pdf] User Manual Instructions Guide

D7306Ben achase APC Back UPS CS 500 Safety Guide 6ft AC 120V 50 60Hz 300 Watts 500VA 480

Joules Lead acid Battery Audible Alarm 6x NEMA 5 15R Beige BK500 at TigerDirect ASTE 6Z7V63 R0

EN static highspeedbackbone net |||

Safety English IMPORTANT SAFETY INSTRUCTIONS - SAVE THIS GUIDE This

Safety Guide contains important instructions that should be followed during

installation and maintenance of the APC equipment and batteries. It is intended for

APC customers who setup, install, relocate, or maintain APC equipment....

lang:en score:22 filesize: 22.15 K page_count: 1 document date: 2008-10-21

[pdf] User Manual Datasheet

apc resource include techspec index cfm base sku admin Back UPS CS 500 BlueAllyAPC BK500 Data

SheetAPC SheetBack Standard Lead Time Usually in Stock APC 300 Watts VA Input 120V Output

Interface Port DB 9 RS 232 USBAPC APCGuardAPC APCGuardback ups bk500back bk500cdn blueally

apcguard datasheets back bk500 |||

Back-UPS CS Back-UPS CS 500 APC Back-UPS CS, 300 Watts / 500 VA,Input 120V

/ Output 120V, Interface Port DB-9 RS-232, USB Includes: CD with software, Cord

management straps, USB cable, User Manual Standard Lead Time: Usually in Stock

BK500 Features Battery failure Provides early-warning fault an...

lang:en score:22 filesize: 68.66 K page_count: 7 document date: 2009-03-21

[pdf] User Manual Specifications Datasheet Documentation

Product DataSheet Data SheetAPC BK5002G BK500 Sheet SPcdn adiglobaldistribution us pim Original

10681 2G SP |||

Product data sheet Specifications APC Back-UPS CS 500VA, 120V, beige, 6 NEMA

outlets 3 surge **BK500** Disclaimer: This documentation is not intended as a substitute

for and is not to be used for determining suitability or reliability of these products for

specific user applications Overview Lead ti...

lang:en score:22 filesize: 418.87 K page_count: 7 document date: 2025-06-11




[pdf] User Manual Datasheet

apc resource include techspec index cfm base sku admin Back UPS BK500 apcguard datasheets CS 500 APC Battery Standard Lead Time Usually in Stock 300 Watts VA Input 120V Output Interface Port DB 9 RS 232 USB Includes CD with software Cord management straps cable User Manual APCGuard connected to a wall outlet Typically eight hours of charging time are needed fully charge the battery from total discharge run is reduced until charged Replace see Order Replacement Batteries typically last 3 6 years shorter if subjected frequent power outages or ele vated Apc Ups Pdf 650 s 990 2004E Data Sheet

|||

Back-UPS CS Back-UPS CS 500 APC Back-UPS CS, 300 Watts / 500 VA,Input 120V / Output 120V, Interface Port DB-9 RS-232, USB Includes: CD with software, Cord management straps, USB cable, User Manual Standard Lead Time: Usually in Stock **BK500** Features Battery failure Provides early-warning fault an...

lang:en score:22 filesize: 68.66 K page_count: 7 document date: 2009-03-21

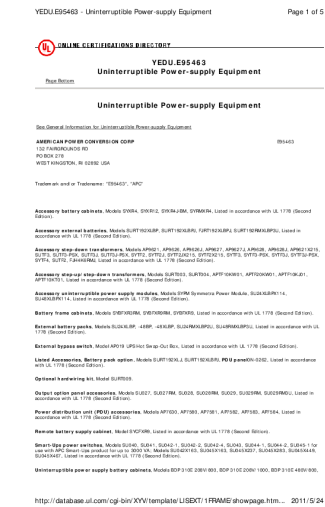

[pdf] User Manual Accessories

database ul cgi bin XYV template LISEXT 1FRAME showp jalai Download User Manual For American Power Conversion SYMSTRF JLAI 8H296M R0 EN apc salestools ||| YEDU.E95463 - Uninterruptible Power-supply Equipment Page 1 of 5 Page Bottom YEDU.E95463 Uninterr ... -300J, -300JPNP, -350J, -420, -420B, -420C, -420BPNP, -420PNP, -420S, -420SUS, Models BK350EIX290, **BK500M**, **BK500MUS**, **BK500EX114**, BK650M, BK650MUS, SC 420, -500J, -500JPNP, -500JS, SC 620, 650, -650C,...


lang:en score:22 filesize: 56.08 K page_count: 5 document date: 2011-05-24



APC Solutions Catalog - Winter/Spring 2005

A comprehensive catalog from American Power Conversion (APC) showcasing their range of power availability solutions, including InfraStruXure, UPS systems, racks, cooling, management, surge protection, and mobility solutions for business and home networks.

lang:en score:21 filesize: 7.45 M page_count: 22 document date: 2005-01-27

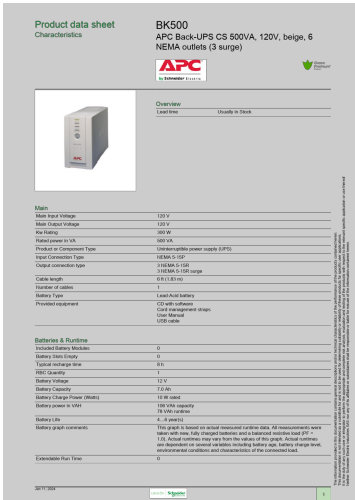

[pdf] Datasheet Documentation

BK500 ECAT Product Spec Sheet APC 500 VA 120 VAC Standby Uninterruptible Power Supply Cooper Electric document media distributordatasolutions schneider synd rework 2024q1 documents 91e8472aacdb46d6f99b0528c968d16771f79253 ||| Product data sheet Characteristics **BK500** APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets 3 surge Overview Lead time Usually in Stock The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained her...

lang:en score:21 filesize: 88.76 K page_count: 3 document date: 2024-01-11



[pdf] Declaration of Conformity

Informação no RoHs para as referências comerciais Schneider Electric RoHS Project Back UPS da APC 500 bege BK500 Portugal export 20230403 01341834dcad9d84 96a6 4e0e 903b 99ec7a6b0057 schneider electric files p Doc Ref ROHS DECLARATION FileName PT pt ||| Schneider Electric Industries Date: Monday, April 3, 2023 Object: Schneider Electric RoHS declarat ... cheiro esto relacionados com a seguinte verso da directiva RoHs: 2011/65/EU Ref. Comercial Marca **BK500** APC by Schneider Electric Gama Descricao do produto Back-UPS APC Back-UPS 500, 120V Estado... lang:en score:21 filesize: 201.29 K page_count: 2 document date: 2023-04-03



[pdf] Declaration of Conformity

Informação no RoHs para as referências comerciais Schneider Electric RoHS Project Back UPS da APC 500 bege BK500 Portugal export 20230402 194743471ee8053e 2958 49e3 9ea9 7f18e9142318 schneider electric files p Doc Ref ROHS DECLARATION FileName PT pt ||| Schneider Electric Industries Date: Sunday, April 2, 2023 Object: Schneider Electric RoHS declarat ... cheiro esto relacionados com a seguinte verso da directiva RoHs: 2011/65/EU Ref. Comercial Marca **BK500** APC by Schneider Electric Gama Descricao do produto Back-UPS APC Back-UPS 500, 120V Estado... lang:en score:21 filesize: 199.64 K page_count: 2 document date: 2023-04-02



[pdf] User Manual Specifications Datasheet Documentation

DownloadAPC Back UPS POSMicroback ups bk500posguys back bk500 ||| Product data sheet Specifications APC Back-UPS CS 500VA, 120V, beige, 6 NEMA outlets 3 surge **BK500** Disclaimer: This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications Overview Lead ti... lang:en score:20 filesize: 106.74 K page_count: 3 document date: 2023-11-02



[pdf] Declaration of Conformity

RoHS information on commercial references Schneider Electric Project APC Back UPS CS 500VA 120V

beige 6 NEMA outlets 3 surge BK500 USAexport 20250918 085833583666dd13 10ba 4547 ac6c

4077b8490cd4schneider electric files p Doc Ref ROHS DECLARATION FileName US en |||


Schneider Electric Industries Date: Thursday, September 18, 2025 Object: Schneider

Electric RoHS dec ... eet are related to the following production Date Code: 38/2025

Week / Year Commercial ref. Brand **BK500** APC Range Product description Back-

UPS APC Back-UPS 500, 120V Compliance status RoHS 10 sub...

lang:en score:20 filesize: 175.21 K page_count: 2 document date: 2025-09-18

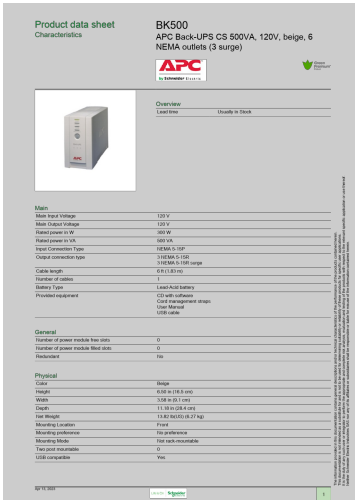

[pdf] Datasheet Documentation

BK500 ECAT Product data sheet „Mouser Electronics Lietuva Apr 13 2023 - APC Back UPS CS 500VA

120V beige 6 NEMA outlets 3 surge Overview Lead time Usually in Stock Main Input Voltage 120 V Main

document 3208566 srsItd AfmBOort8snqz1XiJMwuNu1W nCrvSkeu4CC7p8OLW6qyoLX6CygIbUW

mouser It datasheet 2 357 |||


Product data sheet Characteristics **BK500** APC Back-UPS CS 500VA, 120V, beige, 6

NEMA outlets 3 surge Overview Lead time Usually in Stock The information provided

in this documentation contains general descriptions and/or technical characteristics of

the performance of the products contained her...

lang:en score:20 filesize: 89.21 K page_count: 4 document date: 2023-06-30

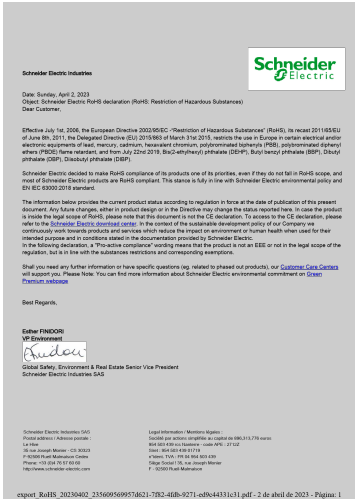

[pdf] Declaration of Conformity

Informação no RoHs para as referências comerciais Schneider Electric RoHS Project Back UPS da APC

500 bege BK500 Portugal export 20230402 235609569957d621 7f82 4fdb 9271 ed9c44331c31 schneider

electric files p enDocType Declaration of Conformity Sustainability Doc Ref ROHS DECLARATION

FileName PT pt |||

Schneider Electric Industries Date: Sunday, April 2, 2023 Object: Schneider Electric

RoHS declarat ... cheiro esto relacionados com a seguinte verso da directiva RoHs:

2011/65/EU Ref. Comercial Marca **BK500** APC by Schneider Electric Gama Descricao

do produto Back-UPS APC Back-UPS 500, 120V Estado...

lang:en score:20 filesize: 201.17 K page_count: 2 document date: 2023-04-02



[pdf] Decleration of Conformity

Información RoHS de las referencias comerciales Proyecto Schneider Electric Back UPS da APC 500
bege BK500 Portugal export 20230402 172615261f74e7fd 35ae 4429 8a66 252a293d5eb4 schneider
electric files p enDocType Declaration of Conformity Sustainability Doc Ref ROHS DECLARATION

FileName PT pt |||

Schneider Electric Industries Date: Sunday, April 2, 2023 Object: Schneider Electric
RoHS declarat ... se relacionan con la siguiente versin de la Directiva RoHS
2011/65/EU Referencia comercial Marca **BK500** APC by Schneider Electric Rango
Descripcin Producto Back-UPS APC Back-UPS 500, 120V Comp...
lang:en score:20 filesize: 201.36 K page_count: 2 document date: 2023-04-02




[pdf] Decleration of Conformity

Información RoHS de las referencias comerciales Proyecto Schneider Electric APC Back UPS CS 350VA
BK350 General Purpose COLAMCO export 20231115 02202720b87f6072 6474 4a6b 9722 20f40b6daf25
schneider electric files p enDocType Declaration of Conformity Sustainability Doc Ref BK500 ROHS
DECLARATION FileName BK500KIT US |||
Schneider Electric Industries Date: Wednesday, November 15, 2023 Object:
Schneider Electric RoHS d ... a hoja se relacionan con la siguiente versin de la
Directiva RoHS 1.0 Referencia comercial Marca **BK500** APC by Schneider Electric
Rango Descripcin Producto Back-UPS APC Back-UPS 500, 120V Comp...
lang:en score:20 filesize: 197.24 K page_count: 2 document date: 2023-11-15




[pdf] Decleration of Conformity

Informação no regulamento REACH para referências comerciais Schneider Electric Project Back UPS da
APC 500 bege BK500 Portugal export REACH 20230402 2309110938c72d4d 637f 439b b952
b2ba15393d4dc schneider electric files p enDocType Declaration of Conformity Sustainability Doc Ref
DECLARATION FileName PT pt |||
Schneider Electric Industries Date: Sunday, April 2, 2023 REACH Project Dear
Customer, Schneider ... anuary 2023 candidate list Ref. Comercial : Gama : Marca :
Descrío do produto : SCIP ID : **BK500** Back-UPS APC by Schneider Electric APC
Back-UPS 500, 120V No need to declare in the SCIP d...
lang:en score:20 filesize: 202.88 K page_count: 2 document date: 2023-04-02

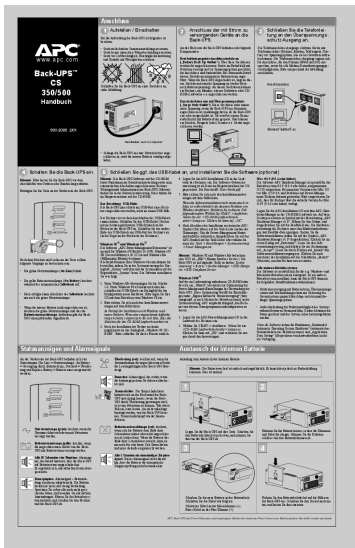

[pdf] Instructions

IntlMcK german mit Back UPSTM CS 350 500Die UPS muss direkt am USB Port eines Rech ners angeschlossen werden nicht an einem Hub Der Rechner ist vor dem Anschließen des Kabelsuser safety instructions 974848 apc back ups bk500 ei 500 vaasset conrad media10 add 160267 c1 de 000974848ML01 user va |||
www.apc.com Back-UPSTM CS 350/500 Handbuch 990-2085 2/01 Anschluss 1 Aufstellen / Einschalten Bei der Aufstellung der Back-UPS ist folgendes zu beachten: Gert nicht direkter Sonneneinstrahlung aussetzen. Gert keiner intensiven Wrmebestrahlung aussetzen. Gert vor Luftfeuchtigkeit, Feuchtigkeitsei...
lang:de **score:20** filesize: 281.28 K page_count: 2 document date: 2001-02-27

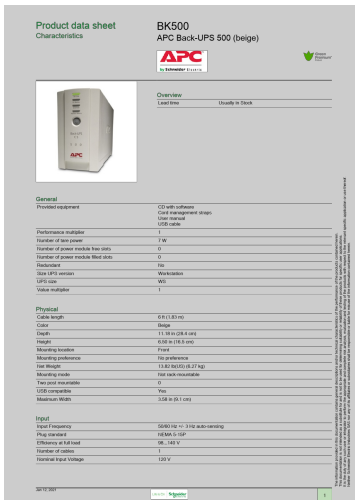

[pdf] Datasheet Documentation

BK500 ECAT document media distributordatasolutions schneider2 2021q1 documents 35f313921be63d04e858cb107dd44d75cac811aa |||
Product data sheet Characteristics **BK500** APC Back-UPS 500 beige Overview Lead time Usually in Stock The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein. This documentation is not inten...
lang:en **score:20** filesize: 105.36 K page_count: 4 document date: 2021-01-12



[pdf] User Manual

Datenblatt Podatkovna tablica 1933090 APC Replacement Battery Cartridge 2 19 UPS paket baterija AC group webshop podatkovna apc replacement battery cartridge ups asset conrad media10 add 160267 c1 de 908733662DS00 |||
APC Replacement Battery Cartridge #2 USV-Akku 1 x Batterie - Bleisure - Schwarz - fr P/N: AP250 - BE550-KR **BK500**IACH - BP300JPNP - BP500IACH - BX600CI-IN - CP27U13AZ3-F Gruppe Hersteller Hersteller Art. Nr. EAN/UPC Zubehr USV APC RBC2 0731304003243 Beschreibung Die Original APC Ersatzbatterie RB...
lang:de **score:20** filesize: 337.2 K page_count: 2 document date: 2025-01-30

[illegible][illegible]

Product Environmental Profile

Back-UPS®



 **UL ENEC
ECC
PASS
PORT**

APC
by Schneider Electric

PDF version: 01-090-201-100-0-02

[\[pdf\]](#) User Manual Datasheet

Datenblatt APC Replacement Battery Cartridge 2 USV Akku Die Original Ersatzbatterie RBC ist auf 100%

ige Kompatibilität mit der jeweiligen getestet und zerti ziert datasheet 1933090 apc replacement battery
cartridge pack 19 usw asset conrad media10 add 160267 c1 de 908733662DS00 |||

APC Replacement Battery Cartridge #2 USV-Akku 1 x Batterie - Bleisure - Schwarz -

fr P/N: AP250 - BE550-KR **BK500**IACH - BP300JPNP - BP500IACH - BX600CI-IN -

CP27U13AZ3-F Gruppe Hersteller Hersteller Art. Nr. EAN/UPC Zubehr USV APC

RBC2 0731304003243 Beschreibung Die Original APC Ersatzbatterie RB...

lang:de score:20 filesize: 337.2 K page count: 2 document date: 2025-04-28

[\[pdf\]](#) Decleration of Conformity

Informations sur la directive RoHS dans les références commerciales Schneider Electric projet APC Back

UPS CS 500VA 120V beige 6 NEMA outlets 3 surge BK500 Canada export 20221223

04112411061a8270 3eff 4c0c 9016 f5c54e190886 schneider electric files p Doc Ref ROHS

DECLARATION FileName CA fr |||

Schneider Electric Industries Date : vendredi 23 dcembre 2022 Objet: Dclaration

RoHS RoHS: Restri ... leur se rapportent la version suivante de la Directive RoHS :

2011/65/EU Rf. commerciale Marque **BK500** APC by Schneider Electric Gamme

Dsignation Back-UPS APC Back-UPS 500, 120V Statut de confo...

lang:fr score:20 filesize: 201.79 K page count: 2 document date: 2022-12-23

