

Rectorseal SS610E

Rectorseal 97622 SS610E Safe-T-Switch Instruction Manual

MODEL: SS610E

Brand: Rectorseal

1. INTRODUCTION AND PRODUCT OVERVIEW

The Rectorseal SS610E Safe-T-Switch is an electronic condensate overflow switch designed to prevent water damage caused by clogged condensate drains in mini-split air conditioning systems. It features a compact sensor that fits into confined spaces and state-of-the-art microelectronics to monitor for water presence. When water is detected, the switch is designed to shut down the air conditioning unit, preventing overflow and potential property damage.

Key features include:

- Easy-to-use sensor connects to indoor units.
- State-of-the-art microelectronic design.
- Attaches to drain pan or coils with unique brackets.
- Multi-voltage compatibility.
- No moving parts for enhanced reliability.

2. SAFETY INFORMATION

WARNING: Installation and servicing of this product should only be performed by qualified personnel. Disconnect all power to the air conditioning unit before installing or servicing the Safe-T-Switch to prevent electrical shock or equipment damage. Failure to follow these instructions may result in personal injury, property damage, or death.

- Always follow local electrical codes and regulations.
- Ensure proper wiring connections to avoid short circuits or malfunction.
- Do not modify the device or its components.
- Keep the device away from excessive moisture or extreme temperatures beyond its operating specifications.

3. PACKAGE CONTENTS

The Rectorseal SS610E Safe-T-Switch package typically includes:

- 1 x SS610E Safe-T-Switch unit with integrated wiring harness.
- Mounting brackets (if applicable, for pan or coil attachment).
- Installation instructions (this manual).

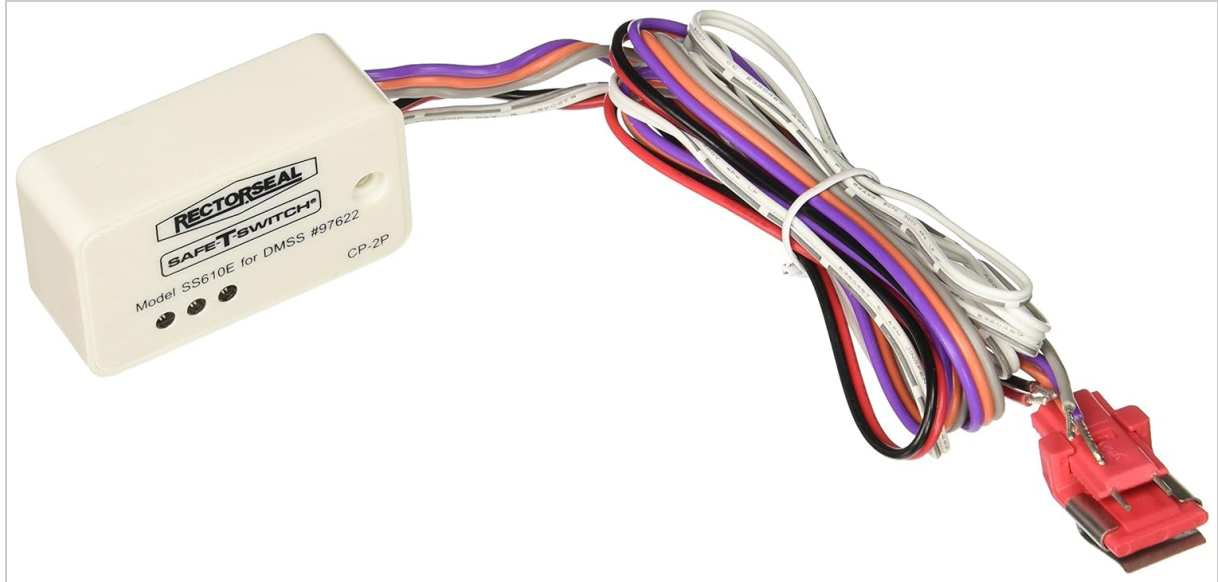


Figure 1: The Rectorseal SS610E Safe-T-Switch unit, showing the main control box and the attached multi-colored wiring harness. The control box is labeled "RECTORSEAL SAFE-T-SWITCH Model SS610E for DMSS #97622".

4. SETUP AND INSTALLATION

The SS610E is specifically designed for use in mini-split systems. Its small sensor can easily fit into the confined internal spaces of most units. It can be installed directly in the drain pan or clipped to the unit's coils.

1. **Power Disconnection:** Before beginning installation, ensure that all power to the mini-split air conditioning unit is completely disconnected at the circuit breaker.
2. **Sensor Placement:**
 - **Drain Pan Installation:** Place the sensor directly into the auxiliary or primary drain pan at a location where water would accumulate if the primary drain line becomes clogged. Ensure the sensor is level and securely positioned.
 - **Coil Installation:** If installing on coils, use the provided clips or brackets to secure the sensor to the coil fins in a position where condensate overflow would first be detected.
3. **CPU Unit Mounting:** The SS610E's CPU unit is housed in an attractive casing. Mount this unit directly to the side of the mini-split unit using appropriate fasteners (not included) or adhesive, ensuring it is accessible for viewing LED indicators.
4. **Wiring Connections:** The SS610E uses power from the A/C unit, so no batteries are required. Connect the wiring harness according to the mini-split unit's wiring diagram and the SS610E's specific wiring instructions (refer to the diagram usually provided with the product packaging). Typically, the switch interrupts the low-voltage control circuit (e.g., 24V AC thermostat wire) to shut down the compressor or entire unit.

Important: Incorrect wiring can damage the switch or the air conditioning unit. If unsure, consult a qualified HVAC technician.

5. **Secure Wiring:** Route and secure all wiring to prevent interference with moving parts or damage from sharp edges.
6. **Power Reconnection:** Once all connections are secure and verified, restore power to the air conditioning unit.

5. OPERATING INSTRUCTIONS

The electronic condensate overflow switch contains low power consuming, state-of-the-art microelectronics. The SS610E's logic circuit continuously samples the probes for water.

- **Normal Operation:** During normal operation, with no water detected in the drain pan or at the coils, the switch remains closed, allowing the air conditioning unit to operate normally.
- **Water Detection:** If water is detected by the probes, the circuit determines if the condition is transient (e.g., a splash) or permanent (e.g., a clogged drain).
- **System Shutdown:** If a permanent water condition is detected, the system will be shut down by opening the control circuit, preventing further condensate production and potential overflow.
- **LED Indicators:** Onboard LEDs indicate the condition of the unit. Refer to the product labeling or specific wiring diagram for LED status interpretations (e.g., power, water detected, system shutdown).

6. MAINTENANCE

The SS610E Safe-T-Switch is designed for minimal maintenance. However, periodic checks are recommended as part of routine HVAC system maintenance:

- **Drain Line Inspection:** Regularly inspect the condensate drain line for blockages (algae, debris) that could lead to overflow. Clear any obstructions promptly.
- **Sensor Check:** Ensure the sensor remains securely in place and is not obstructed by debris.
- **Wiring Integrity:** Periodically check wiring connections for any signs of wear or damage.
- **Functionality Test:** During routine service, a qualified technician can test the switch's functionality by simulating a water overflow condition to ensure it properly shuts down the unit.

7. TROUBLESHOOTING

If your air conditioning unit is not operating, and you suspect the Safe-T-Switch has activated, follow these steps:

1. **Check for Water:** Inspect the condensate drain pan and the area around the sensor for standing water.
2. **Clear Blockages:** If water is present, the primary condensate drain line is likely clogged. Clear the blockage using appropriate methods (e.g., wet/dry vacuum, drain cleaner designed for HVAC).
3. **Dry Sensor:** Once the blockage is cleared and the water has drained, ensure the sensor area is dry. The switch will reset automatically once the water is no longer detected.
4. **Check LED Indicators:** Observe the onboard LEDs on the CPU unit. Consult the product's specific wiring diagram or packaging for the meaning of different LED states (e.g., solid, blinking).
5. **Verify Wiring:** If the unit does not reset after clearing water, or if there are no LED indications, ensure all wiring connections are secure and correct.
6. **Professional Assistance:** If the problem persists after troubleshooting, contact a qualified HVAC technician for diagnosis and repair.

8. SPECIFICATIONS




Feature	Specification
Model Number	97622 (SS610E)
Operation Mode	Automatic
Contact Type	Normally Open
Connector Type	Molex
Brand	Rectorseal
Item Dimensions (L x W x H)	2.5 x 5.5 x 8.25 inches
Circuit Type	1-way
Contact Material	Silver
International Protection Rating	IP54
Specification Met	ETL, CE, IP54
Item Weight	6.7 ounces
UPC	021449976220

9. WARRANTY AND SUPPORT


Warranty information for the Rectorseal SS610E Safe-T-Switch is typically provided with the product packaging or can be obtained directly from the manufacturer. For specific warranty terms, conditions, and to register your product, please refer to the documentation included with your purchase or visit the official Rectorseal website.

For technical support, installation assistance, or to inquire about replacement parts, please contact Rectorseal customer service. You can often find contact information on the manufacturer's website or through the retailer where the product was purchased.

You can visit the [Rectorseal Store on Amazon](#) for more product information.

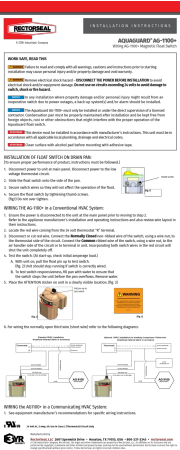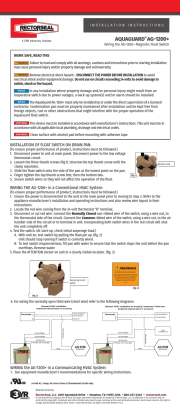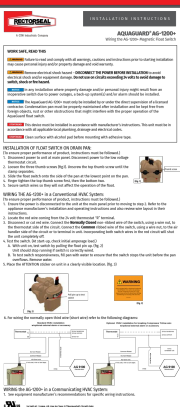 RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1100+ Magnetic Float Switch SAFETY WARNINGS: WARNING: Always read and understand all safety warnings, cautions and instructions before installing this product. Failure to do so may result in property damage, personal injury, or death. WARNING: This product is not to be used in applications where it will be exposed to flammable or combustible liquids or gases. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high voltage or high current. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to corrosive or caustic substances. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high pressure or high temperature. Failure to do so may result in property damage, personal injury, or death. INSTALLATION OF FLOAT SWITCH IN DRAIN PAN: - Remove the drain pan from the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1100+ IN A Conventional HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1100+ IN A Communicating HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1100+ Magnetic Float Switch	RectorSeal AquaGuard AG-1100+ Magnetic Float Switch Installation Guide Detailed installation and wiring instructions for the RectorSeal AquaGuard AG-1100+ magnetic float switch, designed to prevent HVAC system damage from condensate overflow. Includes safety warnings and diagrams.
 RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1200+ Magnetic Float Switch SAFETY WARNINGS: WARNING: Always read and understand all safety warnings, cautions and instructions before installing this product. Failure to do so may result in property damage, personal injury, or death. WARNING: This product is not to be used in applications where it will be exposed to flammable or combustible liquids or gases. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high voltage or high current. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to corrosive or caustic substances. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high pressure or high temperature. Failure to do so may result in property damage, personal injury, or death. INSTALLATION OF FLOAT SWITCH IN DRAIN PAN: - Remove the drain pan from the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1200+ IN A Conventional HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1200+ IN A Communicating HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1200+ Magnetic Float Switch	RectorSeal AquaGuard AG-1200+ Installation Instructions Detailed installation instructions for the RectorSeal AquaGuard AG-1200+ magnetic float switch, including safety precautions, mounting, and wiring diagrams for conventional and communicating HVAC systems.
 RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1200+ Magnetic Float Switch SAFETY WARNINGS: WARNING: Always read and understand all safety warnings, cautions and instructions before installing this product. Failure to do so may result in property damage, personal injury, or death. WARNING: This product is not to be used in applications where it will be exposed to flammable or combustible liquids or gases. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high voltage or high current. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to corrosive or caustic substances. Failure to do so may result in property damage, personal injury, or death. WARNING: Do not use this product in applications where it will be exposed to high pressure or high temperature. Failure to do so may result in property damage, personal injury, or death. INSTALLATION OF FLOAT SWITCH IN DRAIN PAN: - Remove the drain pan from the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1200+ IN A Conventional HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. WIRING THE AG-1200+ IN A Communicating HVAC System: - Turn off the power to the HVAC unit. - Remove the old float switch from the drain pan. - Install the new float switch into the drain pan. - Secure the float switch to the drain pan with the provided screws. - Test the float switch operation by pouring water into the drain pan. RECTORSEAL INSTALLATION INSTRUCTIONS AQUAGUARD® AG-1200+ Magnetic Float Switch	RectorSeal AquaGuard AG-1200+ Installation Instructions Detailed installation and wiring instructions for the RectorSeal AquaGuard AG-1200+ magnetic float switch, designed for HVAC systems. Includes safety warnings, step-by-step guides for drain pan mounting and electrical connections in both conventional and communicating HVAC systems.

Comprehensive installation instructions, wiring diagrams, safety guidelines, and limited warranty information for the RectorSeal AG-9100 AquaGuard Remote Alarm system. Learn how to properly mount, wire, and test your AG-9100 alarm.

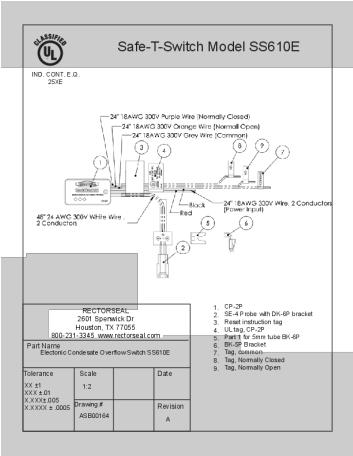


[pdf] Specifications

610e specsheet Safe T Switch Model SS610E Electronic Condensate Overflow ® IND CONT E Q Reset instruction tag UL CP 2P specifications iwae media manuals rectorseal

IND. CONT. E.Q. 25XE Safe-T-Switch Model **SS610E** RECTORSEAL 2601 Spenwick Dr Houston, TX 77055 800-231-3345 www.rectorseal.com Part Name Electronic Condensate Overflow Switch **SS610E** Tolerance Scale XX 1 1:2 XXX .01 X.XXX.005 X.XXXX .0005 Drawing # ASB00164 Date Revision A 1. CP-2P 2. SE-4...

lang: score:47 filesize: 182.79 K page_count: 1 document date: 2012-05-30

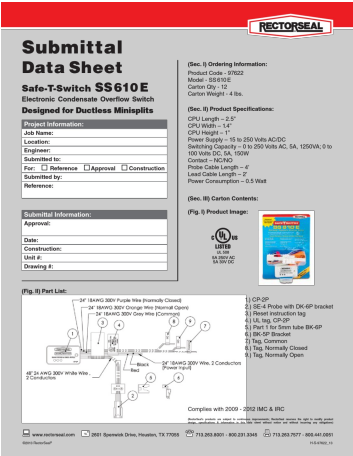

[pdf] Specifications Datasheet

Rectorseal SS610E Submittal Safe T Switch 97622 rectorseal cb74aebda2d4f030bd114b6a5ca5cadf ecomfort manuals |||

Submittal Data Sheet Safe-T-Switch **SS610E** Electronic Condensate Overflow Switch Designed for Ductless Minisplits Project Information: Job Name: Location: Engineer: Submitted to: For: qReference q Approval q Construction Submitted by: Reference: Submittal Information: Approval: Date: Construction: Un...

lang:en score:44 filesize: 201.88 K page_count: 1 document date: 2013-09-03



[pdf] User Manual Declaration of Conformity

Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure shut off UL water wire refrigeration residential RectorSeal SS610E 16834 S G Torrice Instruction

Installation Manual assets unilogcorp 267 ITEM DOC |||

Safe-T-Switch The Most Reliable Condensate Overflow Control Switches FLOAT ACTIVATED adjustable cond ... down the system. Water damage to the structure is prevented. Safe-T-Switch probe switches SS500EP, **SS610E** and SS700E, are versatile and easy to install. Our SS103E combo pack covers applications wher...

lang:en score:39 filesize: 1.53 M page_count: 8 document date: 2021-06-11



[pdf] User Manual Installation Guide

Visual elements Josh Gaynor HP Inc SS610E Install Manual v 3229912042188535396 gotductless cdn shop files |||

SS610E Electronic Condensate Overflow Switch For Mini-Split Systems R50681-0520 RectorSeal 2020 Safe-T-Switch **SS610E** A condensate pump is an essential component to a properly functioning mini-split system and is required by International Mechanical Code. IMC 307.2.3.1 Water-level monitoring devic...

lang:en score:36 filesize: 1.16 M page_count: 12 document date: 2020-05-29

[\[pdf\]](#) Instructions Warranty

SS610E Installation Instructions Safe T Switch For ductless mini splits skipthefarehouse index route

extension module mmos attachmanager getfile product attach file id 9520 |||

NOTICE: WARNING: Failure to read and comply with all warnings, cautions and instructions prior to s ... ctronic Condensate Overflow Switch contains low power consuming, state-of-the-art microelectronics. **SS610E** s logic circuit continuously samples the probes for water. If water is detected, the circuit ...

lang:en [score:36](#) filesize: 1.62 M page_count: 2 document date: 2020-03-26

[\[pdf\]](#) Specifications

610e specs sheet Safe T Switch Model SS610E Safe SS610E Electronic Condensate Overflow ® IND CONT

E Q 25XE 1 2 3 4 5 6 7 8 9 CP 2P SE Probe with DK 6P SS610E specifications i wae media manuals

rectorseal specifications srsItd AfmBOooDXNwQfAyF1lerD9xIGSd20TB5cs0gZyc7E ovpDFAEY2e XIM

|||

IND. CONT. E.Q. 25XE Safe-T-Switch Model **SS610E** RECTORSEAL 2601 Spenwick Dr Houston, TX 77055 800-231-3345 www.rectorseal.com Part Name Electronic Condensate Overflow Switch **SS610E** Tolerance Scale XX 1 1:2 XXX .01 X.XXX.005 X.XXXX .0005 Drawing # ASB00164 Date Revision A 1. CP-2P 2. SE-4...

lang:en [score:34](#) filesize: 182.79 K page_count: 1 document date: 2012-05-30

[\[pdf\]](#) Specifications

SS610E DS R50565 0320 Safe T Switch® Model 9 nov 2023 — CP 2P UL tag Reset instruction Bracket

assembly Ratchet Coil clip for 5mm Tag Normally open closed Specifications Sheet plimptonhills resource

eabdcc5964e2424ce1a7d2e5c9037649 |||

SPECIFICATIONS Safe-T-Switch Model **SS610E** RECTORSEAL, LLC 2601

Spenwick Dr Houston, TX 77055 800-231-3345 www.rectorseal.com Part Name

Electronic Condensate Overflow Switch **SS610E** Tolerance XX 1 XXX .01 X.XXX.005

X.XXXX .0005 Scale 1:2 Drawing # ASB00483 Date Revision A IND. CONT. E.Q.

25XE UL...

lang:es [score:32](#) filesize: 576.97 K page_count: 1 document date: 2020-03-31

[\[pdf\]](#) Specifications Datasheet

Specification Sheet Rectorseal SS610E Safe T Switch Electronic Condensate Overflow Ferguson

Homereactorseal ss610e specification sheets1 img b build mediabase specifications rectorseal 1965800

sheet |||





Submittal Data Sheet Safe-T-Switch **SS610E** Electronic Condensate Overflow Switch

Designed for Ductless Minisplits Project Information: Job Name: Location: Engineer:

Submitted to: For: qReference q Approval q Construction Submitted by: Reference:

Submittal Information: Approval: Date: Construction: Un...

lang:en [score:32](#) filesize: 201.88 K page_count: 1 document date: 2013-09-03

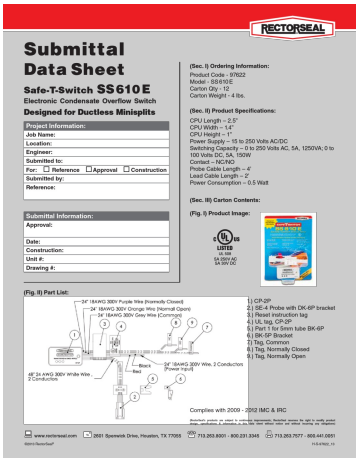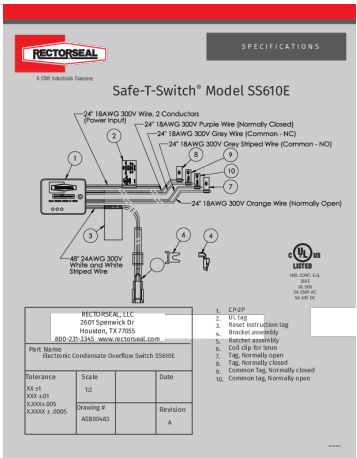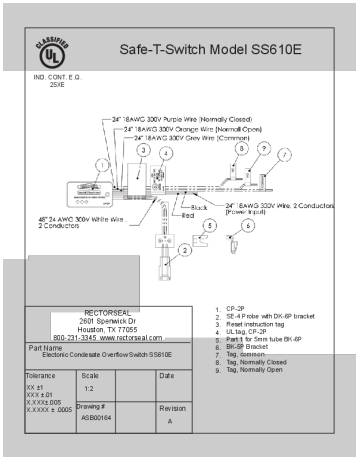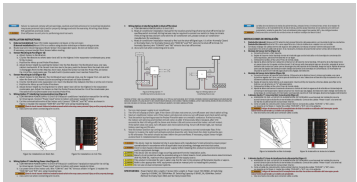

[\[pdf\]](#) Instructions Warranty

INSTALLATION INSTRUCTIONS DCNE If the wiring harness doesn't come with air conditioner unit please contact Purchaser of its product Safe T Switch® that it is Installation CSWIndustrials RectorSeal Switch 00005 INST dcne UserFiles Resources

NOTICE: WARNING: Failure to read and comply with all warnings, cautions and instructions prior to s ... ctronic Condensate Overflow Switch contains low power consuming, state-of-the-art microelectronics. **SS610E**'s logic circuit continuously samples the probes for water. If water is detected, the circuit ...

lang:en score:32 filesize: 1.62 M page_count: 2 document date: 2020-03-26

[\[pdf\]](#) Instructions Warranty Catalog

INSTALLATION INSTRUCTIONS TESTING6ffadfdc 910d 4e6c 8892 3394c9166fd3images thdstatic catalog Images 6f 6ffadfdc 3394c9166fd3 TESTINGMITSU SS610E Mitsubishi Electric MITSUBISHI Drain Pan Level Sensor Control Meier Supply Co Inc6ffadfdc 3394c9166fd3SS610ESERVICEimages 3394c9166fd3meiersupply customer docs skudocs Document Links Vendors 106835 SS610ESERVICE ||| ||| NOTICE: WARNING: Failure to read and comply with all warnings, cautions and instructions prior to starting installation may cause personal injury and/or property damage and void the warranty. All wiring must follow NEC guidelines and local

NOTICE: WARNING: Failure to read and comply with all warnings, cautions and instructions prior to s ... ctronic Condensate Overflow Switch contains low power consuming, state-of-the-art microelectronics. **SS610E**'s logic circuit continuously samples the probes for water. If water is detected, the circuit ...

lang:en score:32 filesize: 1.62 M page_count: 2 document date: 2020-03-26

[\[pdf\]](#) Specifications Borchure

BrochureRectorseal SS610E Safe T Switch Electronic Condensate Overflow Ferguson Homereactorseal ss610e brochures1 img b build mediabase specifications rectorseal 1965800 brochure |||

Designed for Ductless Mini Splits Introducing the New **SS610E** Electronic Condensate Overflow Switch For Installation Directly on Primary Drain Pan or Clipped to Coils Above Primary Drain Pan Easy to Use Sensor Connects to Indoor Units STATE-OF-THE-ART Microelectronics Attaches to Pan or Coils with ...





lang:en score:32 filesize: 443.74 K page_count: 1 document date: 2012-05-30

[\[pdf\]](#) Specifications

610e specsheet Exploded PartsRectorseal SS610E Safe T Switch Electronic Condensate Overflow Ferguson Homereactorseal ss610e exploded partss1 img b build mediabase specifications rectorseal 1965800 parts |||

IND. CONT. E.Q. 25XE Safe-T-Switch Model **SS610E** RECTORSEAL 2601 Spenwick Dr Houston, TX 77055 800-231-3345 www.rectorseal.com Part Name Electronic Condensate Overflow Switch **SS610E** Tolerance Scale XX 1 1:2 XXX .01 X.XXX.005 X.XXXX .0005 Drawing # ASB00164 Date Revision A 1. CP-2P 2. SE...

lang:en score:30 filesize: 179.98 K page_count: 1 document date: 2014-11-17

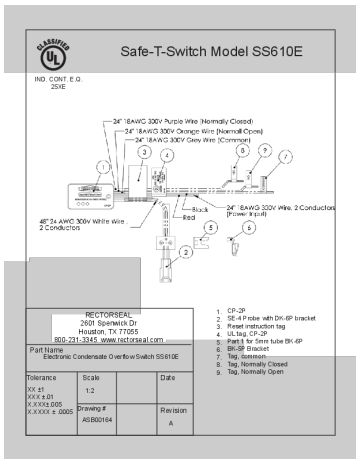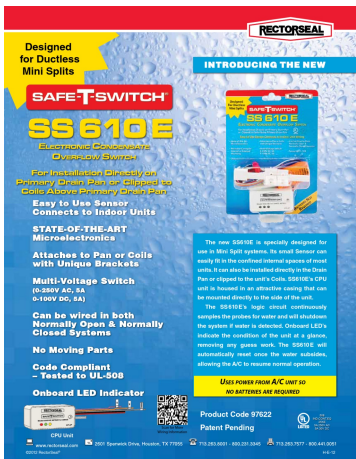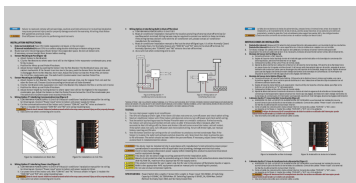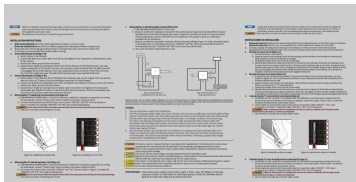

RECTORSEAL SS610E DRAIN PAN LEVEL SENSOR/CONTROL SS610E
COMPATIBLE WITH MSZ, MSY, MFZ, PKA, AND PKFY INDOOR UNITS

Job Name:
System Reference:

Date:



GENERAL FEATURES

- Provides protection against drain pan overflow.
- Powered by the indoor unit and no batteries required.
- LED indicator that provides fault history.
- Can be wired as both Normally Open and Normally Closed systems.
- Installation directly on primary drain pan or clipped to cable above primary drain pan.
- No moving parts.

COMPATIBILITY

Indoor Unit Model	Compatible Sensor/Control
MS Series	MSZ
	MSY
MF Series	MFZ
PK Series	PKA
PKFY Series	PKFY

SPECIFICATIONS

- Power Input: 120V/60Hz
- Power Consumption: 0.5W
- AC wiring capacity: 0.5/0.5/0.5, SA, 120V/60 Hz
- AC wiring capacity: 0.5/0.5/0.5, SA, 120V/60 Hz
- Switch method: Normally Open (NO) and Normally Closed (NC)
- Switch length: 2.5m
- Switch height: 25m
- Probe cable length: 4m
- Lead cable length: 2m

Specifications are subject to change without notice.
© 2020 Mitsubishi Electric. Trade Name: Rectorseal. All rights reserved.

[pdf] Specifications

RECTORSEAL SS610E DRAIN PAN LEVEL SENSOR 2022 06 15 — GENERAL FEATURES Provides

protection against drain pan overflow Powered by the indoor unit and no batteries required

41abe6be9c49fde478091080311cf902e4221ac5 SpecSheet MITSS610E tggcdn azureedge net

tggakeneoassets productspecificationsheets 4 1 a b |||

RECTORSEAL **SS610E** DRAIN PAN LEVEL SENSOR/CONTROL: **SS610E**

COMPATIBLE WITH MSZ, MSY, MFZ, PKA, AND PKFY INDOOR UNITS Job Name:

System Reference: Date: GENERAL FEATURES Provides protection against drain

pan overflow. Powered by the indoor unit and no batteries required. LED indicator that

provide...

lang:en score:28 filesize: 2.35 M page_count: 3 document date: 2020-03-31

RECTORSEAL

Submittal Data Sheet
Safe-T-Switch SS610E
Electronic Condensate Overflow Switch
Designed for Ductless Minisplits

Project Information:
Job Name:
Location:
Engineer:
Submitted to:
Submitted by:
Reference:

Submittal Information:
Approval:
Date:
Construction:
Unit #:
Drawing #:

(Sec. I) Ordering Information:
Product Code: 01022
Model: SS610E
Carton Qty: 12
Carton Weight: 4 lbs.

(Sec. II) Product Specifications:
CPU Length: 2.5
CPU Width: 1.4
CPU Height: 1.4
Power Supply: 15 to 250 Vrms AC, 15-100 volts DC
Building Capacity: 0.5 to 250 Vrms AC, SA, 120V/60 Hz
Control: NC/NO
Probe Cable Length: 4
Lead Cable Length: 2
Power Consumption: 0.5 Watts

(Sec. III) Carton Contents:
(Fig. II) Product Image:

(Fig. III) Part List:
1. CP-2P
2. SE-4 Probe with DIN-6P bracket
3. Read instruction tag
4. UL tag, CP-2P
5. Part for Drain tube BK-6P
6. BK-6P Bracket
7. Tag, Common
8. Tag, Normally Closed
9. Tag, Normally Open

Complete with 2009 - 2010 MCO & RCO
Revised drawing per 2009 - 2010 MCO & RCO

www.rectorseal.com
800-231-3345
2601 Spennick Dr., Houston, TX 77055
713.263.8001 • 800.231.3345 • 713.263.7077 • 800.AS.0801

UL
IND. CONT. E.Q. 25XE

[pdf] Specifications Datasheet

Submittal Alpine Home AirSec II Product Specifications CPU Length 2 5 Width 1 4 Height Power Supply

15 to 250 Volts AC 100 volts DC Rectorseal SS610E Submittal documents alpinehomeair product

Rectorseal |||

Submittal Data Sheet Safe-T-Switch **SS610E** Electronic Condensate Overflow Switch

Designed for Ductless Minisplits Project Information: Job Name: Location: Engineer:


Submitted to: For: qReference q Approval q Construction Submitted by: Reference:

Submittal Information: Approval: Date: Construction: Un...

lang:en score:27 filesize: 237.86 K page_count: 1 document date: 2016-11-02

**Safe-T-Switch Model SS610E**

IND. CONT. E.Q. 25XE



RECTORSEAL
2601 Spennick Dr.
Houston, TX 77055
800-231-3345, www.rectorseal.com

Part Name:
Electronic Condensate Overflow Switch SS610E

Tolerance	Scale	Date
XX.XX ± .01	1:2	
XX.XXX ± .005		

Drawing #	Revision
ASB00164	A

1. CP-2P
2. SE-4 Probe with DIN-6P bracket
3. Read instruction tag
4. UL tag, CP-2P
5. Part for Drain tube BK-6P
6. BK-6P Bracket
7. Tag, Common
8. Tag, Normally Closed
9. Tag, Normally Open

IND. CONT. E.Q. 25XE

[pdf] Specifications

610e specsheets SS610E sidharvey documents |||




IND. CONT. E.Q. 25XE Safe-T-Switch Model **SS610E** RECTORSEAL 2601 Spennick

Dr Houston, TX 77055 800-231-3345 www.rectorseal.com Part Name Electronic

Condensate Overflow Switch **SS610E** Tolerance Scale XX 1 1:2 XXX .01 X.XXX.005

X.XXXX .0005 Drawing # ASB00164 Date Revision A 1. CP-2P 2. SE...

lang:en score:26 filesize: 179.35 K page_count: 1 document date: 2019-05-09

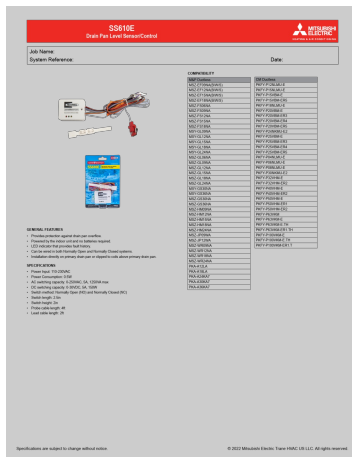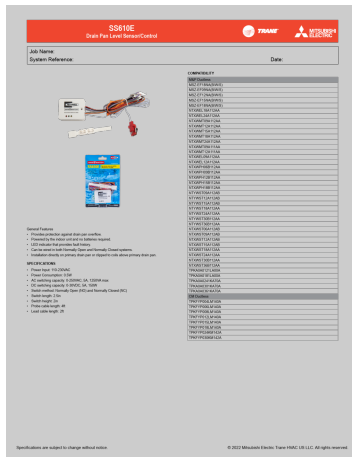



[pdf] User Manual Accessories

Installation Manual Rectorseal 83031 Fittings And Cable DSH 14C Insulated Pipe Adapter

skiphthewarehouse index route extension module mmos attachmanager getfile product attach file id 19181

|||

HVACinstallation/maintenance/repair SOLUTIONS PLUMBING

installation/maintenance/repair SOLUTIONS re ... 713-263-7577 800-441-0051 W

rectorseal.com 24 OVERFLOW SWITCHES EQUIPMENT PAD Safe-T-Switch

SS610E Code Description Qty. 97622 Model **SS610E** 12 FEATURES Sensor

connects to indoor units ...

lang:en score:24 filesize: 6.06 M page_count: 66 document date: 2020-03-23

[pdf] Borchure

PowerPoint Presentation J G Goodman Manufacturing Condensate Overflow Shut off

Switchesv1supplyhouse product files RectorSeal 83417 Brochure srsltid

AfmBOoqa5cRmimsjS7ajBAgt4AzXsRovKOKZaa8uSMWoBVkcEnLesL9Q SwitchesCondensate

Switchesv1v1supplyhouse

AfmBOoqa5cRmimsjS7ajBAgt4AzXsRovKOKZaa8uSMWoBVkcEnLesL9Qsupplyhouse

AfmBOoqUzBzikK3cp3XBguFMUaxGy4uYJjG42hCKaiEI4Uc1jd4MeQ3z |||

Condensate Overflow Shut-off Switches/Sensors - Safe-T-Switch and All AccessTM

by Jerry Myren RRee ... ain pans Plenum-rated model for Commercial Rooftop

primary drain pans SS500EP Electronic Probes **SS610E** SS700E Mini-Split Systems

Switch Auxiliary drain pan only For installation directly on p...

lang:en score:24 filesize: 7.03 M page_count: 33 document date: 2019-09-16



[pdf] Specifications Datasheet

CSWIndustrials RectorSeal Safe T Switch 00019 1 DATA images tradeservice ATTACHMENTS

DIR100289 |||


SUBMITTAL DATA SHEET Safe-T-Switch **SS610E** Electronic Condensate Overflow

Switch Designed for Ductless Minisplits Project Information: Job Name: Location:

Engineer: Submitted to: For: qReference q Approval q Construction Submitted by:

Reference: Submittal Information: Approval: Date: Construction: U...

lang:en score:24 filesize: 565.55 K page_count: 1 document date: 2020-03-31

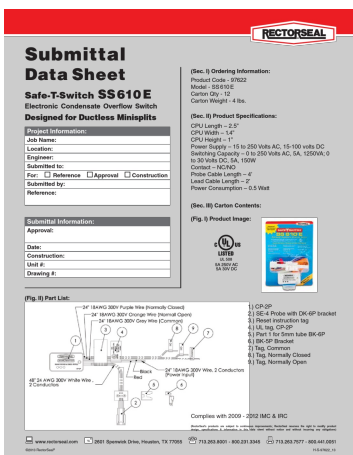

[pdf] Specifications Datasheet

RectorSeal® 97622 Auer Steel RectorSeal Data Sheet auersteel ASSETS DOCUMENTS ITEMS EN |||


Submittal Data Sheet Safe-T-Switch **SS610E** Electronic Condensate Overflow Switch

Designed for Ductless Minisplits Project Information: Job Name: Location: Engineer:

Submitted to: For: qReference q Approval q Construction Submitted by: Reference:

Submittal Information: Approval: Date: Construction: Un...

lang:en score:23 filesize: 237.86 K page_count: 1 document date: 2016-11-02

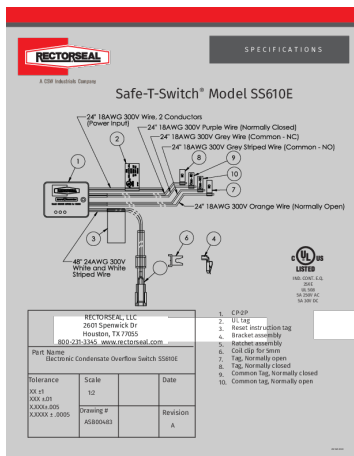

lang:en score:23 filesize: 1.44 M page count: 3 document date: 2022-10-04

lang:es score:23 filesize: 576.98 K page count: 1 document date: 2020-03-31

lang:en score:23 filesize: 7.06 M page count: 8 document date: 2019-04-15

[\[pdf\]](#) Borchure

PowerPoint Presentation J G Goodman Manufacturing Condensate Overflow Shut off

Switchesproxysupplyhouse product files RectorSeal 83417 Brochure srsltid

AfmBOooArpMnTVWLCCB7wcigrTz7B8JJ0Q7xFDx01HdFCR 1RMnYkrtt SwitchesCondensate

Switchesproxyproxysupplyhouse 1RMnYkrttsupplyhouse AfmBOopxhz8yoeUzB

pleobqckilxBGKg6uQBvW 9N9g3EbyRScZ rx Switchesgproxygproxygproxysupplyhouse AfmBOorvD0I

5lvJbTxWwHYz4znUkkeACoTk3QmVoL2vIAK dF JsJNRsupplyhouse

Switchesgproxygproxygproxygproxysupplyhouse rxsupplyhouse

AfmBOooVgTJFTTh2f3Eb93m9749CNRcG9j6yMav7u2f454nJyrK3aeRKE

Switchesgproxygproxygproxygproxysupplyhouse

AfmBOooVgTJFTTh2f3Eb93m9749CNRcG9j6yMav7u2f454nJyrK3aeRKEsupplyhouse

AfmBOOpWbh2wquBZlatOqT jsscGZZIf6gA2UmC71c0ZJducv0cp91EV



Switchesgproxygproxygproxygproxysupplyhouse

jsscGZZIf6gA2UmC71c0ZJducv0cp91EVsupplyhouse AfmBOoqdsKTji0PmmYEoY

M62bfEr9rhAG7La7WQW9GmKd9dccT9JQNp |||

Condensate Overflow Shut-off Switches/Sensors - Safe-T-Switch and All Access™
by Jerry Myren RRee ... ain pans Plenum-rated model for Commercial Rooftop
primary drain pans SS500EP Electronic Probes **SS610E** SS700E Mini-Split Systems
Switch Auxiliary drain pan only For installation directly on p...

lang:en **score:22** filesize: 7.13 M page_count: 33 document date: 2019-09-16

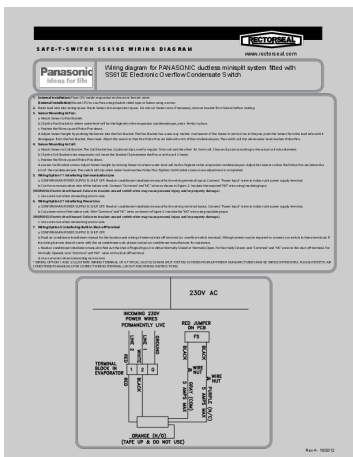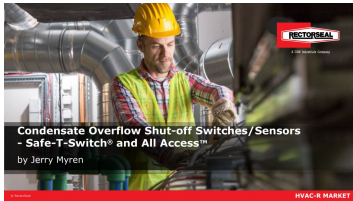


[\[pdf\]](#) User Manual Diagram

Wiring diagram for PANASONIC ductless minisplit system b Read air conditioner installation manual the location and wiring of external shut off terminal or overflow switch harness may be required to connect our these terminals If doesn t come with unit please contact manufacturer assistance Rectorseal SS610E

Panasonic Mini split documents alpinehomeair product |||

S a f e - t - s w i t c h s s 6 1 0 e W i r i n g D i a g r a m www.rectorseal.com Wiring
diagram for PANASONIC ductless minisplit system fitted with **SS610E** Electronic
Overflow Condensate Switch 1. Internal Installation Place CPU inside evaporator
enclosure or line set cover. External Installat...

lang:en **score:22** filesize: 176.17 K page_count: 1 document date: 2012-10-23

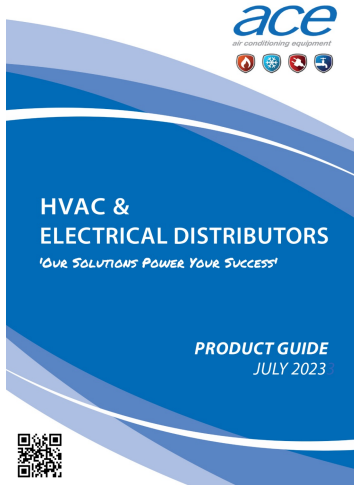


[\[pdf\]](#) Guide Accessories

ACE Product Guide July 2023 Ace Distributors acedist au 07 |||

HVAC ELECTRICAL DISTRIBUTORS PRODUCT GUIDE JULY 20233 HVAC ELECTRICAL DISTRIBUTORS COMPANY S ... iming Fluid 500ml JULY 2023 PRODUCT GUIDE 155 ELECTRICAL ACCESSORIES ISOLATORS SAFE-T-SWITCH **SS610E** CODE UKF4120 UKF4135 UKF4220 UKF4235 UKF4335 DESCRIPTION Isolator 20A Single Pole-Mini/SQ E...

lang:en score:22 filesize: 22.55 M page_count: 166 document date: 2023-07-26

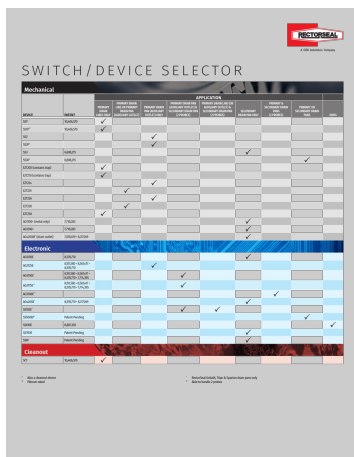


[\[pdf\]](#)

Rectorseal 83226 3 4 Female Slip EZT 226 Compact Overflow Switch Jackson Systems Condensate Overview jacksonsystems 2022 09 |||

SWITCH/DEVICE SELECTOR Mechanical DEVICE SS1 SS1P SS2 SS2P SS3 SS3P EZT205 contains trap EZT210 contains trap EZT224 EZT225 EZT226 EZT228 EZT230 AG1100 metal only AG1200 AG4200M drain outlet Electronic AG1250E AG3125E AG3150E* AG3175E* AG3180E* AG4200E SS103E* SS500EP **SS610E** SS700E SSW ...

lang:en score:22 filesize: 468.22 K page_count: 2 document date: 2022-06-27

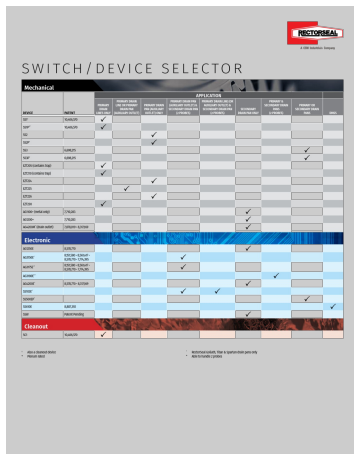

[\[pdf\]](#)

Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure shut off UL water wire refrigeration residential RectorSeal Rectorseal 83205 EZ Trap 205 3 4 inch Deep ComparisonChart jacksonsystems 2022 11 |||

SWITCH/DEVICE SELECTOR Mechanical DEVICE SS1 SS1P SS2 SS2P SS3 SS3P EZT205 contains trap EZT210 contains trap EZT224 EZT225 EZT226 EZT230 AG1100 metal only AG1200 AG4200M drain outlet Electronic AG1250E AG3150E* AG3175E* AG3180E* AG4200E SS103E* SS500EP **SS610E** SSW Cleanout SC1 PATENT 1...

lang:en score:22 filesize: 117.36 K page_count: 2 document date: 2022-11-03



[\[pdf\]](#) Borchure

Imported styles from HVAC Brochure Rectorseal 83418 A C Drain Pump rectorsealsafteyswitchbrochure
skiphthewarehouse index route extension module mmos attachmanager getfile product attach file id 16628

|||

cleaning HVAC enance installation SOLUTIONS Safe-T-Switch HVAC Patented, codreepcaoir pliant co ... aner chemicals are available from RectorSeal. Electronic overflow switches SS103E, SSW, SS500EP and **SS610E** are uniquely designed to offer condensate overflow protection for a variety of applications i...

lang:en score:22 filesize: 2.2 M page_count: 12 document date: 2021-10-27



[\[pdf\]](#) Borchure

Imported styles from HVAC Brochure Rectorseal 97090 Safe T Switch SS3P Plenum skiphthewarehouse
index route extension module mmos attachmanager getfile product attach file id 13172 |||

cleaning HVAC enance installation SOLUTIONS Safe-T-Switch HVAC Patented, codreepcaoir pliant co ... aner chemicals are available from RectorSeal. Electronic overflow switches SS103E, SSW, SS500EP and **SS610E** are uniquely designed to offer condensate overflow protection for a variety of applications i...

lang:en score:22 filesize: 2.17 M page_count: 7 document date: 2022-10-14




[\[pdf\]](#)

CSWIndustrials RectorSeal Novent 00003 25 CAT images tradeservice ATTACHMENTS DIR100289 |||

OVERFLOW SWITCHES EQUIPMENT PAD Safe-T-Switch **SS610E** Code

Description Qty. 97622 Model **SS610E** 12 FEATURES Sensor connects to indoor units IND. CONT. EQ. Attaches to pan or coils with 25XE unique bracket UL 508 Onboard LED indicator can be mounted to side of unit No batteries requ...

lang:en score:22 filesize: 113.95 K page_count: 1 document date: 2020-06-30

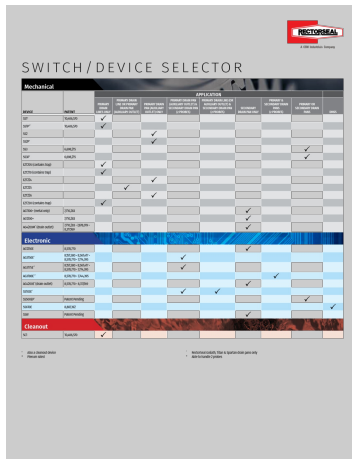

[\[pdf\]](#)

Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary
cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure
shut off UL water wire refrigeration residential RectorSeal Comparison Chart Rectorseal 83113 EZ Trap
113 3 4 CRS Kit No Brush skipthefurniture index route extension module mmos attachmanager getfile
product attach file id 18937 |||


SWITCH/DEVICE SELECTOR Mechanical DEVICE SS1 SS1P SS2 SS2P SS3 SS3P
EZT205 contains trap EZT210 contains trap EZT224 EZT225 EZT226 EZT230
contains trap AG1100 metal only AG1200 AG4200M drain outlet Electronic AG1250E
AG3150E* AG3175E* AG3180E* AG4200E drain outlet SS103E* SS500EP SS...
lang:en score:21 filesize: 101.67 K page_count: 2 document date: 2023-11-17



[\[pdf\]](#) Borchure

Imported styles from HVAC Safe T Switch Brochure Rectorseal 97640 SS2AP Condensate
skipthewarehouse index route extension module mmos attachmanager getfile product attach file id 6791
|||

Safe-T-Switch The Most Reliable Condensate Overflow Control Switches FLOAT
ACTIVATED adjustable cond ... down the system. Water damage to the structure is
prevented. Safe-T-Switch probe switches SS500EP, **SS610E** and SS700E, are
versatile and easy to install. Our SS103E combo pack covers applications wher...
lang:en score:21 filesize: 3 M page_count: 8 document date: 2020-03-22

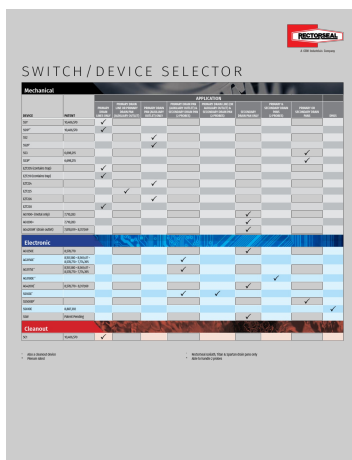

[\[pdf\]](#)

A Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary
cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure
shut off UL water wire refrigeration residential RectorSeal SWITCH DEVICE SELECTOR Jackson
Systems SWITCH Electronic Cleanout † Also a cleanout device ° Plenum rated ^ Goliath Titan Spartan
pans only * Able to RectorSeal Comparison Chart 83205jacksonsystems 2024 07 83205 srsItd
AfmBOornPm4N o rf xe5SwJyUDQSpA75mBZ8gcGYbeE6xmQnQtHBVXR |||
SWITCH/DEVICE SELECTOR Mechanical DEVICE SS1 SS1P SS2 SS2P SS3 SS3P
EZT205 contains trap EZT210 contains trap EZT224 EZT225 EZT226 EZT230
AG1100 metal only AG1200 AG4200M drain outlet Electronic AG1250E AG3150E*
AG3175E* AG3180E* AG4200E SS103E* SS500EP **SS610E** SSW Cleanout SC1
PATENT 1...
lang:en score:21 filesize: 117.36 K page_count: 2 document date: 2022-11-03



[pdf]

Imported styles from HVAC CSWIndustrials RectorSeal 00075 1 5 BROC images tradeservice

ATTACHMENTS DIR100274 |||

THE MOST RELIABLE CONDENSATE OVERFLOW CONTROL SWITCHES FLOAT ACTIVATED adjustable condensate overflo ... down the system. Water damage to the structure is prevented. Safe-T-Switch probe switches SS500EP, **SS610E** and SS700E, are versatile and easy to install. Our SS103E combo pack covers applications wher...

lang:en score:21 filesize: 4.72 M page_count: 5 document date: 2020-02-10



[pdf] Borchure

Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure shut off UL water wire refrigeration residential RectorSeal Brochure 1 airstarsolutions |||

cleaning HVAC enance installation SOLUTIONS Safe-T-Switch HVAC Patented, codreepcaoirimpliant con ... et drain line cleaner chemicals are available from RectorSeal. Electronic overflow switches SSW and **SS610E** are uniquely designed to offer condensate overflow protection for a variety of applications, ...

lang:en score:21 filesize: 2.78 M page_count: 7 document date: 2024-03-15



[pdf] Specifications Borchure

Imported styles from HVAC Safe T Switch® HVACdrain pan or auxiliary drain outlet and Can be check valves ¾ adapter Spare O rings 97795 Mighty Pump 4 97796rectorseal ss2 safe t switch brochures1 img b build mediabase specifications rectorseal 1965798 brochure |||

cleaning HVAC enance installation SOLUTIONS Safe-T-Switch HVAC Patented, codreepcaoirimpliant co ... aner chemicals are available from RectorSeal. Electronic overflow switches SS103E, SSW, SS500EP and **SS610E** are uniquely designed to offer condensate overflow protection for a variety of applications i...


lang:en score:21 filesize: 2.17 M page_count: 7 document date: 2022-10-14



[pdf] Borchure

Contractor Solution Air Condition commercial HVAC switches SMD Safe T Switch adjustable auxiliary cleaning drain float low voltage magnet outlet overflow patent protection Reed reliable run test secure shut off UL water wire refrigeration residential RectorSeal Brochure RectorSeal 97085 Ss1 3rd Generation Mini Split Systems Direct 13771 109012909cdn shopify s files 1 0748 5924 9984 13771 109012909 v 1731191618 |||

cleaning HVAC enhance installation SOLUTIONS Safe-T-Switch HVAC Patented, code compliant condensate overflow float switches and cleanout devices are available from RectorSeal. Electronic overflow switches SSW and **SS610E** are uniquely designed to offer condensate overflow protection for a variety of applications, ...
lang:en score:20 filesize: 2.78 M page_count: 7 document date: 2024-03-15

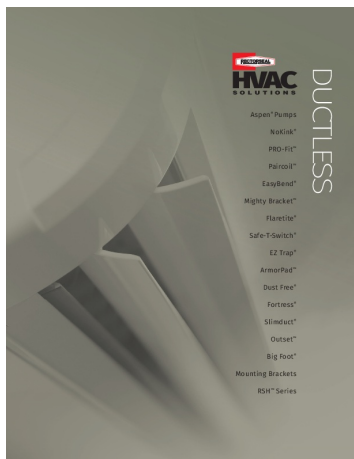

[pdf] Specifications Borchure

RectorSeal HVAC Plumbing CAT 1022 indb delicia shyu DUCTLESS Two mini pump types Split Orange or Aqua are designed with separate and reservoir The includes an electronic PCB the motor RectorSeal np r410 50pk brochures 1 img b build mediabase specifications RectorSeal 1965694 brochure |||
DUCTLESS HVAC SOLUTIONS Aspen Pumps NoKink PRO-Fit™ Paircoil™ EasyBend Mighty Bracket™ FlareTite™ ... 713-263-7577 800-441-0051 W
RectorSeal.com 23 OVERFLOW SWITCHES EQUIPMENT PAD Safe-T-Switch **SS610E** Electronic overflow switch for mini-split systems Code Description Qty 97622 Model **SS610E** ...

lang:en score:20 filesize: 39.11 M page_count: 91 document date: 2023-01-06



[pdf] Borchure

Imported styles from HVAC Brochure Safe T Switch SS700E Electronic Condensate Overflow with LED Indicator CSW Industrials RectorSeal 00075 1 3 7 BROCI images tradeservice Attachments DIR100312 CSW Industrials BROCI |||

Safe-T-Switch The Most Reliable Condensate Overflow Control Switches FLOAT ACTIVATED adjustable cond ... down the system. Water damage to the structure is prevented. Safe-T-Switch probe switches SS500EP, **SS610E** and SS700E, are versatile and easy to install. Our SS103E combo pack covers applications wher...
lang:en score:20 filesize: 2 M page_count: 4 document date: 2021-03-08