

SILENT KNIGHT SK-RELAY

Silent Knight SK-RELAY Addressable Relay Module Instruction Manual

1. PRODUCT OVERVIEW

The Silent Knight SK-RELAY is an addressable relay module designed for seamless integration with Silent Knight IntelliKnight series fire alarm control panels (FACPs). This module enables the FACP to remotely switch discrete contacts based on programmed code commands. It features two isolated sets of Form C contacts, functioning as a Double-Pole, Double-Throw (DPDT) switch, suitable for various normally open or normally closed applications. Each SK-RELAY module is assigned a unique Signaling Line Circuit (SLC) loop address, allowing the FACP to trigger the relay upon specific event occurrences.

Key Features:

- Addressable for precise control within the fire alarm system.
- Compatible with IntelliKnight series Fire Alarm Control Panels.
- Equipped with two sets of Form C contacts for versatile switching.
- Features rotary address switches for quick and straightforward installation.
- Contacts are rated for various current capacities (refer to specifications).
- Includes a panel-controlled status LED that flashes green during normal operation and illuminates solid red in an alarm state.
- Flexible relay programming, allowing mapping to specific zone conditions.
- Polling LED visible through the cover plate for easy status verification.



Figure 1: Front view of the SK-RELAY module, showing the Silent Knight logo and status indicators.

2. INSTALLATION AND SETUP

Mounting:

The SK-RELAY module is designed for panel mount installation. Ensure the mounting location is secure, dry, and within the specified environmental conditions for fire alarm system components. Refer to local codes and standards for proper mounting procedures.

Wiring:

The module utilizes quick connect terminals for wiring. Connect the Signaling Line Circuit (SLC) wires to the

designated terminals. The two isolated sets of Form C contacts (2NO 2NC) provide flexibility for connecting to various devices. Ensure all wiring adheres to NFPA 72 and local electrical codes. Do not apply power until all connections are verified.

Addressing:

Each SK-RELAY module must be assigned a unique address on the SLC loop using the integrated rotary address switches. Carefully set the switches to the desired address as per your system's design and programming. Incorrect addressing can lead to system malfunctions.



Figure 2: Rear view of the SK-RELAY module, illustrating the wiring terminals and rotary address switches.

3. OPERATION

Once installed and addressed, the SK-RELAY module communicates with the IntelliKnight FACP via the SLC loop. The FACP sends commands to the module based on programmed logic, such as zone conditions or specific events. Upon receiving a command, the module's internal relay activates, switching its Form C contacts. This allows the FACP to control external devices like door holders, fans, or other auxiliary equipment.

The module's status LED provides visual feedback: it flashes green during normal polling by the FACP and illuminates solid red when the relay is activated by an alarm or programmed event.

4. MAINTENANCE

Regular maintenance is crucial for the reliable operation of the SK-RELAY module and the overall fire alarm system. It is recommended to perform periodic visual inspections to ensure the module is free from dust, debris, and physical damage. Always ensure the unit is **de-energized prior to servicing** to prevent electrical shock or damage to the module or system components.

Refer to the complete system maintenance schedule provided by Silent Knight and adhere to all applicable local and national fire safety codes and standards.

5. TROUBLESHOOTING

If the SK-RELAY module is not functioning as expected, consider the following:

- **LED Status:** Observe the status LED. A flashing green LED indicates normal communication with the FACP. A solid red LED indicates the relay is activated. If the LED is off, check power and SLC connections.
- **Addressing:** Verify that the rotary address switches are set correctly and uniquely for the module on the SLC loop.
- **Wiring:** Inspect all wiring connections for looseness, corrosion, or incorrect termination. Ensure proper polarity for SLC connections.
- **FACP Programming:** Confirm that the FACP is correctly programmed to control the specific address of the SK-RELAY module and that the desired logic for activation is configured.
- **System Diagnostics:** Utilize the diagnostic tools available on your IntelliKnight FACP to check for SLC loop faults or communication errors related to the module's address.

If issues persist after basic troubleshooting, contact a qualified fire alarm technician or Silent Knight technical

support.


6. TECHNICAL SPECIFICATIONS

Specification	Value
Model Number	SK-RELAY
Product Dimensions	4.9 x 4.9 x 1.4 inches
Weight	4.94 ounces
Manufacturer	Silent Knight
Connector Type	Quick Connect
Contact Material	Silver
Contact Type	2NO 2NC (Form C)
Mounting Type	Panel Mount

7. WARRANTY AND SUPPORT

For information regarding the warranty of your Silent Knight SK-RELAY Addressable Relay Module, please refer to the official warranty statement provided with your purchase or visit the Silent Knight website. Warranty terms and conditions may vary.

For technical support, service, or further inquiries, please contact Silent Knight customer service or your authorized Silent Knight distributor. Ensure you have your product model number and any relevant system information ready when seeking support.

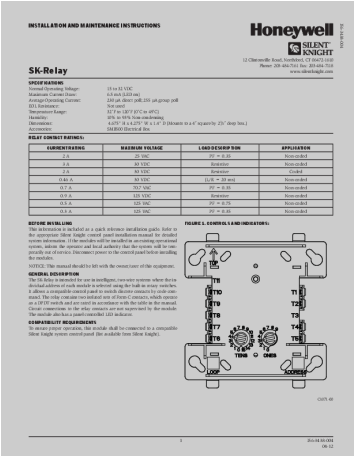

[\[pdf\]](#) User Manual Installation Guide Instructions Specifications Dimension Guide Guide Accessories


SK Relay Manual 2022 08 17 — BEFORE INSTALLING This information is included as a quick reference installation guide Refer to the appropriate Silent Knight control panel installation RELAY false prod edam

honeywell content dam hbt en us documents manuals and guides moved ss ||| I56-3438-004 INSTALLATION AND MAINTENANCE INSTRUCTIONS SK-Relay 12 Clintonville Road, Northford, CT 06472-1610 Phone: 203-484-7161 Fax: 203-484-7118 www.silentknight.com SPECIFICATIONS Normal Operating Voltage: Maximum Current Draw: Average Operating Current: EOL Resistance: Temperature Range: H... lang:en score:50 filesize: 456.27 K page_count: 2 document date: 2017-06-15



[\[pdf\]](#) User Manual Guide

untitled Silent Knight Hfss Manual Pdf Download User Guide For 12 6820EVS silmarelectronics ||| Intelligent Fire Panel with Voice 6820EVS Emergency Voice System and Fire Alarm Control Panel The ... SK-PULL-SA: Addressable single action pull station SK-PULL-DA: Addressable dual action pull station **SK-RELAY**: Addressable relay moduleSKRELAY-6: Addressable Six relay control module **SK-RELAYMON-2**: Add... lang:en score:46 filesize: 126.76 K page_count: 4 document date: 2018-10-09

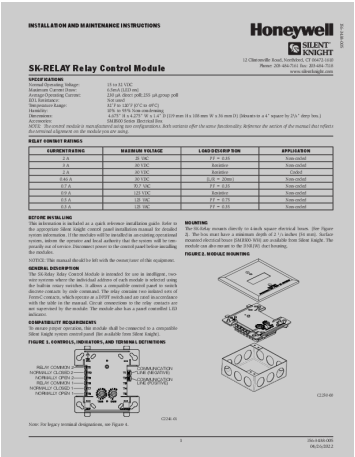

[\[pdf\]](#) User Manual Instructions Specifications Dimension Guide Accessories

HBT Fire I56 3438 005 SK RELAY false prod edam honeywell content dam hbt en us documents manuals and guides installation |||

I56-3438-005 INSTALLATION AND MAINTENANCE INSTRUCTIONS **SK-RELAY** Relay Control Module 12 Clintonville Road, Northford, CT 06472-1610 Phone: 203-484-7161 Fax: 203-484-7118 www.silentknight.com SPECIFICATIONS Normal Operating Voltage: 15 to 32 VDC Maximum Current Draw: 6.5mA LED on Average O... lang:en score:43 filesize: 994.96 K page_count: 4 document date: 2022-04-26




[\[pdf\]](#) User Manual Documentation Guide

151142 L8 book Silent Knight 5895XL fire alarm control panel manual covering installation operation 2017 edition silent knight facp 5895xl detection safety smoke detector suppression emergency systems building automation life documentation technical reference user guide programming maintenance ed Installation Operations Manual FACP Manuals docs facpmanuals manuals |||

5895XL Intelligent Power Module Installation and Operation Guide Document

151142-L8 Rev: L 08/09/201 ... dule SK-MONITOR SK-MINIMON SK-PULL-SA SK-PULL-DA SK-MONITOR-2 SK-MONITOR-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY SK-RELAY-6 SK-RELAYMON-2 SK-ZONE SK-ZONE-6 SLC Modules B200SR Sounder Base B200S Intelligen...**

lang:en **score:38** filesize: 961.81 K page_count: 48 document date: 2025-02-20

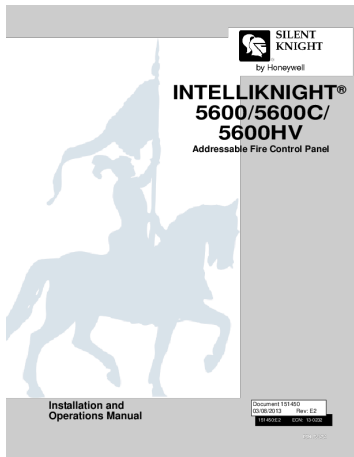


[\[pdf\]](#) User Manual

151450 5600 book E654596 silentknight manual s3 absupply net amazonaws silent knight |||

INTELLIKNIGHT 5600/5600C/ 5600HV Addressable Fire Control Panel Installation and Operations Manual Document 151450 03/08/2013 Rev: E2 151450:E2 ECN: 13-0232 ECN: 13-0232 Installation Procedure Installation Precautions - Adherence to the following will aid in problem-free installation with long-...

lang:en **score:34** filesize: 1.39 M page_count: 114 document date: 2013-03-11

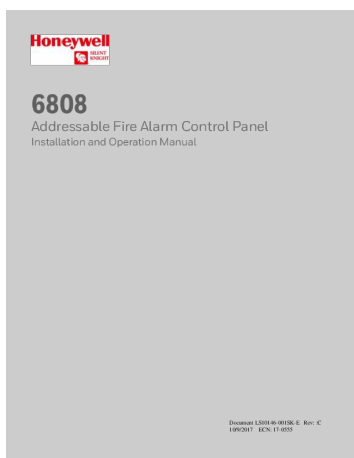


[\[pdf\]](#) User Manual

6808 Manual E654596 LS10146 001SK E false prod edam honeywell content dam hbt en us documents manuals and guides installation |||

6808 Addressable Fire Alarm Control Panel Installation and Operation Manual

Document LS10146-001SK-E ... Model WSK-WGI WSK-PHOTO WSK-PHOTO-T Wireless Misc. WSK-HEAT-ROR WSK-HEAT WSK-MONITOR Module **WSK-RELAY** Module B210W HFSS Honeywell Fire Software Suite 7860 Telephone Cord RBB CELL-MOD CELL-CAB-...

lang:en **score:33** filesize: 4.5 M page_count: 170 document date: 2022-07-19

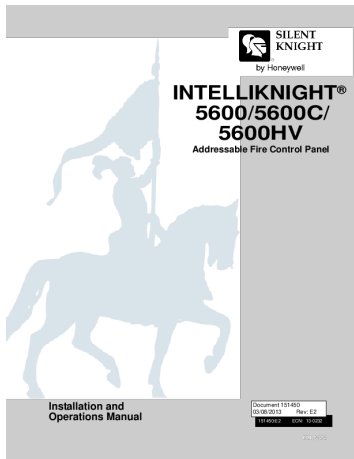


[\[pdf\]](#) User Manual

5600 Installation Manual 151450 E654596 buildings honeywell content dam hbtbt en documents

document lists silent knight archive |||

INTELLIKNIGHT 5600/5600C/ 5600HV Addressable Fire Control Panel Installation and Operations Manual Document 151450 03/08/2013 Rev: E2 151450:E2 ECN: 13-0232 ECN: 13-0232 Installation Procedure Installation Precautions - Adherence to the following will aid in problem-free installation with long-...

lang:en **score:32** filesize: 1.26 M page_count: 114 document date: 2022-01-26

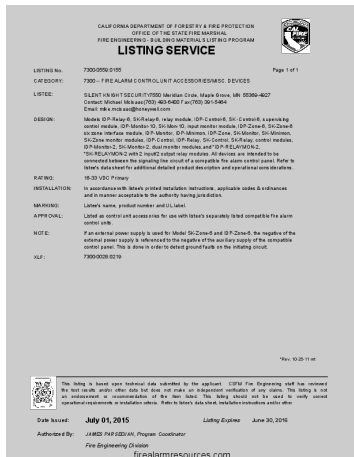


[\[pdf\]](#) Instructions Specifications Datasheet Accessories

Click here to Farenhyt IDP Control Supervised Module CSFM Listing Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676760397 firealarmresources 21735 |||

CALIFORNIA DEPARTMENT OF FORESTRY FIRE PROTECTION OFFICE OF THE STATE FIRE MARSHAL FIRE ENGINEERIN ... SK-Relay, control modules, IDP-Monitor-2, SK-Monitor-2, dual monitor modules,and *IDP-RELAYMON-2, ***SK-RELAYMON-2** with 2 input/2 output relay modules. All devices are intended to be connected between ...

lang:en **score:32** filesize: 733.14 K page_count: 1 document date: 2022-04-15

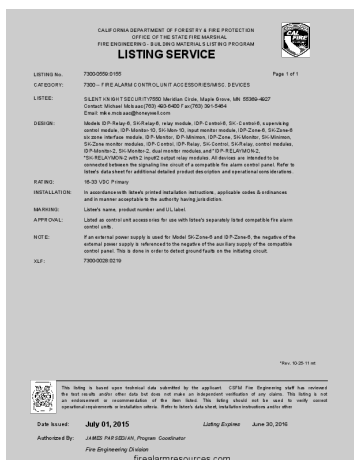


[\[pdf\]](#) Instructions Specifications Datasheet Accessories

Click here to Farenhyt IDP Relay Addressable Module CSFM Listing Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676768820 firealarmresources 21585 |||

CALIFORNIA DEPARTMENT OF FORESTRY FIRE PROTECTION OFFICE OF THE STATE FIRE MARSHAL FIRE ENGINEERIN ... SK-Relay, control modules, IDP-Monitor-2, SK-Monitor-2, dual monitor modules,and *IDP-RELAYMON-2, ***SK-RELAYMON-2** with 2 input/2 output relay modules. All devices are intended to be connected between ...

lang:en **score:32** filesize: 733.14 K page_count: 1 document date: 2022-04-15

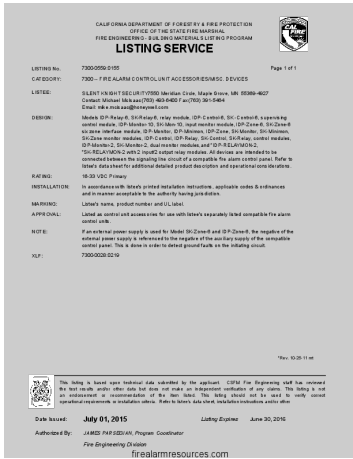


[\[pdf\]](#) Instructions Specifications Datasheet Accessories

Click here to Farenhyt IDP Monitor Input Module CSFM Listing Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676769490
firealarmresources 21505 |||

CALIFORNIA DEPARTMENT OF FORESTRY FIRE PROTECTION OFFICE OF THE STATE FIRE MARSHAL FIRE ENGINEERIN ... SK-Relay, control modules, IDP-Monitor-2, SK-Monitor-2, dual monitor modules,and *IDP-RELAYMON-2, ***SK-RELAYMON-2** with 2 input/2 output relay modules. All devices are intended to be connected between ...

lang:en **score:32** filesize: 733.14 K page_count: 1 document date: 2022-04-15

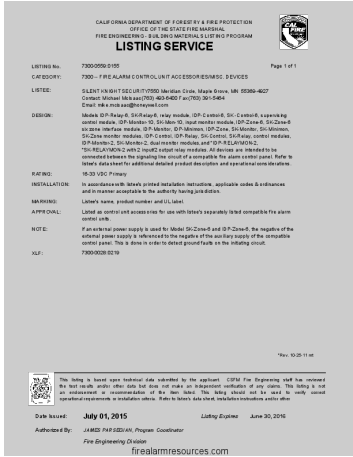


[\[pdf\]](#) Instructions Specifications Datasheet Accessories

Click here to Farenhyt IDP Relay 6 Six Module CSFM Listing Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676769259
firealarmresources 21715 |||

CALIFORNIA DEPARTMENT OF FORESTRY FIRE PROTECTION OFFICE OF THE STATE FIRE MARSHAL FIRE ENGINEERIN ... SK-Relay, control modules, IDP-Monitor-2, SK-Monitor-2, dual monitor modules,and *IDP-RELAYMON-2, ***SK-RELAYMON-2** with 2 input/2 output relay modules. All devices are intended to be connected between ...

lang:en **score:32** filesize: 733.14 K page_count: 1 document date: 2022-04-15

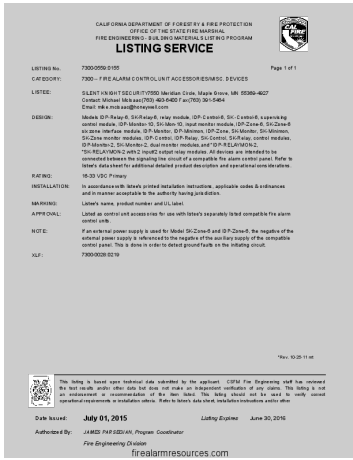


[\[pdf\]](#) Instructions Specifications Datasheet Accessories

Click here to Farenhyt IDP Zone Addressable Interface Module CSFM Listing Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676711539
firealarmresources 21807 |||

CALIFORNIA DEPARTMENT OF FORESTRY FIRE PROTECTION OFFICE OF THE STATE FIRE MARSHAL FIRE ENGINEERIN ... SK-Relay, control modules, IDP-Monitor-2, SK-Monitor-2, dual monitor modules,and *IDP-RELAYMON-2, ***SK-RELAYMON-2** with 2 input/2 output relay modules. All devices are intended to be connected between ...


lang:en **score:32** filesize: 733.14 K page_count: 1 document date: 2022-04-15

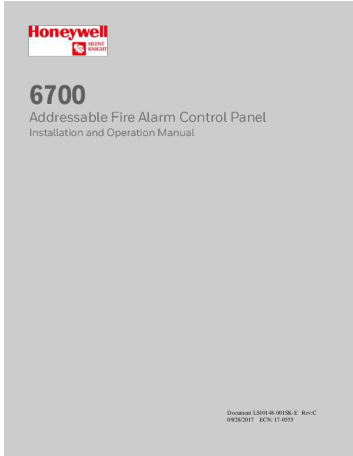


[\[pdf\]](#) User Manual

6700 Manual E654596 LS10148 001SK E false prod edam honeywell content dam hbt en us documents manuals and guides installation |||
6700 Addressable Fire Alarm Control Panel Installation and Operation Manual Document LS10148-001SK-E ... WSK-HEAT Wireless Heat, 135 fixed with 4 base WSK-MONITOR Wireless Addressable Monitor module **WSK-RELAY** Wireless Addressable Relay module B210W 6 wireless base HFSS Honeywell Fire For commun...

lang:en **score:32** filesize: 4.34 M page_count: 172 document date: 2022-06-28

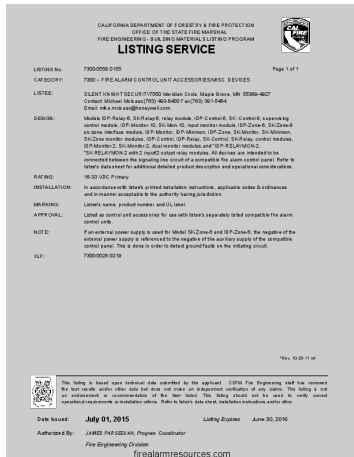


lang:en score:32 filesize: 733.14 K page_count: 1 document date: 2022-04-15

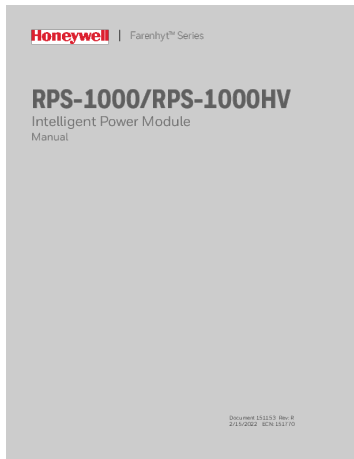

[\[pdf\]](#) User Manual Instructions

LS10259 RPS1000 book E654944 RPS 1000 1000HV Honeywell Digital Assets 15 feb 2022 — Follow the instructions in installation operating and program ming manuals These must be followed to avoid damage control panel and hbt fire 151153 R manual false prod edam honeywell content dam en us documents guides |||


Farenhyt™ Series RPS-1000/RPS-1000HV Intelligent Power Module Manual
Document 151153 Rev: R 2/15/20 ... m: 6.5mA SK-CONTROL-6 SLC Standby 2.65 mA Aux Pwr Alarm: Standby 35 mA 8 mA Alarm: 20 mA **SK-RELAY** Standby/Alarm: 0.255 mA **SK-RELAY-6** Standby: 1.9 mA Alarm: 32 mA **SK-RELAYMON-2** Stan...
lang:en **score:32** filesize: 588.82 K page_count: 38 document date: 2023-02-22

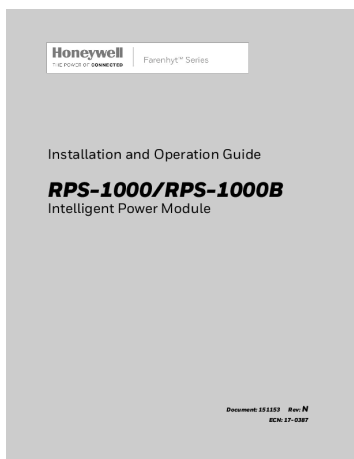

[\[pdf\]](#) User Manual Documentation Guide

151153 book Silent Knight RPS 1000 and 1000B fire alarm control panel manual covering installation operation silent knight facp rps 1000b detection safety smoke detector suppression emergency systems building automation life documentation technical reference user guide programming Installation Operation Manual An automatic system—typically made up of detectors heat pull stations audible warning devices a FACP with remote noti fication capability—can provide early developing Such system however does not assure protection against property damage or loss resulting from docs facpmanuals manuals |||


Installation and Operation Guide RPS-1000/RPS-1000B Intelligent Power Module
Document: 151153 Rev: N ... C Module SK-MONITOR SK-MINIMON SK-PULL-SA SK-PULL-DA SK-MONITOR-2 SK-MON-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY SK-RELAY-6 SK-RELAYMON-2 SK-ZONE SK-ZONE-6 SLC Modules B200SR Sounder Base B200S Sounder Ba...**
lang:en **score:32** filesize: 1005.2 K page_count: 62 document date: 2025-02-20

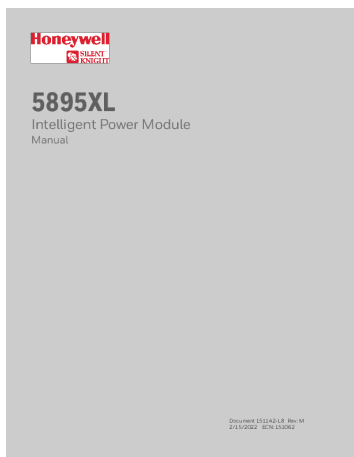

[\[pdf\]](#) User Manual

LS10259 RPS1000 book E654944 hbt fire 151142 L8 M 5895XL installation manual false prod edam honeywell content dam en us documents manuals and guides |||

5895XL Intelligent Power Module Manual Document 151142-L8 Rev: M 2/15/2022 ECN: 151062 Fire Alarm ... ules SK-MONITOR SK-MINIMON SK-PULL-SA/SK-PULL-DA SK-MONITOR-2 SK-MONITOR-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY SK-RELAY-6 SK-RELAYMON-2 SK-ZONE SK-ZONE-6 SLC Accessories B200SR/-W/-IV Sounder Base B200S...**
lang:en **score:32** filesize: 548.32 K page_count: 34 document date: 2023-02-22

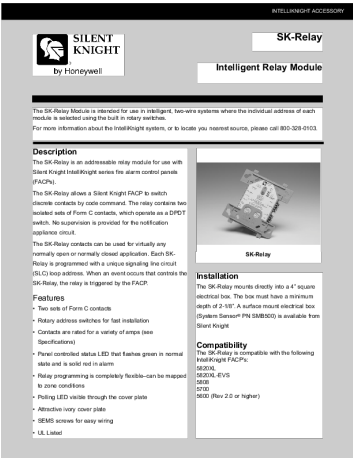


[pdf] Specifications Datasheet Accessories

350127 Rev B SK Relay Spec Sheet Sk by Honeywell silentknight skrelay datasheet s3 absupply net amazonaws silent knight |||

INTELLIKNIGHT ACCESSORY SK-Relay Intelligent Relay Module The SK-Relay Module is intended for use in intelligent, two-wire systems where the individual address of each module is selected using the built in rotary switches. For more information about the IntelliKnight system, or to locate you neares...

lang:en score:31 filesize: 175.89 K page_count: 2 document date: 2013-03-05

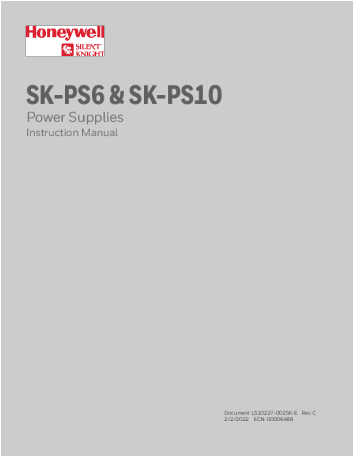


[pdf] User Manual

PS 6 10 book E654944 SK PS6 PS10 Series Instruction Manual — P N LS10227 002SK E C 2 2022 3 Installation Precautions Adherence to the following will aid in problem free installation with long term reliability WARNING Several different sources of power can be con nected fire alarm control panel Disconnect all before servicing hbt false prod edam honeywell content dam en us documents manuals and guides user |||

SK-PS6 SK-PS10 Power Supplies Instruction Manual Document LS10227-002SK-E Rev: C 2/2/2022 ECN: 000 ... ndoffs and secure with screws. Compatible modules include the SK-CONTROL, SK-MONITOR, SK-MONITOR-2, **SK-RELAY**, **SK-RELAYMON-2**, SK-CONTROL-6, **SK-RELAY-6**, and SK-MON-10. NOTE: PS-MOUNT, the optional hardw...

lang:en score:30 filesize: 1.85 M page_count: 52 document date: 2022-07-18

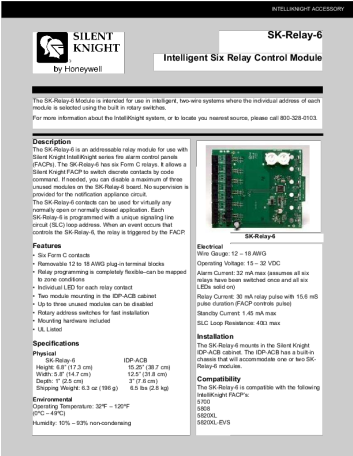


[pdf] Datasheet Accessories

350128 Rev B SK Relay 6 Data Sheet Sk by Honeywell SilentKnight SKRELAY6 DataSheet s3 absupply net amazonaws Silent Knight |||

INTELLIKNIGHT ACCESSORY SK-Relay-6 Intelligent Six Relay Control Module The SK-Relay-6 Module is intended for use in intelligent, two-wire systems where the individual address of each module is selected using the built in rotary switches. For more information about the IntelliKnight system, or to l...

lang:en score:30 filesize: 180.83 K page_count: 2 document date: 2013-03-05

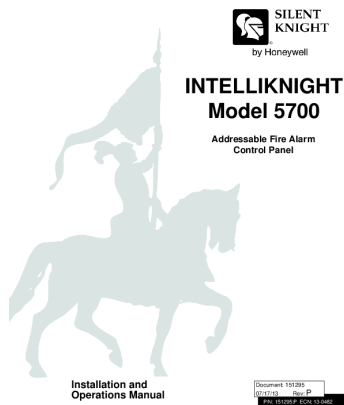


[pdf] User Manual

151295 5700 book E654596 Silent Knight Manual Pdf User Allied Fire Security SilentKnight absupply net

|||

INTELLIKNIGHT Model 5700 Addressable Fire Alarm Control Panel Installation and Operations Manual Document: 151295 07/17/13 Rev: P P/N: 151295:P ECN: 13-0482 Installation Procedure Installation Precautions - Adherence to the following will aid in problem-free installation with long-term relia...

lang:en score:30 filesize: 5.1 M page_count: 232 document date: 2013-07-30

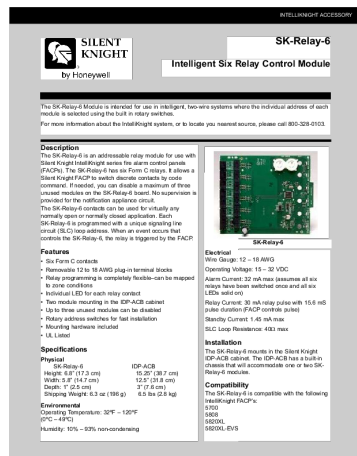


[pdf] Datasheet Accessories

350128 Rev B SK Relay 6 Data Sheet Sk by Honeywell Click to View Silent Knight RELAY Control

Module A alldataresource assets honeywell |||

INTELLIKNIGHT ACCESSORY SK-Relay-6 Intelligent Six Relay Control Module The SK-Relay-6 Module is intended for use in intelligent, two-wire systems where the individual address of each module is selected using the built in rotary switches. For more information about the IntelliKnight system, or to l...

lang:en score:30 filesize: 180.44 K page_count: 2 document date: 2013-03-05

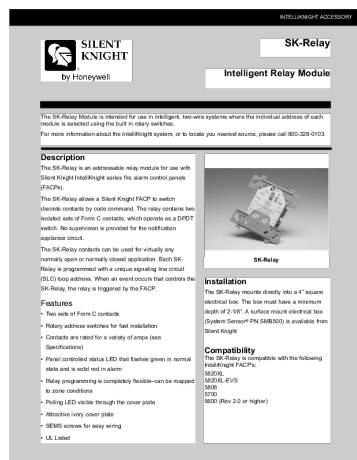


[pdf] Specifications Accessories

350127 Rev B SK Relay Spec Sheet Sk by Honeywell Click to View Silent Knight RELAY Addressable

Module Data alldataresource assets honeywell |||

INTELLIKNIGHT ACCESSORY SK-Relay Intelligent Relay Module The SK-Relay Module is intended for use in intelligent, two-wire systems where the individual address of each module is selected using the built in rotary switches. For more information about the IntelliKnight system, or to locate you neares...

lang:en score:30 filesize: 175.51 K page_count: 2 document date: 2013-03-05

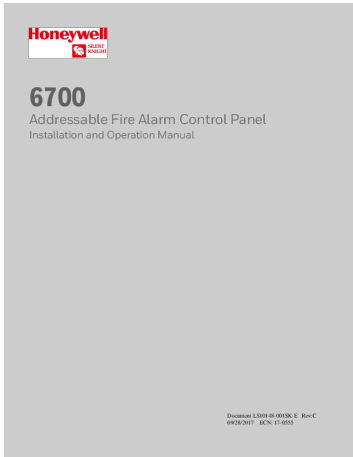


[pdf] User Manual Guide

LS10148 001SK E 6700 book E654596 Go Now Firealarm View guide user manual Url firealarm 2020 07

|||

6700 Addressable Fire Alarm Control Panel Installation and Operation Manual Document LS10148-001SK-E ... WSK-HEAT Wireless Heat, 135 fixed with 4 base WSK-MONITOR Wireless Addressable Monitor module **WSK-RELAY** Wireless Addressable Relay module B210W 6 wireless base HFSS Honeywell Fire For commun...

lang:en **score:30** filesize: 4.34 M page_count: 172 document date: 2018-05-29

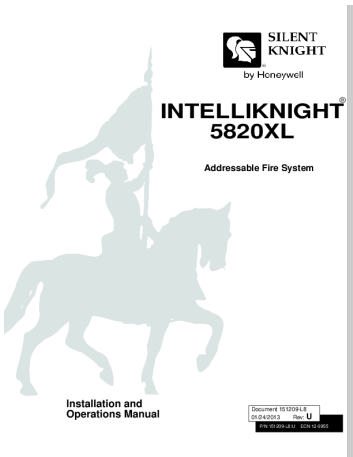


[pdf] User Manual

5820XL Installation Manual Fire Alarm Document 151209 L8 01 24 2013 Rev U P N ECN 12 0955 SK

facpmanuals manuals Silent Knight |||

INTELLIKNIGHT 5820XL Addressable Fire System Installation and Operations Manual Document 151209-L8 01/24/2013 Rev: U P/N 151209-L8:U ECN 12-0955 Installation Procedure Installation Precautions - Adherence to the following will aid in problem-free installation with long-term reliability: WARNIN...

lang:en **score:30** filesize: 5.67 M page_count: 244 document date: 2025-02-20

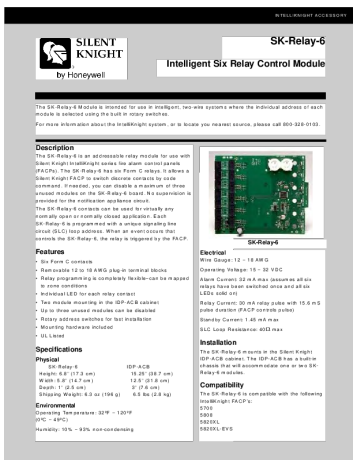

[pdf] Datasheet Accessories

350128 Rev B SK Relay 6 Data Sheet Sk by Honeywell Click to View Silent Knight RELAY Control

Module A Spec alldataresource assets honeywell |||

INTELLIKNIGHT ACCESSORY SK-Relay-6 Intelligent Six Relay Control Module The SK-Relay-6 Module is intended for use in intelligent, two-wire systems where the individual address of each module is selected using the built-in rotary switches. For more information about the IntelliKnight system, or to l...

lang:en **score:30** filesize: 56.97 K page_count: 2 document date: 2017-12-22




[\[pdf\]](#) User Manual Catalog

Silent Knight Catalog null Fire Alarm Control Systems MANUAL PULL STATIONS PS SATK Single Action Metal DATK Dual SA Lexan DA DF 50 firenotifier 2023 02 |||

IntelliKnight™ Series Fire Alarm Control Systems Simple. Smart. Reliable. EMER ... itor Module SK-CONTROL Supervised Control Module SK-CONTROL-6 Six Circuit Supervised Control Module **SK-RELAY** Relay Control Module **SK-RELAY-6** Six Relay Control Module SK-ZONE Zone Interface Module SK-Z...

lang:en score:29 filesize: 3.94 M page_count: 8 document date: 2016-11-11

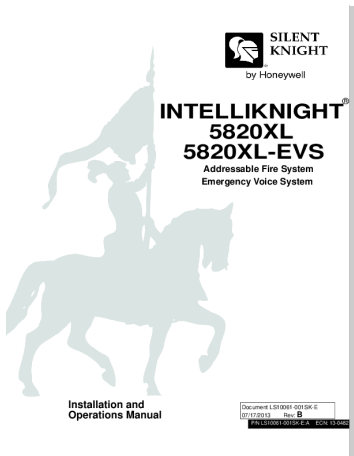


[\[pdf\]](#) User Manual

LS10061 001SK E book E654596 silentknight 5820xlevs manual s3 absupply net amazonaws silent knight |||

INTELLIKNIGHT 5820XL 5820XL-EVS Addressable Fire System Emergency Voice System Installation and Op ... Modules SK-MONITOR SK-MINIMON SK-PULL-SA SK-PULL-DA SK-MONITOR-2 SK-MON-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY** **SK-RELAY-6** **SK-RELAYMON-2** SK-ZONE SK-ZONE-6 SLC Modules B200SR Sounder Base B200S Sounder Ba...

lang:en score:29 filesize: 6.79 M page_count: 294 document date: 2013-07-30

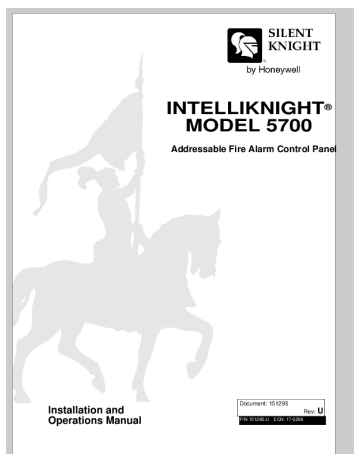


[\[pdf\]](#) User Manual

5700 Manual 151295 E654596 buildings honeywell content dam hbtbt en documents document lists silent knight archive |||

INTELLIKNIGHT MODEL 5700 Addressable Fire Alarm Control Panel Installation and Operations Manual Document: 151295 Rev: U P/N 151295:U ECN: 17-0298 Fire Alarm Emergency Communication System Limitations While a life safety system may lower insurance rates, it is not a substitute for life and ...

lang:en score:29 filesize: 3.52 M page_count: 180 document date: 2022-01-26

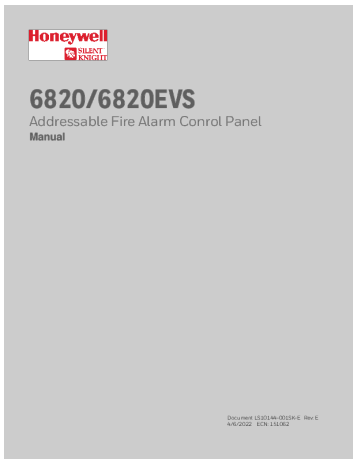


[\[pdf\]](#) User Manual

IFP 2100 6820 book E654944 hbt fire LS10144 001SK E installation manual false prod edam honeywell

content dam en us documents manuals and guides |||

6820/6820EVS Addressable Fire Alarm Control Panel Manual Document LS10144-001SK-E Rev: E 4/6/2022 ECN ... Wireless 135 fixed Heat Detector with 4 base WSK-MONITOR Wireless Addressable Monitor module **WSK-RELAY** Wireless Addressable Relay module Table 1.1 Compatible Products 12 6820/EVS Manual -- P...

lang:en **score:29** filesize: 2.83 M page_count: 170 document date: 2022-11-09

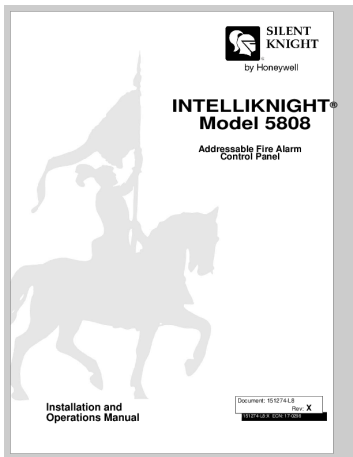

[\[pdf\]](#) User Manual

5808 Manual 151274 E654596 buildings honeywell content dam hbtbt en documents document lists silent knight archive |||

INTELLIKNIGHT Model 5808 Addressable Fire Alarm Control Panel Installation and Operations Manual Document: 151274-L8 Rev: X P/N 151274-L8:X ECN: 17-0298 Fire Alarm Emergency Communication System Limitations While a life safety system may lower insurance rates, it is not a substitute for life ...

lang:en **score:29** filesize: 3.9 M page_count: 180 document date: 2022-01-26

[\[pdf\]](#) User Manual Installation Guide Instructions Specifications Dimension Guide Accessories

SK Relay Addressable Module Manual The relay contains two isolated sets of Form C contacts which operate as a DPDT switch and are rated in accordance with the table manual Circuit SKRelay isheet buildings honeywell bin edam getfileservlet id AfIWBwWZcEX4I9fkxuoMo

ZMYGwakCXgMPayW2opF2M0zEYpqc3V FFwEjPXSaa3pdGkQ2YE ku

erO7ktRgqmqmwqJQjcxjjJnbWWGyGjZqadK0xA0mGBVYahGrFOQZYSc

7hXcVm07zcOySuyLySdhXwd0as3Q0ppDBpjWHpXXVe9bU7EwHjqcEFY0Jb0x OQshEyY6DtHGi

LUvi2Szi59do4HfSFRUjS11jEmTpMKMHPs56MtnGW5fRZcuP4hIKIAL1k 4yUmPRzXGqOhr0etP

KPNmTDXTUhnN |||

I56-3438-001 INSTALLATION AND MAINTENANCE INSTRUCTIONS SK-Relay 12


Clintonville Road, Northford, CT 06472 203.484.7161; Fax: 203.484.7118


www.silentknight.com Specifications Normal Operating Voltage: Maximum Current

Draw: Average Operating Current: EOL Resistance: Temperature Range: Humidity:

Di...

lang:en **score:28** filesize: 892.86 K page_count: 2 document date: 2009-08-03

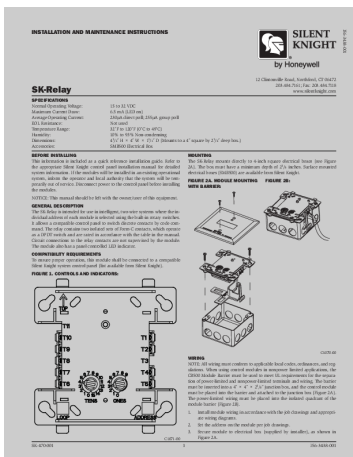

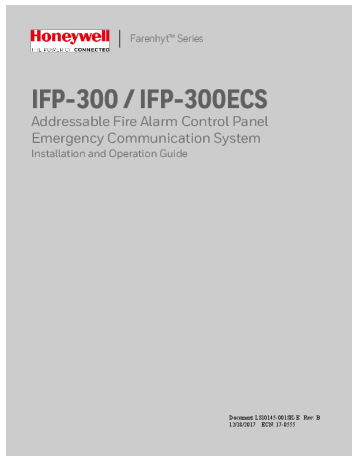


[\[pdf\]](#) User Manual Guide

IFP 300 300ECS Addressable Fire Alarm Control Panel Emergency Communication System Installation and Operation Guide Document Manual false prod edam honeywell content dam hbt en us documents manuals guides installation moved ss |||

Farenhyt™ Series IFP-300 / IFP-300ECS Addressable Fire Alarm Control Panel Emergency Communication ... HEAT WIDP-MONITOR WIDP-RELAY B210W WSK-WGI WSK-PHOTO WSK-PHOTO-T WSK-HEAT-ROR WSK-HEAT WSK-MONITOR **WSK-RELAY** B210W HFSS Honeywell Fire Software Suite 7860 Telephone Cord RBB CELL-MOD CELL-CAB-SK 4 x ...

lang:en **score:28** filesize: 13.1 M page_count: 226 document date: 2018-05-31

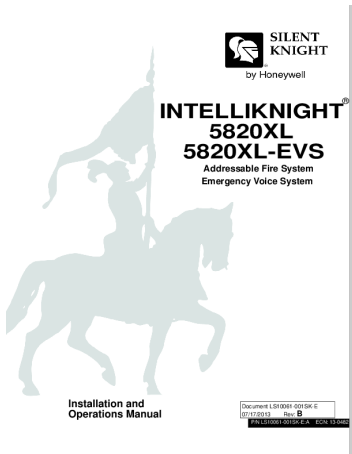

[\[pdf\]](#) User Manual

LS10061 001SK E book E654596 Intelliknight 5820XI Installation And Operation Manual Pdf

INTELLIKNIGHT 5820XL Silent Knight SilentKnight 5820XLEVS absupply net |||

INTELLIKNIGHT 5820XL 5820XL-EVS Addressable Fire System Emergency Voice System Installation and Op ... Modules SK-MONITOR SK-MINIMON SK-PULL-SA SK-PULL-DA SK-MONITOR-2 SK-MON-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY** **SK-RELAY-6** **SK-RELAYMON-2** SK-ZONE SK-ZONE-6 SLC Modules B200SR Sounder Base B200S Sounder Ba...


lang:en **score:27** filesize: 6.46 M page_count: 294 document date: 2013-07-30



[\[pdf\]](#) User Manual Catalog

PS 6 10 book E654944 SK PS6 PS10 Series Instruction Manual — P N LS10227 002SK E B 3 19 2021 and SWIFT® are registered trademarks of Honeywell International Inc silentknight CatalogDocuments SK-PS6 SK-PS10 Power Supplies Instruction Manual Document LS10227-002SK-E Rev: B 3/19/2021 ECN: 29 ... ndoffs and secure with screws. Compatible modules include the SK-CONTROL, SK-MONITOR, SK-MONITOR-2, **SK-RELAY**, **SK-RELAYMON-2**, SK-CONTROL-6, **SK-RELAY-6**, and SK-MON-10. NOTE: PS-MOUNT, the optional hardw...

lang:en **score:27** filesize: 1.74 M page_count: 44 document date: 2021-03-31

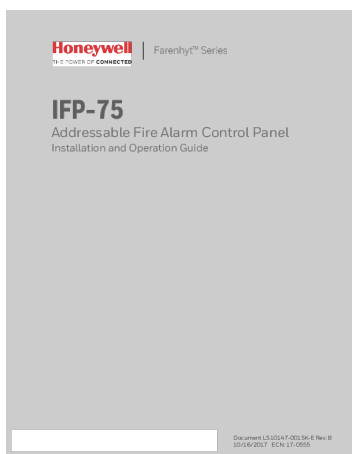

[\[pdf\]](#) User Manual Datasheet Guide

untitled IFP 75B Installation Manual ftp3 syscom mx usuarios yhermosillo SILENT KNIGHT Datasheets manuales |||

Farenhyt™ Series IFP-75 Addressable Fire Alarm Control Panel Installation and Operation Guide Docum ... th 4 base WSK-HEAT Wireless Heat, 135 fixed with 4 base WSK-MONITOR Wireless monitor module **WSK-RELAY** Wireless relay module B210W 6 wireless base Table 1.2 IFP-75 Compatible Products 3 I...

lang:en **score:27** filesize: 10.33 M page_count: 170 document date: 2018-03-27




[\[pdf\]](#) User Manual Guide

LS10148 001SK E 6700 book E654596 Download Manual Silent Knight LOUD Security User loudsecurity 2021 02 |||

6700 Addressable Fire Alarm Control Panel Installation and Operation Guide

Document: LS10148-001SK-E ... WSK-HEAT Wireless Heat, 135 fixed with 4 base WSK-MONITOR Wireless Addressable Monitor module **WSK-RELAY** Wireless Addressable Relay module B210W 6 wireless base 1-3 LS10148-001SK-E Introdu... lang:en **score:27** filesize: 4.45 M page_count: 208 document date: 2017-10-17

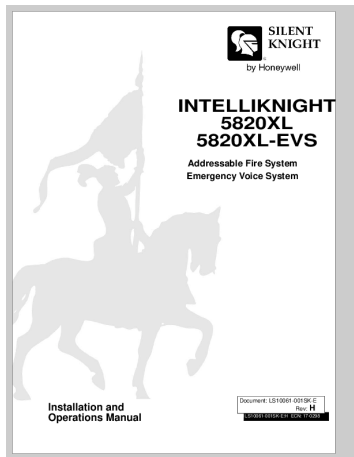


[\[pdf\]](#) User Manual

5820XL EVS Installation Manual LS10061 001SK E E654596 buildings honeywell content dam hbtbt en documents document lists silent knight archive |||

INTELLIKNIGHT 5820XL 5820XL-EVS Addressable Fire System Emergency Voice System Installation and Ope ... C Module SK-MONITOR SK-MINIMON SK-PULL-SA SK-PULL-DA SK-MONITOR-2 SK-MON-10 SK-CONTROL SK-CONTROL-6 **SK-RELAY SK-RELAY-6 SK-RELAYMON-2 SK-ZONE SK-ZONE-6** # of Devices Current per Device Standby Curre...

lang:en **score:26** filesize: 4.45 M page_count: 237 document date: 2022-01-26

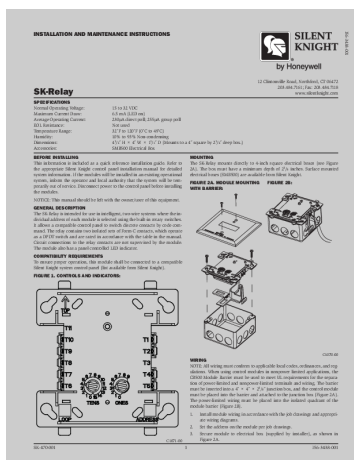

[\[pdf\]](#) User Manual Installation Guide Instructions Specifications Dimension Guide Accessories

silentknight skrelay installationmanual s3 absupply net amazonaws silent knight |||

I56-3438-001 INSTALLATION AND MAINTENANCE INSTRUCTIONS SK-Relay 12 Clintonville Road, Northford, CT 06472 203.484.7161; Fax: 203.484.7118

www.silentknight.com Specifications Normal Operating Voltage: Maximum Current Draw: Average Operating Current: EOL Resistance: Temperature Range: Humidity: Di...

lang:en **score:26** filesize: 890.71 K page_count: 2 document date: 2009-08-03




[\[pdf\]](#) User Manual

IFP 2100 2100ECS Analog Addressable Fire System Emergency Communication Manual prod edam

honeywell content dam hbt en us documents manuals and guides installation moved ss |||

Farenhyt™ Series IFP-2100 / IFP-2100ECS Analog / Addressable Fire System Emergency Communication Sy ... stallation Manual P/N LS10036-SKE for more information on these accessories. WSK-HEAT WSK-MONITOR **WSK-RELAY** B210W 7860 Telephone Cord HFSS Honeywell Fire Software Suite RBB AB-55 Wireless Heat, 135 ...

lang:en **score:26** filesize: 13.42 M page_count: 232 document date: 2018-05-31

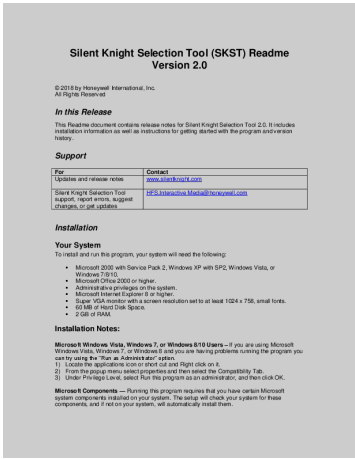

[pdf] Quick Start Guide Installation Guide Instructions Release Notes

Your System JackR Silent Knight Selection Tool SKST Readme buildings honeywell content dam hbtbt en

documents document lists silent knight |||

Silent Knight Selection Tool SKST Readme Version 2.0 2018 by Honeywell

International, Inc. All R ... the program to crash when canceling changing circuit

options for Intelligent Control Panels. Added **SK-RELAYMON-2** to all relevant battery calculation sheets. Corrected a bug that would not remove pow...

lang:en score:26 filesize: 342.06 K page_count: 7 document date: 2018-04-02



[pdf] User Manual Instructions Specifications Dimension Guide Accessories

silentknight skrelay6 installationmanual s3 absupply net amazonaws silent knight |||


I56-3439-000 INSTALLATION AND MAINTENANCE INSTRUCTIONS SK-Relay-6

Six Relay Control Module 7550 Meridian Circle, Maple Grove, MN 55369-4927

763.493.6455, 800.328.0103; Fax: 763.493.6475 http://www.silentknight.com

SPECIFICATIONS Normal Operating Voltage: Alarm Current: Temperature Range: Humidit...

lang:en score:25 filesize: 464.71 K page_count: 3 document date: 2009-02-25

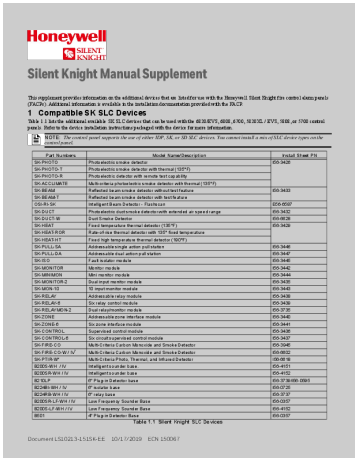

[pdf] User Manual Installation Guide Instructions Documentation

LS10213SKFHSupplement fm E342683 LS10213 151SK E Manuals silentknight documentation

Documents |||

Silent Knight Manual Supplement This supplement provides information on the

additional devices that ... AT SK-HEAT-ROR SK-HEAT-HT SK-PULL-SA SK-PULL-

DA SK-ISO SK-MONITOR SK-MINIMON SK-MONITOR-2 SK-MON-10 **SK-RELAY**

SK-RELAY-6 SK-RELAYMON-2 SK-ZONE SK-ZONE-6 SK-CONTROL SK-

CONTROL-6 SK-FIRE-CO SK-FIRE-CO-W ...

lang:en score:25 filesize: 157.08 K page_count: 3 document date: 2019-11-06



SILENT KNIGHT
by Honeywell

IntelliKnight 5600 25-Point Hybrid Conventional Fire Alarm Control Panel

Step up to Addressable Fire Alarm Systems with the affordable IntelliKnight 5600 from Silent Knight

The IntelliKnight 5600 is a 25-point, class leading, single loop addressable fire alarm control and communicator system. IntelliKnight 5600 provides you with the revolutionary value and performance of addressable warning technology combined with patented, built-in digital communication that includes an easy to use 7-8-9-10-11-12 code wheel addressable detector module and JumpStart™ feature. The 5600 can be UL6 Safety operational without a single programming tool. Powerful features such as 40% compensation and maintenance alert are achieved in this powerful FACP from Silent Knight.

For more information about the IntelliKnight 5600 system, or to locate your nearest source, please call 800-338-0553.

Description

The IntelliKnight 5600 is a 25-point, single loop, addressable fire alarm control and communicator system. The 5600 supports Honeywell Fire Systems (HFS) or equivalent SK detectors and modules. The 5600 also features a powerful built-in dual line fire communicator that allows for reporting by zone of all system activity to a remote monitoring location.

Features

- Support for any combination of up to 25 Honeywell Fire Systems (HFS) or equivalent SK protocol detectors and modules (Maximum 2.0 or higher)
- HFS support for two SKS Remote Annunciators (Maximum 2.0 or higher)
- Built-in digital communicator. Report by zone.
- Code wheel detector and module for faster installation time.
- In communication complete.
- Maintenance alert option.
- Point device ready-to-install module but requires for NFPA 72.
- Auto learn "JumpStart™" feature for easy programming.
- Custom programming can be performed through FACP push-in-browser. No programming software required.
- Dual detector wire - no detector or module pair required.
- Control Station reporting up to five zones.
- Built-in synchronization for System Sensor® ADDRESSOL, Guard® or Wireless®.
- Two Stage Y (Class B) notification appliance circuit (NAC).



Model 5600

Compatibility

The 5600 is UL6 Safety operational without a single programming tool. Powerful features such as 40% compensation and maintenance alert are achieved in this powerful FACP from Silent Knight.

Specifications

Electrical

Primary AC: 120 Vrms @ 60 Hz, 1.5A
1000W Primary AC
240 Vrms @ 50/60, 75A Hz
Total Auxiliary Load: 2.0A @ 24 VDC
Notification Signal: 2.0A @ 24 VDC
Standby Current: 130 mA
Alarm Current: 230 mA

Dimensions

17 1/2" (443 mm) H x 10 1/2" (267 mm) W x 4 1/2" (114 mm) D

© 2014 Honeywell International Inc.

[pdf] Datasheet

5600 Data Sheet 350137 Silent Knight by Honeywell buildings honeywell content dam hbtbt en

documents document lists silent knight archive |||

INTELLIKNIGHT FIRE ALARM CONTROL PANEL IntelliKnight 5600 25-Point Hybrid Conventional Fire Alarm Control Panel Step up to Addressable Fire Alarm Systems with the affordable IntelliKnight 5600 from Silent Knight The IntelliKnight 5600 is a 25 point, class leading, single loop addressable fire alar...

lang:en score:25 filesize: 246.91 K page_count: 2 document date: 2014-09-11