

Notifier NCA-2

Notifier NCA-2 Network Control Annunciator Instruction Manual

Model: NCA-2

1. INTRODUCTION

The Notifier NCA-2 Network Control Annunciator is a sophisticated device designed for use in fire alarm and emergency communication systems. It provides a 640-character display for monitoring and controlling network systems. This manual provides essential information for the proper installation, operation, and maintenance of the NCA-2 unit.

When used with single panel NFS2-640 systems, the NCA-2 can serve as the primary display, connecting directly to the CPU2-640. For network systems involving two or more Fire Alarm Control Panels (FACPs), one network display (NCA-2, NCS, or ONYXWorks) is required per system, and each NCA-2 must connect to and utilize an NCM Network Control Module.



Figure 1.1: Front view of the Notifier NCA-2 Network Control Annunciator. This image shows the main unit with its 640-character display screen and integrated keypad, housed within a dark gray enclosure.

2. COMPONENTS INCLUDED

Upon unpacking, verify that all components are present and undamaged. The standard package for the Notifier NCA-2 typically includes:

- Notifier NCA-2 Network Control Annunciator Unit
- Instruction Manual (this document)
- Mounting hardware (may vary based on specific kit)
- Interconnection wiring harness

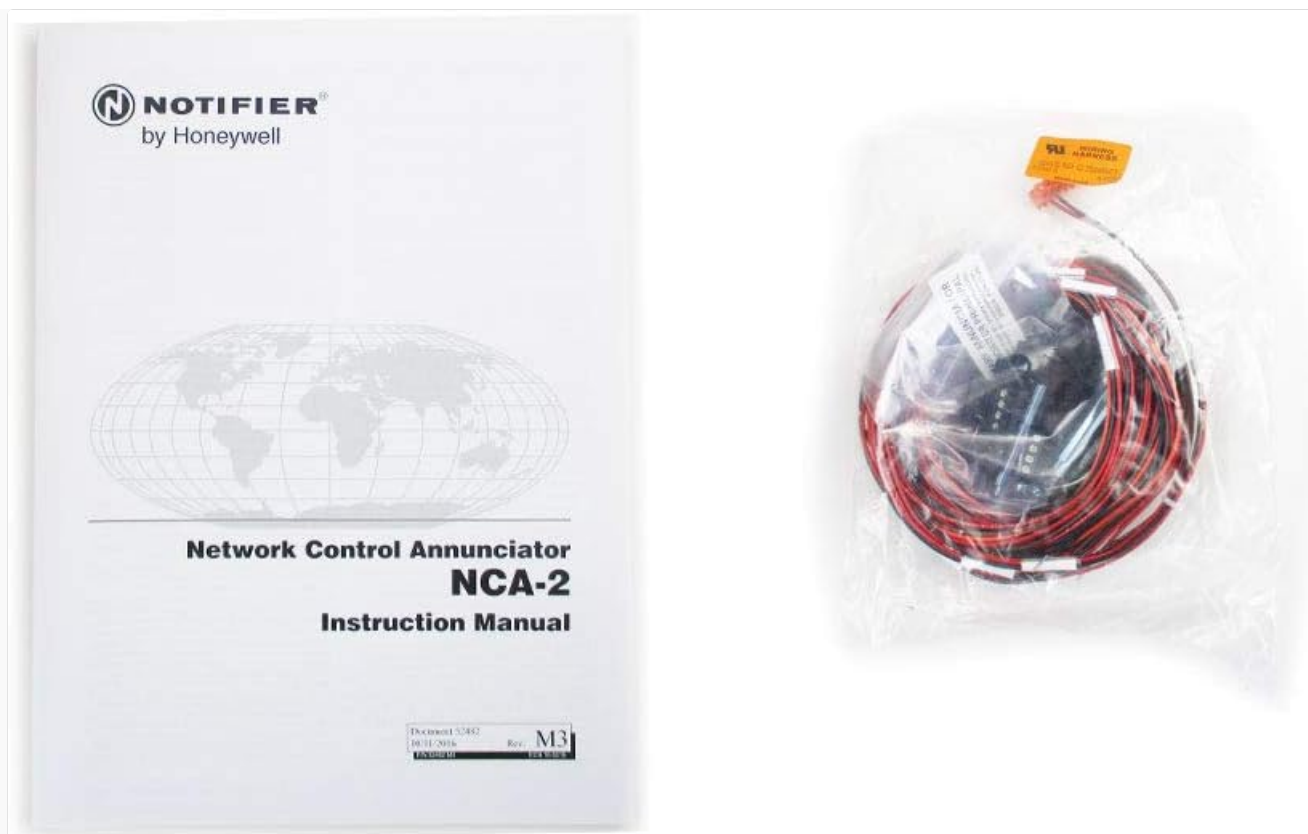


Figure 2.1: The Notifier NCA-2 instruction manual and a bundled wiring harness, essential for connecting the annunciator within a fire alarm system.



Figure 2.2: The Notifier NCA-2 unit, protected within an anti-static shielding bag, showing its display and keypad through the

transparent material.



Figure 2.3: The Notifier NCA-2 unit securely packaged in a cardboard box with bubble wrap for protection during transit.

3. SETUP AND INSTALLATION

Installation of the NCA-2 unit requires adherence to local codes and the National Fire Protection Association (NFPA) standards. It should only be performed by qualified personnel.

3.1 Mounting Options

The NCA-2 offers flexible mounting solutions:

- **Direct FACP Node Mounting:** The unit can be mounted directly in a row of a Fire Alarm Control Panel (FACP) node.
- **Annunciator Module Positions:** It can occupy two annunciator module positions within a compatible enclosure.
- **Specific Mounting Kits:**
 - NCA/640-2-KIT: For direct mounting to the CHS2-M2 chassis.
 - CA-2, ADP-4B: Other compatible mounting plates or kits.
- **Annunciator Box Installation:** Can be installed in an annunciator box, such as the ABS-2DB (requires the CHS-2D chassis).

3.2 Electrical Connections

Ensure all power is disconnected before making any electrical connections.

- **Single Panel Systems (NFS2-640):** The NCA-2 connects directly to the CPU2-640 for primary display functionality.
- **Network Systems (Multiple FACP's):** Each NCA-2 unit requires an NCM Network Control Module for connection to the network. Refer to the NCM module's instruction manual for specific wiring diagrams and configuration.

Always follow the detailed wiring diagrams provided with the NCA-2 and associated modules. Incorrect wiring can lead to system malfunction or damage.

4. OPERATING INSTRUCTIONS

The Notifier NCA-2 serves as a central point for monitoring and controlling networked fire alarm systems. Its 640-character display provides detailed event information, system status, and user prompts.

4.1 Power-Up Sequence

1. Ensure all connections are secure and verified.
2. Apply power to the FACP or network control module as per system specifications.
3. The NCA-2 display will illuminate and perform a self-test.
4. Upon successful power-up, the display will show the system's normal operating status or any active events.

4.2 Navigating the Display and Keypad

The NCA-2 features a keypad for user interaction. Common functions include:

- **Event Acknowledge:** Press the 'ACK' button to acknowledge new alarms or troubles.
- **Silence Alarms:** Use the 'SILENCE' button to silence audible alarms.
- **System Reset:** The 'RESET' button clears active alarms and restores the system to normal operation after an event has been resolved.
- **Menu Navigation:** Utilize arrow keys and 'ENTER' to navigate through menus for viewing event history, system programming, or diagnostic information.
- **Text Input:** The alphanumeric keypad allows for entering specific commands or information as required by the system.

Refer to the specific system programming manual for detailed instructions on advanced operations and configuration.

5. MAINTENANCE

Regular maintenance ensures the reliable operation of the Notifier NCA-2 and the overall fire alarm system. Maintenance should only be performed by authorized and trained personnel.

5.1 Routine Checks

- **Visual Inspection:** Periodically inspect the unit for any visible damage, loose connections, or environmental factors that could affect performance (e.g., excessive dust, moisture).
- **Display Functionality:** Verify that the 640-character display is clear and all segments are functioning correctly.

- **Keypad Response:** Test the responsiveness of all keypad buttons.
- **System Status:** Confirm that the NCA-2 accurately reflects the status of the connected fire alarm system.

5.2 Cleaning

Clean the exterior of the NCA-2 with a soft, dry, lint-free cloth. Do not use abrasive cleaners, solvents, or excessive moisture, as these can damage the display or electronic components.

5.3 Firmware Updates

Firmware updates may be released periodically to enhance functionality or address issues. Consult Notifier technical support or your system integrator for information on available updates and the proper procedure for installation.

6. TROUBLESHOOTING

This section provides basic troubleshooting steps for common issues. For complex problems, contact qualified service personnel.

6.1 Display Not Illuminating

- **Check Power:** Ensure the FACP or network control module supplying power to the NCA-2 is operational and receiving power.
- **Verify Connections:** Inspect all power and communication wiring for secure connections.
- **System Status:** Check the status of the main FACP for any power-related troubles.

6.2 Incorrect System Status Displayed

- **Network Communication:** For networked systems, verify the NCM Network Control Module is functioning correctly and network cabling is intact.
- **Configuration:** Ensure the NCA-2 is correctly configured to communicate with the specific FACP or network segment.
- **FACP Status:** Confirm the actual status of the FACP or network nodes directly.

6.3 Keypad Unresponsive

- **Power Cycle:** Perform a controlled power cycle of the FACP (if safe and permissible) to reset the NCA-2.
- **Physical Damage:** Inspect the keypad for any physical damage or debris that might be obstructing button presses.

If issues persist after basic troubleshooting, contact Notifier technical support or a certified service technician.

7. SPECIFICATIONS

Feature	Specification
Model Number	NCA-2
Part Number	NNCA2
Display Type	640-Character LCD
Brand	Notifier
Manufacturer	NOTIFIER

Feature	Specification
Item Weight	1 pound
Power Source	System PowerSource (via FACP or NCM)
Alarm Type	Audible (via system)
UPC	734038305652
Date First Available	May 5, 2019

8. WARRANTY AND SUPPORT

For specific warranty information, please refer to the documentation provided with your purchase or contact Notifier directly. Warranty terms typically cover manufacturing defects under normal use conditions.


For technical support, service, or to report issues, please contact your authorized Notifier distributor or a certified fire alarm system technician. Ensure you have your product model number (NCA-2) and any relevant system information available when seeking support.



Notifier Contact Information: Please visit the official Notifier website for the most current contact details and support resources.




© 2023 Notifier. All rights reserved. Information in this manual is subject to change without notice.

Related Documents - NCA-2

	Notifier NCD Network Control Display: Features and Specifications Explore the Notifier NCD Network Control Display, a next-generation annunciator for the NOTI FIRE NET network. Learn about its advanced features, hardware capabilities, and system integration for fire alarm control.
	NOTIFIER NCA-2 Network Control Annunciator Instruction Manual Comprehensive instruction manual for the NOTIFIER NCA-2 Network Control Annunciator, detailing installation, operation, and programming. Covers system limitations, safety precautions, and technical specifications for fire alarm and emergency communication systems.

	NOTIFIER NCA-2 Network Control Annunciator Instruction Manual Comprehensive instruction manual for the NOTIFIER NCA-2 Network Control Annunciator by Honeywell. Details installation, operation, programming, system overview, and compliance for fire alarm and emergency communication systems.
	NOTIFIER ACS Series Annunciator Control System Manual This manual provides comprehensive installation, configuration, and programming guidance for the NOTIFIER ACS Series Annunciator Control System, covering models like ACM-24AT, ACM-48A, ACM-16AT, ACM-32A, and their expanders, essential for fire alarm system integration.
	Notifier NFS-320 Intelligent Addressable Fire Alarm System Datasheet Comprehensive datasheet for the Notifier NFS-320 Intelligent Addressable Fire Alarm System, detailing its features, intelligent sensing capabilities, FlashScan protocol, system specifications, compatible devices, and agency approvals.
	NOTIFIER LCD-80 Installation Manual: Features, Modes, and Setup This installation manual provides detailed information on the NOTIFIER LCD-80 Liquid Crystal Display, covering its features, ACS and Terminal modes, system compatibility with various NOTIFIER fire alarm panels, and essential installation and configuration procedures.


Documents - Notifier – NCA-2

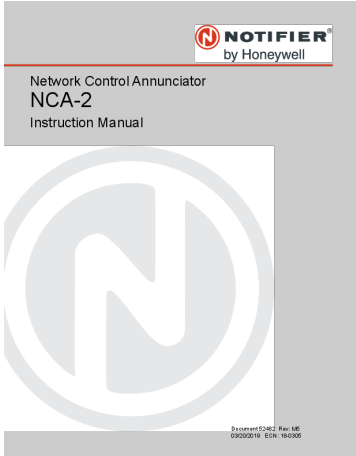

[NOTIFIER NCA-2 Network Control Annunciator Instruction Manual](#)

Comprehensive instruction manual for the NOTIFIER NCA-2 Network Control Annunciator by Honeywell. Details installation, operation, programming, system overview, and compliance for fire alarm and emergency communication systems.

lang:en score:46 filesize: 3.07 M page_count: 108 document date: 2019-03-20

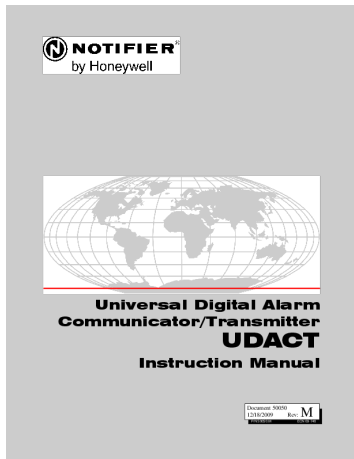


[\[pdf\]](#) User Manual

untitled M Universal Digital Alarm Communicator Transmitter Instruction Manual ba fire 50050 false prod
edam honeywell content dam hbt en us documents manuals and guides installation notifier |||

Universal Digital Alarm Communicator/Transmitter UDACT Instruction Manual M
Document 50050 12/18/2094

Appendix G: **NCA-2** UL 9th and NCA UL 8th
100...


lang:en **score:46** filesize: 4.07 M page_count: 124 document date: 2010-02-22

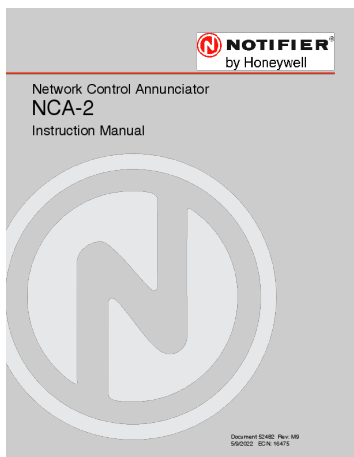

[NOTIFIER NCA-2 Network Control Annunciator Instruction Manual](#)

Comprehensive instruction manual for the NOTIFIER NCA-2 Network Control Annunciator, detailing installation, operation, and programming. Covers system limitations, safety precautions, and technical specifications for fire alarm and emergency communication systems.

lang:en **score:44** filesize: 3.09 M page_count: 110 document date: 2022-06-06

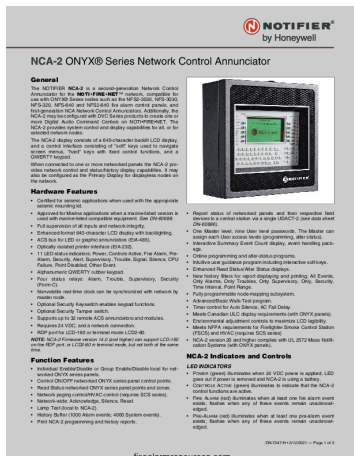


[\[pdf\]](#) Instructions Specifications Datasheet

untitled Click here to Notifier NCA 2 Data Sheet Fire Alarm Resources Free fire alarm manuals
documents installation instructions and technical specifications tmstv 1676768919 firealarmresources
24257 |||

NCA-2 ONYX Series Network Control Annunciator General The NOTIFIER **NCA-2** is a second-generation Network Control Annunciator for the NOTIFIRENETTM network, compatible for use with ONYX Series nodes such as the NFS2-3030, NFS-3030, NFS-320, NFS-640 and NFS2-640 fire alarm control panels, and first-ge...

lang:en **score:41** filesize: 750.52 K page_count: 3 document date: 2022-02-15

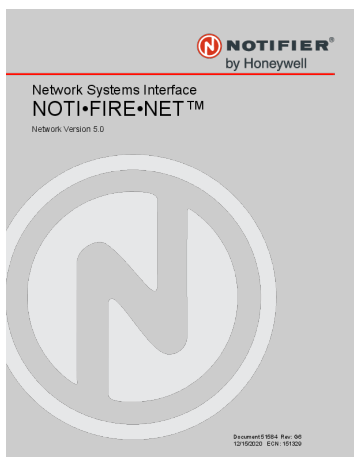


[\[pdf\]](#) User Manual Instructions Documentation Guide

51584 G6 NFN V5 book Notifier NOTI FIRE NET Network Version 5 fire alarm control panel manual with
installation operation and programming instructions 2020 edition notifier facp noti net network version
detection safety smoke detector suppression emergency systems building automation life documentation
user guide technical reference Manuals 88 Free Downloads FACP Manuals sv docs facpmanuals manuals
50 |||

Network Systems Interface NOTIFIRENETTM Network Version 5.0 Document 51584
Rev: G6 12/15/2020 ECN: 1 ... quirements for the AM2020/AFP-1010 DVC/DVC-EM
Digital Voice Command NCA Network Control Annunciator **NCA-2** Network Control
Annunciator NCD Network Control Display NCS Network Control Station, ONYXTM
Ne...


lang:en **score:39** filesize: 561.59 K page_count: 32 document date: 2025-02-18

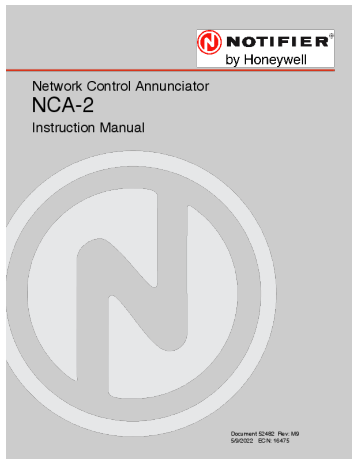

[\[pdf\]](#) User Manual Documentation Guide

52482 NCA2 book Notifier NCA 2 fire alarm control panel manual covering installation operations programming 2022 edition notifier facp nca detection safety smoke detector suppression emergency systems building automation life documentation user guide operation ma Manuals 88 Free Downloads FACP Manuals v1 docs facpmanuals manuals |||


Network Control Annunciator **NCA-2** Instruction Manual Document 52482 Rev: M9 5/9/2022 ECN: 16475 Fire Alarm Emergency Communication System Limitations While a life safety system may lower insurance rates, it is not a substitute for life and property insurance An automatic fire alarm system--ty...
lang:en score:39 filesize: 3.01 M page_count: 110 document date: 2022-06-06

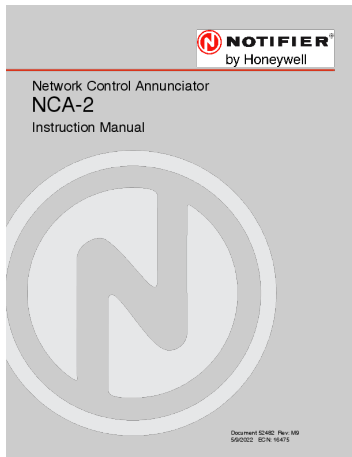

[\[pdf\]](#) User Manual Documentation Guide

52482 NCA2 book Notifier NCA 2 fire alarm control panel manual covering installation operations programming 2022 edition notifier facp nca detection safety smoke detector suppression emergency systems building automation life documentation user guide operation ma Manuals 88 Free Downloads FACP Manuals v1 docs facpmanuals manuals |||


Network Control Annunciator **NCA-2** Instruction Manual Document 52482 Rev: M9 5/9/2022 ECN: 16475 Fire Alarm Emergency Communication System Limitations While a life safety system may lower insurance rates, it is not a substitute for life and property insurance An automatic fire alarm system--ty...
lang:en score:39 filesize: 3 M page_count: 110 document date: 2025-02-18

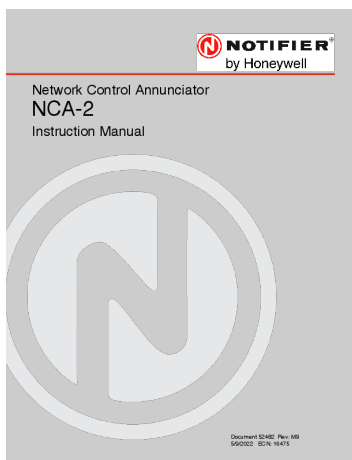


[\[pdf\]](#) User Manual Documentation Guide

52482 NCA2 book Notifier NCA 2 fire alarm control panel manual covering installation operation programming 2022 edition notifier facp nca detection safety smoke detector suppression emergency systems building automation life documentation technical reference user guide g Installation Operations Programming Manual FACP Manuals v1 docs facpmanuals manuals |||

Network Control Annunciator **NCA-2** Instruction Manual Document 52482 Rev: M9 5/9/2022 ECN: 16475 Fire Alarm Emergency Communication System Limitations While a life safety system may lower insurance rates, it is not a substitute for life and property insurance An automatic fire alarm system--ty...
lang:en score:39 filesize: 3 M page_count: 110 document date: 2025-02-18




Slide 1 Notifier Marketing Communications WELCOME ba fire NF ALC2017 Sales Applications Training
false prod edam honeywell content dam hbt en us documents manuals and guides reference notifier |||
31ST ANNUAL LEADERSHIP CONFERENCE WELCOME Sales Application Training
Dan Corbett Sr. Sales Applicat ... dalone/direct connect to DVC If using Digital Audio
Loop DAL devices DAA2/DAX/DS-DB, etc... an **NCA-2** is required as the primary
display to annunciate DAL events Refer to the DVC applications guid...
lang:en score:35 filesize: 3.82 M page count: 63 document date: 2017-10-31



Sales Application Training Reference Guide Notifier Marketing Communications Dan Corbett Honeywell
Digital Assets - Plug the CPU2 3030D NUP directly into DVC ❖Not networkable if Proprietary NOTIFIER
~ Whelen interface No control modules required! ba fire NF ALC2017 Applications prod edam honeywell
content dam hbt en us documents manuals and guides reference notifier |||
31ST ANNUAL LEADERSHIP CONFERENCE WELCOME Sales Application Training
Dan Corbett Sr. Sales Applicat ... dalone/direct connect to DVC If using Digital Audio
Loop DAL devices DAA2/DAX/DS-DB, etc... an **NCA-2** is required as the primary
display to annunciate DAL events Refer to the DVC applications guid...
lang:en score:35 filesize: 4.01 M page count: 63 document date: 2017-10-31



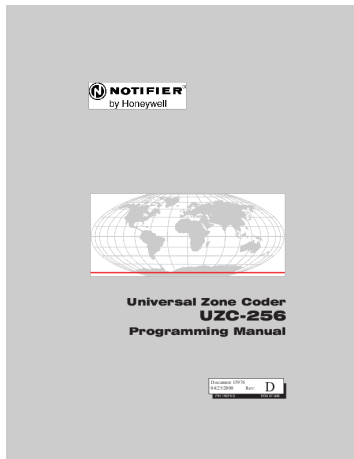

[\[pdf\]](#) User Manual

untitled e650889 D UZC 256 ba fire 15976 false prod edam honeywell content dam hbt en us documents manuals and guides programming notifier |||


Universal Zone Coder UZC-256 Programming Manual Document 15976 04/25/2008

Rev: P/N 15976:D D ECN 0 ... mming Guidelines for System 5000 w/AIM-

200..... 41 Appendix C: NFS-3030/NFS2-3030, NCA/**NCA-2**, and

AM2020/AFP1010 42 C.1: ...

lang:en score:34 filesize: 811.95 K page_count: 52 document date: 2015-09-01

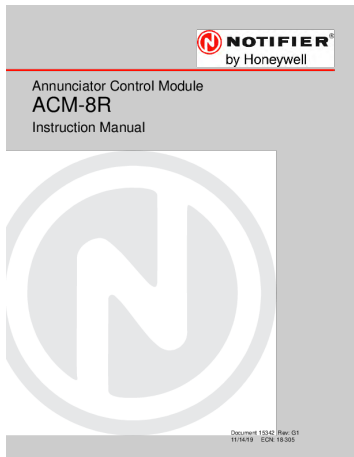

[\[pdf\]](#) User Manual


15342 G book e451217 ACM 8R ba fire false prod edam honeywell content dam hbt en us documents manuals and guides user notifier |||

Annunciator Control Module ACM-8R Instruction Manual Document 15342 Rev: G1

11/14/19 ECN: 18-305 F28 B.2:

NFS2-3030 and **NCA-2** Connections

.....
lang:en score:34 filesize: 730.2 K page_count: 50 document date: 2020-01-23

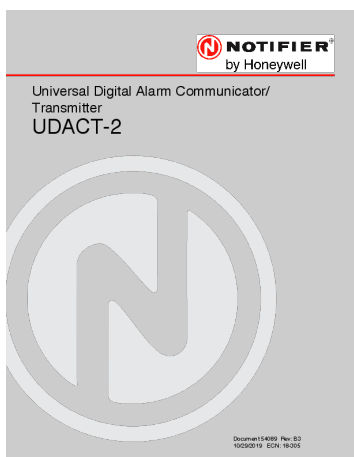

[\[pdf\]](#) User Manual Documentation Guide

54089 UDACT 2 rev B3 book Notifier fire alarm control panel manual covering installation operations

programming 2019 edition notifier facp udatc detection safety smoke detector suppression emergency

systems building automation life documentation user guide operation Manuals 88 Free Downloads FACP

Manualsv1docs facpmanuals manuals |||

Universal Digital Alarm Communicator/ Transmitter UDACT-2 Document 54089 Rev:

B3 10/29/2019 ECN: 18- ...

.....37 A.4: **NCA-2** UL 864 10th

, NCA UL 8th

lang:en score:33 filesize: 2.8 M page_count: 52 document date: 2025-02-18




[\[pdf\]](#) Instructions Specifications Datasheet

untitled Click here to Notifier NFS2 640 E Data Sheet Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676713096 firealarmresources 23003 |||

NFS2-640 Intelligent Addressable Fire Alarm Control Panel General The NFS2-640 intelligent Fire Ala ... s are available for use with the FWSG. Standard 80-character display, 640-character large display **NCA-2** , or display-less a node on a network . Network options: High-speed network for up to 200 n...

lang:en **score:33** filesize: 886.91 K page_count: 9 document date: 2022-02-15

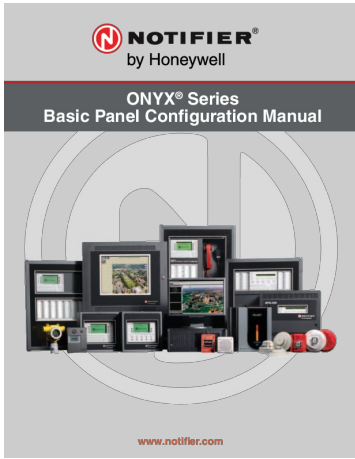


[\[pdf\]](#) User Manual

ONYX Series Basic Panel User Manual e315024 ONYX® Configuration 27 фєрр 2025 r — This document provides guidance on basic system configurations Not every possible configuration is covered NOTIFIER By Honeywell Security and ba fire prod edam honeywell content dam hbt en us documents manuals guides user notifier |||

ONYX Series Basic Panel Configuration Manual www.notifier.com Panel Configuration Manual Purpose ... CPU2-3030ND-SC CPU2-3030ND-HE CPU2-3030ND-SP CPU2-3030ND-KO CPU2-3030ND-TC CPU2-3030ND-PO **NCA-2 NCA-2-FR NCA-2-SC NCA-2-HE NCA-2-SP NCA-2-KO NCA-2-TC NCA-2-M NCA-2-TH NCA-2-PO** ...


lang:en **score:33** filesize: 4.83 M page_count: 52 document date: 2025-03-14

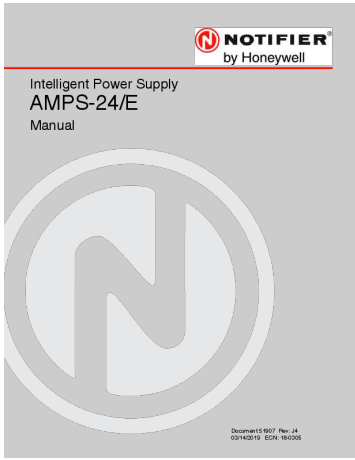

[NOTIFIER AMPS-24/E Intelligent Power Supply Manual](#)

This manual provides comprehensive guidance for the NOTIFIER AMPS-24/E Intelligent Power Supply and Battery Charger. It details installation, configuration, specifications, wiring, programming, and power supply calculations for fire alarm and life safety systems, ensuring compliance with standards like NFPA 72 and UL 864.

lang:en **score:33** filesize: 1.58 M page_count: 44 document date: 2025-08-18

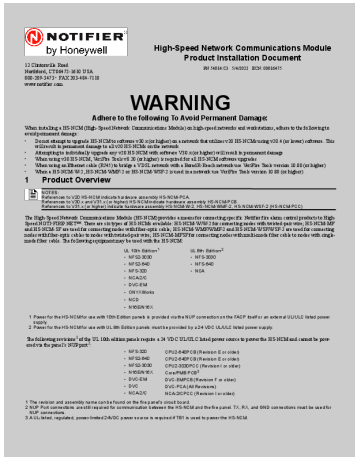

[pdf]

54014 B9 HSNCM book E654944 WARNING ba fire false prod edam honeywell content dam hbt en us

documents manuals and guides installation notifier |||


12 Clintonville Road Northford, CT 06472-1610 USA 800-289-3473 FAX 203-484-

7118 www.notifier.com H ... e following equipment may be used with the HS-NCM: UL

10th Edition1 NFS2-3030 NFS2-640 NFS-320 **NCA-2/C** DVC-EM ONYXWorks NCD

N16E/N16X UL 8th Edition2 NFS-3030 NFS-640 NCA 1 Power for the...

lang:en score:33 filesize: 1014.71 K page_count: 16 document date: 2022-06-13

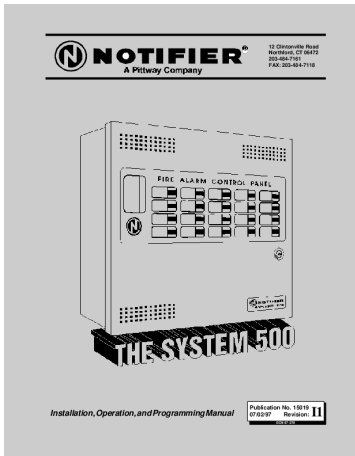

[pdf]

User Manual Documentation Guide

Untitled 1 Notifier System 500 fire alarm control panel manual covering installation operations

programming 1997 edition notifier facp system detection safety smoke detector suppression emergency

systems building automation life documentation user guide o DAVEP NCA 2 Installation Operations


Programming Manual FACP Manuals v1 docs facpmanuals manuals |||

12 Clintonville Road Northford, CT 06472 203-484-7161 FAX: 203-484-7118

Installation, Operation, and Programming Manual I1 Publication No. 15019 07/02/97

Revision: ECN 97-278 Installation Precautions - Adherence to the following will aid in problem-free installation with long-term reliability: ...

lang:en score:32 filesize: 857.93 K page_count: 70 document date: 2004-06-16

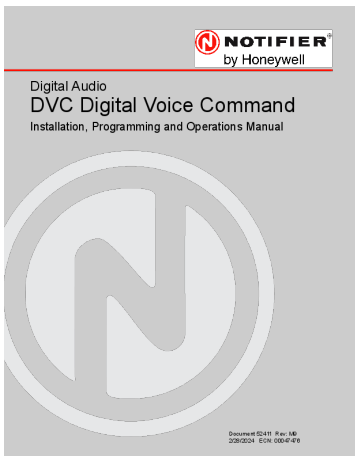

[pdf]

User Manual Documentation Guide

Digital Voice Command book Notifier DVC fire alarm control panel manual covering installation operations

programming 2024 edition notifier facp dvc em and empcc detection safety smoke detector suppression

emergency systems building automation life documentation user guide installati Manuals 88 Free

Downloads FACP Manualsv1docs facpmanuals manuals |||

Digital Audio DVC Digital Voice Command Installation, Programming and Operations


Manual Document 524 ... Programming, Operations Manual 51330, 51345, 51344

NCA Network Control Annunciator Manual 51482 **NCA-2** Network Control

Annunciator Manual 52482 NCD Network Control Display LS10210-051NF-E

ONYXW...

lang:en score:32 filesize: 3.86 M page_count: 104 document date: 2025-02-18

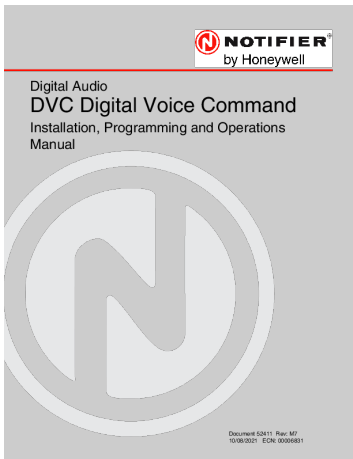

[\[pdf\] User Manual](#)


52411 M7 book E654326 DVC Digital Voice Command ba fire false prod edam honeywell content dam

hbt en us documents manuals and guides installation notifier |||

Digital Audio DVC Digital Voice Command Installation, Programming and Operations Manual Document 524 ... Programming, Operations Manual 51330, 51345, 51344

NCA Network Control Annunciator Manual 51482 **NCA-2** Network Control Annunciator Manual 52482 NCD Network Control Display LS10210-051NF-E ONYXW...

lang:en **score:32** filesize: 3.85 M page_count: 104 document date: 2021-12-07

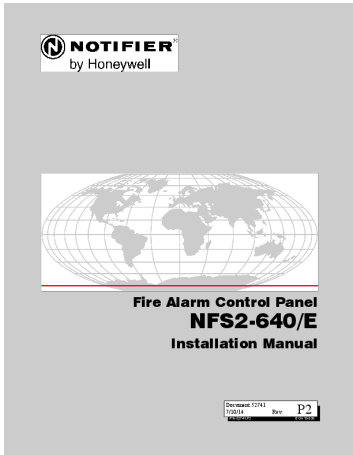

[\[pdf\] User Manual Datasheet Documentation Guide](#)

untitled Notifier NFS2 640 E fire alarm control panel manual covering installation 2014 edition notifier facp

nfs2 e detection safety smoke detector suppression emergency systems building automation life


documentation technical reference user guide programming Datasheet Manuals 88 Free Downloads

FACP Manualsproxycdocs facpmanuals manuals backup 2025 07 02T14 52 41 244Z |||

Fire Alarm Control Panel NFS2-640/E Installation Manual Document 52741 7/10/14 P/N 52741:P2 Rev: ... Display Unit25

3.5.2: Using **NCA-2** as Primary Display

lang:en **score:32** filesize: 2.93 M page_count: 78 document date: 2014-08-08

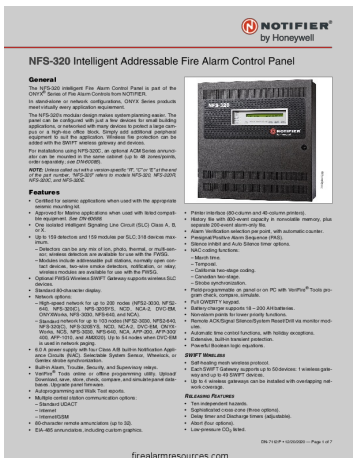

[NOTIFIER NFS-320 Intelligent Addressable Fire Alarm Control Panel Datasheet](#)

Comprehensive details on the NOTIFIER NFS-320 Intelligent Addressable Fire Alarm Control Panel, part of the ONYX Series. Covers features, specifications, networking, compatible devices, and intelligent sensing capabilities for advanced fire alarm systems.

lang:en **score:32** filesize: 943.49 K page_count: 7 document date: 2022-02-15



[Notifier ACM-8R Relay Module: Technical Overview and Specifications](#)

Detailed overview of the Notifier ACM-8R Relay Module, a component for ACS class fire alarm control panels, including features, specifications, mounting, and agency approvals.

lang:en **score:32** filesize: 665.33 K page_count: 2 document date: 2022-02-18

04-04-08 11:57:17

SCS Series

Smart Control Station SCS-A, SCS-E, SCS-IE, SCS-EE

NOTIFIER
by Honeywell

Accession number

Overview

The SCS series Smart Control Stations include the SCS-A and SCS-E (SCS-A includes a battery) and the SCS-IE and SCS-EE (SCS-IE includes a battery). These stations are compatible for the NOTIFIER 5W2000 and 5W2000L fire alarm control panels. The SCS-A and SCS-E series stations are compatible with the NOTIFIER 5S2000 and 5S2000L series stations.

Each SCS control station and receiver signal path device has 4 control lines for expansion in groups of 4 control lines. The SCS-A and SCS-E series stations have 4 control lines for expansion per interface to a total of 16 signal paths. The SCS-IE and SCS-EE series stations have 4 control lines for expansion per interface to a total of 16 signal paths. The SCS-A and SCS-E series stations are compatible with NOTIFIER receivers, including a 4-line receiver and NOTIFIER 5S2000L receivers. The SCS-IE and SCS-EE series stations are configured with a 4-line control signal path, receiver and a 4-line SCS-IE receiver.

Features

The SCS-A/SCS-E and SCS-IE/SCS-EE are capable of up to 16 control lines for expansion. Possibilities for Receiver Control Signal Path: 4, 8, 16, 32, 64, 128, 256, 512, 1024, 2048, 4096 and 8192.

SCS-A/SCS-E

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• 4 control lines for expansion to 16 signal paths

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

• NOTIFIER Receiver (Select)

NOTIFIER 5W2000L

[illegible][illegible][illegible]

[\[pdf\]](#) Instructions Specifications Datasheet

alarm manuals documents installation instructions and technical specifications tmstv 1676770738
firealarmresources 23741 ||

SCS Series Smoke Control Station SCS-8, SCE-8, SCS-8L, SCE-8E DN-4818:B D-170 General SCS series Smoke Control Stations include the SCS-8 and SCE-8 Smoke control modules and the SCS-8L and SCE-8L lamp driver versions. These products are used with the Notifier NFS2-3030 panel or the **NCA-2** network ...

[\[pdf\]](#) Instructions Specifications

Click here to Notifier ABS Confirmation of Product Type Approval NFS2 3030 Fire Alarm Resources Free
fire alarm manuals documents installation instructions and technical specifications tmstv 1676770119
firealarmresources 24027 |||

Certificate Number: 16-HS1551271-PDA 04/JAN/2017 Confirmation of Product Type
Approval Please refer ... ence, Declaration of Conformity, Revision: -, Pages: 1
Identifying Data ref Task 863505 916025 : **NCA-2** Instruction Manual Document No.
52482 Rev. H1; Modbus Gateway Installation and Operation Manua...
lang:en score:31 filesize: 615.27 K page_count: 3 document date: 2022-02-17

[\[pdf\]](#) Instructions Specifications

DN 7070 P fm E451217 Click here to Notifier NFS2 3030 Intelligent Addressable Fire Alarm System
Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv
1676770338 firealarmresources 23095 |||

NFS2-3030 Intelligent Addressable Fire Alarm System DN-7070:P A-10 General The
NFS2-3030 is an in ... work options: High-speed network for up to 200 nodes NFS2-
3030, NFS2-640, NFS-320 C , NFS-320SYS, **NCA-2**, DVC-EM, ONYXWorks, NFS-
3030, NFS-640, and NCA . Standard network for up to 103 nodes NFS2-3...

lang:en score:31 filesize: 908.84 K page_count: 8 document date: 2022-02-19

[\[pdf\]](#) Instructions Specifications

untitled e650889 Click here to Notifier BACNET GW 3 BACnet Gateway Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmtsv 1676769980 firealarmresources 24073 |||

BACNET-GW-3 BACnet Gateway DN-6877:C A0-190 General The BACNET-GW-3 provides an interface between ... nels. NFS-320, NFS2-640, NFS23030. ONYXWorks™ Workstation. Other Devices. Digital Voice Command, **NCA-2**, NWS-3, MODBUS-GW, NFN-GW-EM-3, PC NFN Gateways, VESDAHLI-GW. Standard and High-speed NOTIFIR...

lang:en score:31 filesize: 792.13 K page_count: 2 document date: 2022-02-19



[pdf] Instructions Specifications

DN 7111 M fm e451217 Click here to Notifier NFS2 640 E Intelligent Addressable Fire Alarm System

Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv

1676768631 firealarmresources 22821 |||

NFS2-640 E Intelligent Addressable Fire Alarm System DN-7111:M A-13 General The

NFS2-640 intelli ... s are available for use with the FWSG. Standard 80-character display, 640-character large display **NCA-2** , or display-less a node on a network .

Network options: High-speed network for up to 200 n...

lang:en score:31 filesize: 1007.33 K page_count: 8 document date: 2022-02-19



VESDA-HLI-GW VESDA Gateway with VHX-1420-HFS Technical Specification

Technical overview of the VESDA-HLI-GW, a gateway connecting Xtralis VESDAnet and Honeywell NOTIFIER FIRE NET networks, detailing its features, compatibility, specifications, and network integration.

lang:en score:31 filesize: 840.49 K page_count: 2 document date: 2022-02-19



[pdf] Installation Guide Instructions Specifications

DN 60897 C fm e451217 Click here to Notifier PRN 7 Printer Fire Alarm Resources Free fire alarm

manuals documents installation instructions and technical specifications tmstv 1676770845

firealarmresources 23817 |||

PRN-7 Printer DN-60897-C G-156 General The PRN-7 printer is used with Notifier

fire alarm control panels FACP's with printer capability to provide a written record of system events and status changes. In NOTIFIENET™ applications, PRN-7 can be used with the **NCA-2**, NCA, Onyxworks. Peripheral De...

lang:en score:31 filesize: 660.32 K page_count: 2 document date: 2022-02-15

[\[pdf\]](#) User Manual Instructions Specifications

DN 60686 a1 fm E451217 Click here to Notifier UDACT 2 Universal Digital Alarm Communicator

Transmitter Fire Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676770090 firealarmresources 24467 |||

UDACT-2 Universal Digital Alarm Communicator Transmitter DN-60686:A1 General
The Universal Digital Alarm Communicator Transmitter UDACT2 is designed for use
on Notifier Fire Alarm Control Panels and on the **NCA-2** Network Control Annunciator.
When used in conjunction with the **NCA-2** network control...

lang:en score:31 filesize: 711.54 K page_count: 2 document date: 2022-02-18

[\[pdf\]](#) Instructions Specifications

51690 C pmd wendyf Click here to Notifier VeriFire Tools CD Insert Fire Alarm Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv 1676679665

firealarmresources 24229 |||

Technical Manuals Online - <http://www.tech-man.com> eriFire™ Tools V T C Document
51690 12/10/2003 Rev: ECN 03-487 firealarmresources.com eriFire™ T V VeriFire
Tools allows you to create and edit databases for NOTIFIER ONYX™ Series Fire
Alarm Control Panels FACP and the NCA Network Contr...

lang:en score:31 filesize: 1.03 M page_count: 12 document date: 2022-02-19

[\[pdf\]](#) Instructions Specifications

2013 ProjectProfile Derryfield indd E315024 Click here to Notifier Project Profile School Fire Alarm

Resources Free fire alarm manuals documents installation instructions and technical specifications tmstv
1676770098 firealarmresources 23179 |||

Project Profile Derryfield School SUCCESS STORY Since its start in 1964, The Derryfield School in M ... from many buildings or locations. To offer more immediate access to real time network information, **NCA-2** Network Control Annunciators were installed at each building s main entrance, plus one was ins...

lang:en score:31 filesize: 993.56 K page count: 2 document date: 2022-02-17

[\[pdf\]](#) Instructions Specifications

DN 7113 fm E652336 [Click here to Notifier NWS 2 NOTI FIRE NET Web Server Fire Alarm Resources](#)

Free fire alarm manuals documents installation instructions and technical specifications tmstv
1676770257 firealarmresources 23365 |||

NWS-2 NOTIFIRENETTM Web Server-2 DN-7113 A0-141 General The NOTIFIRENETTM Web Server-2 NWS-2 is ... ort for remote programming/configuration of the NWS-2 with ONYX Series NFS-640, NFS/NFS2-3030, NCA, **NCA-2** . Event Refresh, if enabled, allows the event list to refresh itself at the specified time in...

lang:en score:31 filesize: 1 M page count: 2 document date: 2022-02-17

[illegible][illegible][illegible]

[NOTIFIER NFS-320C Intelligent Addressable Fire Alarm Control Panel | Datasheet & Features](#)

Explore the NOTIFIER NFS-320C Intelligent Addressable Fire Alarm Control Panel.

This datasheet covers its advanced features, ONYX intelligent sensing, FLASHSCAN protocol, network capabilities, and comprehensive device compatibility.

lang:en score:30 filesize: 721.25 K page_count: 6 document date: 2022-02-19

Notifier NFS-320 Intelligent Addressable Fire Alarm System Datasheet

Comprehensive datasheet for the Notifier NFS-320 Intelligent Addressable Fire Alarm System, detailing its features, intelligent sensing capabilities, FlashScan protocol, system specifications, compatible devices, and agency approvals.

lang:en score:30 filesize: 1007.92 K page_count: 6 document date: 2022-02-19

Notifier NCD Network Control Display: Features and Specifications

Explore the Notifier NCD Network Control Display, a next-generation annunciator for the NOTI FIRE NET network. Learn about its advanced features, hardware capabilities, and system integration for fire alarm control.

lang:en score:30 filesize: 795.71 K page count: 2 document date: 2022-02-15




[\[pdf\]](#) Instructions Specifications Borchure

Flexible Network 2010 rev Layout 1 qxd e315024 Click here to Notifier Networking and Integration Brochure Fire Alarm Resources Free fire alarm manuals documents installation instructions technical specifications tmstv 1676769601 firealarmresources 23651 |||

NETWORKING AND INTEGRATION firealarmresources.com NOTIFIER NETWORKING AND INTEGRATION FLEXIBLE, S ... le node from compromising other panels. The result is greater system survivability. FirstVision™ **NCA-2** ONYXWorks Workstation NWS NOTIFIER Fire Panels EASILY ACCOMMODATES FUTURE GROWTH NOTI-FIRE-N...

lang:en score:30 filesize: 1.39 M page_count: 6 document date: 2022-02-17

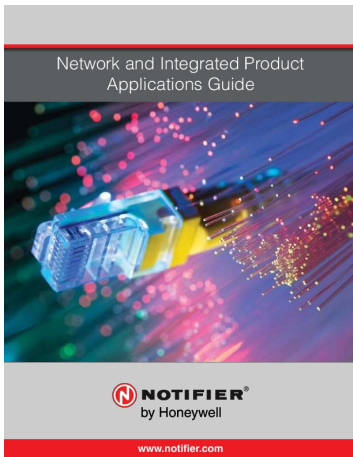

[NOTIFIER Network and Integrated Product Applications Guide](#)

A comprehensive guide to NOTIFIER's network and integrated product solutions for fire alarm systems and emergency communications, covering NCA-2, NOTI-FIRE-NET, ONYXWorks, and ECS components.

lang:en score:29 filesize: 1.78 M page_count: 32 document date: 2025-02-22