



## aspar Mini Modbus 4DI Expansion Module User Manual

[Home](#) » [aspar](#) » aspar Mini Modbus 4DI Expansion Module User Manual 

aspar Mini Modbus 4DI Expansion Module



## Contents

- 1 Introduction
- 2 Safety rules
- 3 Module Features
  - 3.1 Purpose and description of the module
  - 3.2 Technical Specifications
  - 3.3 Dimensions of the product
- 4 Communication configuration
  - 4.1 Grounding and shielding
  - 4.2 Network Termination
  - 4.3 Types of Modbus Registers
  - 4.4 Communication settings
- 5 Indicators
- 6 Block diagram
- 7 Module Connection
- 8 Modules Registers
  - 8.1 Registered access
  - 8.2 Bit access
- 9 Configuration software
- 10 Customer Support
- 11 Documents / Resources
- 12 Related Posts

## Introduction

Thank you for choosing our product.

This manual will help you with proper support and proper operation of the device.

The information contained in this manual have been prepared with utmost care by our professionals and serve as a description of the product without incurring any liability for the purposes of commercial law.

This information does not release you from the obligation of own judgement and verification.

We reserve the right to change product specifications without notice.

Please read the instructions carefully and follow the recommendations contained therein.



### **WARNING!**

Failure to follow instructions can result in equipment damage or impede the use of the hardware or software.

## Safety rules

- Before first use, refer to this manual
- Before first use, make sure that all cables are connected properly
- Please ensure proper working conditions, according to the device specifications (eg: supply voltage, temperature, maximum power consumption)
- Before making any modifications to wiring connections, turn off the power supply

## Module Features

### **Purpose and description of the module**

4DI Module is an innovative device that provides a simple and cost-effective extension of the number of lines of

input in popular PLCs.

The module has 4 digital inputs with configurable timer/counter option, which allow to connect two encoders. All inputs are isolated from the logic by optocouplers. Each channel can be individually configured in one of several modes.

his module is connected to the RS485 bus with twisted-pair wire.

Communication is via MODBUS RTU or MODBUS ASCII. The use of 32-bit ARM core processor provides fast processing and quick communication. The baud rate is configurable from 2400 to 115200.

The module is designed for mounting on a DIN rail in accordance with DIN EN 5002.

The module is equipped with a set of LEDs used to indicate the status of inputs and outputs useful for diagnostic purposes and helping to find errors.

Module configuration is done via USB by using a dedicated computer program.

You can also change the parameters using the MODBUS protocol.


#### Technical Specifications

<b>Power Supply</b>	Voltage	10-38VDC; 20-28VAC
	Maximum Current*	62 mA @ 12V / 35 mA @ 24V
<b>Digital Inputs</b>	No of inputs	4
	Voltage range	0 – 36V
	Low State „0”	0 – 3V
	High State „1”	6 – 36V
	Input impedance	4kΩ
	Isolation	1500 Vrms
	Input Type	PNP or NPN
<b>Counters</b>	No	4
	Resolution	32 bits
	Frequency	1kHz (max)

	Impulse Width	500 $\mu$ s (min)
<b>Temperature</b>	Work	-10 °C – +50°C
	Storage	-40 °C – +85°C
<b>Connectors</b>	Power Supply	3 pin
	Communication	3 pin
	Inputs	2 x 3 pin
	Configuration	Mini USB
<b>Size</b>	Height	90 mm
	Length	56 mm
	Width	17 mm
<b>Interface</b>	RS485	Up to 128 devices

#### Dimensions of the product

Look and dimensions of the module are shown below. The module is mounted directly to the rail in the DIN industry standard.

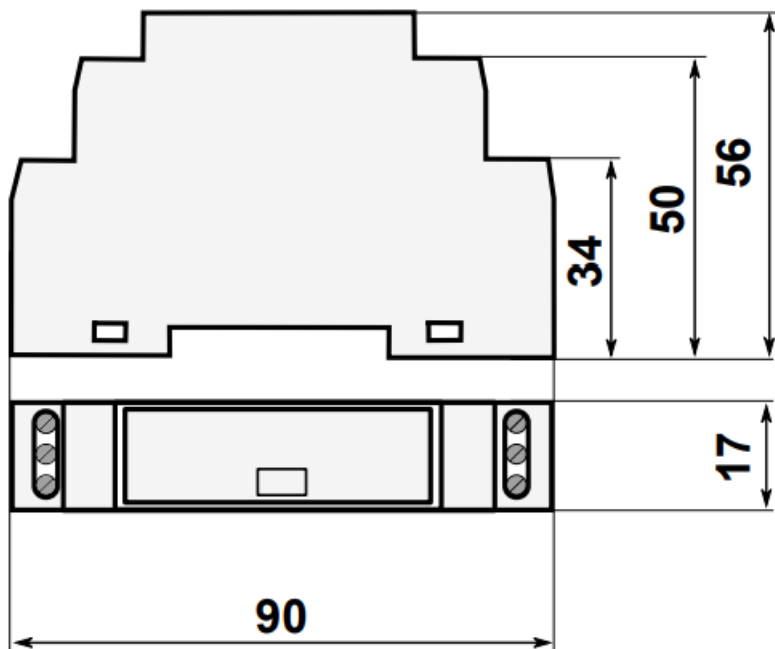

## Communication configuration

### Grounding and shielding

In most cases, IO modules will be installed in an enclosure along with other devices which generate electromagnetic radiation. Examples of these devices are relays and contactors, transformers, motor controllers etc. This electromagnetic radiation can induce electrical noise into both power and signal lines, as well as direct radiation into the module causing negative effects on the system. Appropriate grounding, shielding and other protective steps should be taken at the installation stage to prevent these effects. These protective steps include control cabinet grounding, module grounding, cable shield grounding, protective elements for electromagnetic switching devices, correct wiring as well as consideration of cable types and their cross sections.

### Network Termination

Transmission line effects often present a problem on data communication networks. These problems include reflections and signal attenuation.

To eliminate the presence of reflections from the end of the cable, the cable must be terminated at both ends with a resistor across the line equal to its characteristic impedance. Both ends must be terminated since the direction of propagation is bidirectional. In the case of an RS485 twisted pair cable this termination is typically 120  $\Omega$ .

### Types of Modbus Registers

There are 4 types of variables available in the module

Type	Beginning address	Variable	Access	Modbus Command
1	00001	Digital Outputs	Bit Read & Write	1, 5, 15
2	10001	Digital Inputs	Bit Read	2
3	30001	Input Registers	Registered Read	3
4	40001	Output Registers	Registered Read & Write	4, 6, 16

#### Communication settings

The data stored in the modules memory are in 16-bit registers. Access to registers is via MODBUS RTU or MODBUS ASCII.

#### Default settings

Parameter name	Value
Address	1
Baud rate	19200
Parity	No
Data bits	8
Stop bits	1
Reply Delay [ms]	0
Modbus Type	RTU

#### Configuration registers


Modbus	Dec	Hex	Name	Values
Address				
40003	2	0x02	Baud rate	0 – 2400 1 – 4800 2 – 9600 3 – 19200 4 – 38400 5 – 57600 6 – 115200 other – value * 10
40005	4	0x04	Parity	0 – none 1 – odd 2 – even 3 – always 1 4 – always 0
40004	3	0x03	Stop Bits LSB	1 – one stop bit 2 – two stop bits
40004	3	0x03	Data Bits MSB	7 – 7 data bits 8 – 8 data bits
40006	5	0x05	Response delay	Time in ms
40007	6	0x06	Modbus Mode	0 – RTU 1 – ASCII

## Indicators




Indicator	Description
ON	LED indicates that the module is correctly powered.
TX	The LED lights up when the unit received the correct packet and sends the answer.
1, 2, 3, 4	LED indicates that on the input is high state.

Block diagram

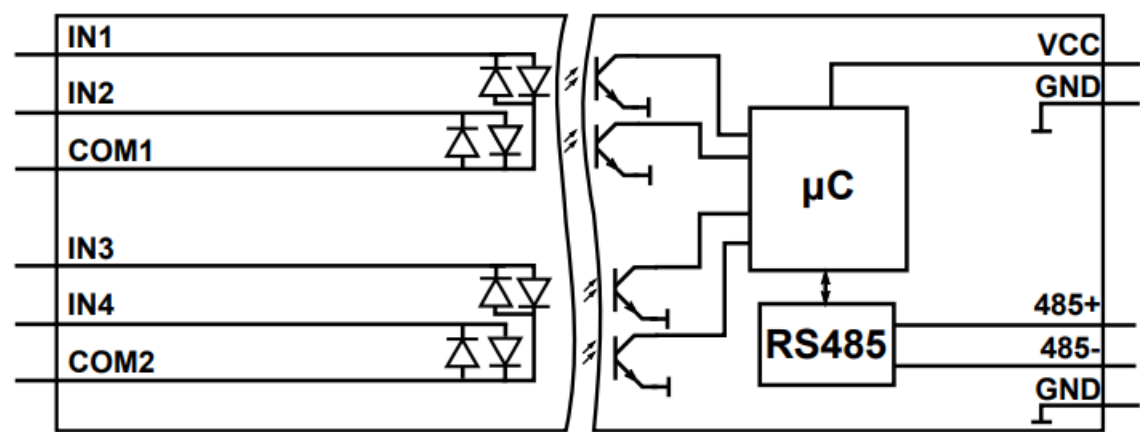

Module Connection

input connection

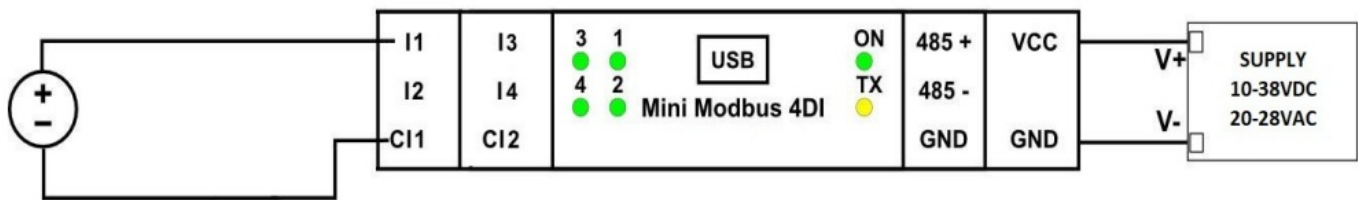

Modules Registers

Registered access

Modbus	Dec	Hex	Register Name	Access	Description
--------	-----	-----	---------------	--------	-------------



30001	0	0x0 0	Version/Type	Read	Version and Type of the device
30002	1	0x0 1	Address	Read	Module Address
40003	2	0x0 2	Baud rate	Read & Write	RS485 baud rate
40004	3	0x0 3	Stop Bits & Data Bits	Read & Write	No of Stop bits & Data Bits ( <a href="#">see 3.4.2</a> )
40005	4	0x0 4	Parity	Read & Write	Parity bit
40006	5	0x0 5	Response Delay	Read & Write	Response delay in ms
40007	6	0x0 6	Modbus Mode	Read & Write	Modbus Mode (ASCII or RTU)
40009	8	0x0 8	Watchdog	Read & Write	Watchdog
40033	32	0x2 0	Received packets LSB	Read & Write	No of received packets
40034	33	0x2 1	Received packets MSB	Read & Write	
40035	34	0x2 2	Incorrect packets LSB	Read & Write	No of received packets with error
40036	35	0x2 3	Incorrect packets MSB	Read & Write	
40037	36	0x2 4	Sent packets LSB	Read & Write	No of sent packets
40038	37	0x2 5	Sent packets MSB	Read & Write	
30051	50	0x3 2	Inputs	Read	Inputs state
40053	52	0x3 4	Counter 1 LSB	Read & Write	

40054	53	0x3 5	Counter 1 MSB	Read & Write	32-bit counter 1
40055	54	0x3 6	Counter 2 LSB	Read & Write	32-bit counter 2
40056	55	0x3 7	Counter 2 MSB	Read & Write	
40057	56	0x3 8	Counter 3 LSB	Read & Write	32-bit counter 3
40058	57	0x3 9	Counter 3 MSB	Read & Write	
40059	58	0x3 A	Counter 4 LSB	Read & Write	32-bit counter 4
40060	59	0x3 B	Counter 4 MSB	Read & Write	
40061	60	0x3 C	CCounter 1 LSB	Read & Write	32-bit value of captured counter 1
40062	61	0x3 D	CCounter 1 MSB	Read & Write	
40063	62	0x3 E	CCounter 2 LSB	Read & Write	32-bit value of captured counter 2
40064	63	0x3 F	CCounter 2 MSB	Read & Write	
40065	64	0x4 0	CCounter 3 LSB	Read & Write	32-bit value of captured counter 3
40066	65	0x4 1	CCounter 3 MSB	Read & Write	
40067	66	0x4 2	CCounter 4 LSB	Read & Write	32-bit value of captured counter 4
40068	67	0x4 3	CCounter 4 MSB	Read & Write	
40069	68	0x4 4	Counter Config 1	Read & Write	


40070	69	0x4 5	Counter Config 2	Read & Write	Counter Configuration +1 – time measurement (if 0 counting impulse s) +2 – autocatch counter every 1 sec +4 – catch value when input low +8 – reset counter after catch +16 – reset counter if input low +32 – encoder
40071	70	0x4 6	Counter Config 3	Read & Write	
40072	71	0x4 7	Counter Config 4	Read & Write	
40073	72	0x4 8	Catch	Read & Write	Catch counter
40074	73	0x4 9	Status	Read & Write	Captured counter

#### Bit access

<b>Modbus Address</b>	<b>Dec Address</b>	<b>Hex Address</b>	<b>Register name</b>	<b>Access</b>	<b>Description</b>
10801	800	0x320	Input 1	Read	Input 1 state
10802	801	0x321	Input 2	Read	Input 2 state
10803	802	0x322	Input 3	Read	Input 3 state
10804	803	0x323	Input 4	Read	Input 4 state
1153	1152	0x480	Capture 1	Read & Write	Capture counter 1
1154	1153	0x481	Capture 2	Read & Write	Capture counter 2
1155	1154	0x482	Capture 3	Read & Write	Capture counter 3
1156	1155	0x483	Capture 4	Read & Write	Capture counter 4
1169	1168	0x490	Captured 1	Read & Write	Captured value of counter 1
1170	1169	0x491	Captured 2	Read & Write	Captured value of counter 2
1171	1170	0x492	Captured 3	Read & Write	Captured value of counter 3
1172	1171	0x493	Captured 4	Read & Write	Captured value of counter 4

## Configuration software

Modbus Configurator is software that is designed to set the module registers responsible for communication over Modbus network as well as to read and write the current value of other registers of the module. This program can be a convenient way to test the system as well as to observe real-time changes in the registers. Communication with the module is done via the USB cable. The module does not require any drivers.

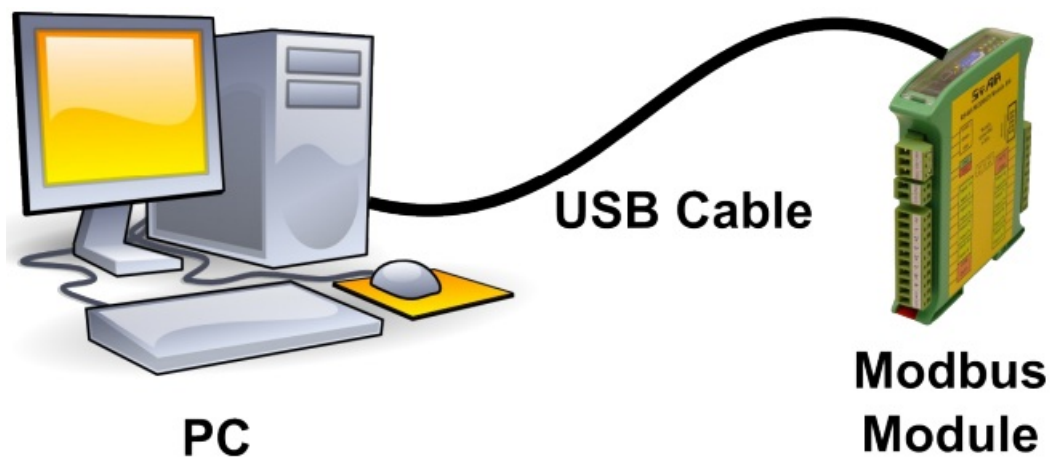

Configurator is a universal program, whereby it is possible to configure all available modules.

The screenshot shows the 'Konfigurator' application window. It has tabs for 'Transmisja', 'Moduł 8180', 'Moduł 16I', 'Moduł 16O', and 'Info'. The 'Moduł 16I' tab is selected. The main area is titled 'Konfiguracja wejść i liczników' (Input and Counter Configuration). It contains a table for configuring 8 counters and a section for output configuration.

	Stan licznika	Przechwycona wartość	Przechwyć	Status	Konfiguracja licznika
Licznik 1	290330	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 2	101614	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 3	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 4	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 5	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 6	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 7	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj
Licznik 8	0	0	<input type="checkbox"/>	<input type="checkbox"/>	Konfiguruj

Below the table, there is a 'Konfiguracja wyjść' (Output Configuration) section with checkboxes for 'Stan wyjść' and 'Domyślny stan wyjść', and a 'Watchdog' field set to 0.

## Customer Support

Manufactured for:  
**Aspar s.c.**  
 ul. Oliwska 112  
 80-209 chwaszczyno  
 Poland


[ampero@ampero.eu](mailto:ampero@ampero.eu)  
[www.ampero.eu](http://www.ampero.eu)

Tel. +48 58 351 39 89; +48 58 732 71 73





## Documents / Resources

 <p>Mini Modbus 4DI Expansion Module - 4 Digital Inputs 16mm D-Sub</p> <p>CE</p> <p>aspar</p>	<p><a href="#">aspar Mini Modbus 4DI Expansion Module</a> [pdf] User Manual Mini Modbus 4DI, Expansion Module, Mini Modbus 4DI Expansion Module, Module</p>
--	---

Manuals+.