

atop Technologies IEC61850 Protocol Gateway Client or Server Configuration User Manual

Home » atop Technologies » atop Technologies IEC61850 Protocol Gateway Client or Server Configuration User Manual



Atop Technologies, Inc.
Protocol Gateway
IEC61850 Client/Server
Protocol and
eNode Designer configuration
eNode Configuration
V1.5
December 8 th, 2022

Contents

- 1 IEC61850 Protocol Gateway Client or Server Configuration
- 2 Introduction
- **3 General Description**
- 4 IEC 61850 ADH Application Configuration Guide
- **5 Reference Guide**
- 6 Protocol Implementation Conf. Statement (PICS)
- 7 Documents / Resources
 - 7.1 References

IEC61850 Protocol Gateway Client or Server Configuration

This PDF Document contains internal hyperlinks for ease of navigation. For example, click on any item listed in the Table of Contents to go to that page

- IEC 61850 Configuration Guide
- IEC 61850 Interoperability

Published by:

Atop Technologies, Inc.

2F, No. 146, Sec. 1, Tung-Hsing Rd, 30261 Chupei City, Hsinchu County Taiwan, R.O.C.

Tel: +886-3-550-8137 Fax: +886-3-550-8131 www.atoponline.com www.atop.com.tw

Important Announcement

The information contained in this document is the property of Atop technologies, Inc., and is supplied for the sole purpose of operation and maintenance of Atop Technologies, Inc., products.

No part of this publication is to be used for any other purposes, and it is not to be reproduced, copied, disclosed, transmitted, stored in a retrieval system, or translated into any human or computer language, in any form, by any means, in whole or in part, without the prior explicit written consent of Atop Technologies, Inc.Offenders will be held liable for damages and prosecution.

All rights, including rights created by patent grant or registration of a utility model or design, are reserved.

Disclaimer

We have checked the contents of this manual for agreement with the hardware and the software described. Since deviations cannot be precluded entirely, we cannot guarantee full agreement. However, the data in this manual is reviewed regularly and any necessary corrections will be included in subsequent editions.

Suggestions for improvement are welcome.

All other product's names referenced herein are registered trademarks of their respective companies.

Documentation Control

Author:	Charlie Yeh
Revision:	1.5
Revision History:	Features improvement
reation Date:	12 September
Last Revision Date:	8-December -22
Reviewer	Simon Huang
Product Reference:	PG59XX Protocol Gateways
Document Status:	Release

Introduction

Thank you for Buying Atop's Protocol Gateway.

The product is bundled with the following three user manuals:

- 1. Hardware specific installation user manual- not covered in this document. It covers Atop's hardware installation procedure, wiring, power connection etc.
- 2. Getting started with Atop's Protocol Gateway user manual configuration tool introduction, web configuration, software architecture introduction– not covered in this document. This manual covers the introduction,

installation, network set-up aintenance and using of the configuration tool software, including the procedure to be followed for uploading new configurations to Atop's device.

- 3. Protocol specific user manual (This Manual). One protocol-specific manual will be provided for each protocol installed on the device. This manual covers:
 - a. Basic device network configuration
 - b. Step-by-step protocol set-up for in eNode designer
 - c. Description of the protocol-specific software features, the device profile and the implementation table of supported functionalities.

This manual is for IEC 61850 Client/Server and describes how to use the IEC 61850 eNode Designer Module to configure Atop's IEC 61850 ADH Application within the eNode Designer configuration tool.

1.1 Scope

This document is divided into 3 major sections:

- · Overview with General Description; and a
- IEC 61850 ADH Application Configuration Guide
- IEC 61850 ADH Application Interoperability

EC 61850 Standard related information and the IEC 61850 Standard itself is not part of the scope of this document, so it is assumed the user to have some basic knowledge about the protocol. For more detailed information on the IEC 61850 Standard visit the official IEC website on http://www.iec.ch

This manual assumes that reader has some basic knowledge of the IEC 61850 standard documents and protocol. The following is the document list:

IEC 61850 Docu ment Part	Description
IEC 61850-1	Introduction and overview
IEC 61850-2	Glossary
IEC 61850-3	General requirements
IEC 61850-4	System and project management
IEC 61850-5	Communication requirements for functions and device models
IEC 61850-6	Configuration description language for communication in electrical substations related to IE D's
IEC 61850-7-1	Basic communication structure for substation and feeder equipment – Principles and model s
IEC 61850-7-2	Basic communication structure for substation and feeder equipment – Abstract communication service interface (ACSI)
EC 61850-7-3	sic communication structure for substation and feeder equipment – Common data classe
IEC 61850-7-4	Basic communication structure for substation and feeder equipment – Compatible logical node classes and data classes
IEC 61850-8-1	Specific communication service mapping (SCSM) – Mappings to MMS (ISO/IEC 9506-1 and USO/IEC 9506-2) and to ISO/IEC 8802-3
IEC 61850-9-1	Specific communication service mapping (SCSM) – Sampled values over serial unidirection al multi-drop point-to-point link
IEC 61850-9-2	Specific communication service mapping (SCSM) – Sampled values over ISO/IEC 8802-3 2
IEC 61850-10	Conformance testing
IEC 61850-801 Ed. 1.0	Communication networks and systems for power utility automation – Part 80-1: Guideline to exchange information from a CDC based data model using IEC 60870-5-101/104

1.2 Overview

1.2.1 Document Reference

1. Document Title: 197-0100 eNode Designer User Manual Revision: Version 1.00

1.2.2 List of Abbreviations

ADH	=Application Data Hub
DA	=Data Attribute
IEC	=International Electrotechnical Commission
IED	=Intelligent Electronic Device
SCL	=Substation Configuration Language

General Description

The IEC 61850 eNode Designer Module uses a pre-existing SCL file for configuration; the configuration tool's primary action is to select which data points should be added to or mapped from the ADH database.

When an SCL file is loaded into eNode Designer, a copy is automatically saved in the eNode Designer project file. This allows the project file to be sent (e.g. email) and opened anywhere without the need to send the SCL file as well.

The generation or the editing of the SCL file (ICD designer) is not covered inside this manual. For SCL file creation or editing, please contact an Atop Technologies representative

2.1 General Screen Description

Once an SCL file has been imported, a view similar to the following will be shown. The tab section allows the user to browse the local IED versus the connected remote IEDs.

In the client, there are no configuration options for the local IED so that tab will not be displayed. It just has a tab of remote IEDs showing all the servers connected.

In the server, the local IED is configurable so that tab is shown. In 61850 servers, the only data points should be accessed access from remote IEDs are those published on GOOSE, so the remote IEDs tabbed is named "GOOSE subscription".




Figure 2-1 - View of a newly loaded server SCL file.

- Tabs Local IEDs will be separate from Remote IEDs. See details above.
- SCL Tree Windowpane This shows the Project Tree of the currently selected IED. The tick-boxes allow for selection of data points for mapping. Expand the branches to view further down the project tree.
- Mapped Points This is where the points that have been mapped will appear. Each row in this table corresponds to a single "ticked" leaf DA node in the tree.

2.2 SCL Tree Explanation

The SCL file given is expanded into a tree-view showing different levels of IED, Logical Devices, Logical Nodethen into Data Objects and Data Attributes. The "final" nodes are mappable data points. A screen shot is shown below.

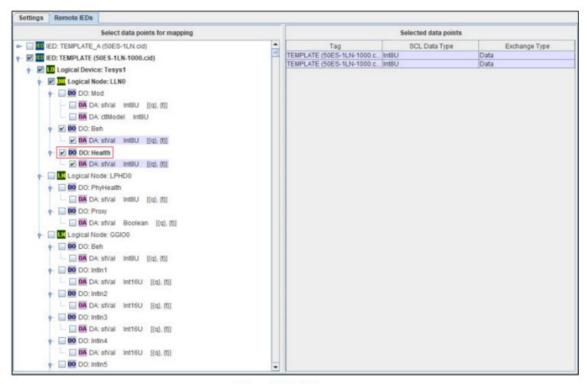


Figure 2-2 - Main screen.

Each mappable point has a description of its data type, which is extracted from the SCL file. A zoomed-in portion of the tree is shown below along with a more detailed description of the components.

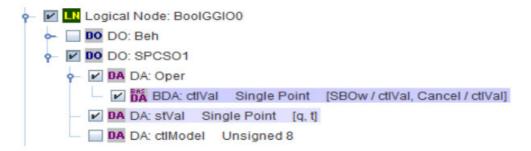


Figure 2-3 - Main screen of a single logical node.

For example with this BoolGGIO0/SPCSO1/stVal, the tree node text contains information about its node type (DA), node name (stVal), ADH Data Type (Single Point), and in this case also some square bracket notation. The square bracket notation shows that the q and t DAs are bound with the stVal data point. This is explained further in section 2.3.

The data type of the point is extracted from the IEC 61850 data type (e.g. "BOOLEAN" becomes "Single Point"). A special case is 61850 enumerated types, which are placed in the eNode Database as "Unsigned 8". Data types that the ADH does not support, such as string types, are not shown in the SCL tree at all.

2.3 Associated DAs are Combined into a Single Data Point

Every eNode Designer data point has an associated timestamp (when the data value changed) and quality flags. This is similar to how IEC 61850 works with q (quality) and t (timestamp) DAs being updated together with DAs such as stVal. Thus eNode Designer groups the q and t with the appropriate values according to the 61850 specification to the single eNode (a.k.a. ADH) data point. This means that the with the stVal eNode data point, the associated quality and time are mapped with the 61850 data attributes q and t.

Multi-stage commands (such as Select Before Operates) are represented as a single data point for mapping in eNode Designer. Thus, the 61850 Operate structures are combined to a single structure: the "Oper".

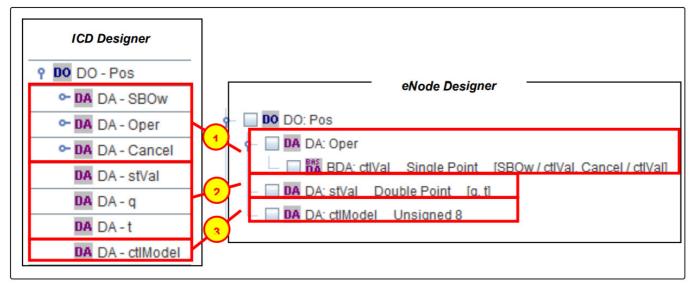


Figure 2-4 – Combined DAs, example one.

This figure contains a screenshot from ICD Designer and a screenshot from eNode Designer to illustrate how data points are grouped together within eNode Designer. Both images show the same Pos Data Object in a XCBR Logical Node.

DA: Oper – Shown in the ICD designer image as DA – SBOw, DA – Oper and DA – Cancel, these data attributes are all grouped as DA: Oper within eNode Designer. This point contains the ctlVal data points of DA – SBOw, DA – Oper and DA – Cancel. This is shown using the square brackets notation.

DA: stVal – According to IEC 61850 specification, q and t apply to stVal. They are separate DAs but they are grouped together in eNode Designer. This is shown using the square bracket notation after the "stVal": [q, t].

3

DA: ctlModel – This is only a single Data Point in both ICD designer and eNode Designer.

Another example is shown below. In this example, the q and t apply to the mag according to the 61850 specification. Any selected point "inside" this mag will have the q and t values associated with the mag combined into one data point.

For example, in this case, the mag\$i has its quality and time mapped with the 61850 q and t DAs adjacent to the mag.

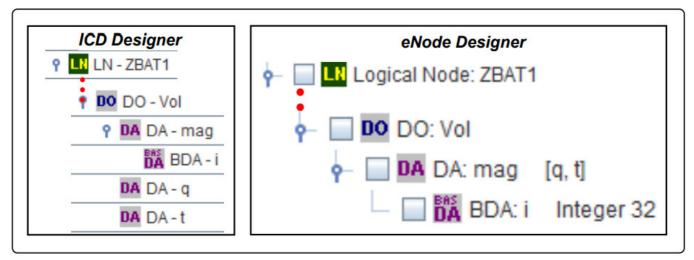


Figure 2-5 – Combined DAs, example two.

2.4 Replaces Ethernet Properties

When generating and sending the configuration to the target platform, the SCL's local IED Ethernet properties are

modified to match those specified in eNode Designer.

That is, the following attributes are changed in the Access Point associated with the first IED in the SCL file that is sent to the target device.

Attribute	Modification
<p type="IP"></p>	Replaced by Ethernet's property in eNode Designer
<p type="IP-SUBNET"></p>	Replaced by Ethernet's property in eNode Designer
<p type="IP-GATEWAY"></p>	Replaced by Ethernet's property in eNode Designer
<p type="MAC-Address"></p>	Removed. Obtained automatically.

Table 2-1 – Automatic IP Setting Modifications.

IEC 61850 ADH Application Configuration Guide

3.1 Adding the Module in eNode Designer

The IEC 61850 module can only be added to Ethernet ports. An IEC 61850 ADH Application can be set up as a Client or a Server. The choice will be presented when adding it to the project. Atop device supports one server application per protocol per device.

To add the module to the project, follow the steps explained below.

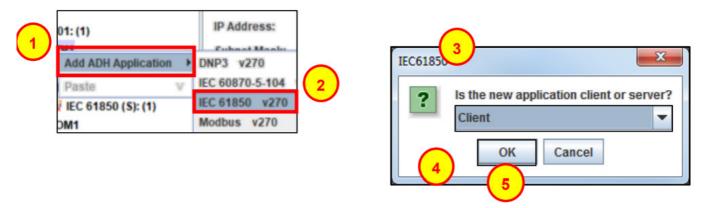


Figure 3-1 - Adding an IEC 61850 module to the project.

- Click Add ADH Application.
- Click IEC61850.
- This dialogue box will appear asking whether the new application is to be configured as a Client or a Server.
- Select either Client or Server from the drop down menu.
- 5 Click OK to add the application.

3.2 Common Configuration Details

After a new IEC61850 Server or Client is added, an SCL file needs to selected. The following pane will appear at the top centre of the screen for both IEC61850 Servers and Clients.



Figure 3-2 - SCL file selection.

SCL file – Shows location and name of the SCL file once it has been added to eNode Designer.

Browse – This button will bring up an Open File dialogue box to select the SCL file to be loaded for the ADH Application, see: Open SCL File Dialogue Box.

Reload File – This option is only available once a file has been loaded. Reload file is explained further in Changing and Reloading SCL Files.

3.2.1 Changing and Reloading SCL Files

When an SCL file is loaded into eNode Designer, it is saved into the eNode Designer project file. If the SCL file has been changed, a warning will appear next to Reload File, Left clicking the reload file button will load the changes into eNode Designer.



Figure 3-3 - Altered file warning.

Browse – This button can be used to change the current SCL file, however this will require confirming login details. This will bring up the Open File dialogue box to select the SCL file to be loaded for the ADH Application, see: Open SCL File Dialogue

Box. Altered File Warning – The exclamation mark within the yellow triangle will be shown when the currently loaded SCL file has been changed externally. This indicates that it will need to be reloaded to reflect those changes within eNode Designer.

3.3 Client Configuration

3.3.1 IEC 61850 Client – Select which data points to use in eNode Designer.

Once a Client SCL file has been imported, the following view will be shown. In this example, some of the SCL Tree has been expanded and some data points selected.

Selecting data attributes in the tree assigns eNode Data points to them. Each eNode data point is shown in the table on the right. All the data points in the table are those available in eNode Designer for mapping. All data point values have default values automatically assigned based on the SCL file. The Tag and Description are, however, changeable by the user.

Checking (or unchecking) a tree node will check (or uncheck) all tree nodes "inside" it.

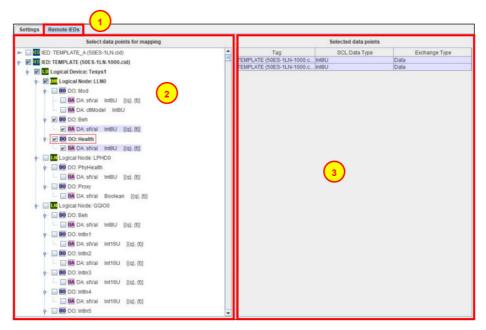


Figure 3-4 - Mapped client example.

Remote IEDs – This shows the Remote IED's connected to the client, all Remote IED's will show in this area under their respective IED tree nodes within the Project Tree Windowpane.

Project Tree Windowpane – This shows a tree view of all remote IEDs. The tick-boxes allow for selection of data points to be made available for mapping in the database. Expand the branches to view further down the project tree.

Selected Data Points – This is where the points selected for inclusion in the database will appear. Points that show in this area have been made available to the database and can be utilised by other applications.

3.4 Server Configuration

If the server SCL file has more than one IED in the file, the first one is the Local IED, and the rest are remote IEDs. The GOOSE subscription tab shows all remote IEDs. The way 61850 works, the only data points accessible in a server from remote IEDs are those that are published on GOOSE.

The IEC 61850 server application in some way acts like a server and a client. It is able to reference "client" points to and from the local IED, but also "produces" client points it puts in to the eNode Database from the remote IEDs.

3.4.1 IEC 61850 Server – Mapping Data Points to the Local IED

To select a DA to map, expand the tree down to the final level (the final DA) and tick the checkbox.


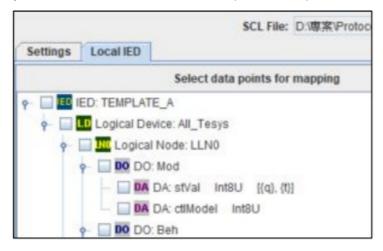


Figure 3-5 - To map, first browse to the desired point.

Selecting a point for mapping from eNode will bring up the following window. This window allows you to select which data point value to map to. Points are live mapped within the dialogue: as soon as a mapping is changed in this window, it is changed within eNode Designer.

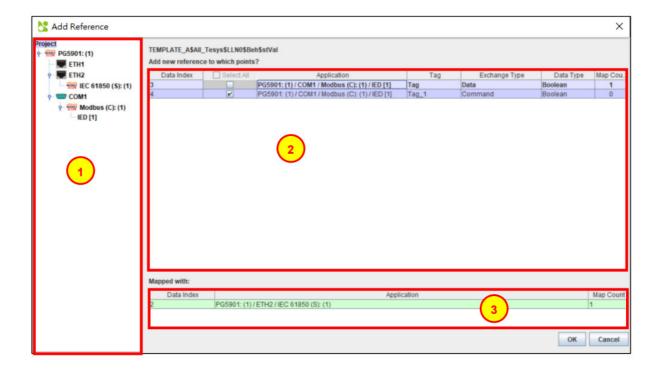

- Project Tree Windowpane This shows the eNode Designer project view. Use this to filter the list of available data points.
- Available Points This shows the list of possible points which can map to the given point.
- Mapped Points Shows the applications the selected point in (2) is currently mapped to. Once points have been mapped they are added to the table.

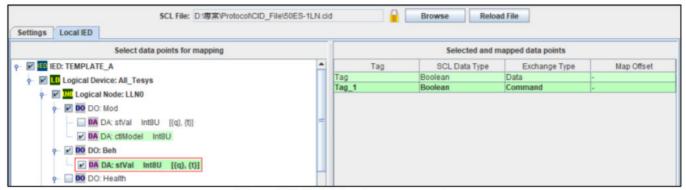


Figure 3-7 - Point has been mapped.

Reference Guide

4.1 Mass Tree Expanding and Collapsing

There are several options for expanding and collapsing many tree nodes at once.

Right click a tree node:

Expand All	Expands all tree nodes inside the tree node.
Collapse All	Collapses the tree nodes inside it and the tree node itself.
Collapse Below	Collapses the tree nodes inside it

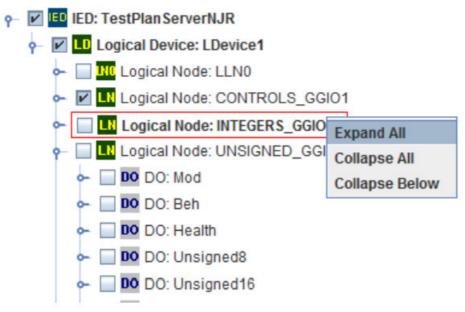


Figure 4-1 - SCL tree node context menu

Right click empty space in the SCL tree pane:

Expand Entire Tree	Expands the entire SCL tree. For very large files, it enforces a limit as a maximum number of nodes it will expand.
Collapse Entire Tree	Collapse the entire SCL tree.

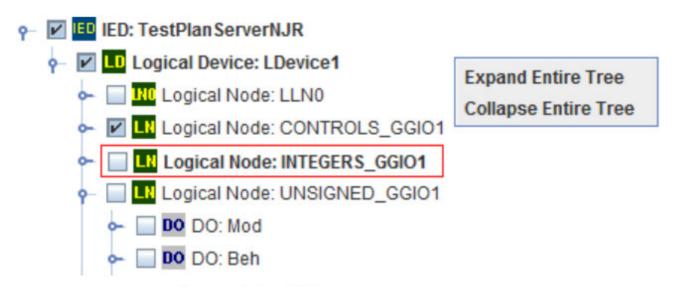


Figure 4-2 - SCL tree pane context menu

Protocol Implementation Conf. Statement (PICS)

5.1 IEC 61850 Protocol Implementation Conformance Statement

Protocol Implementation Conformance Statements (PICS) contain information regarding the Abstract Communication Service Interface (ACSI) {IEC61850-7-2 edition 2.0 2010-08} components that may be tested. This tick list is a summary of the ACSI that has not been implemented and has been implemented by Atop Technologies Inc.

The following ACSI conformance statements are used to provide an overview and details about the Atop implementation for IEC 61850 software:

ACSI basic conformance statement

- · ACSI models conformance statement
- · ACSI service conformance statement

5.2 ACSI Basic Conformance

The basic conformance statement shall be as defined in Table 1. Table 1 – Basic conformance statement

		Client/ sub scriber	Server/ p ublisher	Value/ co mments
Client-se	rver roles			
B11	Server side (of TWO-PARTY-APPLICATION-ASSOCIATION)		×	
B12	Client side of (TWO-PARTY-APPLICATION-ASSOCIATION)	×		
SCSMs s	upported			
B21	SCSM: IEC 61850-8-1 used	×	\boxtimes	
B22	SCSM: IEC 61850-9-1 used	\boxtimes	\boxtimes	
B23	SCSM: IEC 61850-9-2 used	×	\boxtimes	
B24	SCSM: other			
Generic s	substation event model (GSE)			
B31	Publisher side		×	
B32	Subscriber side	\boxtimes		
Transmis	sion of sampled value model (SVC)			
B41	Publisher side			
B42	Subscriber side			

5.3 ACSI Models Conformance Statement

The ACSI models conformance statement shall be as defined in Table 2. | Table 2 – ACSI models conformance statement

		Client/ subscriber	Server/ publishe r	Value/ comment s
If Server sic	de (B11) supported			
MI	Logical device	×	×	
M2	Logical node	×	×	

МЗ	Data	\boxtimes	X	
M4	Data set	X	×	
M5	Substitution	X	\boxtimes	
M6	Setting group control			
	Reporting			
M7	Buffered report control	X	\boxtimes	
M7-1	sequence-number			
M7-2	report-time-stamp			
M7-3	reason-for-inclusion			
M7-4	data-set-name			
M7-5	data-reference			
M7-6	buffer-overflow			
M7-7	entryID			
M7-8	BufTm			
M7-9	IMgPd			
M7-10	GI			
M8	Unbuffered report control	\boxtimes	\boxtimes	
M8-1	sequence-number			
M8-2	report-time-stamp			
M8-3	reason-for-inclusion			
MB-4	data-set-name			
M8-5	data-reference			
M8-6	BufTm			
M8-7	IMgPd			
M8-8	GI			
	Logging			
M9	Log control			
M9-1	IMgPd			

M10	Log			
M11	Control	X	\boxtimes	
If GSE (B31	/B32) is supported			
M12	GOOSE	×	\boxtimes	
M13	G SSE			
If SVC (B41	/B42) is supported			
M14	Multicast SVC			
M15	Unicast SVC			
For all IEDs				
M16	Time	×	\boxtimes	
M17	File Transfer			

5.4 ACSI Service Conformance Statement

The ACSI service conformance statement shall be as defined in Table 3 (depending on the statements in Table 1).

Table 3 – ACSI service conformance statement

	Services	AA:TP/M C	Client/ subs	Server/ pu blisher	Comments
Server (Cla	use 7)				
S1	ServerDirectory	TP		×	
Application	n association (Clause 8)				
S2	Associate		×	×	
S3	Abort		\boxtimes	×	
S4	Release		×	×	
Logical de	vice (Clause 9)				
S5	I Logical DeviceDirectory	TP	×	×	
Logical no	de (Clause 10)				
S6	LogicalNodeDirectory	TP	\boxtimes	×	
S7	GetAllDataValues	TP		×	

Data (CI	ause 11)				
S8	GetDataValues	ТР	\boxtimes	X	
S9	SetDataValues	TP			
S10	GetDataDirectory	ТР		×	
S11	GetDataDefinition	TP		×	
Data set	t (Clause 12)				
S12	GetDataSetValues	TP		X	
S13	SetDataSetValues	TP			
S14	CreateDataSet	TP			
S15	DeleteDataSet	TP			
S16	GetDataSetDirectory	TP			
Setting (group control (Clause 16)				
S18	SelectActiveSG	TP			
S19	SelectEditSG	TP			
S20	SetSGValues	TP			
S21	ConfirmEditSGValues	ТР			
S22	GetSGValues	TP			
S23	GetSGCBValues	TP			

Reporting (Clause 17)

Buffered report control block (BRCB)					
S24	Report	ТР	\boxtimes	×	
524.1	data-change (dchg)		\boxtimes	\boxtimes	
S24.2	gchg-change (dcag)				
S24-3	data-update (dupd)				
S25	GetBRCBValues	TP	\boxtimes	\boxtimes	

S26	SetBRCBValues	TP	\boxtimes	\boxtimes	
Unbuffered	report control block (URCB)				
S27	Report	TP	\boxtimes	\boxtimes	
S27-1	data-change (dchg)				
S27-2	gchg-change (dchg)				
S27-3	data-update (dupd)				
S28	GetURCBValues	TP	\boxtimes	\boxtimes	
S29	SetURCBValues	TP	×		
Logging (C	clause 17)				
Log control	block				
S30	GetLCBValues	TP	×	X	
S31	SetLCBValues	TP		\boxtimes	
Log					
S32	QueryLogByTime	TP	\boxtimes	\boxtimes	
S33	QueryLogAfter	TP	\boxtimes	\boxtimes	
S34	GetLogStatusValues	TP	\boxtimes	\boxtimes	
Generic su	bstation event model (GSE)				
GOOSE (C	lause 18)				
S35	SendGOOSEMessage	MC	×	X	
S36	GetGoReference	TP			
S37	GetGOOSEElementNumber	TP			
S38	GetGsCBValues	TP			
S39	SetGsCBValues	TP			
GSSE					
S40	SendGSSEMessage	MC			
S41	GetGsReference	TP			
S42	GetGSSEElementNumber	TP			

S43	GetGsCBValues	ТР				
S44	SetGsCBValues	ТР				
Transmission of sampled value model (SVC) (Clause 19)						
Mulacast SVC						
S45	SendMSVMessage	МС	\boxtimes	\boxtimes		
S46	GetMSVCBValues	TP				
S47	SetMSVCBValues	ТР				

S48	SendUSVMessage	TP					
S49	GetUSVCBValues	TP					
S50	SetUSVCBValues	TP					
Control (Clause 20)						
S51	Select		\boxtimes				
S52	SelectWithValue	TP	×				
S53	Cancel	ТР					
S54	Operate	TP	\boxtimes	×			
S55	Command-Termination	ТР	×	×			
S56	TimeAct ivated-Operate	TP					
File trans	efer (Clause 23)						
S57	GetFile	ТР		×			
S58	SetFile	TP					
S59	DeleteFile	TP					
S60	GetFileAttributeValues	TP		×			
Time (5.5)						
T1	Time resolution of internal clock	Nearest ne	Nearest negative power of 2 in seconds				
T2	Time accuracy of internal clock	ТО	ТО				
		T1	T1 T2 T3 T4				
		T2					
		Т3					
		T4					
		T5	T5				
T3	Supported TimeStamp resolution	Nearest value of 2**-n in seconds					



www.atoponline.com www.atop.com.tw

TAIWAN HEADQUARTER:

2F, No. 146, Sec. 1, Tung-Hsing Rd,

30261 Chupei City, Hsinchu CountyTaiwan, R.O.C.

Tel: +886-3-550-8137 Fax: +886-3-550-8131

ATOP CHINA BRANCH:

3F, 75 th, No. 1066 Building, Qingzhou North Road, Shanghai, China

Tel: +86-21-64956231

ATOP INDIA OFFICE:

Abhishek Srivastava

Head of India Sales

Atop Communication Solution(P) Ltd.No. 22, Kensington Ter

race,

Kensington Rd,

Bangalore, 560008, India Tel: +91-80-4920-6363

E-mail: Abhishek.S@atop.in

ATOP INDONESIA BRANCH:

Jopson Li

Branch Director

Wisma Lampung Jl.

No. 40, Tomang Raya

Jakarta, Barat, 11430, Indonesia

Tel: +62-857-10595775

E-mail: jopsonli@atop.com.tw

ATOP EMEA OFFICE:

Bhaskar Kailas (BK)

Vice President (Business Development)

Atop Communication Solution(P) Ltd.

No. 22, Kensington Terrace,

Kensington Rd,

Bangalore, 560008, India Tel: +91-988-0788-559

E-mail: Bhaskar.k@atop.in

ATOP AMERICAs OFFICE:

Venke Char

Sr. Vice President & Head of Business 11811 North Tatum Blvd. Suite 3031

Phoenix, AZ 85028,

United States

Tel: +1-602-953-7669 E-mail: venke@atop.in

Documents / Resources



atop Technologies IEC61850 Protocol Gateway Client or Server Configuration [pdf] User

Manual

IEC61850, IEC61850 Protocol Gateway Client or Server Configuration, Protocol Gateway Client or Server Configuration, Gateway Client or Server Configuration, Client or Server Configuration, Server Configuration

References

- ATOP Technologies Shaping Industrial Connections
- ATOP Technologies Shaping Industrial Connections
- March Home ATOP
- Home ATOP
- E Homepage | IEC
- E Homepage | IEC

