

 **AutomatikCentret**

**VC Control  
Valve**



# AutomatikCentret VC Control Valve Instruction Manual

[Home](#) » [AutomatikCentret](#) » **AutomatikCentret VC Control Valve Instruction Manual** 

## Contents

- [1 AutomatikCentret VC Control Valve](#)
- [2 Product Usage Instructions](#)
- [3 FAQ](#)
- [4 Specifications](#)
- [5 Benefits](#)
- [6 Valve types and operation modes](#)
- [7 Actuator types and operation modes](#)
- [8 Cartridge types](#)
- [9 Selection guide for VC valves and actuators](#)
- [10 Valve and actuator positions during operation](#)
- [11 Good to know](#)
- [12 How to wire](#)
- [13 Wiring VC actuators to Honeywell Home thermostats](#)
- [14 Troubleshooting](#)
- [15 Order numbers](#)
- [16 Application examples](#)
- [17 Documents / Resources](#)
  - [17.1 References](#)



**AutomatikCentret VC Control Valve**



#### **Specifications:**

- Medium: Water or water-glycol mixture (max. 50% glycol content), quality to VDI 2035, pH-value: 8...9.5
- Operating temperature: Ambient temperature
- Operating pressure: max. 20 bar
- Differential pressure: max. 4 bar
- Actuator Voltage: 24 V, 50 Hz (blue label) or 230 V, 50 Hz (red label)
- Actuator Power consumption: 6 VA (when valve position changes)
- Auxiliary switch rating: 1.0 A @ 250 V, 50-60 Hz (minimum 0.05 A @ 24 Vdc)
- Runtime: 6 seconds on/off actuators, 120 seconds floating or modulating actuators
- Actuator electrical rating: IP40
- Storage temperature: Humidity rating

#### **Product Information:**

The VC valves are used in closed heating and cooling systems in residential and light commercial applications to control the flow of hot and/or cold water within specified technical limits. They can be used for control and on/off, changeover applications, offering flexibility in various tasks by combining valves and actuators as needed.

#### **Components:**

The device consists of three parts: the valve body, the valve cartridge, and the actuator. The valve body and cartridge are delivered as one unit, with the cartridge available as a spare part. All moving and sealing parts are in the cartridge assembly, making the product flexible for different applications.

## Product Usage Instructions

Valve Types and Operation Modes:

**2-way (2-port) valves:** Used for on/off or open/close operation with an on/off actuator.

**3-way (3-port) valves:** Control operation with equal percentage characteristics.

### Actuator Types and Operation Modes:

**Control Actuators:** Used for control valve applications to regulate flow rate on 2-way valves or mixing operations on 3-way valves.

**Floating Actuators:** Can be used for on/off operation controlled by SPDT relay or thermostat, but with a longer runtime of 120 seconds.

## FAQ

### • What are the benefits of using VC valves?

- The VC valves offer flexibility in various applications, can be used for both control and on/off operations, and have interchangeable components for customization.

### • What are the different valve operation modes?

- The valves can operate in on/off mode for open/close functions or in control mode with equal percentage characteristics for regulating flow.

## VC valve series

### Application guide

VC valves are used in closed heating and cooling systems in residential and light commercial applications to control the flow of hot and/or cold water within the limits of technical specifications. VC valves are universal as they can be used both for control and on/off, changeover applications. You can use it for various tasks combining the valves and actuators as you wish. It's up to your creativity how and where to use them. The device consists of three parts. The valve body, the valve cartridge and the actuator. As shown on the picture the valve body and the valve cartridge are delivered as one unit, however valve cartridge is available as spare part as well. All moving and sealing parts of the valve are constructed in the cartridge assembly. The combination of different types of cartridge designs, valve bodies and actuators makes this range of products extremely flexible and suitable for many applications.

## Specifications


- Medium Water or water-glycol mixture (max. 50% glycol content), quality to VDI 2035, pH-value: 8...9.5
- Operating temperature 1...95°C, 120°C short duration peak
- Ambient temperature max. 65°C
- Operating pressure max. 20 bar
- Differential pressure max. 4 bar
- Actuator Voltage 24 V, 50 Hz (blue label) or 230 V, 50 Hz (red label)
- Actuator Power consumption 6 VA (when valve position changes)

- Auxiliary switch rating 1.0 A @ 250 V, 50-60 Hz (minimum 0.05 A @ 24 Vdc)
- Runtime 6 seconds on/off actuators, 120 seconds floating or modulating actuators
- Actuator electrical rating IP40
- Storage temperature  $-40\ldots65^{\circ}\text{C}$
- Humidity rating 5...95% RH (non-condensing)




## Benefits

- Almost like a ball valve VC valves can close against high pressure up to 4 bar




- VC valves are bubble tight. No flow when closed. This is valid for both control and on/off, changeover variants.
- VC valves are available in two versions: 2-way (2-port) valves and 3-way (3-port) mixing/ diverting valves:

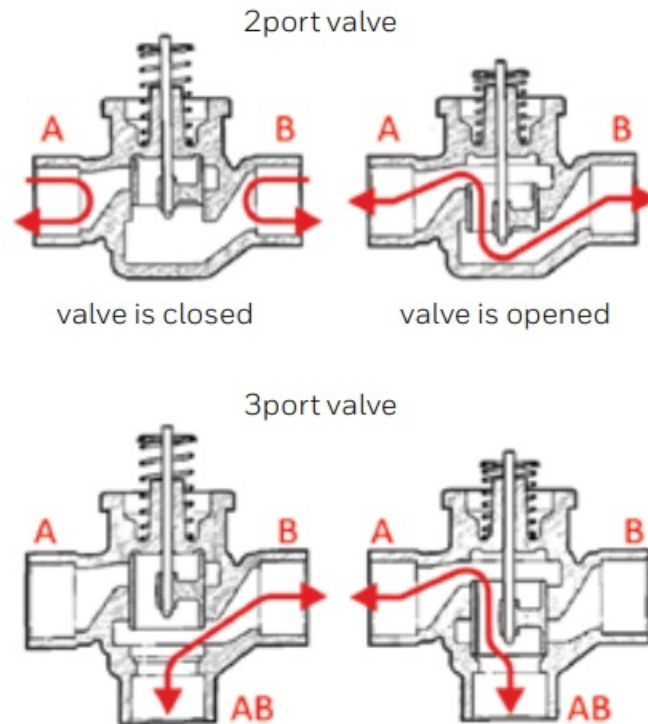


- VC valves can work in both flow directions as shown above.
- The valve cartridge is replaceable, so it can be replaced either with the same cartridge type, or by changing the cartridge type to transform the valve from on/off to control or vice versa.
- Some variants are considered as universal solutions:
  - control cartridge versions can also be used for on/off applications if using it with on/off actuator
  - VC4613 on/off actuator can be driven by both SPST and SPDT controllers/thermostats

SPST is single pole single throw relay (two terminals for two wires):

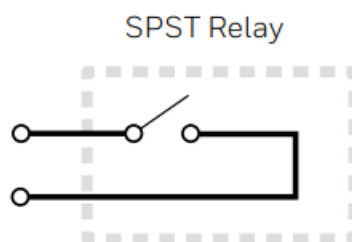


SPDT is single pole double throw relay (three terminals for two or three wires)

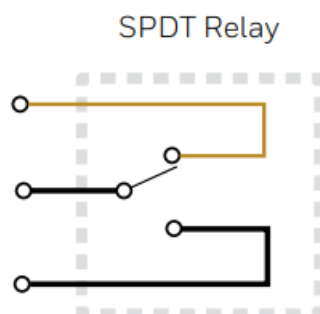

SPST and SPDT contacts are potential free contacts means there is no current on terminals unless an external phase is connected to one of it's ports.

### SPDT Relay used as SPST

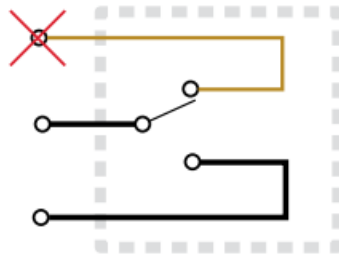

Please note if you do not connect any wire to one terminal of SPDT contact, it works like SPST

- No water hammers. A VC valve with on/off actuator closes in 6 sec which is fast enough but does not cause water hammer.
- 230V actuators as standard, but 24V actuators are also available.
- Actuators can be mounted onto the valve with one push and turn. No tools required.
- Valve can be moved manually to the middle position by pushing in the actuator's position indicator and move it to the middle position.
- As minimum media temperature is 1°C VC valves are suitable to use in cooling systems as well.

### Valve types and operation modes

#### 2-way (2-port) valves:

- If it is used for on/off operation it called as zone valve.
- If it is in control operation, then it can be called as control valve.

#### 3-way (3-port) valves:

- If water flows in through two inlets and flows out through one outlet (from A and B to AB) valve is used in mixing mode. If the valve is in on/off operation it is a changeover valve in mixing mode. If the valve is in control operation, then it is called as control valve in mixing mode.
- If water flows in through one inlet and flows out through two outlets (from AB to A or B) valve is used in diverting mode. If the valve is in on/off operation it is a changeover valve in diverting mode. If the valve is in control operation, then it is called as control valve diverting mode.


#### On/off or better to say open/close operation as a result of using an on/off actuator:

- 2-way valves are moved by the actuator either to the fully open position (valve stem pushed in – A port is open), or to the fully closed position (valve stem extends by the spring force – A port is closed).
- 3-way valves are moved by the actuator either to open A port (valve stem pushed in), or to close A port thus opening B port (valve stem extends by the spring force) while AB port is always open.
- There is no middle position in this operation, A port is either fully opened, or fully closed.
- Both on/off and control cartridges can be used for on/off operations, as if control cartridge is equipped by on/off actuator it works like an on/off cartridge.

## Control operation with equal percentage characteristics:

- 2-way valve can control the flow between 0-100%. 0% means A port is closed.
- 3-way valves can be used either as mixing or diverting control valve. Where flow on A port is controlled between 0-100%, while on B port between 100-0% respectively.
- Control VC valves with floating or modulating actuator can move to any position between fully closed and fully opened position.
- For control applications only control valve cartridges are suitable.

As an example see below 3-way valve operation modes with on/off and with control cartridges

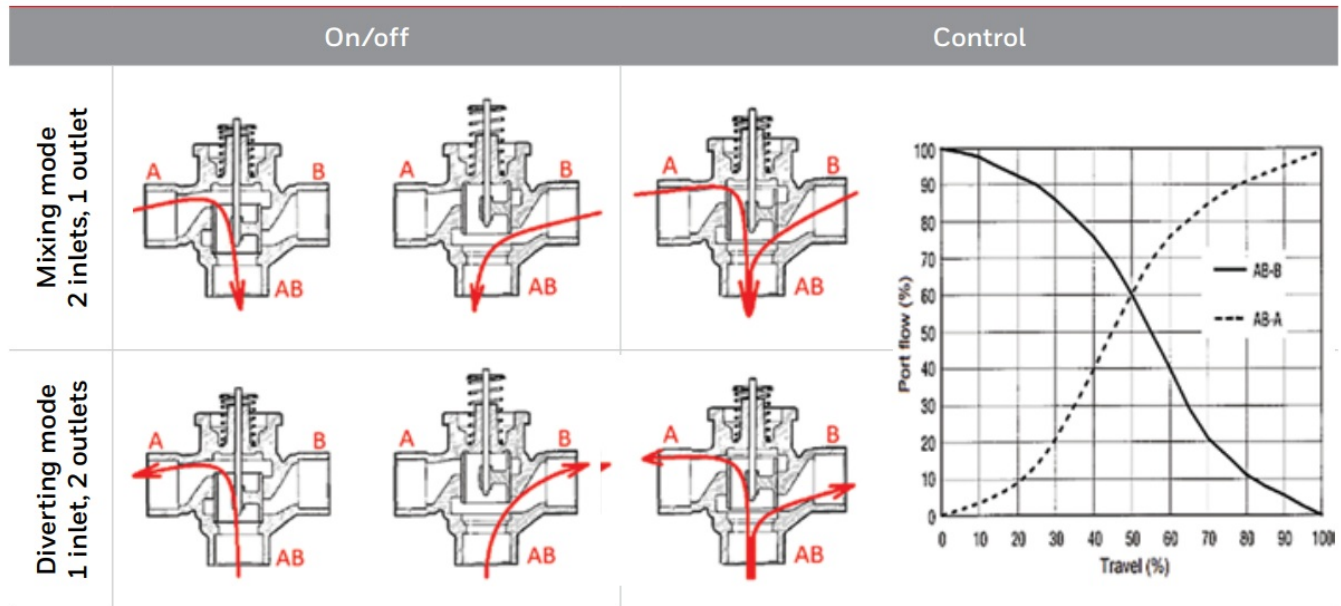

## Actuator types and operation modes

On/off actuators with 6 sec runtime VC4 series and VC6 series.

- Control actuators with 120 sec runtime:
  - Floating or also called as 3-pt actuator VC6983 (3-point control means that controller makes the actuator either to move to open direction, or to move to close direction, or by not giving any signal let it stay stopped in any position).
  - Modulating actuator VC7931 which receives 0-10V control signal from a controller and sets the valve position between 0-100% accordingly.
- Control actuators are typically used for control valve applications to control the flow on 2-way valves between 0-100% thus control the flow rate or as an example using 3-way control valve to mix the boiler's supply flow and heating circuit's return flow to control the heating circuit's supply temperature.


If you wish floating actuator can be used for on/ off operation as well controlled by SPDT relay or thermostat, however 120 sec runtimes is quite long for such applications. SPDT relay can not let the actuator stay in a mid position it either gives open signal, or close signal thus after the 120 sec runtime valve either fully opens, or fully closes.

Cartridge types

2-way (2-port)		3-way (3-port)	
on/off (open/close)	2-way on/off (zone valve) Order Number: <b>VCZZ1000/U</b>	3-way on/off (changeover valve) Order Number: <b>VCZZ6000/U</b>	
			
Control	2-way control (control valve) Order Number: <b>VCZZ1100/U</b>	3-way control (mixing/diverting valve) Order Number: <b>VCZZ6100/U</b>	
			

Selection guide for VC valves and actuators



valves	beginning of product ID	midle of product ID	end of product ID	DN	thread	kvs (m³/h)	2-way open/close	3-way diverter	2-way regulating	3-way mixing	3-way diverting		
	VCZ	AF	1000/U	½"	internal	3.2	•	—	—	—	—		
			1100/U			2.6	•	—	•	—	—		
			ME			6000/U	3.2	—	•	—	—	—	
						6100/U	3.2	—	•	—	•	•	
		AJ	1000/U	¾"	internal	5.0	•	—	—	—	—		
			1100/U			4.5	•	—	•	—	—		
			MH			6000/U	6.6	—	•	—	—	—	
						6100/U	5.9	—	•	—	•	•	
		AH	1000/U	external	5.3	•	—	—	—	—	—		
			1100/U		4.5	•	—	•	—	—	—		
		MG	6000/U		6.6	—	•	—	—	—	—		
			6100/U		5.7	—	•	—	•	•			
		AP	1000/U	1"	internal	5.5	•	—	—	—	—		
			1100/U			5.7	•	—	•	—	—		
			MP			6000/U	8.5	—	•	—	—	—	
						6100/U	6.4	—	•	—	•	•	
		AQ	1000/U	external	5.5	•	—	—	—	—	—		
			1100/U		5.3	•	—	•	—	—	—		
			6000/U		8.5	—	•	—	—	—	—		
			MQ		6000/U	external	8.5	—	•	—	—	—	
		6100/U		6.8	—		•	—	•	•			
		MU	6000/U	1¼"	external	11 (B->AB)	—	•	—	—	—		
		actuators				230Vac	SPST controller 1 open + 1 fix phase	number of auxiliary switches	—	VC4013ZZ00/U VC4013ZZ11/U	230Vac Floating with auxiliary switch: VC6983ZZ11/U		
							SPDT controller 1 open + 1 close phase		1 SPDT	VC4613ZZ00/U VC4613ZZ11/U			
						24Vac	SPST controller 1 open + 1 fix phase		1 SPDT	VC6613ZZ00/U		24Vac 0-10Vdc modulating: VC7931ZZ11/U	
							SPDT controller 1 open + 1 close phase		1 SPDT	VC8011ZZ00/U			
									1 SPDT	VC8611ZZ00/U			
									1 SPDT	VC2011ZZ00/U			
				1 SPDT	VC2611ZZ00/U								

## Most universal on/off actuator solution is VC4613

as it can be controlled by both SPST and SPDT thermostats as you can see in the How to wire section. It also has an auxiliary switch that can stay unused, but it is there in a case of a need to start a heat source or a pump for example.

## Most universal valve cartridge solution is the control cartridge

2-way valves with control cartridges can be used either for flow control if equipped with a floating or modulating actuator or for on/off application (zone valve) if equipped with on/off actuator

3-way valves with control cartridges can be used either for mixing control, diverting control if equipped with a floating or modulating actuator or in changeover applications if equipped with on/off actuator


## VC valves flow rates and related heat loads

## Heat loads in kW


				Δp = 5 kPa								Δp = 10 kPa								Δp = 20 kPa							
Cartridge	Size	kvs [m³/h]		ΔT [°C]				ΔT [°C]				ΔT [°C]				ΔT [°C]				ΔT [°C]				ΔT [°C]			
		2	3	5	10	15	20	5	10	15	20	5	10	15	20	5	10	15	20	5	10	15	20	5	10	15	20
		-way	-way	2-way				3-way				2-way				3-way				2-way				3-way			
On/Off	½"	3.2	3.2	4.2	8.3	12.5	16.6	4.2	8.3	12.5	16.6	5.9	11.8	17.7	23.5	5.9	11.8	17.7	23.5	8.3	16.6	25.0	33.3	8.3	16.6	25.0	33.3
	¾"	5.3	6.6	6.9	13.8	20.7	27.6	8.6	17.2	25.7	34.3	9.7	19.5	29.2	39.0	12.1	24.3	36.4	48.5	13.8	27.6	41.3	55.1	17.2	34.3	51.5	68.7
	1"	5.5	8.5	7.2	14.3	21.5	28.6	11.1	22.1	33.2	44.2	10.1	20.2	30.3	40.5	15.6	31.3	46.9	62.5	14.3	28.6	42.9	57.2	22.1	44.2	66.3	88.4
	1¼"	–	11.00	–	–	–	–	14.3	28.6	42.9	57.2	–	–	–	–	20.2	40.5	60.7	80.9	–	–	–	–	28.6	57.2	85.8	114.4
Control	½"	2.6	3.2	3.4	6.8	10	14	4.2	8.3	12	17	4.8	9.6	14	19	5.9	12	18	24	6.8	14	20	27	8.3	17	25	33
	¾"	4.5	6.0	5.9	12	18	23	7.8	16	23	31	8.3	17	25	33	11	22	33	44	12	23	35	47	16	31	47	62
	1"	5.7	6.8	7.4	15	22	30	8.8	18	27	35	10	21	31	42	13	25	38	50	15	30	44	59	18	35	53	71

## Valve and actuator positions during operation

### 2-way valve

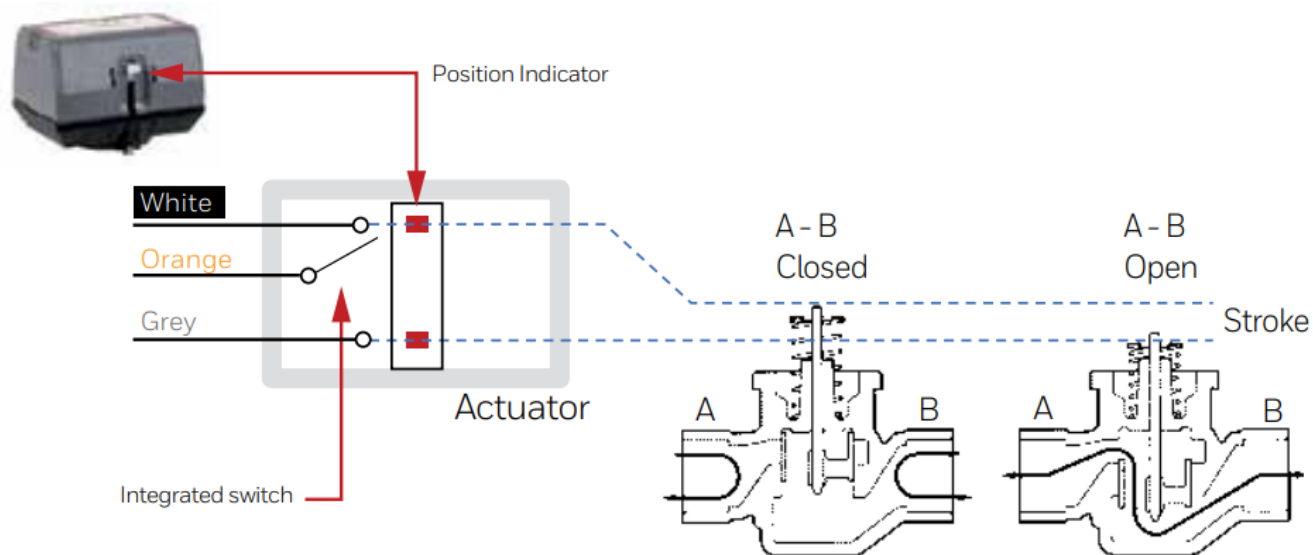

### 3-way valve

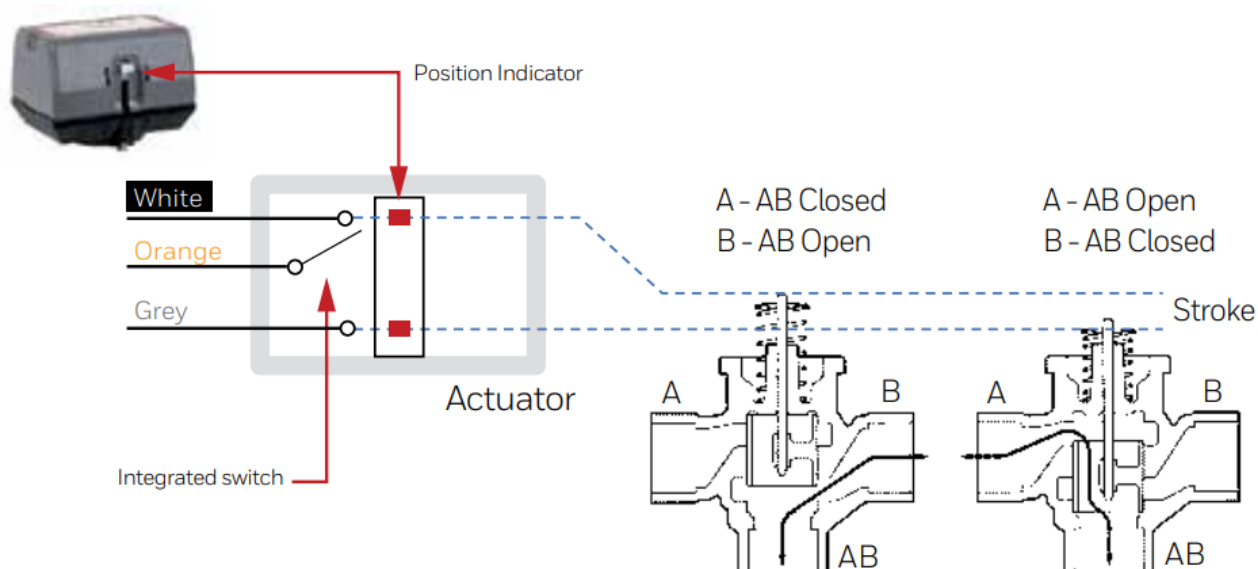

Please note when spring fully extends the valve stem A port is closed on both 2-way and 3-way valves. When actuator pushes in the valve stem against the spring load making it to retract fully, B port is closed on all valve variants.

## Good to know

- Control valves can be used both in control and in on/ off applications as the valve cartridge closes tightly the related port in end position
- Control valves have equal percentage flow characteristic
- Control and on/off cartridges can be ordered as spare part

## As an example

- VCZMQ6000/U -> 3-way on/off changeover valve
- VCZZ6000/U -> on/off spare cartridge for 3-way valve
- VCZMQ6100/U -> 3-way control valve
- VCZZ6100/U -> control spare cartridge for 3-way valve
- On/off cartridge can be replaced by the control cartridge in the same valve body and vice versa
- SPDT contact (Relay or thermostat) is universal as it can be used both as SPDT or SPST contact
- 2-port VC valves are neither NC (Normally Closed), nor NO (Normally Open) valves. VC valves do not have return spring, they are “fail in place” type: for both types of actuators (SPDT and SPST), a power failure will leave the valve at the position it was in when interrupted. When power is restored, the valve will respond to controller demand,


## How to wire

### WARNING


All electrical wiring should be made by trained and authorized technicians only. In case of 3-phase environment make sure you use only one phase on one actuator, both on the power supply and on the auxiliary switch side.

- on/off SPST controlled actuator: VC4 series requires phase to be switched on to the Black wire if valve need to be opened (A port to be opened).

This actuator can be controlled with one on/off contact (SPST)

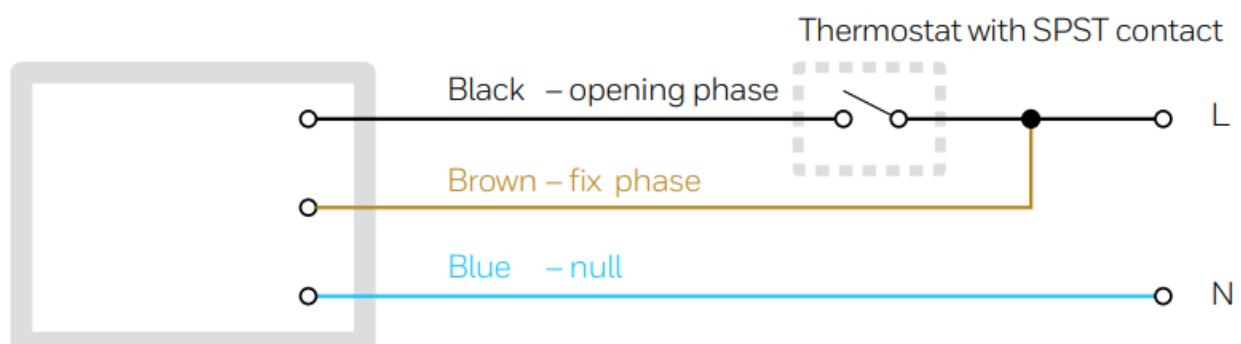


VC4 series SPST controlled actuator can be also controlled by an SPDT contact.

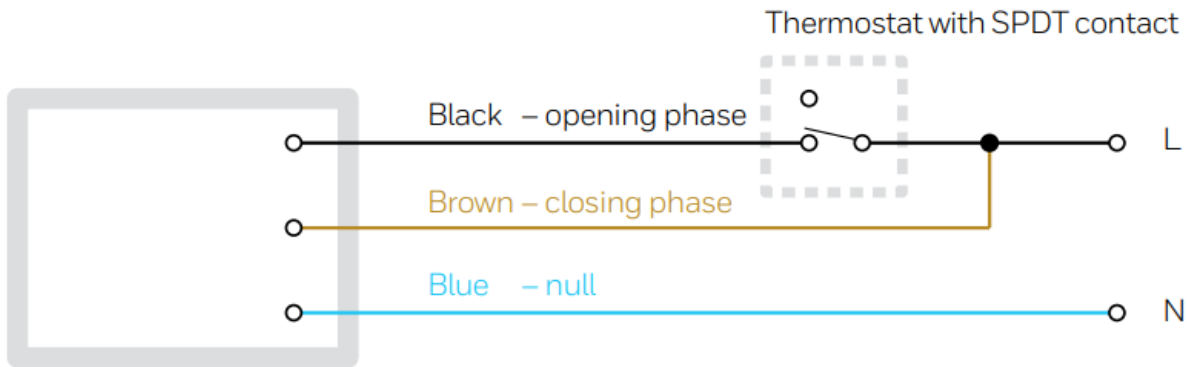


- on/off SPDT controlled actuator: VC6 series: requires either phase to be switched on to the Black wire if valve need to be opened (A port to be opened) or phase to be switched on to the Brown wire if valve need to be closed (A port to be closed). This actuator can be controlled with one switchover contact (SPDT)




- Actuator with floating control: VC6983 requires either phase to be switched on to the Black wire if valve need to be opened further (A port to be opened further) or phase to be switched on to the Brown wire if valve need to be closed further (A port to be closed further). Typically used for control valve applications with boiler controller such as SMILE controllers from Resideo.

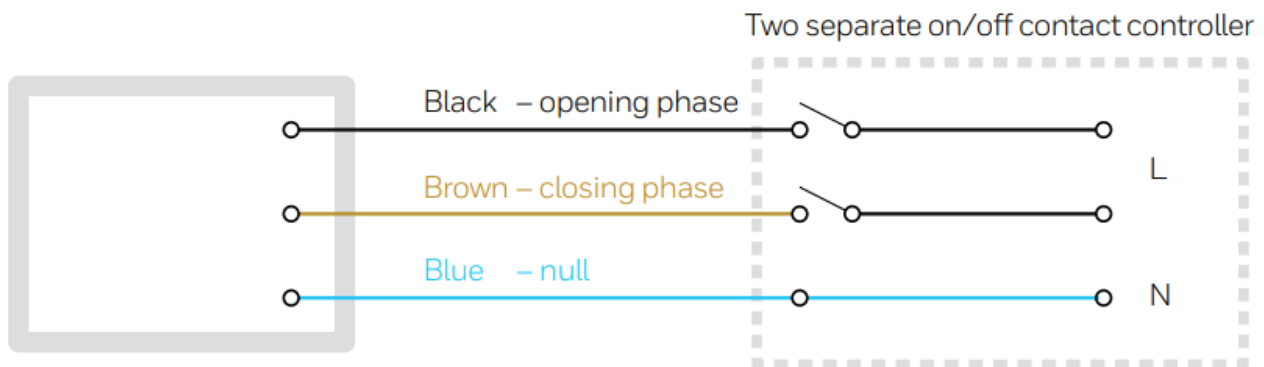

- Actuator with modulating control: VC7931 requires 24Vac power supply and 0-10Vdc control signal to be provided by a controller. Typically used in building management systems for control valve applications.

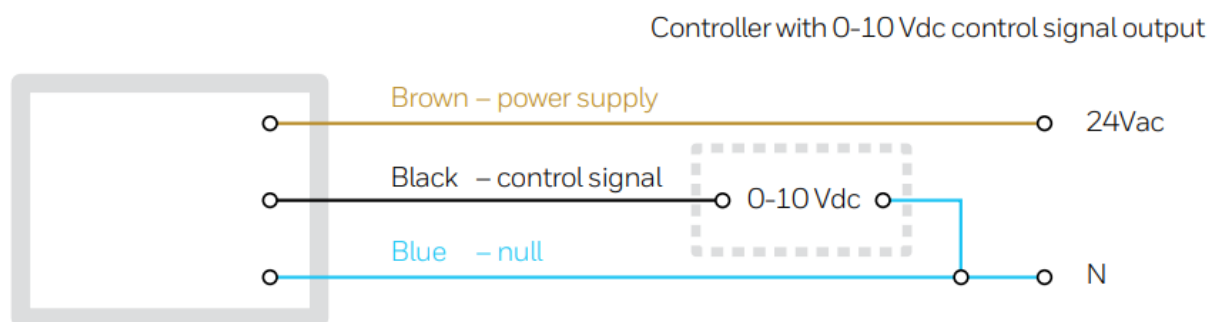

- VC actuators have either 3 or 6 wires. 3 wires versions have no auxiliary switch integrated, 6 wires versions have one potential free SPDT auxiliary switch integrated. The 3 wires operate the actuator are Black, Brown, Blue colored, the integrated SPDT auxiliary switch has Orange, Grey, White-colored wires. If you have a 6 wire actuator but does not use the auxiliary switch insulate the unused wires one-on-one or connect in the wiring box to separate unused terminals as the example shows below.

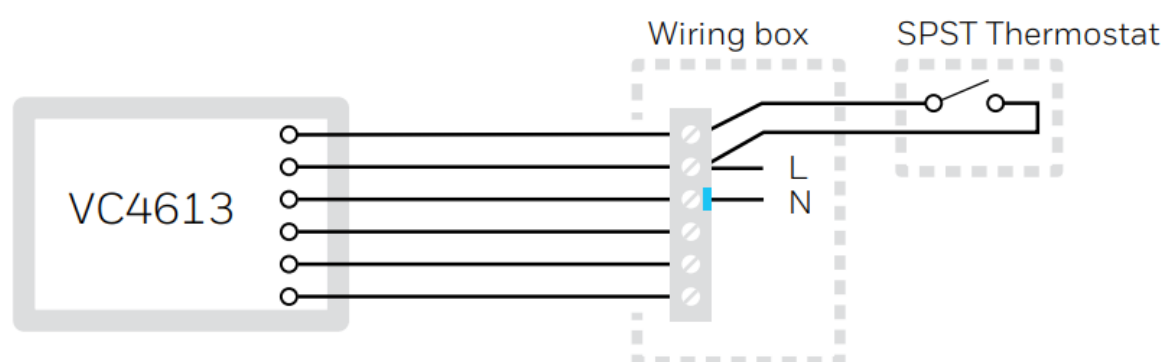

## Wiring VC actuators to Honeywell Home thermostats

As an example see below 3-way valve operation modes with on/off and with control cartridges

Thermostat type	VC4013 or VC4613 (wiring of auxiliary switch is not shown on the picture)	VC6013 or VC6613 (wiring of auxiliary switch is not shown on the picture)
DT90 T3 T4 CM700 CM900		

Honeywell Home T6 wired thermostat chronotherm is supplied with relay box having SPDT relay

Thermostat type	VC4013 or VC4613 (wiring of auxiliary switch is not shown on the picture)	VC6013 or VC6613 (wiring of auxiliary switch is not shown on the picture)
T6 control box		

Honeywell Home wireless thermostats chronotherms are supplied with relay box having SPDT relay, the same type of relay box is used in Evohome zone system


Thermostat type	VC4013 or VC4613 (wiring of auxiliary switch is not shown on the picture)	VC6013 or VC6613 (wiring of auxiliary switch is not shown on the picture)
T3R T4R T6R  and BDR91 relay box supplied with DT92 T87RF CM727 CM927  also used in Evohome systems		

## Be aware

- VC valves can work with the media temperature up to 95°C.
- Do not install (solar panel outlet), but in return only.
- Do not install in steam application.
- It is not mandatory, but we recommend installing

VC valves into cooler section of the heating systems and into warmer section of the cooling systems.


- VC actuators have an electrical protection IP20. Do not use them outdoors or in wet environment.
- It is forbidden to manually adjust the stem.

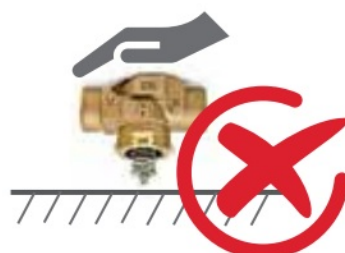

- Do not install actuators downwards or where water can drop into the actuator



- Do not connect a port that has not been used for a long time. In generally it should not be a problem, but it could happen that dirt cumulates in the closed port and may result a valve blockage.
- In 3-phase systems do not use two different phases for one actuator

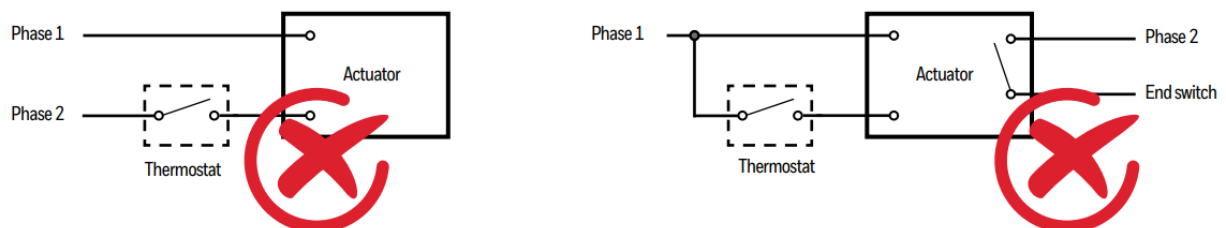

- Do not use on/off actuator for floating (3pt) control application. It can work but due a fast (6 sec) runtime control, output can oscillate.
- If there is need for valve insert replacement use the tool delivered with the spare cartridge. The tool can be also ordered separately as accessory



- Do not try to install a 3-way cartridge to a 2-way valve and vice versa.

## Troubleshooting

### Troubleshooting actuators

Issue	Solution			
	VC4XXX	VC6XXX	VC6983X	VC7931
Continuously opens and closes in sequence	Replace the actuator	Make sure there is no phase both on opening and closing wire at the same time		Replace the actuator
Strong burned plastic smell	Internal short circuit – replace actuator. Check wiring and make sure water cannot flow or drop on or inside the actuator.			
Actuator don't move while control signal is given	Check wiring first make sure Null is connected, but if wiring is OK then replace the actuator			Check wiring first make sure 24Vac power supply is available and connected, but if wiring is OK then replace the actuator
Auxiliary switch does not contact	Check wiring first, if wiring is OK check in fully closed and fully opened position if the auxiliary switch works fine, if not then replace the actuator			There is no auxiliary switch in this product

### Troubleshooting valves

Issue	Solution
Leaking at the pipe connection	Tighten the pipe connection or change the sealing
Leaking at the valve stem	Replace the valve cartridge
Valve stem is stuck as the spring can not make it to extend	Replace the valve cartridge
Valve stem is stuck as the actuator can not push the stem in	Replace the valve cartridge

## Order numbers

### Actuators

Order Number	Control type	Power supply	Control signal	Auxiliary switch
VC4013ZZ00/U	SPST	230 Vac	opening phase	No
VC4613ZZ00/U	SPST	230 Vac	opening phase	1 x SPDT
VC6013ZZ00/U	SPDT	230 Vac	opening and closing phase	No
VC6613ZZ00/U	SPDT	230 Vac	opening and closing phase	1 x SPDT
VC6983ZZ11/U	Floating	230 Vac	opening and closing phase	1 x SPDT
VC7931ZZ11/U	Modulating	24 Vac	0-10 Vdc	No

### Valves

Order Number	Type	Operation	Size	Connection	kvs [m3/h]
VCZAF1000/U	2-way	on/off	1/2"	internal threaded	3.2
VCZAJ1000/U	2-way	on/off	3/4"	internal threaded	5.0
VCZAH1000/U	2-way	on/off	3/4"	external threaded	5.3
VCZAP1000/U	2-way	on/off	1"	internal threaded	5.5
VCZAQ1000/U	2-way	on/off	1"	external threaded	5.5
VCZME6000/U	3-way	on/off	1/2"	internal threaded	3.2
VCZMH6000/U	3-way	on/off	3/4"	internal threaded	6.6



VCZMG6000/U	3-way	on/off	3/4"	external threaded	6.6
VCZMP6000/U	3-way	on/off	1"	internal threaded	8.5
VCZMQ6000/U	3-way	on/off	1"	external threaded	8.5
VCZMU6000/U	3-way	on/off	1 1/4"	external thread	11 (B->AB)
VCZAF1100/U	2-way	control	1/2"	internal threaded	2.6
VCZAJ1100/U	2-way	control	3/4"	internal threaded	4.5
VCZAH1100/U	2-way	control	3/4"	external threaded	4.5
VCZAP1100/U	2-way	control	1"	internal threaded	5.7
VCZAQ1100/U	2-way	control	1"	external threaded	5.3
VCZME6100/U	3-way	control	1/2"	internal threaded	3.2
VCZMH6100/U	3-way	control	3/4"	internal threaded	5.9
VCZMG6100/U	3-way	control	3/4"	external threaded	5.7
VCZMP6100/U	3-way	control	1"	internal threaded	6.4
VCZMQ6100/U	3-way	control	1"	external threaded	6.8

### Spare cartridges

Order Number	Type	Operation	Size
VCZZ1000/U	2-way	on/off	for all sizes
VCZZ6000/U	3-way	on/off	for all sizes
VCZZ1100/U	2-way	control	for all sizes
VCZZ6100/U	3-way	control	for all sizes

Standard models are listed above. If you require a special valve or actuator or you prefer to use valve&actuator kit, please contact your Resideo account manager

### Application examples

#### WARNING


All electrical wiring should be made by trained and authorized technicians only. In case of 3-phase environment make sure you use only one phase on one actuator, both on the power supply and on the auxiliary switch side.

## NOTE


The number of green crosslines on the drawing represents how many wires needed in the electrical cable. Application examples may show the wiring of the system using wired room thermostats. To wire any Honeywell Home wired or wireless thermostats please consult the “Wiring VC actuators to Honeywell Home thermostats” section of this manual

## Two Zone heating system


In this application two independent heating zones were created by installing two 2-way VC zone valves in the heating distribution system. The particular room thermostat opens the related heating zone valve in case heating is needed in that heating zone. Each zone valves equipped with on/off actuators with auxiliary switches. The auxiliary switches are used to provide heat demand contact to the boiler. The auxiliary switches are connected in parallel to the room thermostat input terminals of the boiler. With this solution both zones can initiate boiler demand independently. In this application both heating and combi boilers can be used, either with integrated outside air temperature compensated boiler temperature controller or without it.

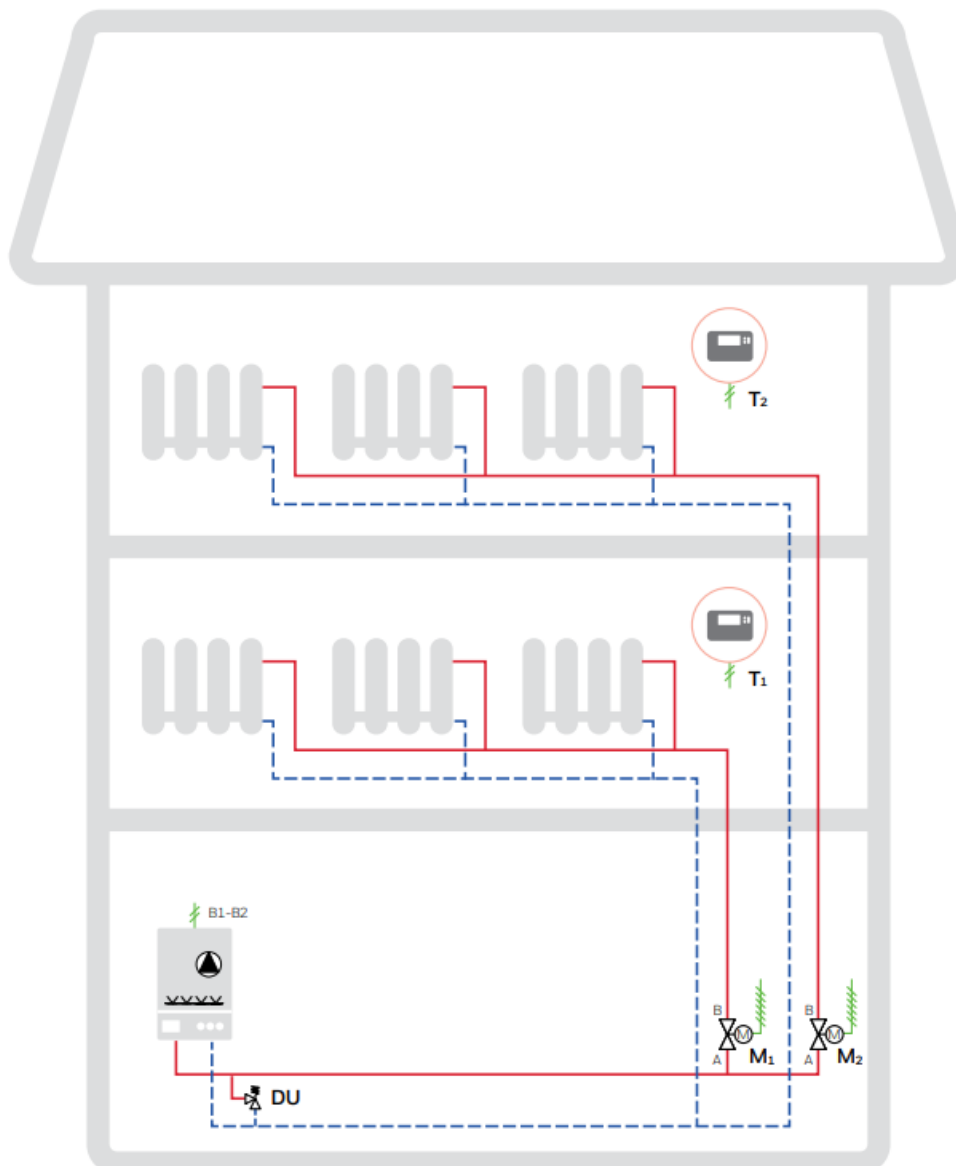

Schematic drawing of the wiring using VC4613 actuators

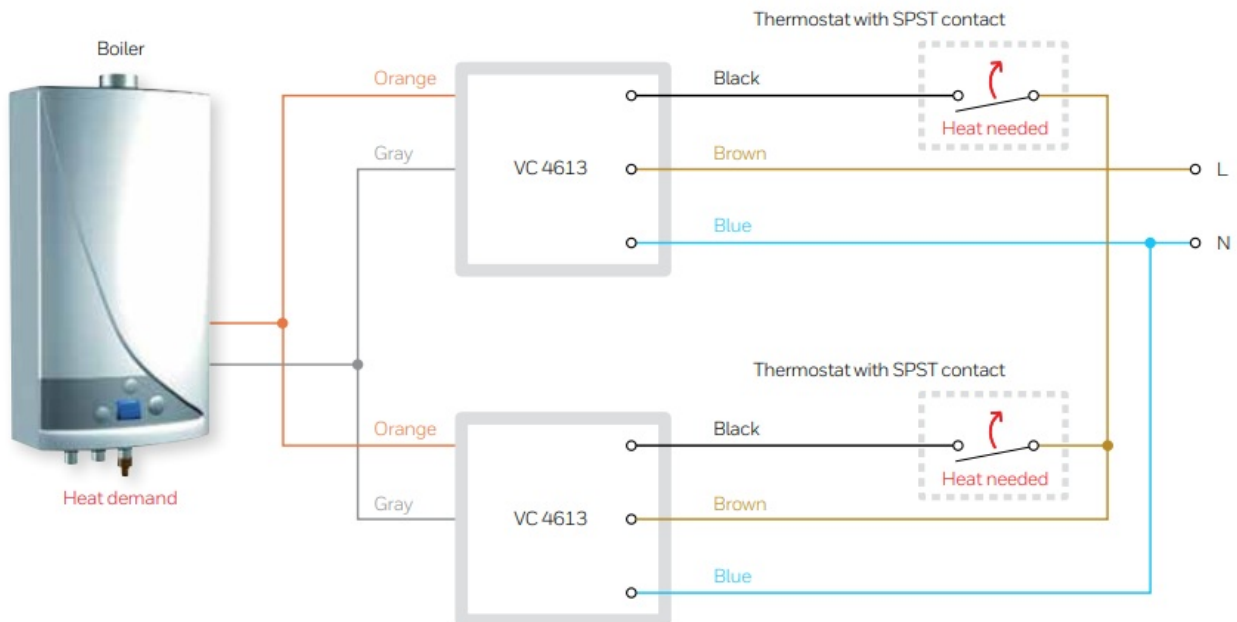


### Physical wiring in an electrical wiring box in the boiler room using VC4613 actuators

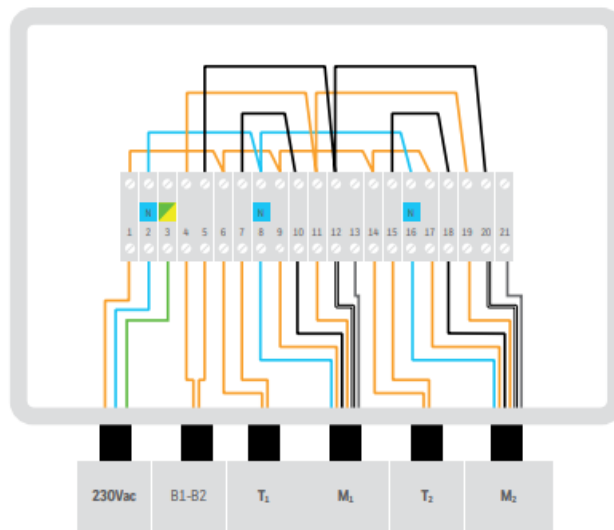


### 230Vac is the power supply

- B1-B2 are the two terminals in the boiler for potential free room thermostat contact. To identify the terminals in the boiler please check the boiler's installation manual.
- T<sub>1</sub> and T<sub>2</sub> are the A and B terminals of the room thermostats. (See Wiring VC actuators to Honeywell Home thermostats section)
- M<sub>1</sub> and M<sub>2</sub> are the VC4613 actuators with their 6 wires of each

### Schematic drawing of the wiring using VC6613 actuators

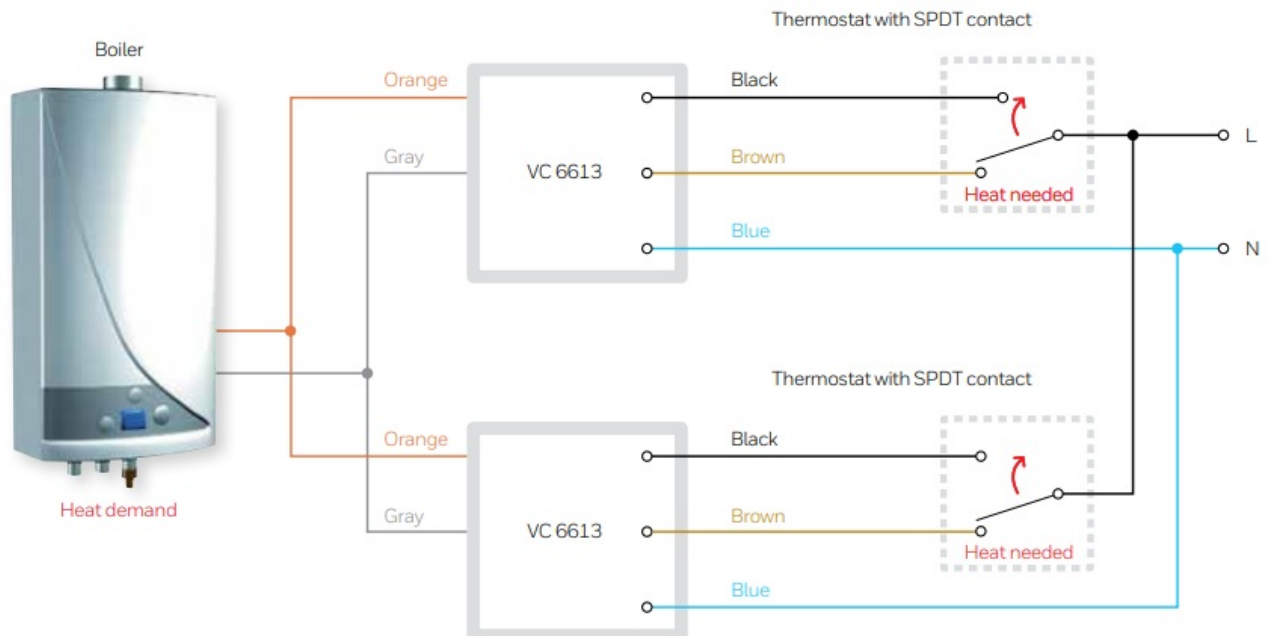

### Physical wiring in an electrical wiring box in the boiler room using VC6613 actuators

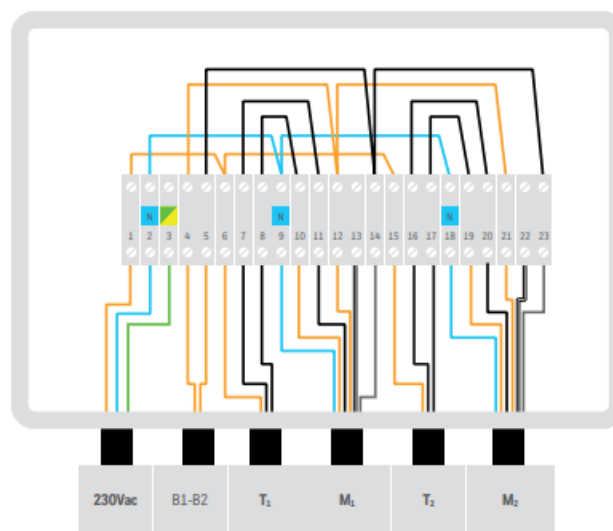


### 230Vac is the power supply

- B1-B2 are the two terminals in the boiler for potential free room thermostat contact. To identify the terminals in the boiler please consult boiler's installation manual.
- T1 and T2 are the A and B terminals of the room thermostats. (See Wiring VC actuators to Honeywell Home thermostats section)
- M1 and M2 are the VC6613 actuators with their 6 wires of each

### Two Zone heating system with parallel domestic hot water production

In this application two independent heating zones were created by installing two 2-way VC zone valves in the heating distribution system. Domestic hot water tank is loaded through it's heat exchanger controlled by a 2-way VC zone valve. The particular room thermostat opens the related heating zone valve in case heating is needed in that heating zone. Each zone valves equipped with on/off actuators with auxiliary switches. The auxiliary switches are used to provide heat demand contact to the boiler. The auxiliary switches are connected in parallel to the room

thermostat input terminals of the boiler. With this solution both zones can initiate boiler demand independently. When the hot water tank thermostats require tank loading, it opens the zone valve which is equipped with an on/off actuator with auxiliary switch. The auxiliary switch of the hot water loading zone valve is also connected in parallel to the room thermostat input terminals of the boiler. In this application only heating boiler can be used, without integrated outside air temperature compensated boiler temperature controller, and the boiler supply temperature has to be set to the level which is high enough to heat up the rooms and load the hot water tank at any time. In this application domestic hot water tank loading and heating can be performed in parallel so the boiler should be powerful enough to supply sufficient performance to all heat consumers at the same time.

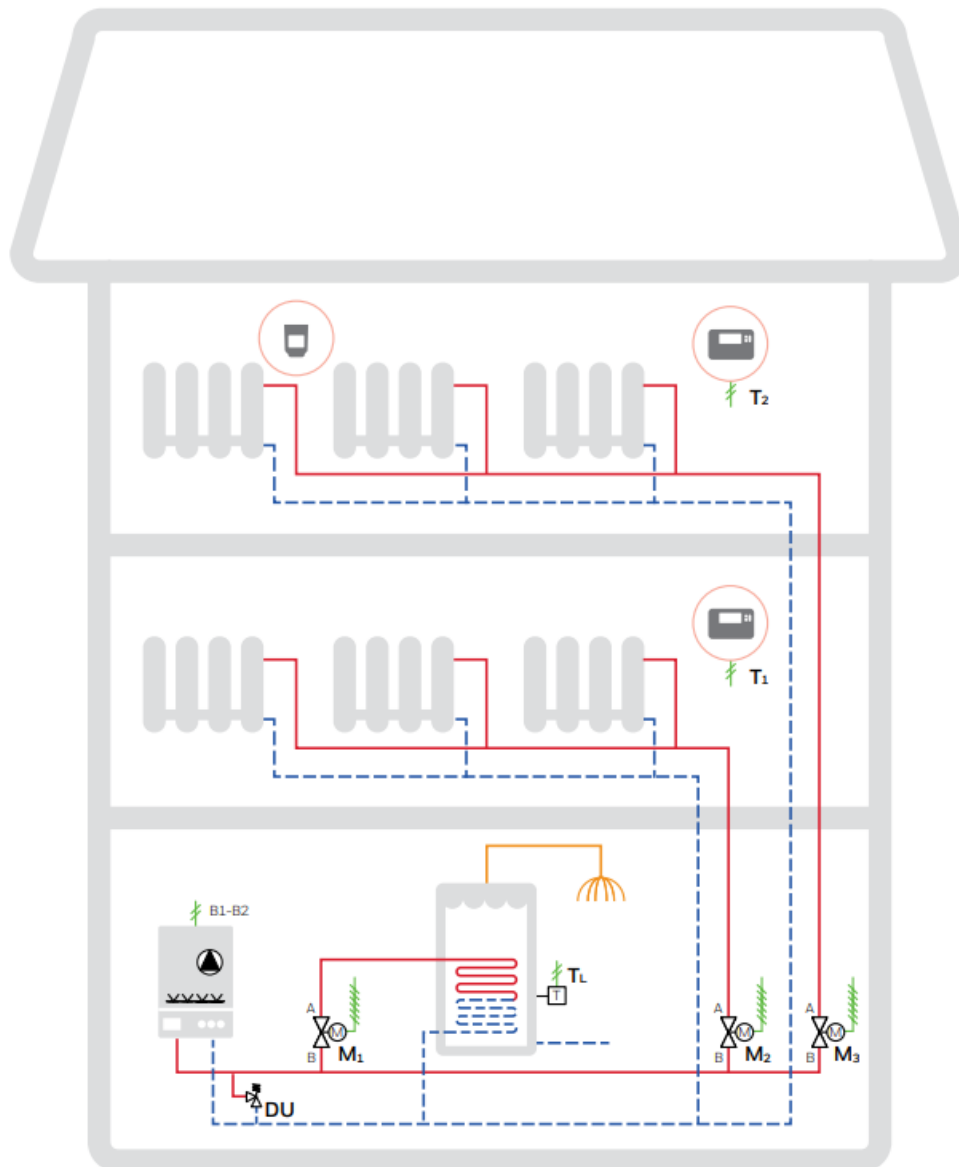


### Physical wiring in an electrical wiring box in the boiler room using VC4613 actuators

#### 230Vac is the power supply

- B1-B2 are the two terminals in the boiler for potential free room thermostat contact.
- To identify the terminals in the boiler please consult the boiler's installation manual.
- TDHW represents the two respective terminals of the hot water tank thermostat which are closed when the temperature drops below the setpoint. To identify the terminals in the tank thermostat please consult its installation manual
- T1 and T2 are the A and B terminals of the room thermostats. (See Wiring VC actuators to Honeywell Home thermostats section)


- M1 , M2 and M3 are the VC4613 actuators with their 6 wires of each

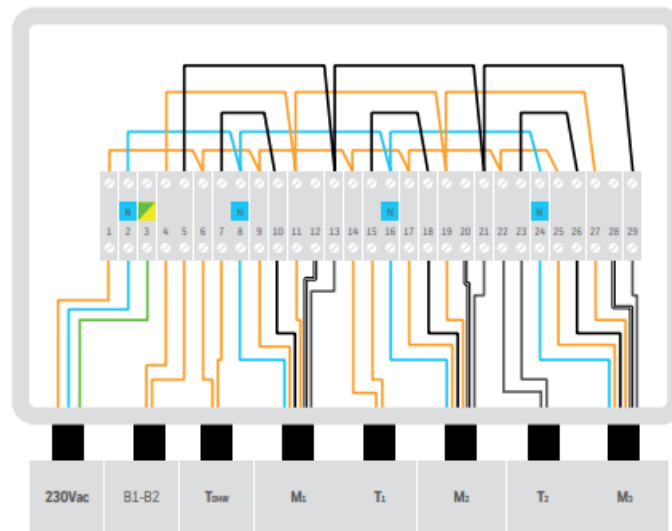

### Physical wiring in an electrical wiring box in the boiler room using VC6613 actuators

#### 230Vac is the power supply


- B1-B2 are the two terminals in the boiler for potential free room thermostat contact. To identify the terminals in the boiler please consult boiler's installation manual.
- TDHW represents the two respective terminals of the hot water tank thermostat which are closed when temperature drops below the setpoint. To identify the terminals in the tank thermostat please consult it's installation manual
- T1 and T2 are the A and B terminals of the room thermostats. (See Wiring VC actuators to Honeywell Home thermostats section)
- M1 , M2 and M3 are the VC6613 actuators with their 6 wires of each

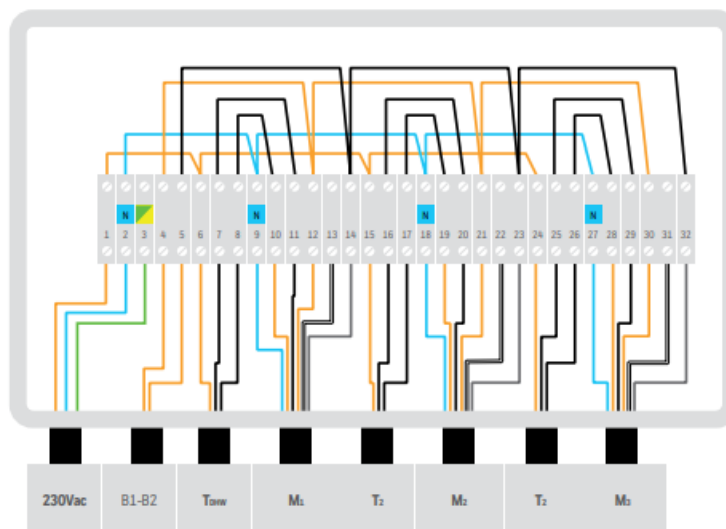

### Two Zone heating system with priority domestic hot water production

In this application, two independent heating zones were created by installing two 2-way VC zone valves in the heating distribution system. The domestic hot water tank is loaded through it's heat exchanger controlled by a 3-way VC changeover valve. The particular room thermostat opens the related heating zone valve incase heating is


needed in that heating zone. Each zone valve is equipped with on/off actuators with auxiliary switches. The auxiliary switches are used to provide heat demand contact to the boiler. The auxiliary switches are connected in parallel to the room thermostat input terminals of the boiler. With this solution, both zones can initiate boiler demand independently. When the hot water tank thermostats require tank loading, it opens the changeover valve switching the flow from the heating system to the domestic hot water tank loading circuit. The Changeover valve is equipped with an on/off actuator with an auxiliary switch. The auxiliary switch of the hot water loading changeover valve is also connected in parallel to the room thermostat input terminals of the boiler. In this application, only a heating boiler can be used, without an integrated outside air temperature compensated boiler temperature controller, and the boiler supply temperature has to be set to the level which is high enough to heat up the rooms and load the hot water tank at any time. In this application, domestic hot water tank loading has a priority over the heating so even a less powerful boiler can supply the heat consumers

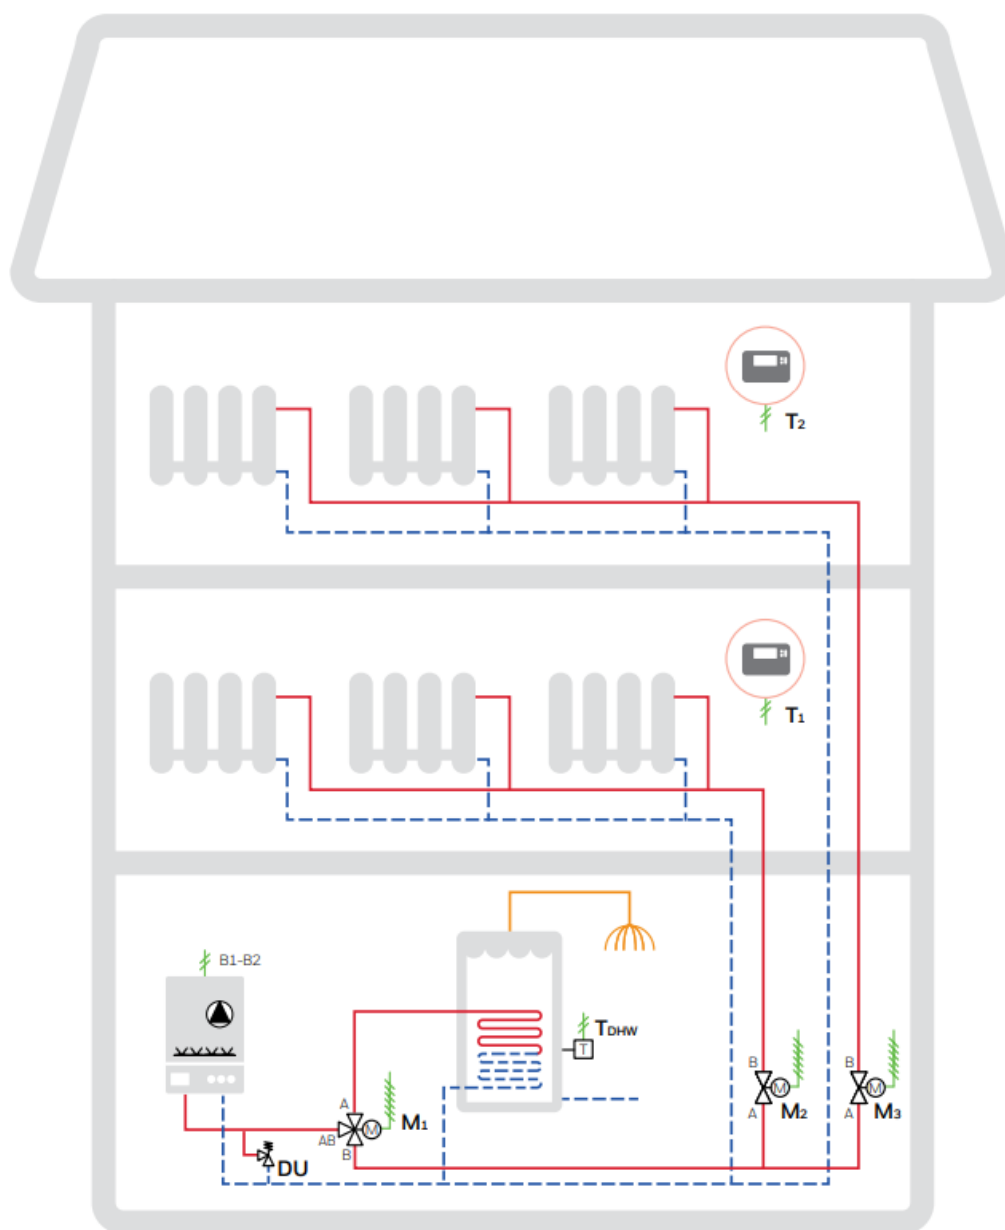

### Two Zone heating/cooling system with heating/cooling changeover valve

This application is quite similar to the previous ones from the heating zones point of view, however here two heating/cooling zones were created. Zones are controlled with room thermostats which open the related 2-way VC zone valves. A 3-way changeover valve is installed to select the heat source according the needs. In this application either heating or cooling mode is available, it is not possible to heat one zone while cool the other. The best way to control such application is using an applicable boiler room controller, however with a heat/cool manual operation mode selector switch and using some electrical relays the system can be managed without using a central controller. To design the wiring please consider that room thermostats should open the zone valves


equipped with on/off actuators with auxiliary switch. The auxiliary switch starts the pump of the related circuit as well as send a heat demand contact to the heat source through an electrical relay. Heat demands are collected by a relay which sends the demand signal to the boiler when the system is in heating mode set by the manual operation mode selector, and sends the demand signal to the cooler appliance if the system is in cooling mode. User should aware that both room thermostats and the manual operation mode switch have to be all set either to heating or cooling mode.

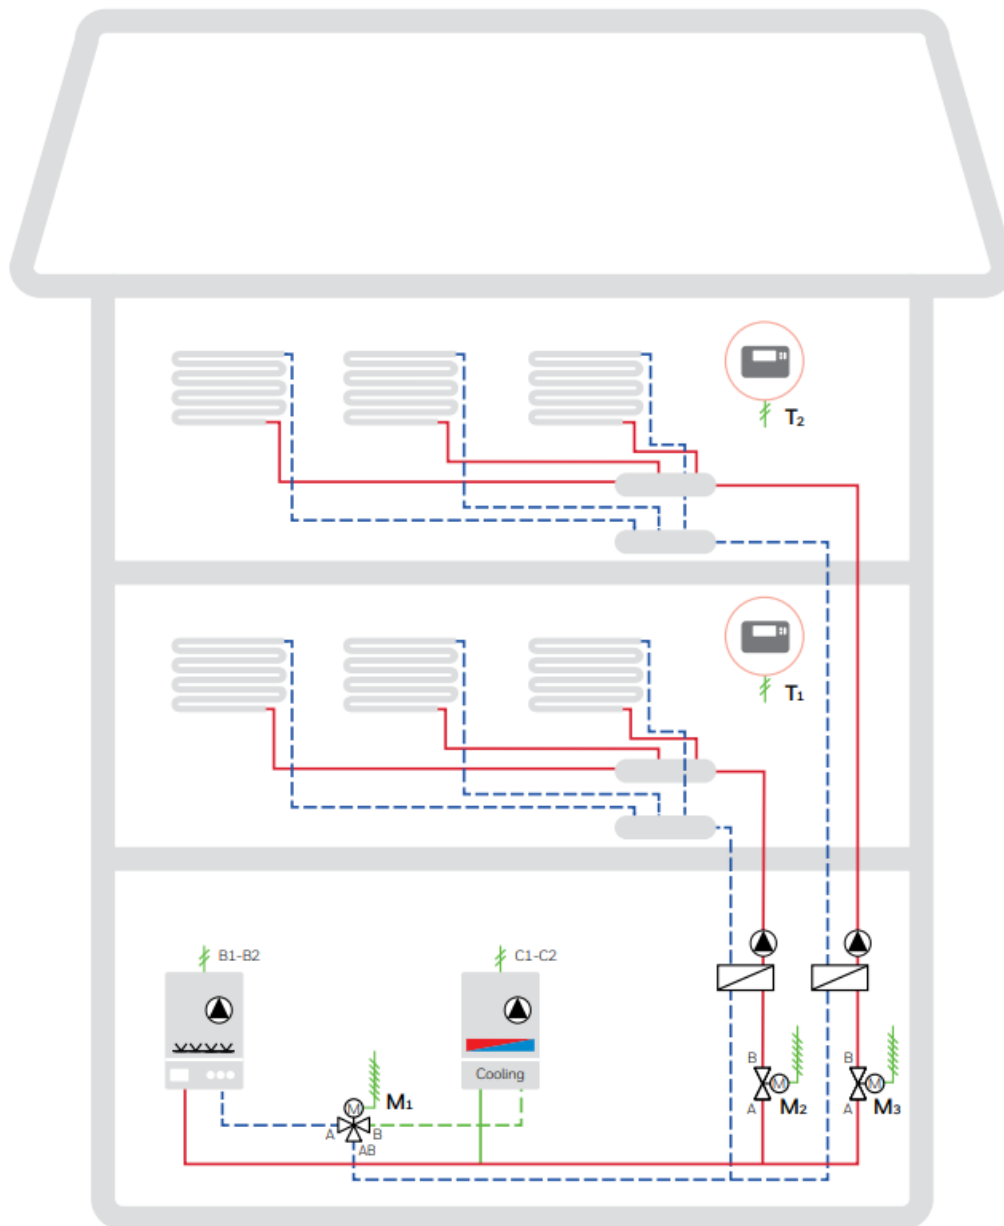

#### Some more ideas where to use VC valves:


- priority domestic hot water production
- the 3-way changeover valve switches the flow from the heating system to the domestic hot water tank and viceversa.



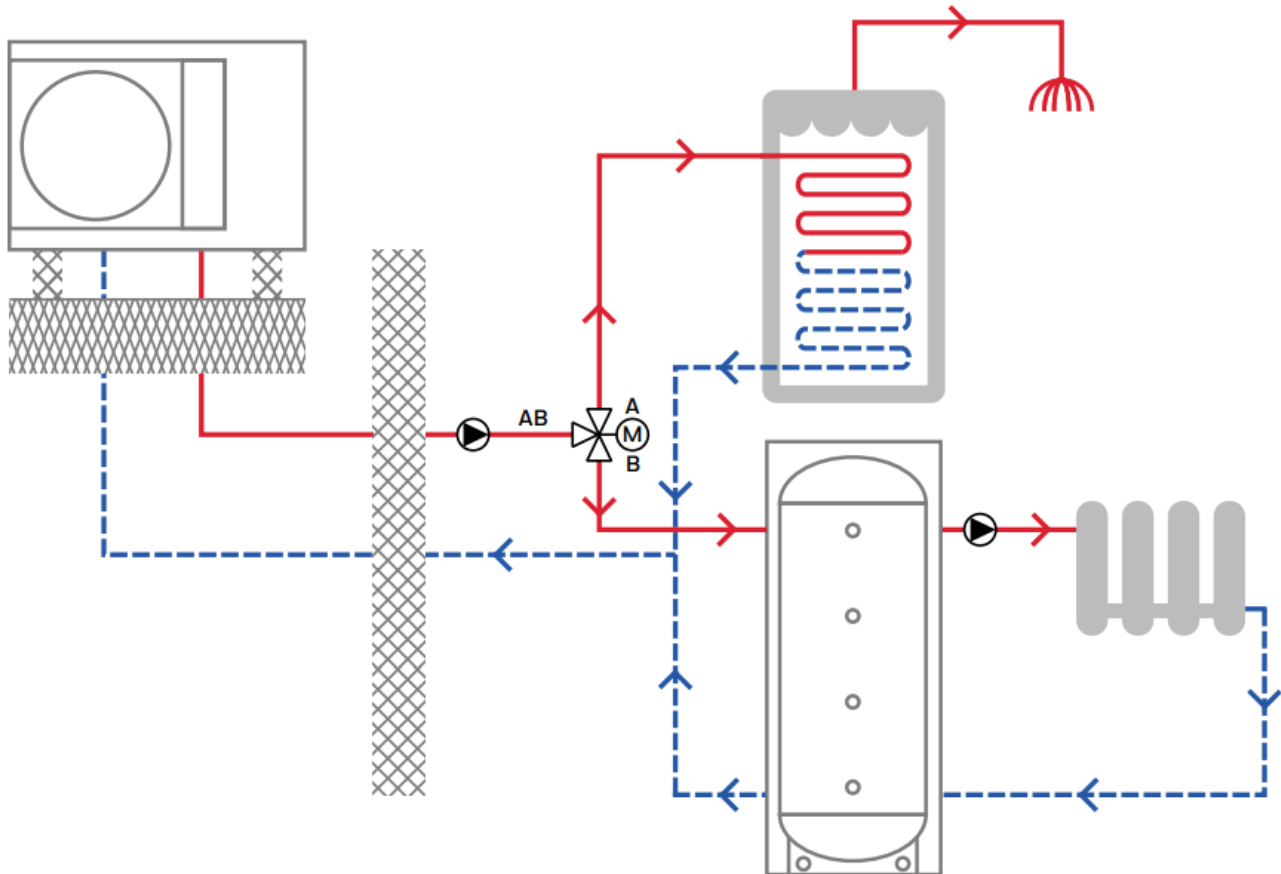

#### Some more ideas where to use VC valves:

- 3-way changeover valve in the solar circuit to let the solar panel loads either the domestic hot water tank, or heat up the water in the swimming pool through a heat exchanger
- 2-way zone valves to create independent heating zones
- 2-way zone valve to load the domestic hot water tank by the boiler

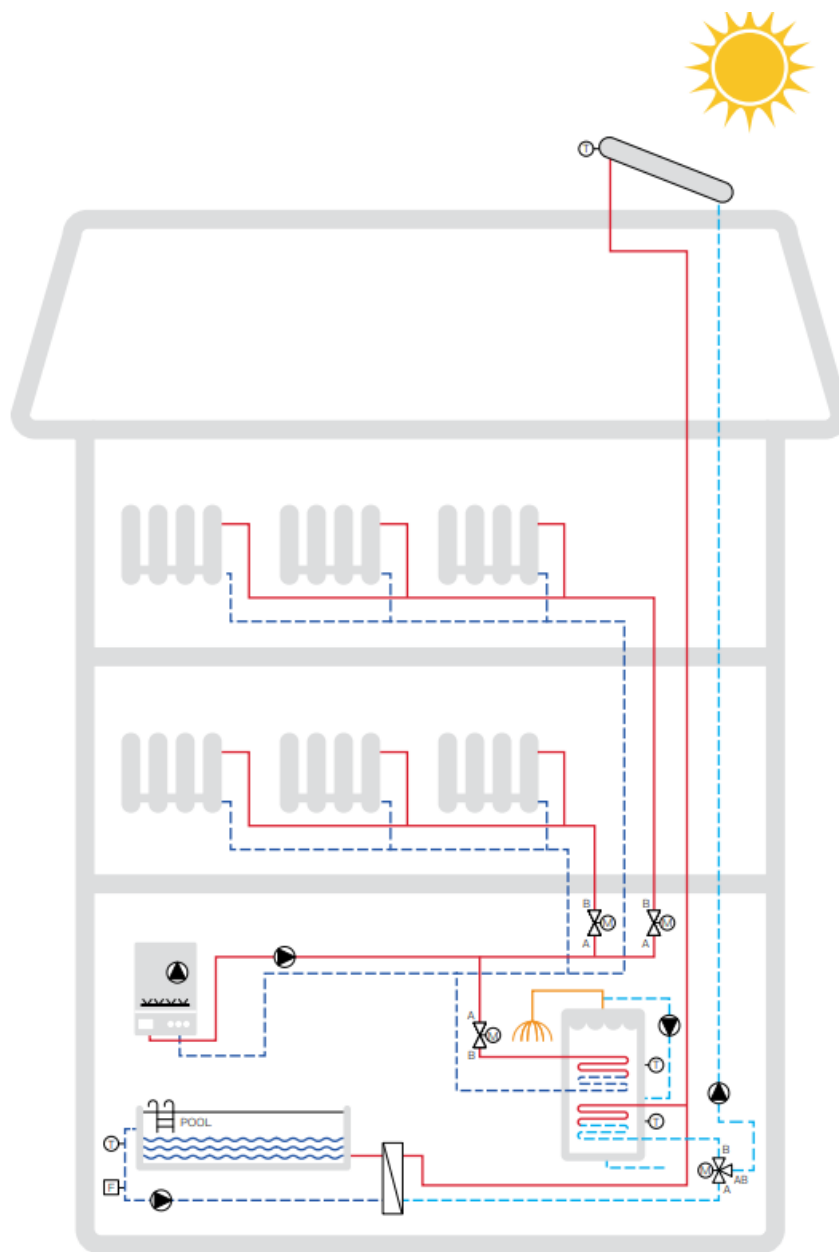

## Resideo

Resideo is a leading global manufacturer and developer of technology-driven products and components that provide critical comfort, energy management, and safety and security solutions to more than 150 million homes globally. A history of innovation is in our DNA and we have 2,300 patents across hardware and software. We benchmark ourselves to the highest global ESG standards and are proud to have achieved a Silver rating from EcoVadis, which represents a strong demonstration in environmental, ethics, and human rights categories. In EMEA, we have a wide product portfolio across Security, Water (including our Braukmann product family) and home Comfort (including our Honeywell Home and Centra branded products) categories – with around 110 different product groups. Over 87% of products made for Europe are made in Europe and we have 6 production sites.


## For more information

[resideo.com](https://resideo.com) Zone d'Activités La Piece 4 1180 Rolle Switzerland 04/24 © 2024 Resideo Technologies, Inc.

- Strandvejen 42
- Saksild
- 8300 Odder

- 86 62 63 64
- [www.automatikcentret.dk](http://www.automatikcentret.dk)
- [info@automatikcentret.dk](mailto:info@automatikcentret.dk)

## Documents / Resources

	<p><a href="#">AutomatikCentret VC Control Valve</a> [pdf] Instruction Manual VC Control Valve, Control Valve, Valve</p>
---	--

## References

- [Smart Home Products and Systems | Resideo](#)
- [User Manual](#)

### Manuals+, Privacy Policy

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.