



BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor Instruction Manual

[Home](#) » [BAPI](#) » BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor Instruction Manual 

Contents

- [1 BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor](#)
- [2 BAPI-Stat Quantum Slim Room Temperature Sensor](#)
- [3 Specifications](#)
- [4 Installation Instructions](#)
- [5 Termination Instructions](#)
- [6 Wiring](#)
- [7 Diagnostics](#)
- [8 Overview and Identification](#)
- [9 Documents / Resources](#)
 - [9.1 References](#)
- [10 Related Posts](#)



BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor



BAPI-Stat Quantum Slim Room Temperature Sensor


The BAPI-Stat Quantum Slim Temperature Room Sensor is a sleek, low profile room enclosure designed for applications where a temperature output is required. It is available with thermistor and RTD elements. Ideal for locations where aesthetics are as important as the temperature measurement.

Specifications

- **Wiring:** One pair of 22 AWG wires
- **Mounting:** Surface or drywall mount (screws provided)
- **Sensing Element:** Thermistor or RTD (See the Sensors Section of the BAPI catalog or the BAPI website for sensor specifications)
- **Environmental Operation Range:**
 - **Temperature:** 32 to 122 °F (0 to 50 °C)
 - **Humidity:** 0 to 95%, non-condensing
- **Agency:** RoHS, CE

Installation Instructions


Drywall Mounting

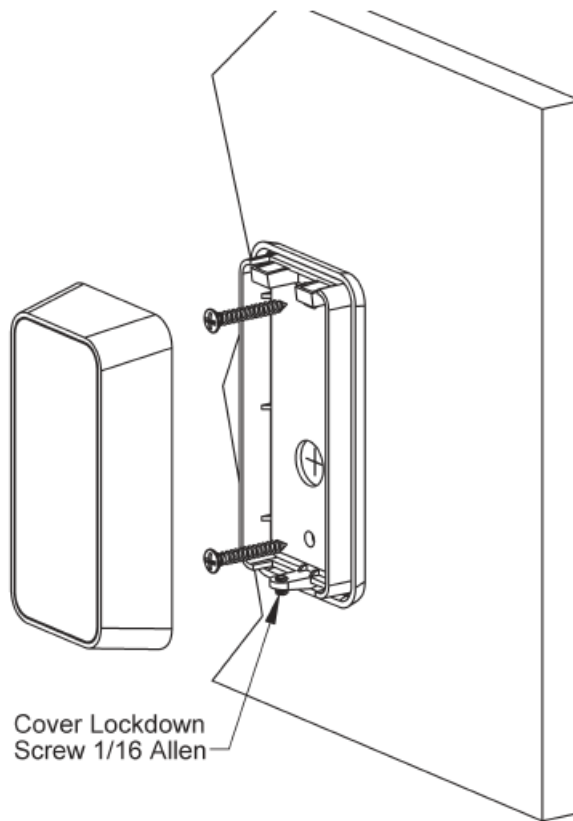

1. Place the base plate against the wall where you want to mount the sensor and mark the two mounting holes.
2. Drill two 3/16 holes in the center of each marked mounting hole. Insert a drywall anchor into each hole.
3. Secure the base to the drywall anchors using the #6 x 1 inch mounting screws provided.
4. Attach Cover by latching it to the top of the base, rotating the cover down and snapping it into place. Secure the cover by backing out the lock-down screws using a 1/16 Allen wrench until they are flush with the bottom of the cover.

Termination Instructions

BAPI recommends using twisted pair of at least 22AWG and sealant filled connectors for all wire connections. Larger gauge wire may be required for long runs. All wiring must comply with the National Electric Code (NEC) and local codes. Do NOT run this device's wiring in the same conduit as high or low voltage AC power wiring. BAPI's tests show that inaccurate signal levels are possible when AC power wiring is present in the same conduit as the sensor wires. BAPI recommends wiring the product with power disconnected. Proper supply voltage, polarity, and wiring connections are important to a successful installation. Not observing these recommendations may damage the product and will void the warranty.

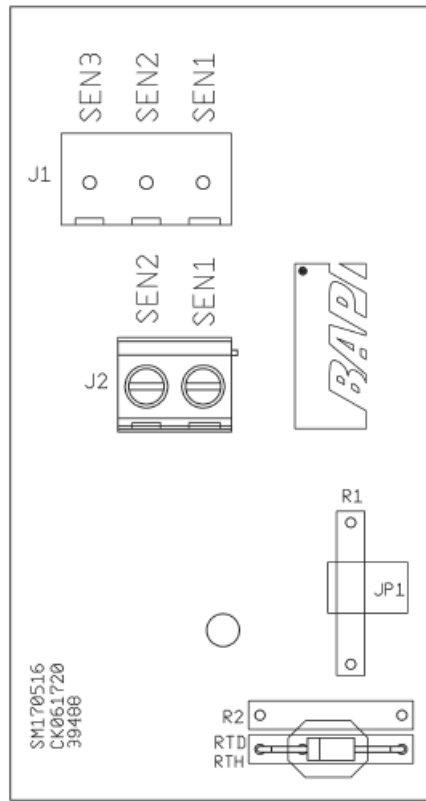

Wiring

J2 Terminal Block

- SEN 2Temperature Sensor, Resistance Output – To analog input of controller
- SEN 1Temperature Sensor, Resistance Output – To analog input of controller

J1 Terminal Block (only used for special order 3-wire sensors)

- SEN 3Temperature Sensor, Resistance Output – To analog input of controller (Common with Sen 2)
- SEN 2Temperature Sensor, Resistance Output – To analog input of controller (Common with Sen 3)
- SEN 1Temperature Sensor, Resistance Output – To analog input of controller

Diagnostics

Possible Problems:

Controller reports temperature that is higher or lower than actual temperature


Possible Solutions:

- Confirm the input is set up correctly in the front end software
- Check wiring for proper termination
- Determine if the sensor is exposed to an external source different from room environment such as conduit draft. If the sensor is exposed to conduit draft, fill the box with fiberglass or polyester fill or plug the conduit.
- Compare the sensor's resistive output to the actual temperature in the room. Measure the temperature at the sensor's location using an accurate standard. Disconnect the temperature sensor wires (SEN1 to SEN2) and measure the actual resistance across pins with an ohmmeter. Compare the sensor's resistance to the

appropriate temperature sensor table on the BAPI website. If the measured resistance varies by more than 5% from the temperature table, call BAPI technical support. To view the temperature table, go to the BAPI website (www.bapihvac.com), click on “Resource Library” and “Sensor Specs”, then click on the type of sensor you have.

Overview and Identification

The new BAPI-Stat “Quantum Slim” Temperature Room Sensor is designed for applications where a temperature output is required with a sleek, low profile room enclosure. Available with thermistor and RTD elements. Ideal for locations where aesthetics are as important as the temperature measurement

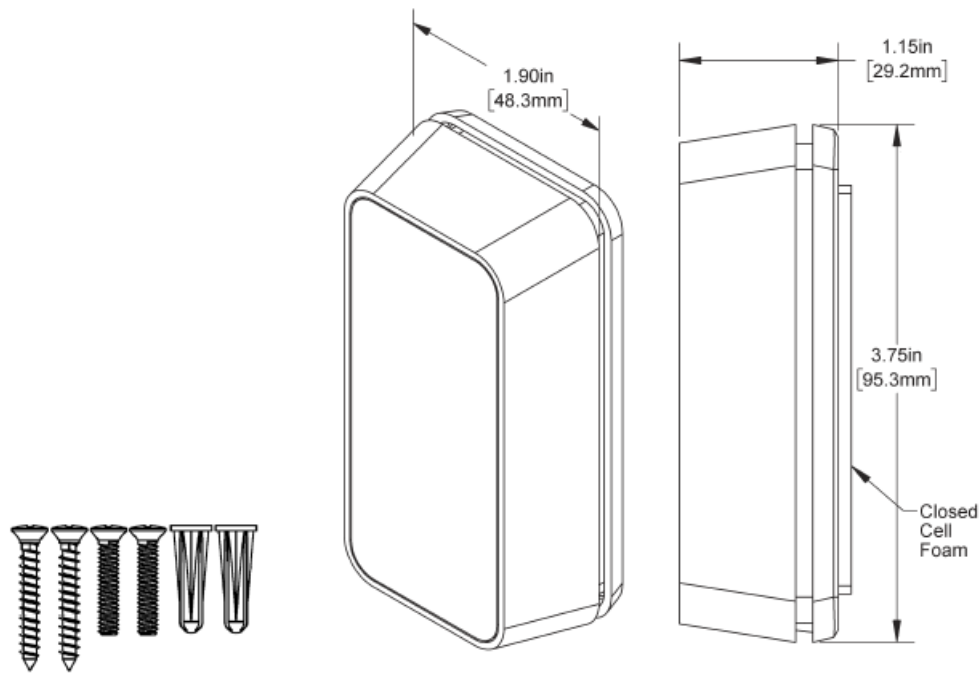

Building Automation Products, Inc., 750 North Royal Avenue, Gays Mills, WI 54631 USA

- **Tel:**+1-608-735-4800
- **Fax**+1-608-735-4804
- **E-mail:**sales@bapihvac.com
- **Web:**www.bapihvac.com

Documents / Resources

	<p>BAPI BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor [pdf] Instruction Manual</p> <p>BA-QS-W-B BAPI-Stat Quantum Slim Room Temperature Sensor, BA-QS-W-B, BAPI-Stat Quantum Slim Room Temperature Sensor, Quantum Slim Room Temperature Sensor, Slim Room Temperature Sensor, Room Temperature Sensor, Temperature Sensor, Sensor</p>
--	--

References

-  **[BAPI - Sensor Products for HVAC/R Duct and Room](#)**

