

# Beijer ELECTRONICS GT-222F Digital Output



## Beijer ELECTRONICS GT-222F Digital Output Module User Manual


[Home](#) » [Beijer ELECTRONICS](#) » Beijer ELECTRONICS GT-222F Digital Output Module User Manual 

### Contents

- [1 Beijer ELECTRONICS GT-222F Digital Output](#)
- [2 Product Usage Instructions](#)
- [3 About This Manual](#)
- [4 Safety](#)
- [5 Specifications](#)
- [6 Wiring Diagram](#)
- [7 LED Indicator](#)
- [8 Mapping Data Into the Image Value](#)
- [9 Parameter Data](#)
- [10 Hardware Setup](#)
- [11 More Info](#)
- [12 FAQ](#)
- [13 Documents / Resources](#)
  - [13.1 References](#)

**Beijer**  
ELECTRONICS

Beijer ELECTRONICS GT-222F Digital Output

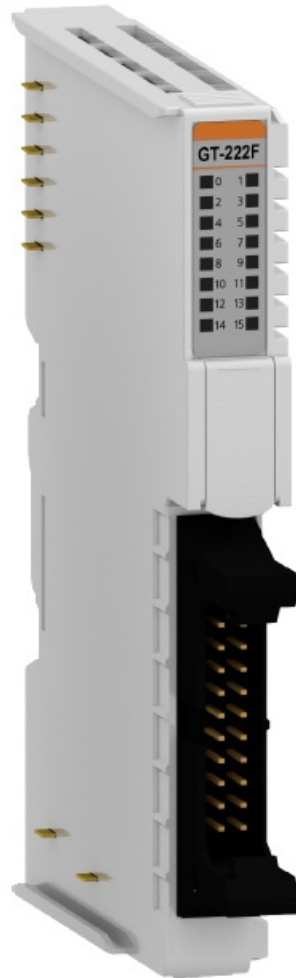

## Specifications

- **Model:** GT-222F Digital Output Module
- **Channels:** 16
- **Voltage:** 24 VDC
- **Current:** 0.3 A
- **Source:** 20 pt connector

## Product Usage Instructions

### Installation

1. Ensure power is off before installation.
2. Mount the module securely to a DIN rail using appropriate mounting hardware.
3. Connect field power and data pins to the designated connectors.

### Setup

1. Refer to the IO Process Data Mapping section in the manual for configuring input/output data.
2. Ensure proper grounding to avoid damage from electrostatic discharge.

### Usage

1. Power on the system and module.
2. Monitor the output status through the provided software interface or indicators on the module.
3. Follow safety guidelines mentioned in the manual during operation.

## About This Manual

This manual contains information on the software and hardware features of the Beijer Electronics GT-222F Digital Output Module. It provides in-depth specifications, guidance on installation, setup, and usage of the product.

## Symbols Used in This Manual

This publication includes Warning, Caution, Note and Important icons where appropriate, to point out safety-related, or other important information. The corresponding symbols should be interpreted as follows:



The Warning icon indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury, and major damage to the product.



The Caution icon indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury, and moderate damage to the product.



The Note icon alerts the reader to relevant facts and conditions.



The Important icon highlights important information.

## Safety

Before using this product, please read this manual and other relevant manuals carefully. Pay full attention to safety instructions!

In no event will Beijer Electronics be responsible or liable for damages resulting from the use of this product.

The images, examples and diagrams in this manual are included for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Beijer Electronics cannot take responsibility or liability for actual use based on the examples and diagrams.

## Product Certifications

The product has the following product certifications.



## General Safety Requirements


### WARNING

- Do not assemble the products and wires with power connected to the system. Doing so cause an “arc flash”, which can result in unexpected dangerous events (burns, fire, flying objects, blast pressure, sound blast, heat).
- Do not touch terminal blocks or IO modules when the system is running. Doing so may cause electric shock, short circuit or malfunction of the device.
- Never let external metallic objects touch the product when the system is running. Doing so may cause electric shock, short circuit or malfunction of the device.
- Do not place the product near inflammable material. Doing so may cause a fire.
- All wiring work should be performed by an electrical engineer.
- When handling the modules, ensure that all persons, the workplace and the packing are well grounded. Avoid touching conductive components, the modules contain electronic components that may be destroyed by electrostatic discharge.

### CAUTION

- Never use the product in environments with temperature over 60°C. Avoid placing the product in direct sunlight.
- Never use the product in environments with over 90% humidity.
- Always use the product in environments with pollution degree 1 or 2.
- Use standard cables for wiring.

## About the G-series System

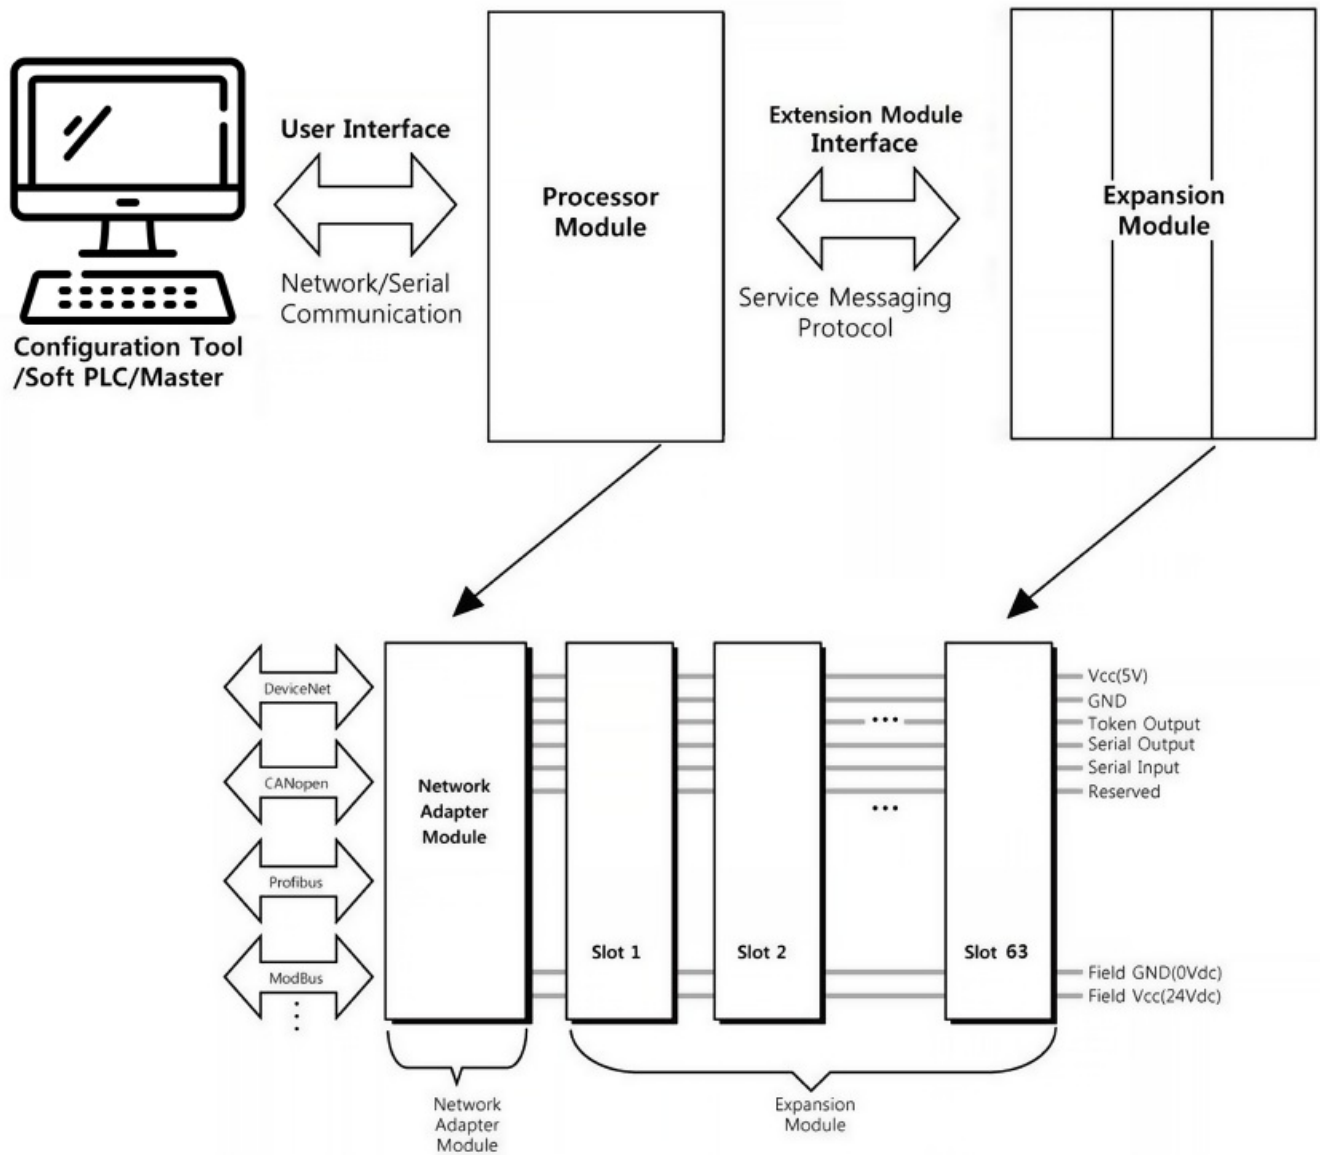


## System overview

- **Network Adapter Module:** The network adapter module forms the link between the field bus and the field devices with the expansion modules. The connection to different field bus systems can be established by each of the corresponding network adapter module, e.g., for MODBUS TCP, Ethernet IP, EtherCAT, PROFINET, CC-Link IE Field, PROFIBUS, CANopen, DeviceNet, CC-Link, MODBUS/Serial etc.
- **Expansion Module:** Expansion module types: Digital IO, Analog IO, and Special modules.
- **Messaging:** The system uses two types of messaging: Service messaging and IO messaging.

## IO Process Data Mapping

An expansion module has three types of data: IO data, configuration parameter, and memory register. The data exchange between the network adapter and the expansion modules is made via IO process image data by internal protocol.

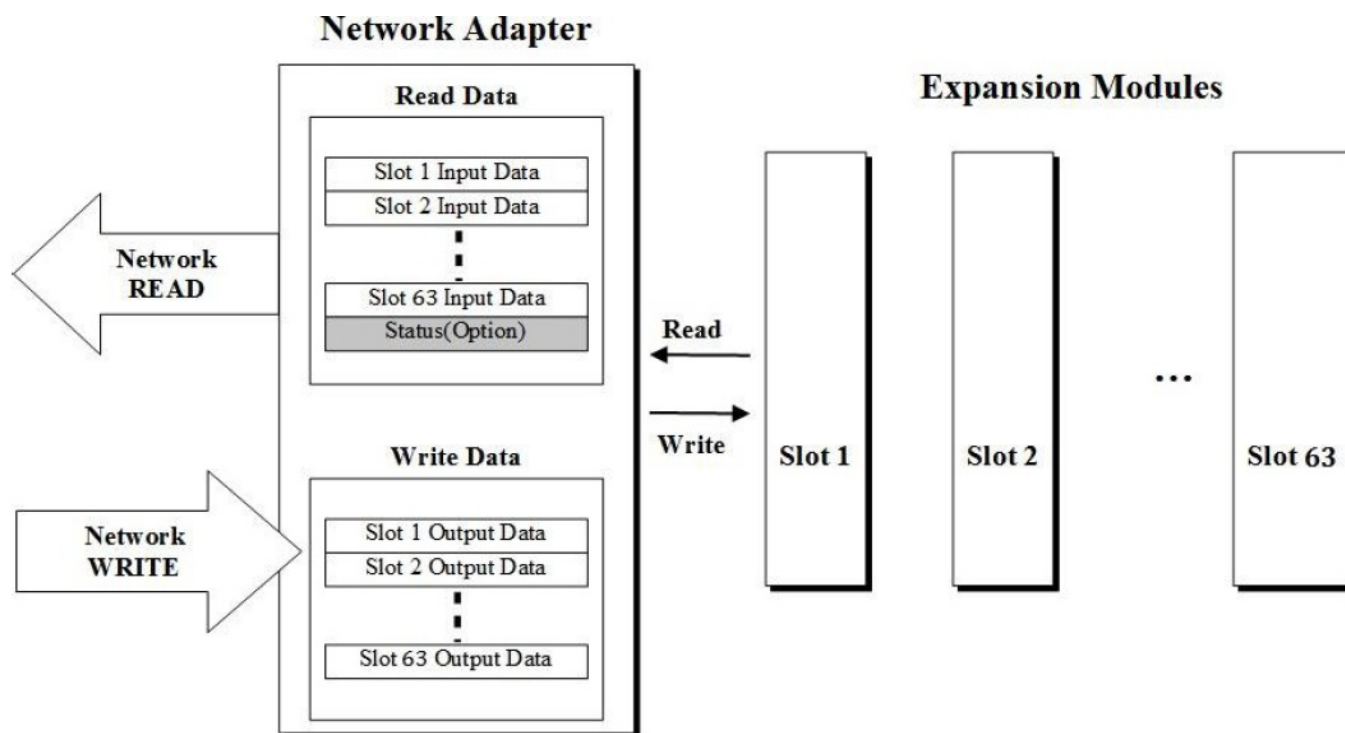

Data flow between network adapter (63 slots) and expansion modules

The input and output image data depend on the slot position and the data type of the expansion slot. The ordering of input and output process image data is based on the expansion slot position. Calculations for this arrangement are included in the manuals for network adapter and programmable IO modules.

Valid parameter data depends on the modules in use. For example, analog modules have settings of either 0-20 mA or 4-20 mA, and temperature modules have settings such as PT100, PT200, and PT500. The documentation for each module provides a description of the parameter data.

## Specifications


### Environmental Specifications

<b>Operating temperature</b>	-20°C – 60°C
<b>UL temperature</b>	-20°C – 60°C
<b>Storage temperature</b>	-40°C – 85°C
<b>Relative humidity</b>	5% – 90% non-condensing
<b>Mounting</b>	DIN rail
<b>Shock operating</b>	IEC 60068-2-27 (15G)
<b>Vibration resistance</b>	IEC 60068-2-6 (4 g)
<b>Industrial emissions</b>	EN 61000-6-4: 2019
<b>Industrial immunity</b>	EN 61000-6-2: 2019
<b>Installation position</b>	Vertical and horizontal
<b>Product certifications</b>	CE, FCC, UL, cUL

General Specifications

Power dissipation	Max. 50 mA @ 5 VDC
Isolation	I/O to Logic: Photocoupler isolation Field power: Non-isolation
UL field power	Supply voltage: 24 VDC nominal, Class 2
Field power	Supply voltage: 24 VDC nominal Voltage range: 15-30 VDC Power dissipation: 20 mA @ 24 VDC
Wiring	Module connector: HIF3BA-20D-2.54R
Weight	52 g
Module size	12 mm x 99 mm x 70 mm

Dimensions

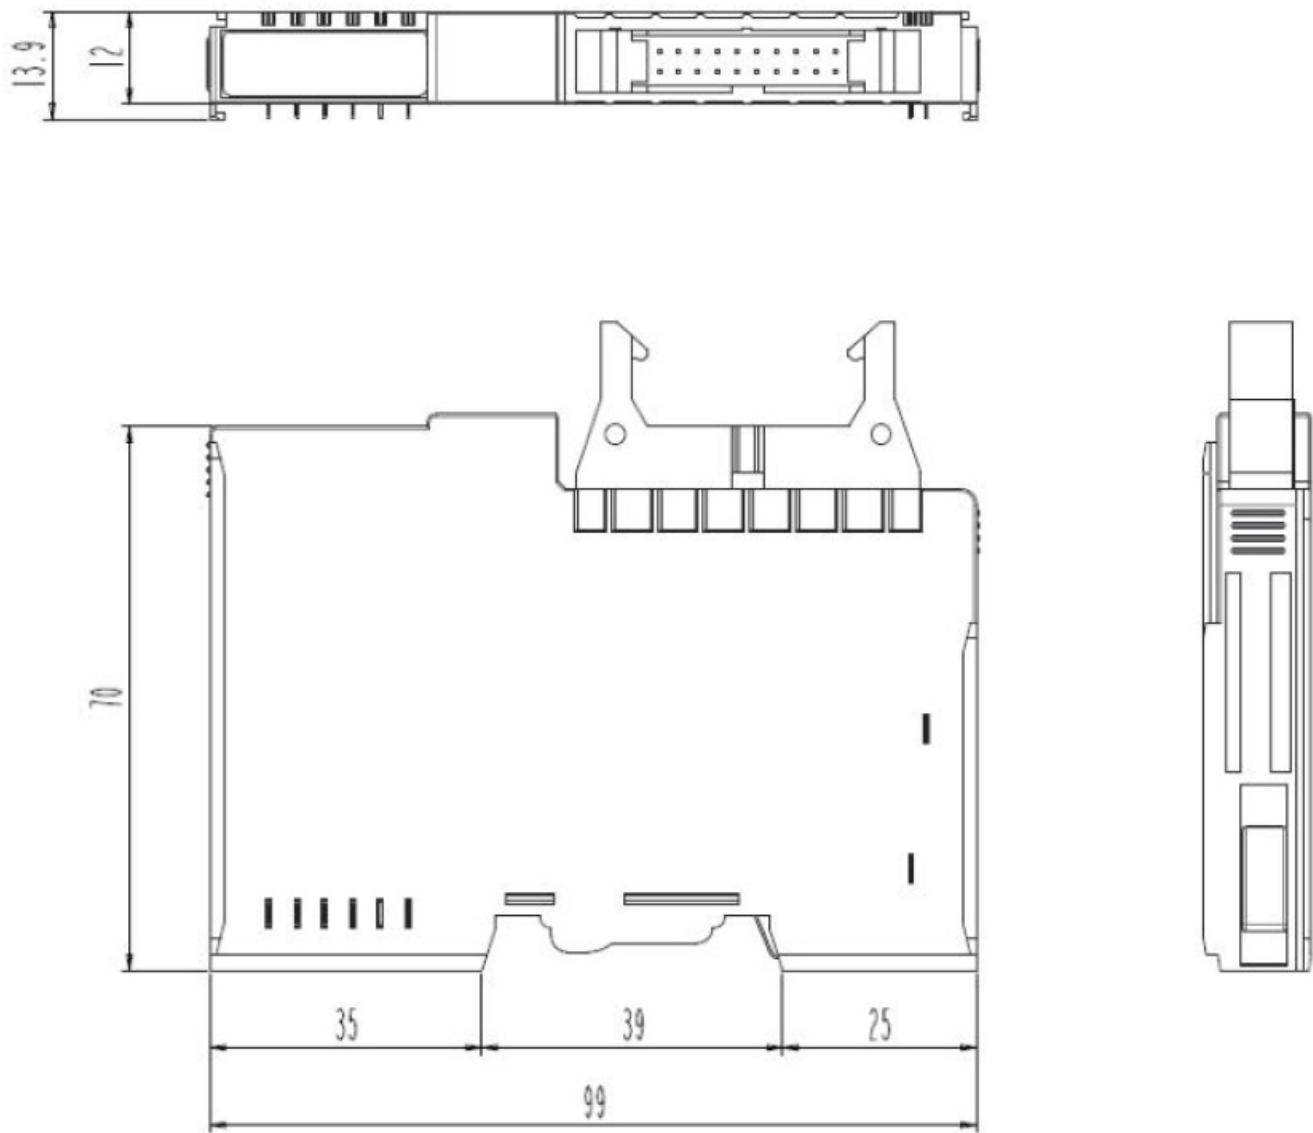


Module dimensions (mm)

## Output Specifications

<b>Output per module</b>	16 points source type
<b>Indicators</b>	16 green output status
<b>Output voltage range</b>	24 VDC nominal 15 VDC – 30 VDC @ 70 °C
<b>On-state voltage drop</b>	0.3 VDC @ 25 °C 0.5 VDC @ 70 °C
<b>On-state min. current</b>	Min. 1 mA
<b>Off-state leakage current</b>	Max. 5 uA
<b>Output signal delay</b>	OFF to ON: Max. 0.3 ms ON to OFF: Max 0.3 ms
<b>Output current rating</b>	Max. 0.3 A per channel / Max. 3.6 A per unit
<b>Protection</b>	Over current limit: Min. 6.5 A @ 25 °C per channel Thermal shutdown: Min 4 A @ 25 °C per channel  Short circuit protection
<b>Common type</b>	16 points / 2 COM

## Wiring Diagram

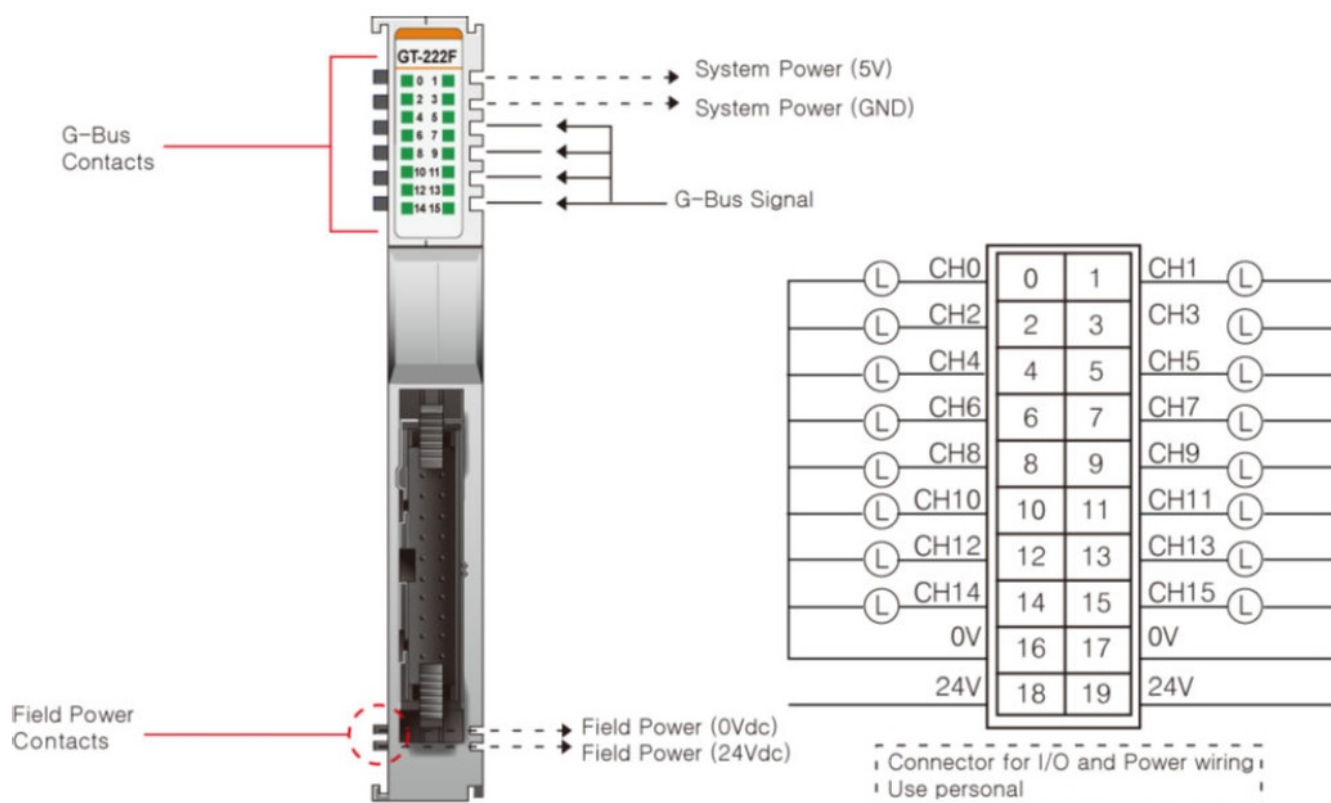



Pin no.	Signal description
0	Output channel 0
1	Output channel 1
2	Output channel 2
3	Output channel 3
4	Output channel 4
5	Output channel 5
6	Output channel 6
7	Output channel 7
8	Output channel 8
9	Output channel 9
10	Output channel 10
11	Output channel 11
12	Output channel 12
13	Output channel 13
14	Output channel 14
15	Output channel 15
16	Common (Field power 0 V)
17	Common (Field power 0 V)
18	Common (Field power 24 V)
19	Common (Field power 24 V)

## LED Indicator



LED no.	LED function / description	LED color
0	OUTPUT channel 0	Green
1	OUTPUT channel 1	Green
2	OUTPUT channel 2	Green
3	OUTPUT channel 3	Green
4	OUTPUT channel 4	Green
5	OUTPUT channel 5	Green
6	OUTPUT channel 6	Green
7	OUTPUT channel 7	Green
8	OUTPUT channel 8	Green
9	OUTPUT channel 9	Green
10	OUTPUT channel 10	Green
11	OUTPUT channel 11	Green
12	OUTPUT channel 12	Green
13	OUTPUT channel 13	Green
14	OUTPUT channel 14	Green
15	OUTPUT channel 15	Green

## Channel Status

Status	LED	Indicates
Not signal	Off	Normal operation
On signal	Green	Normal operation

Mapping Data Into the Image Value

Output Image Value

Bit no.	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Byte 0	D7	D6	D5	D4	D3	D2	D1	D0
Byte 1	D15	D14	D13	D12	D11	D10	D9	D8



Output Module Data

D7	D6	D5	D4	D3	D2	D1	D0
D15	D14	D13	D12	D11	D10	D9	D8

Parameter Data

Valid parameter length: 4 Bytes

Bit no.	Bit 7	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
<b>Byte 0</b>	Fault action (ch0-ch7) 0: Fault value, 1: Hold last state							
<b>Byte 1</b>	Fault action (ch8-ch15) 0: Fault value, 1: Hold last state							
<b>Byte 2</b>	Fault value (ch0-ch7) 0: Off, 1: On							
<b>Byte 3</b>	Fault value (ch8-ch15) 0: Off, 1: On							

## Hardware Setup

### CAUTION



- Always read this chapter before installing the module!
- Hot surface! The surface of the housing can become hot during operation. If the device is used in high ambient temperatures, always let the device cool down before touching it.
- Working on energized devices can damage the equipment! Always turn off the power supply before working on the device.

### Space Requirements

The following drawings show the space requirements when installing the G-series modules. The spacing creates space for ventilation, and prevents conducted electromagnetic interference from influencing the operation. Installation position is valid vertical and horizontal. The drawings are illustrative and may be out of proportion.

### CAUTION

NOT following the space requirements may result in damaging the product.

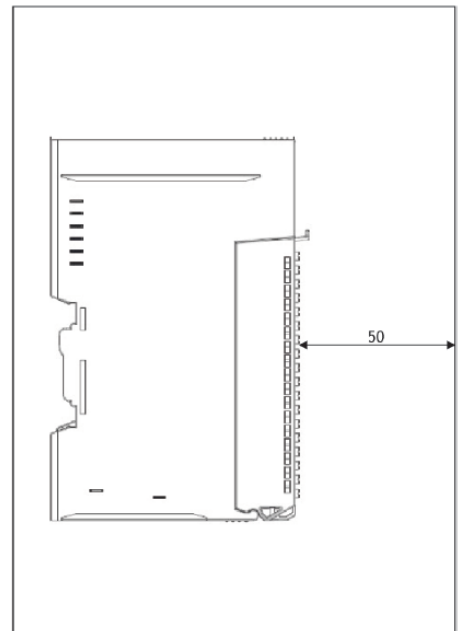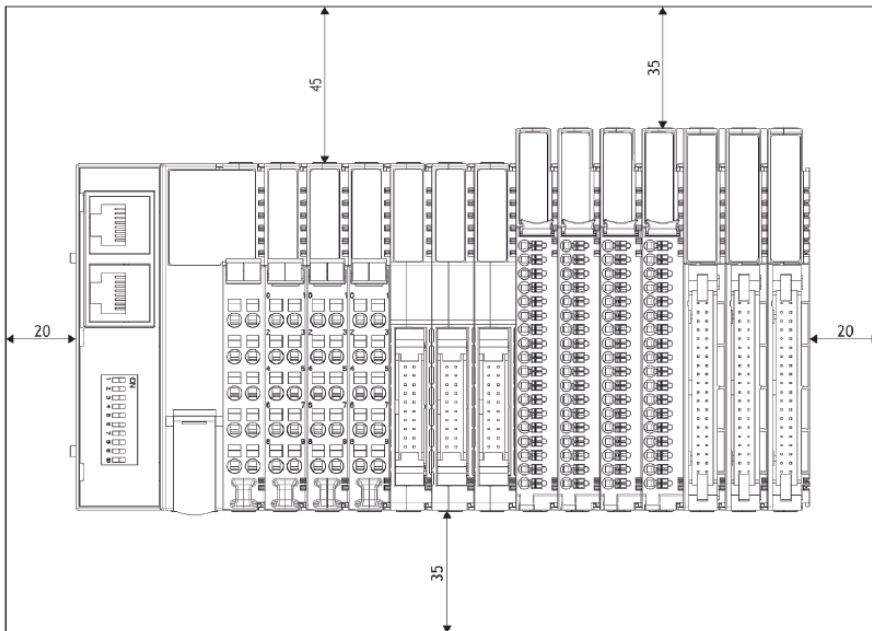

## Mount Module to DIN Rail

The following chapters describe how to mount the module to the DIN rail.

### CAUTION

The module must be fixed to the DIN rail with the locking levers.

## Mount GL-9XXX or GT-XXXX Module

The following instructions apply to these module types:

- GL-9XXX
- GT-1XXX
- GT-2XXX
- GT-3XXX
- GT-4XXX
- GT-5XXX
- GT-7XXX

GN-9XXX modules have three locking levers, one at the bottom and two on the side. For mounting instructions, refer to Mount GN-9XXX Module.





*Mount to DIN rail*





*Dismount from DIN rail*

#### **Mount GN-9XXX Module**

To mount or dismount a network adapter or programmable IO module with the product name GN-9XXX, for example GN-9251 or GN-9371, see the following instructions:

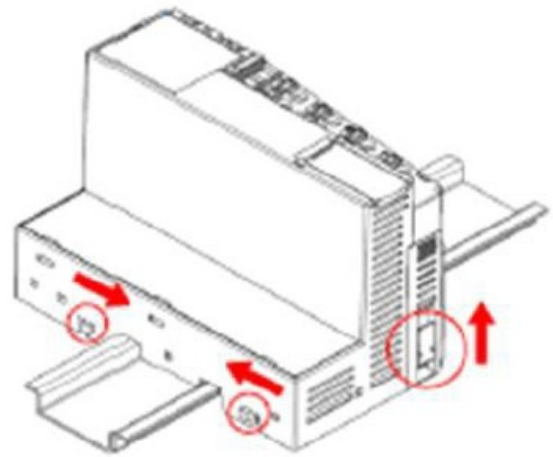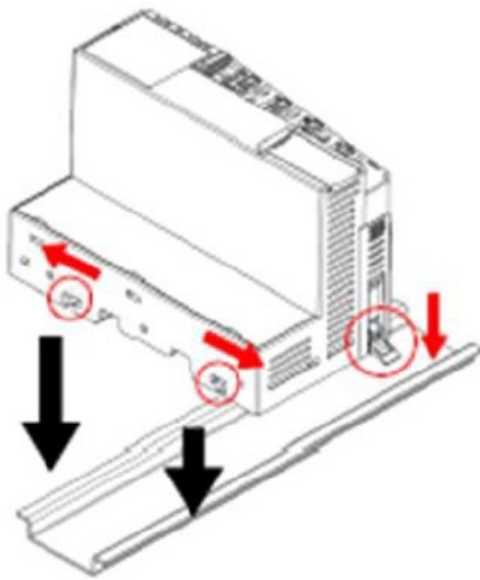

*Mount to DIN rail*

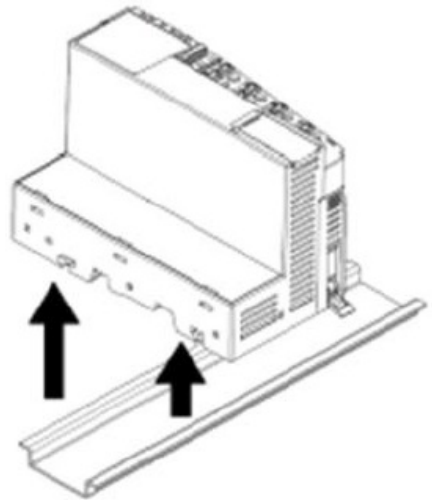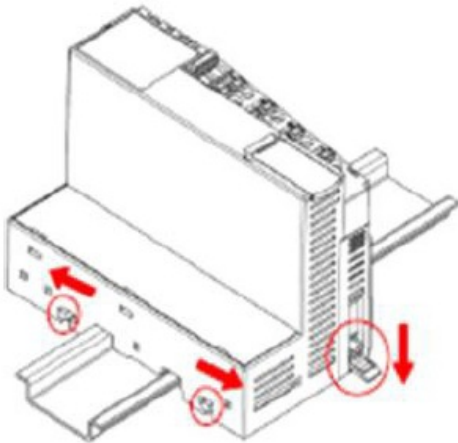


*Dismount from DIN rail*

### Field Power and Data Pins

Communication between the G-series network adapter and the expansion module, as well as system /field power supply of the bus modules is carried out via the internal bus. It is comprised of 2 Field Power Pins and 6 Data Pins.

### WARNING

Do not touch the data and field power pins! Touching can result in soiling and damage by ESD noise.

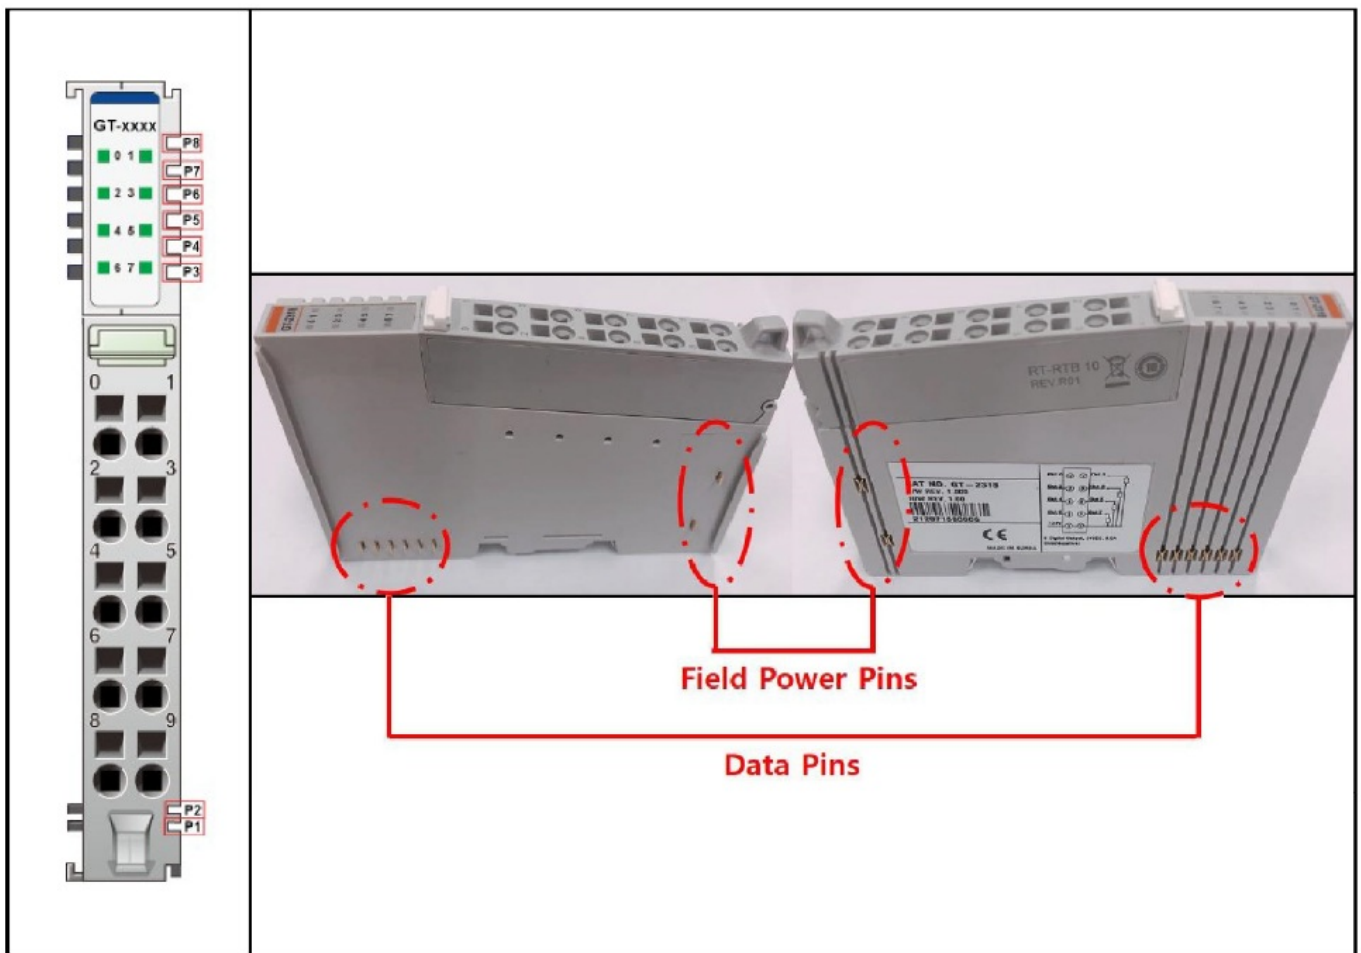

Pin no.	Name	Description
P1	System VCC	System supply voltage (5 VDC)
P2	System GND	System ground
P3	Token output	Token output port of processor module
P4	Serial output	Transmitter output port of processor module
P5	Serial input	Receiver input port of processor module
P6	Reserved	Reserved for bypass token
P7	Field GND	Field ground
P8	Field VCC	Field supply voltage (24 VDC)

The information in this document is subject to change without notice and is provided as available at the time of printing. Beijer Electronics AB reserves the right to change any information without updating this publication. Beijer Electronics AB assumes no responsibility for any errors that may appear in this document. All examples in this document are only intended to improve understanding of the functionality and handling of the equipment. Beijer Electronics AB cannot assume any liability if these examples are used in real applications.

In view of the wide range of applications for this software, users must acquire sufficient knowledge themselves in order to ensure that it is correctly used in their specific application. Persons responsible for the application and the equipment must themselves ensure that each application is in compliance with all relevant requirements, standards, and legislation in respect to configuration and safety. Beijer Electronics AB will accept no liability for any damage incurred during the installation or use of equipment mentioned in this document. Beijer Electronics AB prohibits all modification, changes, or conversion of the equipment.



## More Info

### Head Office

Beijer Electronics AB

Box 426

201 24 Malmö, Sweden

- [www.beijerelectronics.com](http://www.beijerelectronics.com)
- +46 40 358600

### FAQ

- **Q: What should I do if the module does not power on?**
  - **A:** Check the power source and connections to ensure proper installation. If issues persist, contact customer support.
- **Q: Can I use this module with a different voltage input?**
  - **A:** No, this module is designed for use with a 24 VDC input only. Using a different voltage may damage the module.

### Documents / Resources

	<p><a href="#">Beijer ELECTRONICS GT-222F Digital Output Module</a> [pdf] User Manual GT-222F Digital Output Module, GT-222F, Digital Output Module, Output Module, Module</p>
---	--

### References

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.