



## BSLBATT BSL\_8\_2 8.2KWH Lithium ion Battery User Manual

[Home](#) » [BSLBATT](#) » BSLBATT BSL\_8\_2 8.2KWH Lithium ion Battery User Manual 

# BSLBATT®

*Best Solution Lithium Battery*

BSL\_8\_2 8.2KWH Lithium ion Battery  
User Manual



8.2KWH Lithium-ion battery

## Contents

### [1 SAFETY GUIDELINES](#)

### [2 Pin out diagram](#)

### [3 Battery set-up](#)

### [4 Inverter set-up](#)

### [5 Inverter settings \(Victron\)](#)

### [6 Other specifications](#)

### [7 Documents / Resources](#)

### [8 Related Posts](#)

## SAFETY GUIDELINES



Work or maintenance on the BSL battery should be carried out by qualified personnel only. Do not attempt to open or dismantle battery and/or cells.



The electrolyte contained in the battery cells is highly corrosive. In the event of any damage to or leakage from the cells, treat contents with care, do not allow contact with exposed skin or eyes. DO NOT INGEST.



The terminals of the BSL battery should always be considered live, therefore do not place tools or any other items across the terminals. Do not pierce, short or damage the terminals in any way. Do not touch the terminals of the battery.



Fire Hazard: Do not discharge battery below specified minimum level as this poses an increased fire risk. Do not attempt to charge a swollen or damaged battery. In the event of fire, a CO2 or Dry Powder extinguisher should be used. Class D extinguishers are not suitable.



Dispose of batteries through the proper local regulations. Not suitable for regular refuse/recycling.

## Pin out diagram



Figure 1: Pin-out diagram for 8.2kWh BSL battery.

A- Power indicator light B- Run light (battery activity) C- Alarm indicator light D- State of charge indicator lights E- Reset switch (BMS Power button) F- Dip switches for parallel connection G- Dry Contacts (mostly unused) H- RS485 Left port (Port 1)	I- CAN Port (Port 2) J- RS232 Port (Unused) K- RS485 Right Ports (Ports 4 L- Circuit breaker (terminal pov M- Positive terminal N- Negative terminal O- Carry handles P- Mounting holes
---	--

## Battery set-up

### 2.1 General

#### 2.1.1 Turning battery on and off

The battery can be switched on or off by holding down the small recessed button marked “RESET”.

#### 2.1.2 CAN communication

A VE. Can to CAN-bus BMS “Type B” cable is required for CAN-Bus communication between the BSL battery and the Victron GX device. Some inverters will use different cable configuration, please check this with inverter suppliers. (Black to inverter/GX device, red to battery).

Function	Victron VE. Can Side (GX)	Battery side
GND	Pin 3	Pin 2
CAN – L	Pin 8	Pin 5
CAN – H	Pin?	Pin 4


#### 2.1.3 Smart shunt

A Battery Monitoring Device (Victron BMV/Smarts hunt) is not required as State of Charge (SOC) is sent to the GX device via the CAN-Bus cable.

#### 2.1.4 Dry contacts

Dry Contacts are mostly unused, but for communication with some non-smart systems please see the table below. Working current should be less than 2A, mainly to connect with an external indicator light or buzzer.

PIN 1 to PIN2	Always open, will close with low battery signal
PIN3 to PIN4	Always Open, will close with fault/protection signal.

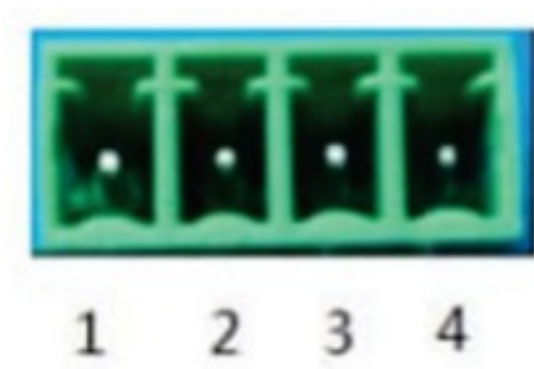

### 2.1.5 Other ports

Port 1 (RS485) and port 3 (RS232) are used for programming and retrieving information only and must be left open.

## 2.2 Multiple batteries

### 2.2.1 Max number of parallel batteries

A maximum of 20 batteries can be connected in parallel. Each battery will require a unique binary address which can be setup via the dip-switches located on the front of the battery.

### 2.2.2 Installing multiple batteries

When installing more than one battery in parallel, a standard RJ45 patch network cable will be required for inter-battery communication. These cables will need to be connected to port 4 or 5 between all the connected batteries. The ports are paralleled therefore any port can be used for in or out connection.

### 2.2.3 Cable sizing with multiple batteries

It is recommended to make use of a common rail bus-bar when more than 4 batteries are to be installed. All positive cables running between the battery and bus-bar must be the same length and all negative cables must be the same length. The batteries should be evenly grouped where possible. The recommended battery cable sizes from the batteries (going to the inverter) in parallel are as follows: 1 battery – 50mm<sup>2</sup>, 2 batteries – 70mm<sup>2</sup>, 3 batteries – 95mm<sup>2</sup> or 2 x 50mm<sup>2</sup>, 4 batteries – 120mm<sup>2</sup> or 2 x 70mm<sup>2</sup>

### 2.2.4 Dip switch settings for multiple batteries

Address	Dial switch position						Remark
	#1	#2	#3	#4	#5	#6	
0	OFF	OFF	OFF	OFF	OFF	OFF	Steeple connection, Single use
1	ON	OFF	OFF	OFF	OFF	OFF	Set as main Pack
2	OFF	ON	OFF	OFF	OFF	OFF	Set as subordinate Pack
3	ON	ON	OFF	OFF	OFF	OFF	Set as subordinate Pack2
4	OFF	OFF	ON	OFF	OFF	OFF	Set as subordinate Pack3
5	ON	OFF	ON	OFF	OFF	OFF	Set as subordinate Pack4
6	OFF	ON	ON	OFF	OFF	OFF	Set as subordinate Packs
7	ON	ON	ON	OFF	OFF	OFF	Set as subordinate Pack6
8	OFF	OFF	OFF	ON	OFF	OFF	Set as subordinate Pack?
9	ON	OFF	OFF	ON	OFF	OFF	Set as subordinate Pack8
10	OFF	ON	OFF	ON	OFF	OFF	Set as subordinate Pack9
11	ON	ON	OFF	ON	OFF	OFF	Set as subordinate Pack10
12	OFF	OFF	ON	ON	OFF	OFF	Set as subordinate Pack11
13	ON	OFF	ON	ON	OFF	OFF	Set as subordinate Pack12
14	OFF	ON	ON	ON	OFF	OFF	Set as subordinate Pack13
IS	ON	ON	ON	ON	OFF	OFF	Set as subordinate Pack14

## Inverter set-up

### 3.1 Batteries per inverter size


Inverter size 15kVA	Recommended N.O. batteries	Minimum N.O. of batteries
10kVA	3	2
8kVA	2	2
5kVA	2	1
3kVA	1	1
	1	1

### 3.2 Battery set-up on Victron GX device

1. The VE. Can to CAN-bus BMS Type B cable needs to be connected to the VE-Can port on the GX device and the second unused VE. Can port needs to be terminated with the Victron blue terminator. Ensure that the cable is marked CCGX at the end.
2. Press the enter button on the GX device. This should take you to the device list page. Scroll down to settings,


press enter, and scroll to services and press enter again. Navigate to the CAN settings and change the CAN speed from 250 KB to 500 KB.

3. Scroll to DVCC and select Switch DVCC on. Flag SHARED VOLTAGE SENSE and CHARGE LIMIT. Set CCL (charge current limit) to 80 amps/battery.
4. Navigate back to the device list and the BSL battery should appear on the device list.
5. Select the BSL battery set the parameters as follows:
  - Charge Voltage 54.5V.
  - Charge Current Limit: 90A per battery (recommended 80A).
  - Discharge Current Limit: 180A per battery (constant 150A).

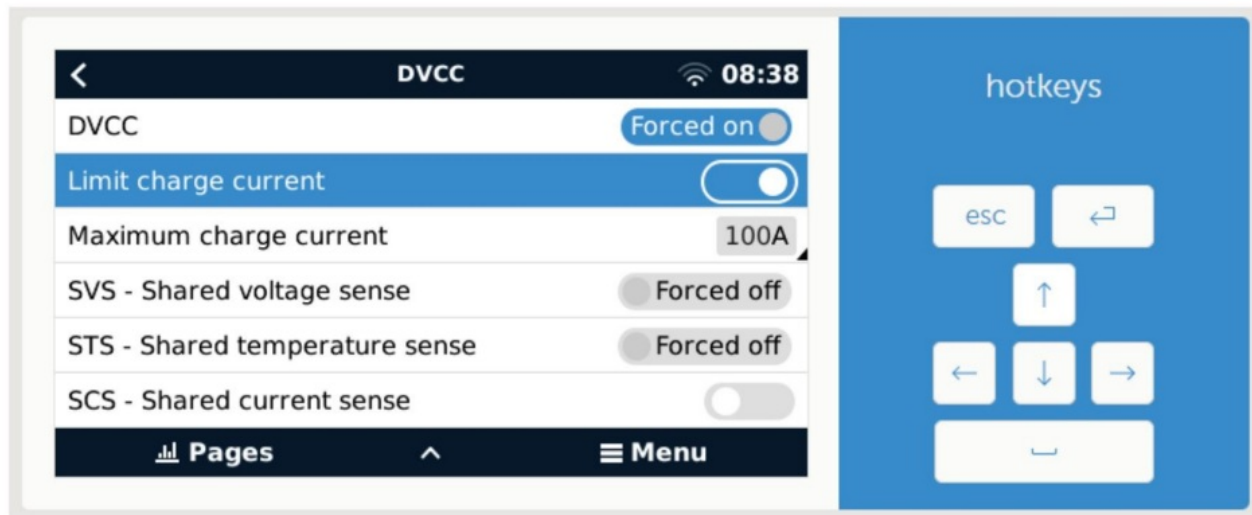


## Inverter settings (Victron)


### 4.1 General Tab

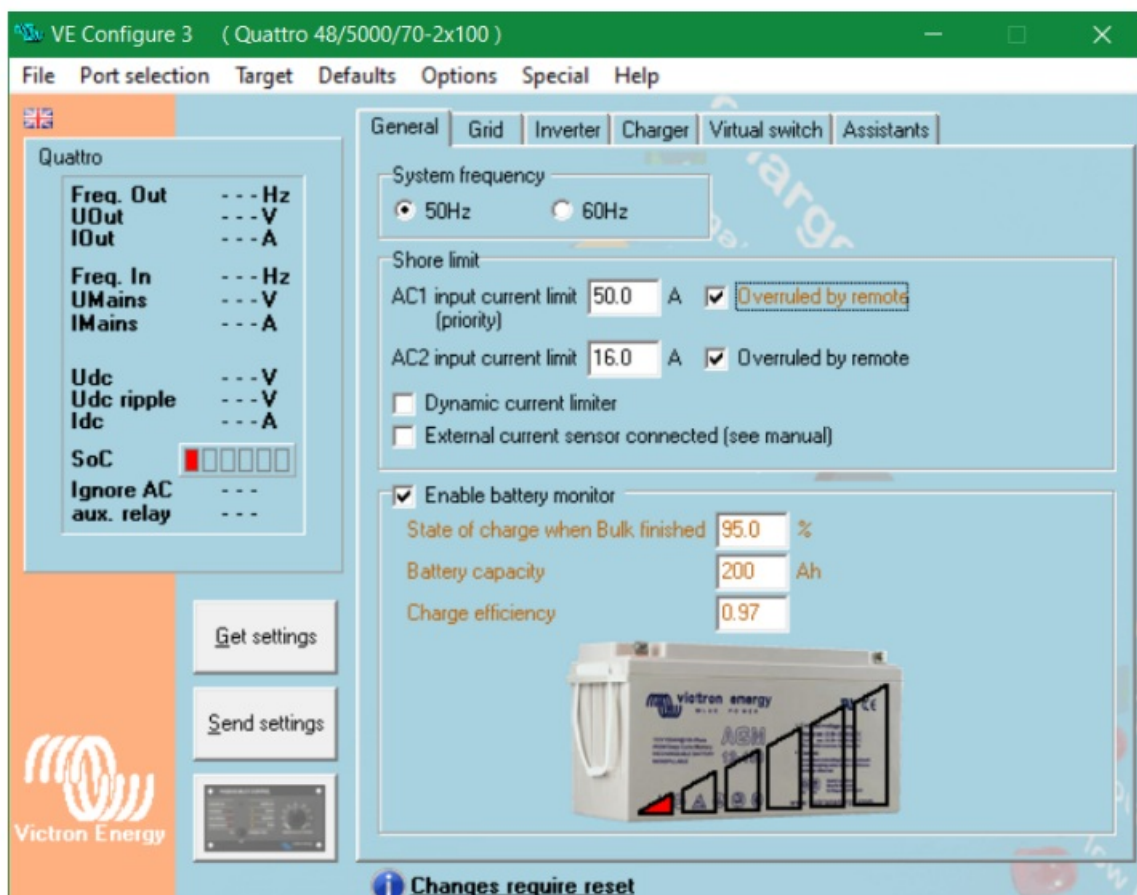


## 4.2 Grid Tab

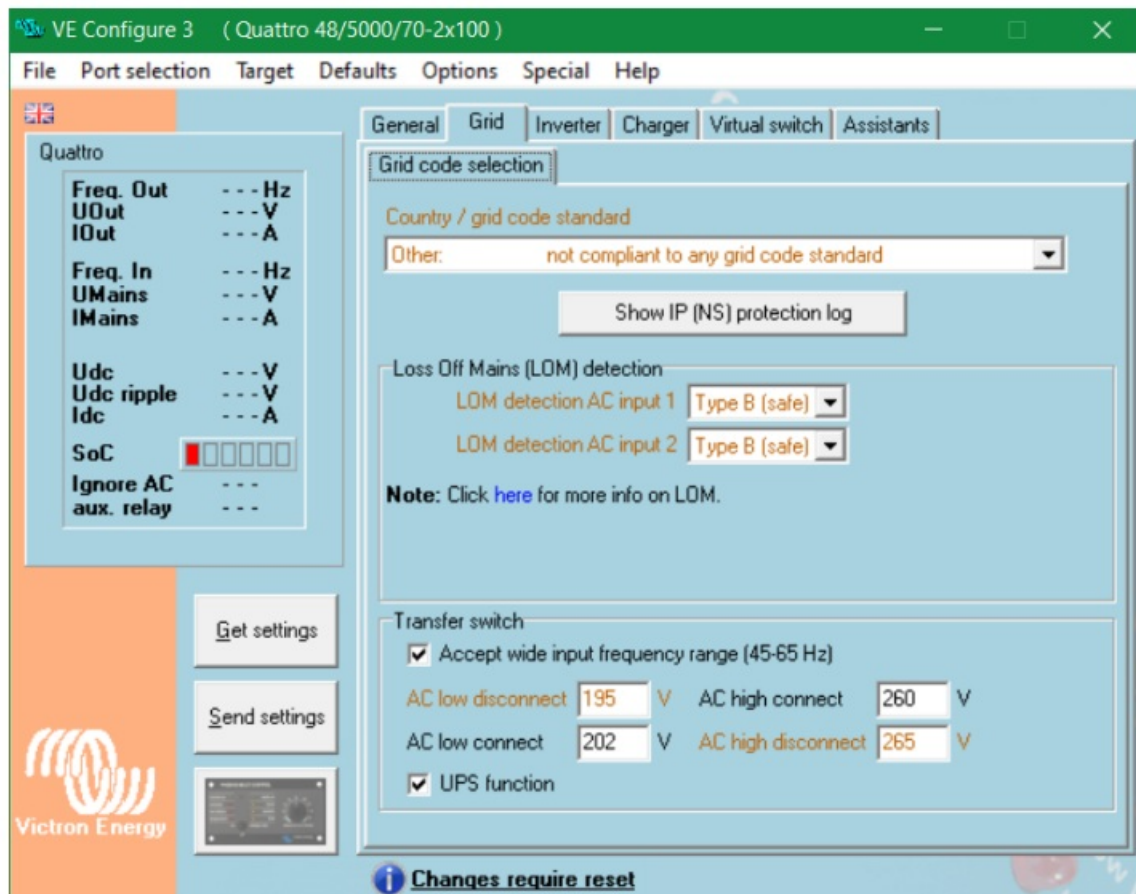


## 4.3 Inverter Tab

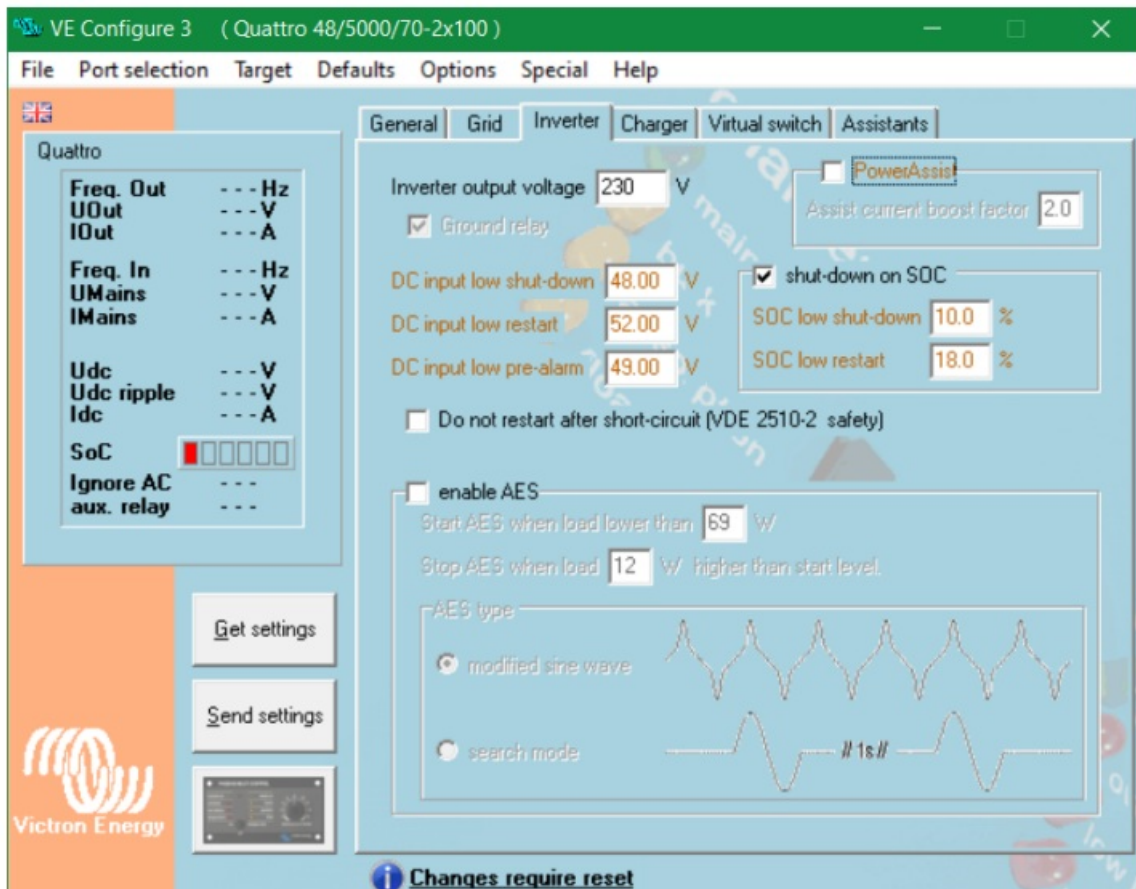


## 4.4 Charger Tab

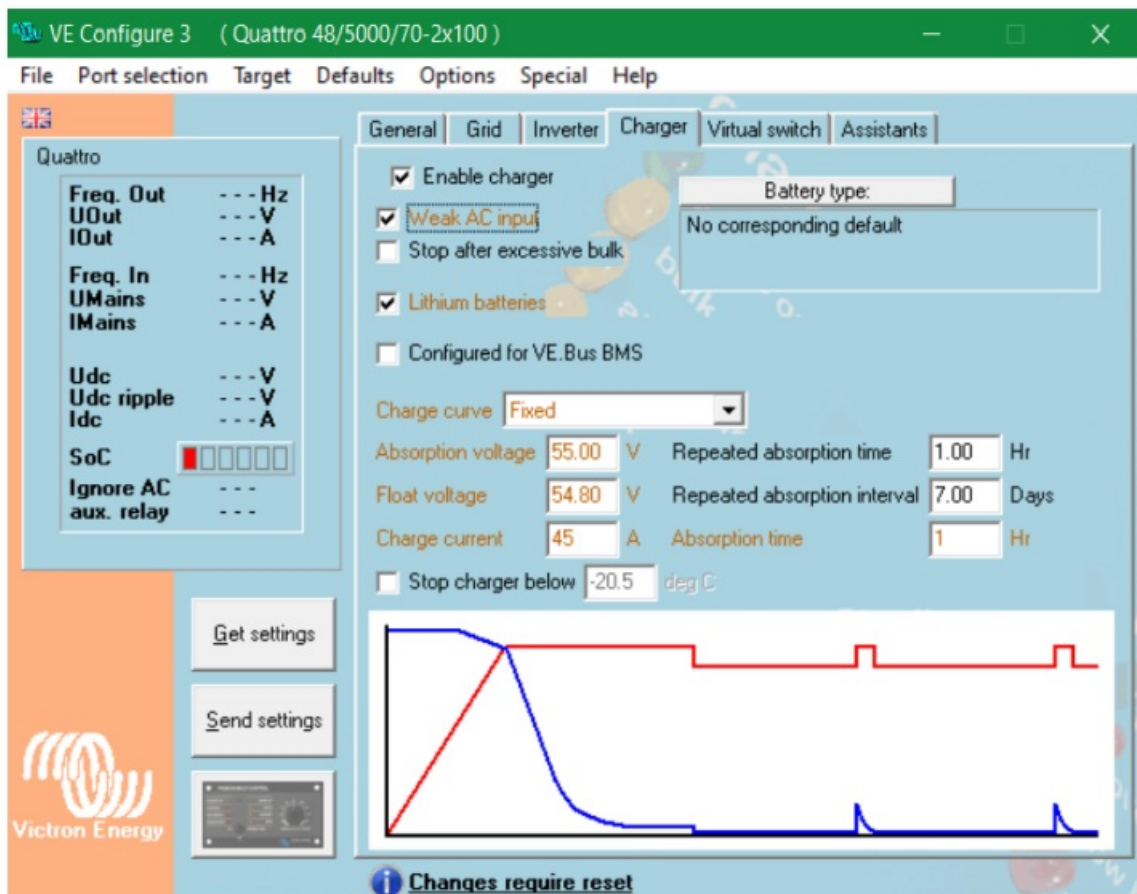


#### 4.5 Assistant tab (a)

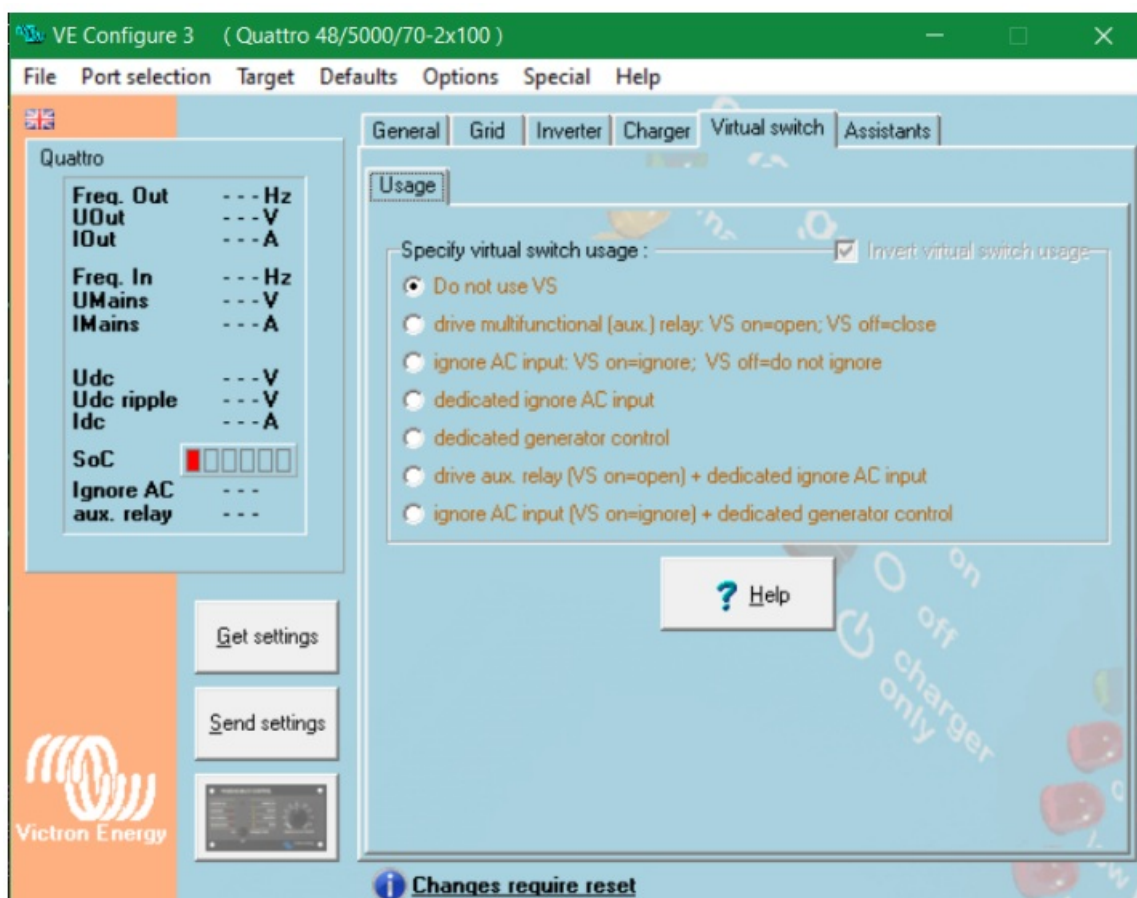


#### 4.6 Assistant tab (b)

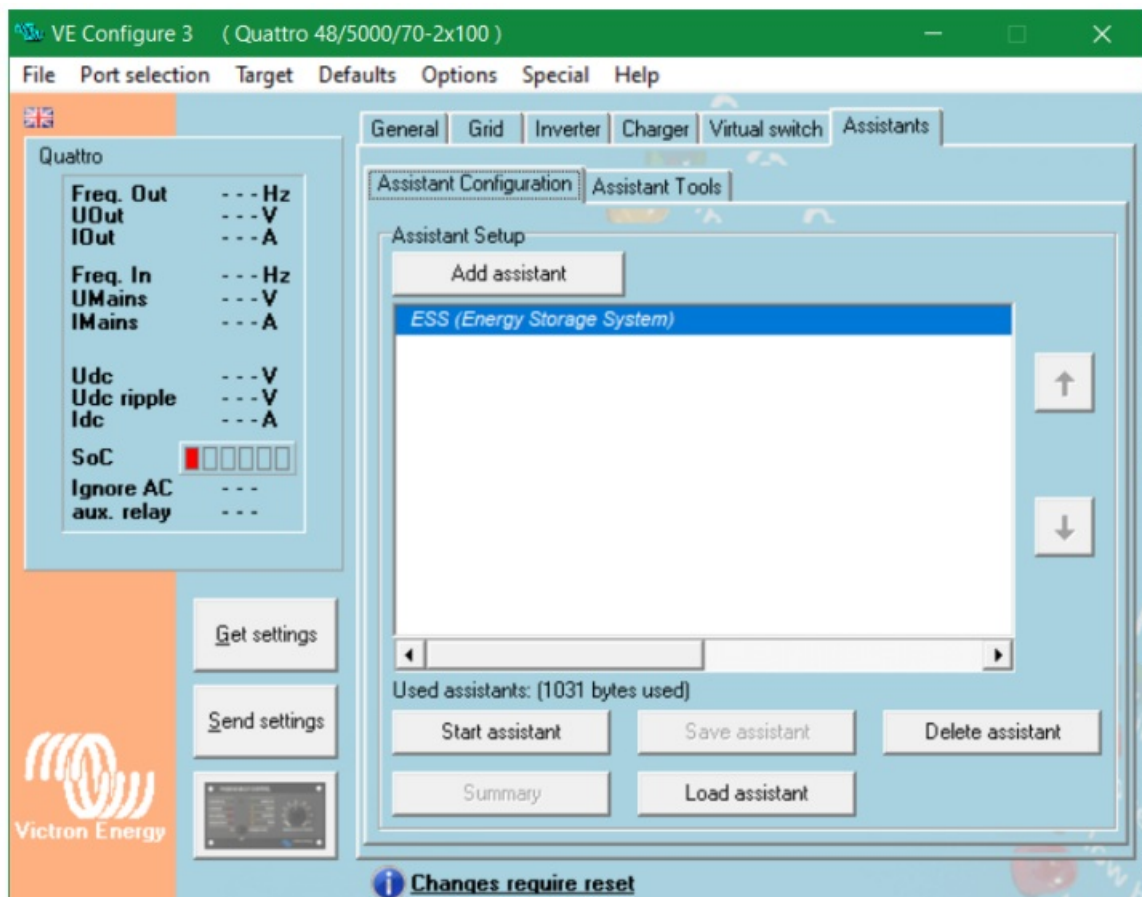


4.7 Assistant tab (c)

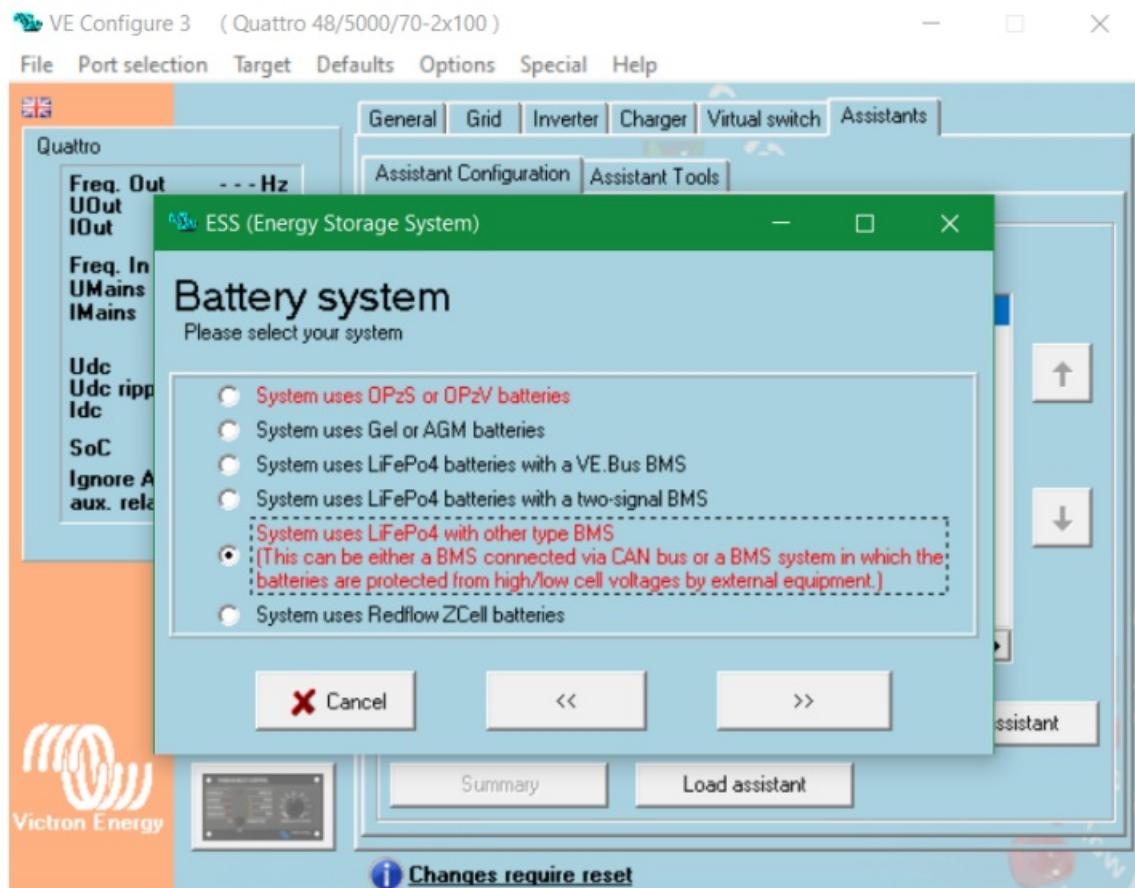


4.8 Assistant tab (d)

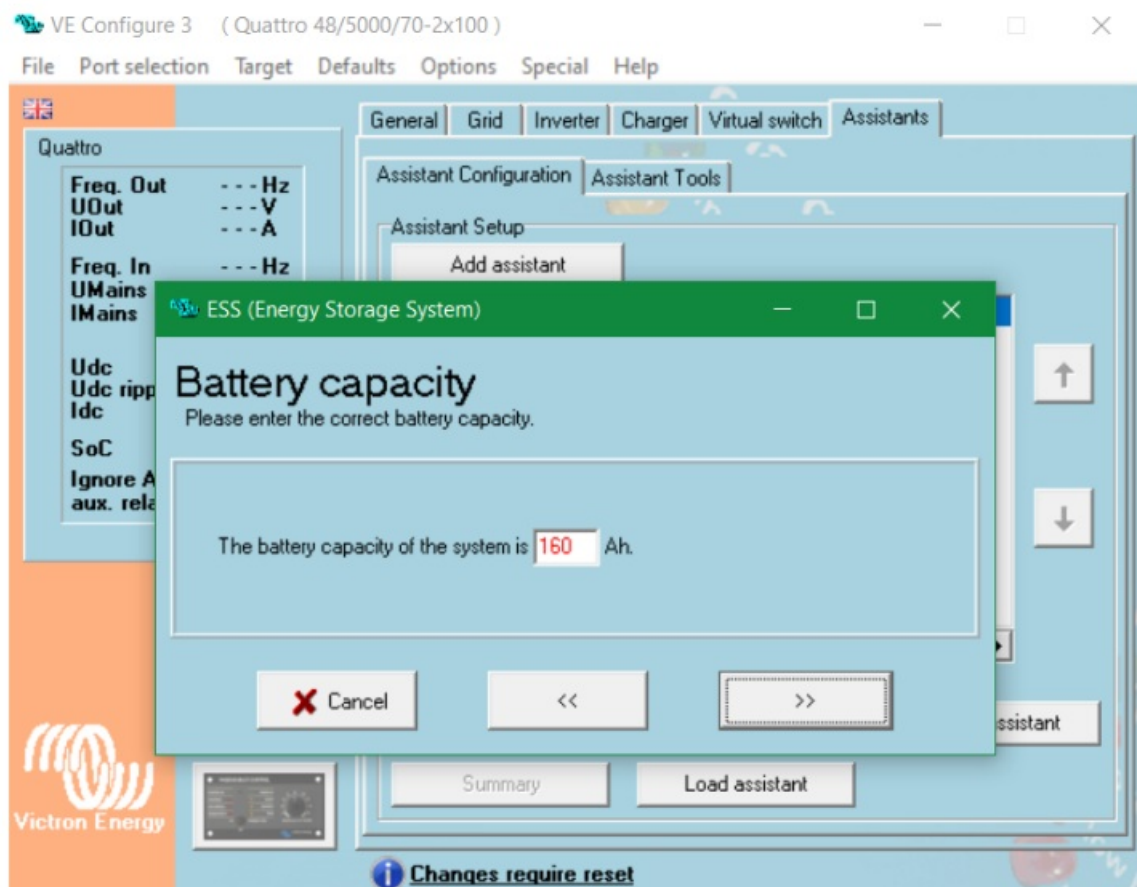


#### 4.9 Assistant tab (e)

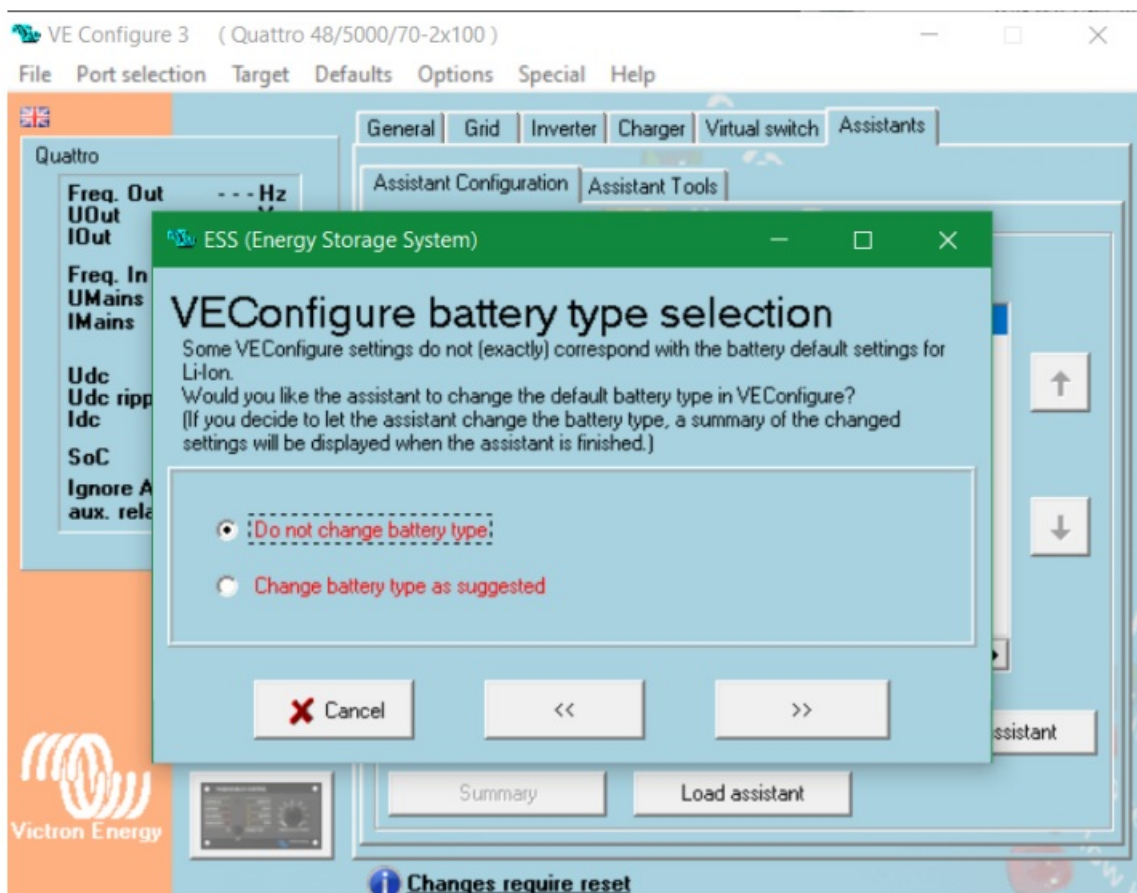


#### 4.10 Assistant tab (f)

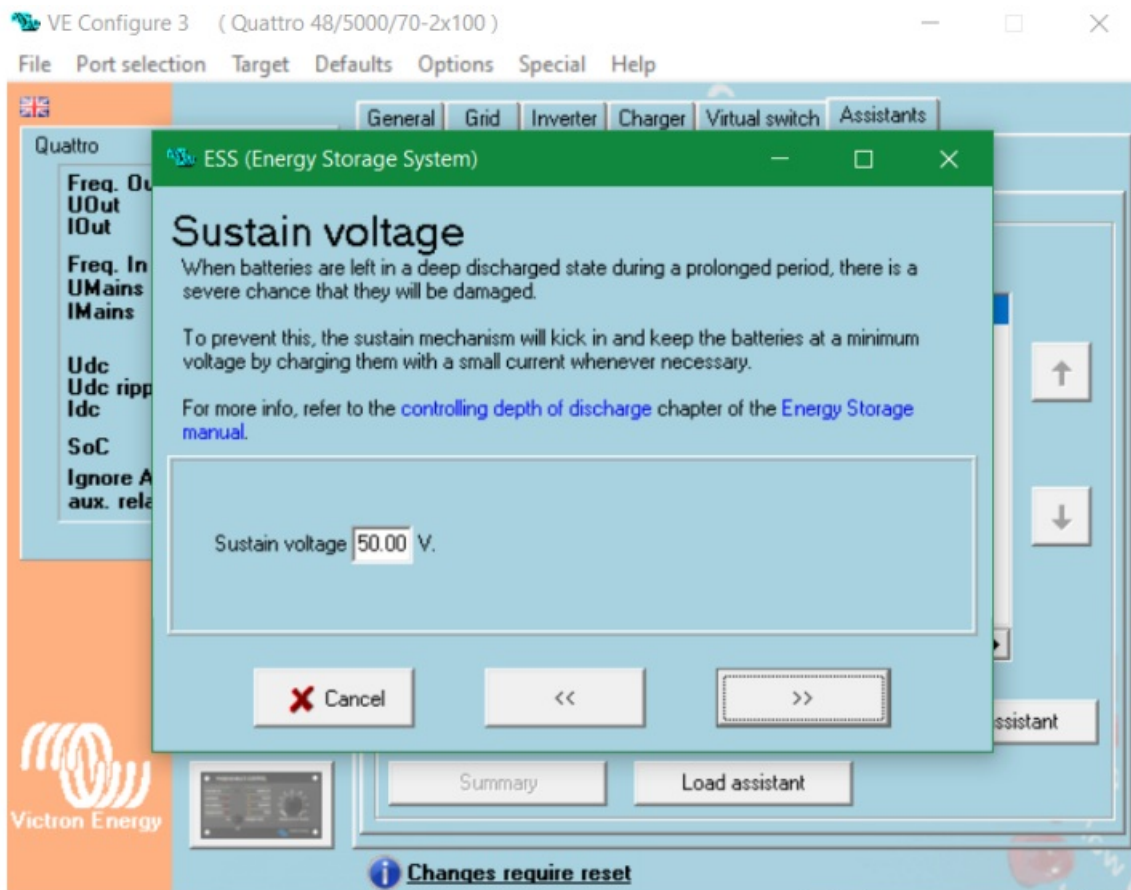





#### 4.11 Assistant tab (g)

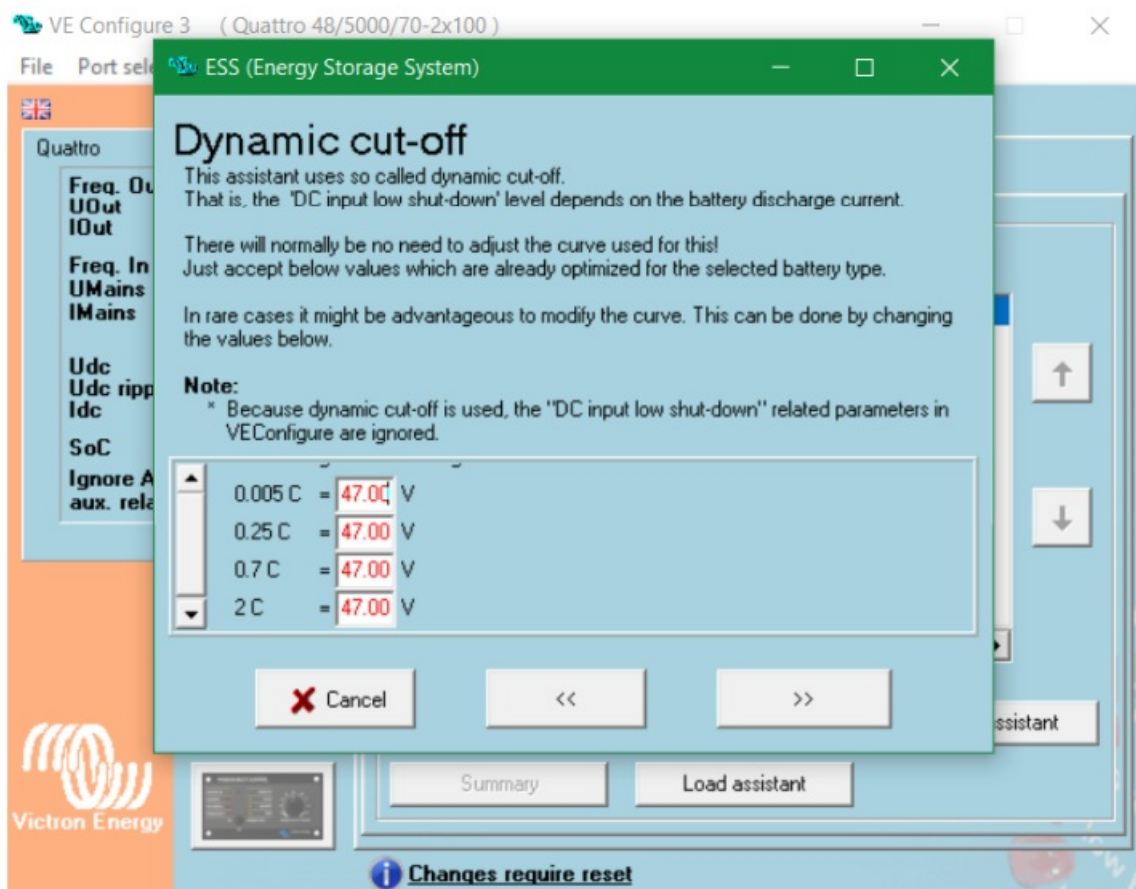

#### 4.12 Assistant tab (h)

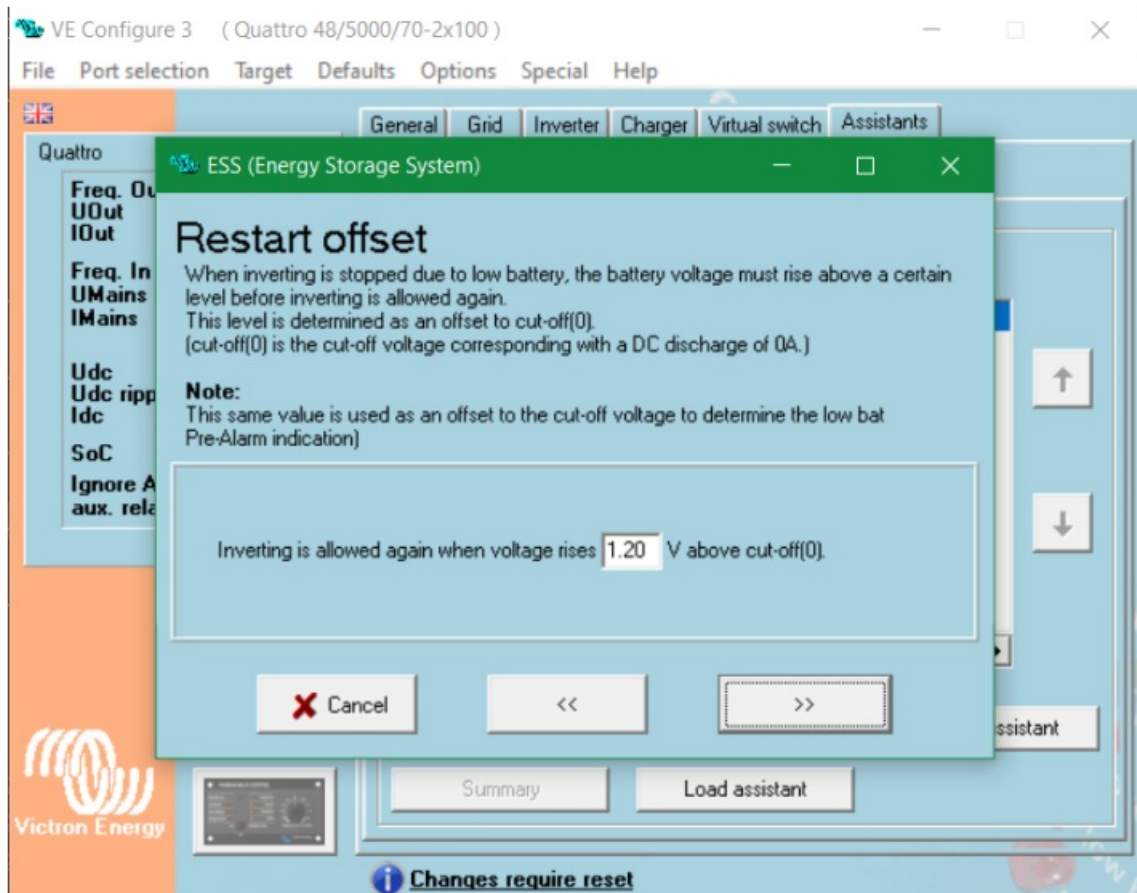

Other specifications

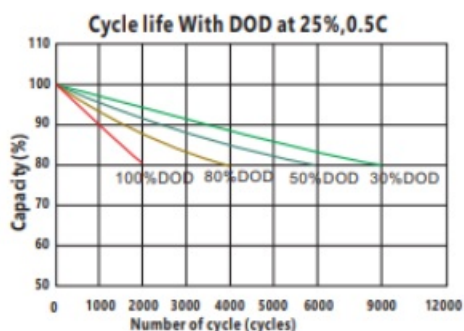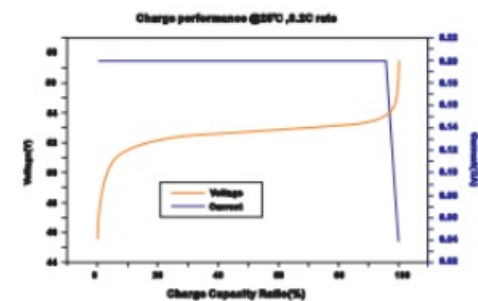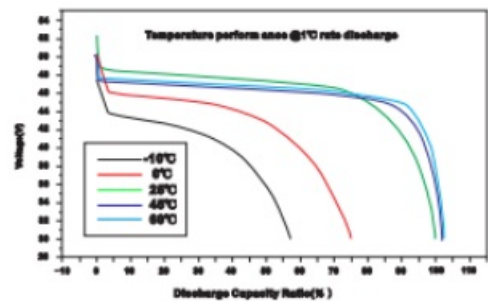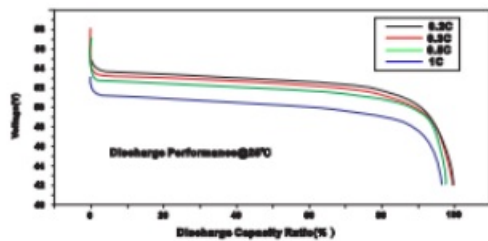

#### ELECTRICAL SPECIFICATIONS

Nominal Voltage	51.2V (16S)
Nominal Capacity	160AH
Energy	8192WH
Efficiency	99%
Self Discharge	<1% per Month

#### DISCHARGE SPECIFICATIONS

Max. Discharge current	150A
Peak Discharge Current	180A in 1 second
Recommend Discharge current	150A
Voltage at end of Discharge	47-48V

#### TEMPERATURE SPECIFICATIONS

Discharge Temperature	(-20~60°C)
Charge Temperature	(0~45°C)
Storage Temperature	(-20~55°C)

#### MECHANICAL SPECIFICATIONS

Dimensions (L x W x H)	600*403.5*225mm
Weight	73KG
Case Material	Steel
Cell Type	Prismatic
Chemistry	LiFePO4

#### CHARGE SPECIFICATIONS

Recommended Charge Current	80A
Maximum Charge Current	100A
Recommended Charge Voltage	55-56V

#### COMPLIANCE SPECIFICATIONS

Certifications	CE (battery) UN38.3 (battery) ROHS2.0 (cells)
Shipping Classification	UN 3480, CLASS 9

[www.lithium-battery-factory.com](http://www.lithium-battery-factory.com)

**BSLBATT®**  
Best Solution Lithium Battery

## Documents / Resources



[BSLBATT BSL\\_8\\_2 8.2KWH Lithium ion Battery \[pdf\] User Manual](#)

BSL\_8\_2 8.2KWH Lithium ion Battery, BSL\_8\_2, 8.2KWH Lithium ion Battery, Lithium ion Battery, Battery