



bticino PM1WS255 Energy Management Web Server Instructions

[Home](#) » [bticino](#) » bticino PM1WS255 Energy Management Web Server Instructions 




bticino PM1WS255 Energy Management Web Server



Contents



- [1 Package Content](#)
- [2 Description](#)
- [3 Wiring diagram](#)
- [4 Installation](#)
- [5 Documents / Resources](#)
 - [5.1 References](#)
- [6 Related Posts](#)


Package Content

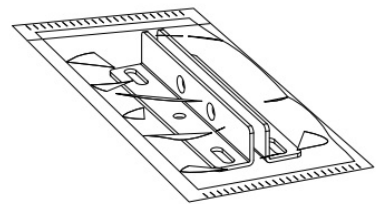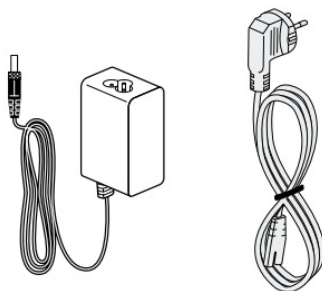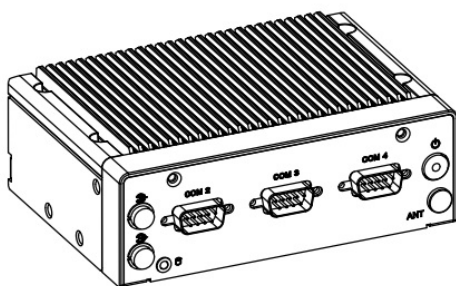


The instructions for installation and use must be strictly observed in order to avoid the risk of electric shock or fire.

Description

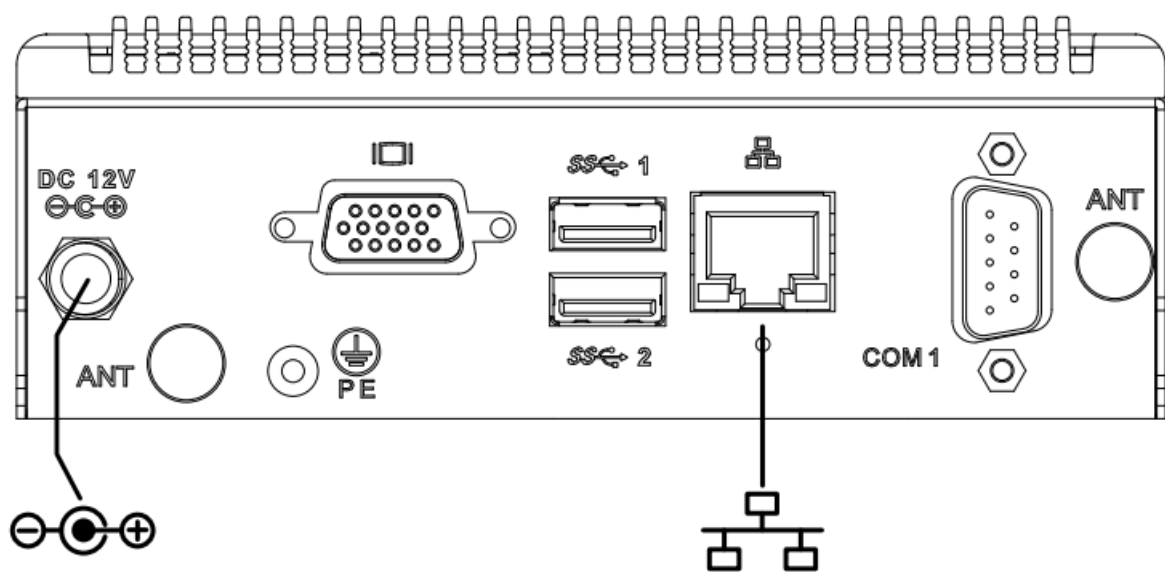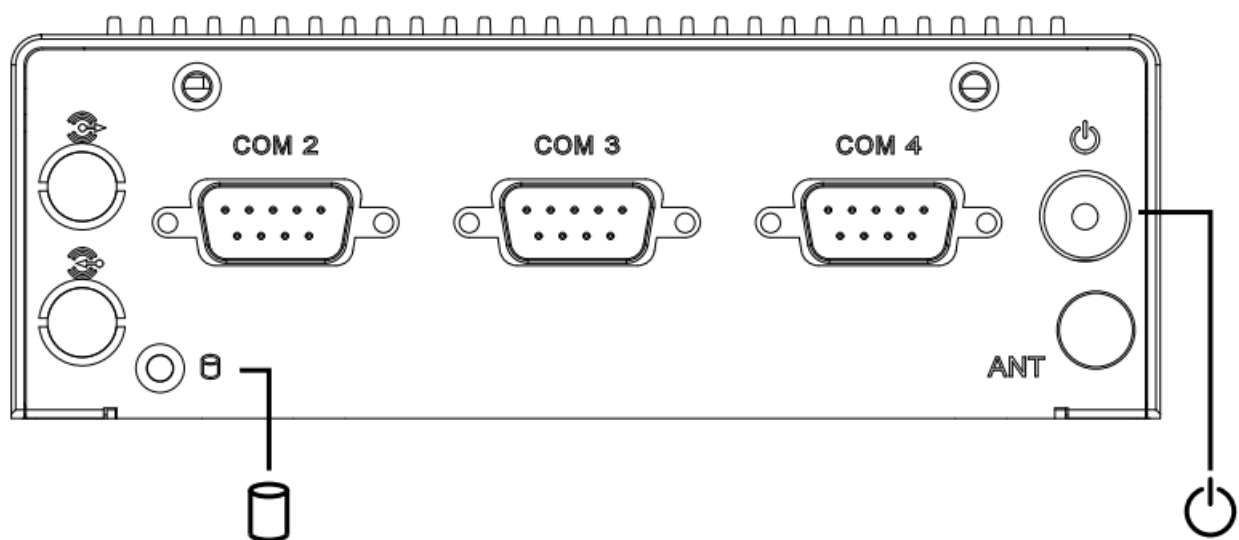


U	 230 V~ / 12 V—, 3 A
P	10,2 W
	Ethernet RJ45; 10/100/1000Mb
	192.168.1.100
	255.255.255.0
	192.168.1.1
PIN	99999
PUK	00000 9999 00000
	(-20°C) – (+60°C)



		Green	Device powered
		Orang	Device off/suspended
		Rouge	HDD activity

	Power input connector (Power supplier included)
---	---


Wiring diagram

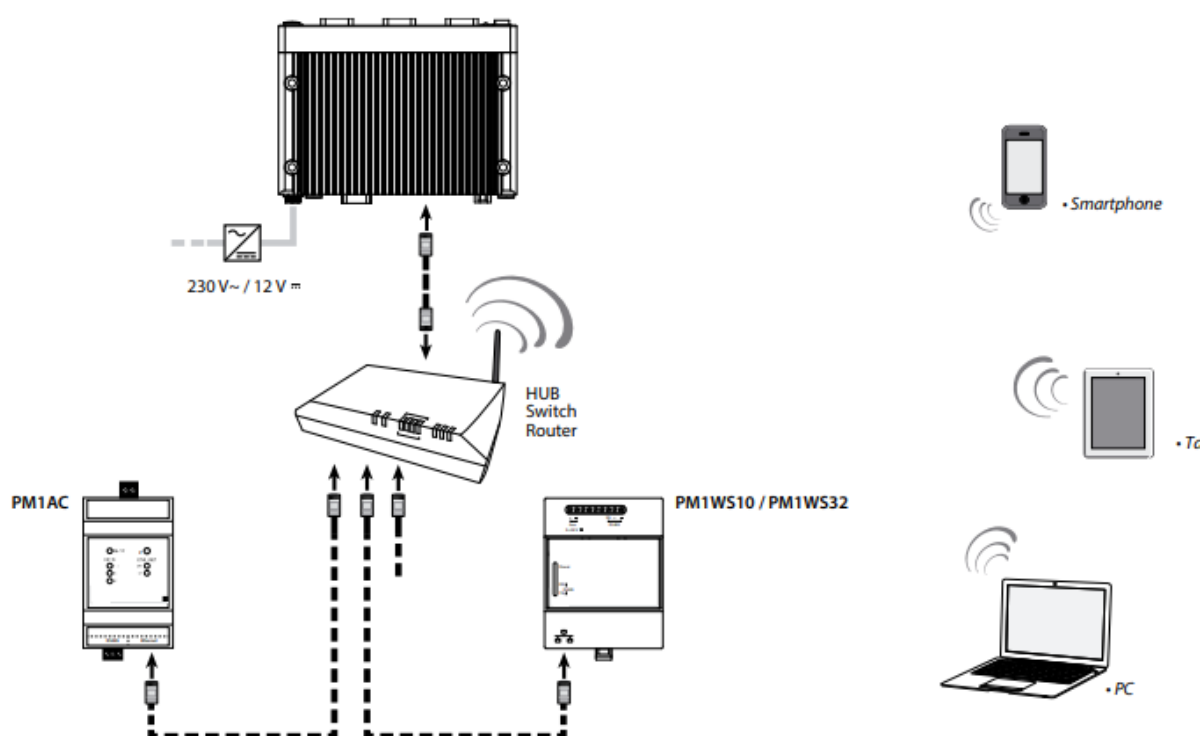

Installation

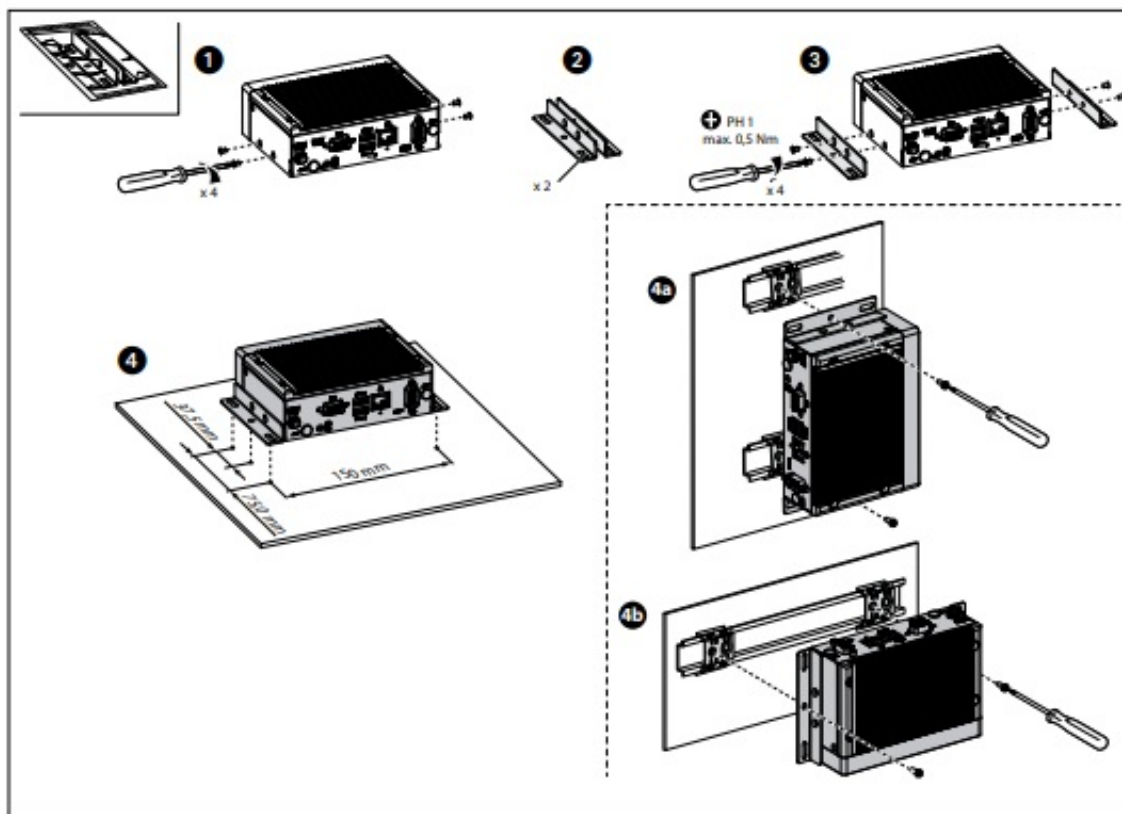

Parts not included



RAEE/WEEE: bticino.com/disposal



<https://professionisti.bticino.it/>


Complete documentation is available in the "Configuration software" area at



<https://www.bticino.com/products-catalogue/>

bticino

Documents / Resources



[bticino PM1WS255 Energy Management Web Server](#) [pdf] Instructions
PM1WS255, Energy Management Web Server, Web Server, Energy Management Server, Serv
er, Management Server

References

- [b The WEEE European directive \(2012/19/EU\) | Bticino International](#)
- [b Bticino International](#)
- [b HomePage | BTicino Portale Professionisti](#)
- [b Products Catalogue | Product Catalogue](#)