




CERBERUS PYROTRONICS MC 3-Tone Signaling Devices Owner's Manual

[Home](#) » [CERBERUS PYROTRONICS](#) » CERBERUS PYROTRONICS MC 3-Tone Signaling Devices Owner's Manual 

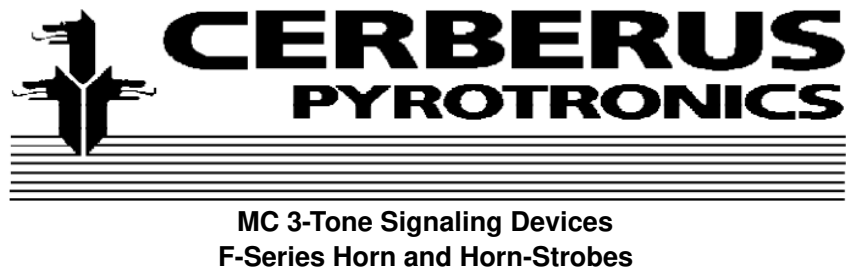

MC 3-Tone Signaling Devices
F-Series Horn and Horn-Strobes


Contents

- [1 ENGINEER AND ARCHITECT SPECIFICATIONS](#)
- [2 Introduction](#)
- [3 Description](#)
- [4 Horns](#)
- [5 Wiring Diagram](#)
- [6 Accessories](#)
- [7 Documents / Resources](#)
 - [7.1 References](#)
- [8 Related Posts](#)


ENGINEER AND ARCHITECT SPECIFICATIONS

- Three Unique Sounds
- Low Operating Current
- High dB Output
- ADA/UL 1971 Horn-Strobe Versions
- Available in Flush, Surface, or Ceiling Mount
- Standard 4-inch Square Mounting


- Listed
- ULC, FM, CSFM, NYMEA Pending

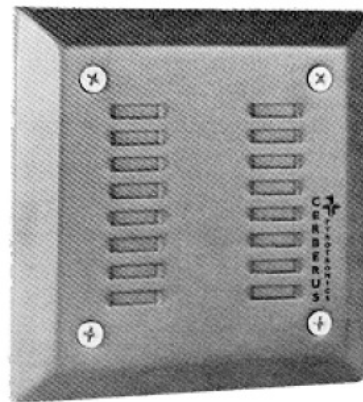

FLUSH

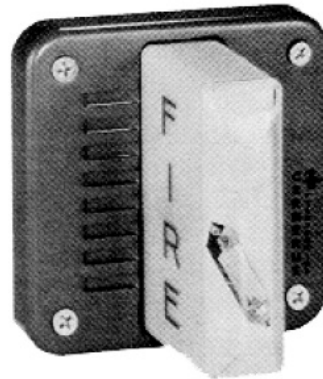

SURFACE WITH STROBE

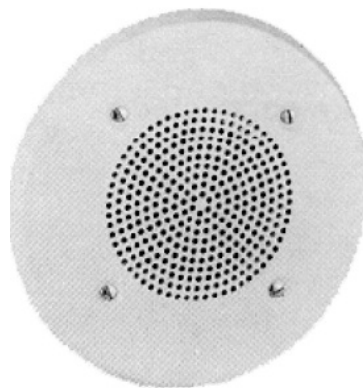

CEILING

Introduction

The Cerberus Pyrotronics F-Series of horns and hornstrobes combines high quality electronics with the rugged durability of a metal housing, providing the penetrating sound power of an electromechanical horn while eliminating the inrush and RFI noise problems associated with mechanical signals. These units are designed for ADA applications and meet the latest requirements of NFPA 72 (the National Fire Alarm Code) and UL 1971 standards for signaling devices for the hearing impaired.

Description

The three distinct sounds (HORN, SIREN, WARBLE) are field selectable. The energy efficient horn design draws only 20 mA while supplying 100 dB at 10 feet. Screw Terminals are provided for both the horn and strobe and can be configured to operate together or independently.

Units are available for flush, surface, or ceiling installation.

All strobe versions utilize a Xenon flashtube with solid state circuitry for maximum reliability and efficiency. Strobes are available in 15, 15/75, 75 and 110 Candela ratings with various mounting configurations. The strobe lens has a bottom material made of white Lexan with 5/8" red "FIRE" letters. The top of the strobe has a rounded dome shape made of clear Lexan. The overall lens height is 2.5" with a width of 1.25".

The S15 model provides 15 cd and are used in non-sleeping areas where lower candela is required per UL 1971.

The S17 model is for non-sleeping installations requiring 15 cd output while also providing an ADA compliant 75 cd frontal output for public areas.

The S75 version offers a 75 cd polar output that meets ADA requirements for regular lighted public areas while also satisfying UL 1971 in substitution of multiple 15 cd units.

The S110 version intensifies a non-sleeping ADA area with 110 cd and can be used in sleeping areas to help wake the hearing impaired person per UL 1971.

Horns

Model No.	Mounting	24 VDC Ratings		
		Volts	Typ. dB** 10'	AMP
MC-F	Flush	24 VDC	100	20 mA
MC-S	Surface	24 VDC	100	20 mA
MC-C	Ceiling	24 VDC	100	20 mA

Horn-Strobes

Model No.	Mounting	Nominal Horn Ratings			Nominal Strobe Current Ratings (mA)			
		Volts	Typ. dB** 10'	AMP	15	17 (15/75)	75	110
MC-S()-F	Flush	24 VDC	100	20 mA	80	80	175	245
MC-S()-S	Surface	24 VDC	100	20 mA	80	80	175	245
MC-S()-C	Ceiling*	24 VDC	100	20 mA	80	80	NA	NA

* Only 15 & 17 units available in ceiling mount.

** Minimum UL measurements are 75 dB @ 12 VDC & 85 dB @ 24 VDC taken in a reverberant room

Note: () represents strobeWiring Diagram model, e.g., 15, 17, 75 or 110.

Wiring Diagram

When strobe and electronic signal are connected to same signal circuit.	When strobe and electronic signal are connected to separate signal circuits.

Accessories

Model No.	Description
FIB	Indoor Surface Box, Red
FDBB	2.7"D Surface Box for Flush Horn/Strobe, Red
FBDM	Pendent Wall / Ceiling Housing for Bi-Directional Flush Horn / Strobe, Red
FSFP	Semi-Flush Plate, Red
FCCP	Concealed Conduit Plate, Red

NOTICE: The use of other than Cerberus Pyrotronics detectors and bases with Cerberus Pyrotronics control equipment will be considered a misapplication of Cerberus Pyrotronics equipment and as such void all warranties either expressed or implied with regard to loss, damage, liabilities and/or service problems.



Cerberus Pyrotronics
 8 Ridgedale Avenue
 Cedar Knolls, NJ 07927
Tel: (201) 267-1300
FAX: (201) 397-7008
 6/96 5M CPY-IG
 Printed in U.S.A.
 Cerberus Pyrotronics
 50 East Pearce Street
 Richmond Hill, Ontario L4B, 1B7 CN
Tel: (905) 764-8384
FAX: (905) 731-9182
 April 1996
 Supersedes sheet dated 2/96
firealarmresources.com

Documents / Resources

	<p>CERBERUS PYROTRONICS MC 3-Tone Signaling Devices [pdf] Owner's Manual MC 3-Tone Signaling Devices, Tone Signaling Devices, Signaling Devices, Devices</p>
--	---

References

- [Fire Alarm Resources | Download fire alarm documents](#)