



CERBERUS PYROTRONICS RR-35 Remote Reset Device Owner's Manual

[Home](#) » [CERBERUS PYROTRONICS](#) » CERBERUS PYROTRONICS RR-35 Remote Reset Device Owner's
Manual 




Contents

- [1 ENGINEER AND ARCHITECT SPECIFICATIONS](#)
- [2 Description](#)
- [3 Wiring Diagram](#)
- [4 Documents / Resources](#)
 - [4.1 References](#)
- [5 Related Posts](#)

ENGINEER AND ARCHITECT SPECIFICATIONS



- Remote Reset Module and Switch
- Available for Use with AC or DC Notification Appliances
- Requires One Module Space
-  Reset Switch is Momentary and Key Operated

Description


The model RR-35 Remote Reset Device includes a System 3™ module for mounting in the System 3™ enclosure and a reset switch mounted on a single gang plate. This device will reset a System 3™ from a remote location. A System 3™ utilizing a model RR-35 can also be reset from the local system reset switch on the CP-35. The RR-35 reset switch is key operated and momentary. The system module requires one module space for mounting. The assembly comes complete with the necessary cables for operation of 24 VDC or 120 VDC notification appliances.

Ordering Information

Model No.	Description	Part No.
RTA-38	System 3™ Remote Trouble/Alarm Indicator	500-684960

Please refer to Installation Instructions, P/N 315-091469.

Wiring Diagram

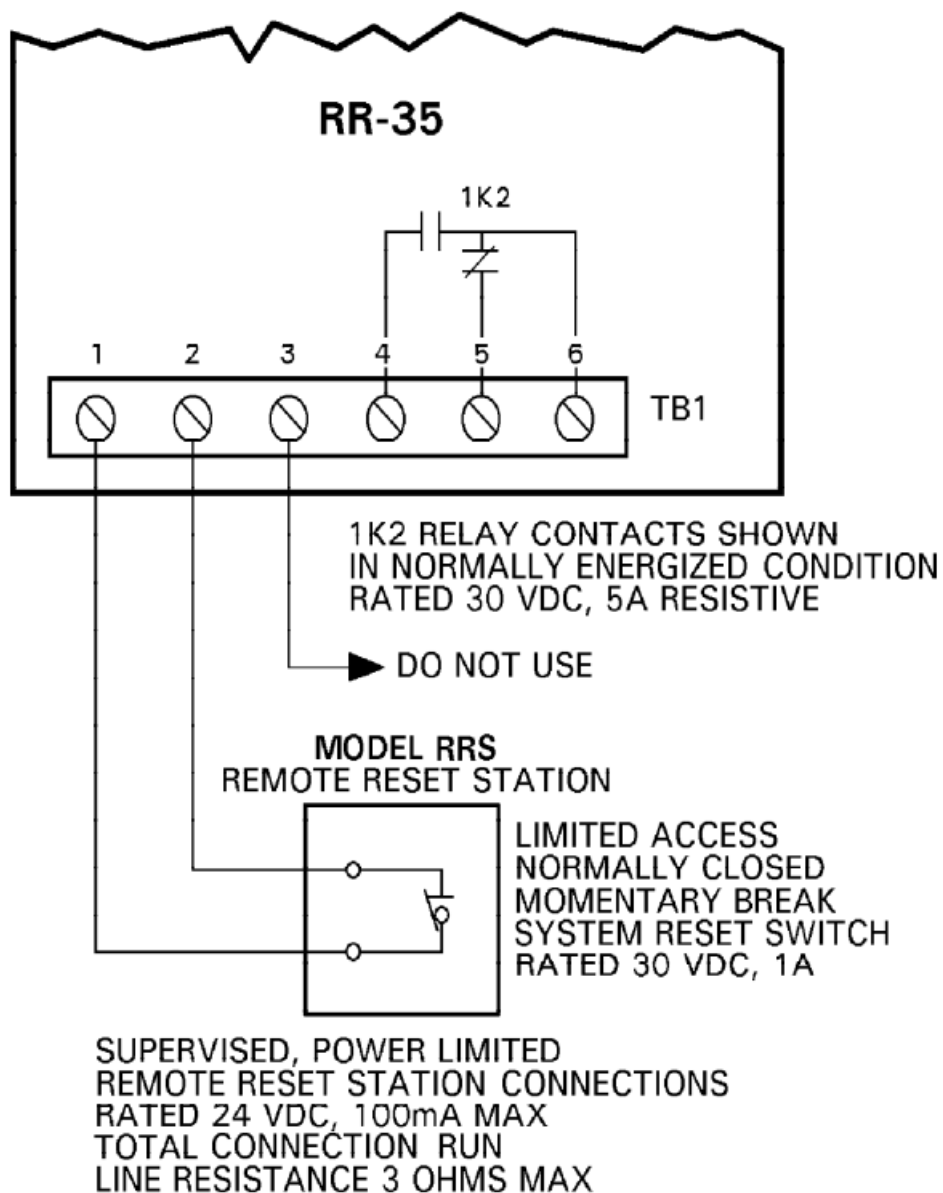

intelINK
SYSTEMS • SERVICES

Cerberus Pyrotechnics 8 Ridgedale Avenue

Cedar Knolls, NJ 07927

Tel: (201) 267-1300

FAX: (201) 397-7008

Website: www.cerbpyro.com

4/97 5M CPY-IG

Printed in U.S.A.

Cerberus Pyrotechnics 50 East Pearce Street

Richmond Hill, Ontario L4B, 1B7 CN

Tel: (905) 764-8384

FAX: (905) 731-9182

Documents / Resources



[CERBERUS PYROTRONICS RR-35 Remote Reset Device](#) [pdf] Owner's Manual
RR-35 Remote Reset Device, RR-35, Remote Reset Device, Reset Device, Device

References

- [!\[\]\(4c660a3c4ce1da3313488b7854f55083_img.jpg\) Fire Alarm Resources | Download fire alarm documents](#)
- [!\[\]\(f01c435bb39e3068a9b4895c9a993158_img.jpg\) cerbpyro.com](#)

Manuals+,