

checkline

CHECKLINE RMS-
TD-60-ETHERNET
Humidity and
Temperature
Transmitter



CHECKLINE RMS-TD-60-ETHERNET Humidity and Temperature Transmitter Instructions

[Home](#) » [CHECKLINE](#) » CHECKLINE RMS-TD-60-ETHERNET Humidity and Temperature Transmitter Instructions



Contents

- 1 CHECKLINE RMS-TD-60-ETHERNET Humidity and Temperature Transmitter
- 2 Product Information
- 3 Product Usage Instructions
- 4 Introduction
- 5 For your safety
- 6 Warranty
- 7 On receipt of your device
- 8 Installation of the transmitter
- 9 Technical drawing RMS-TD-60-ETHERNET
- 10 Adjustment behavior of the sensor
- 11 Definition relative humidity
- 12 Cleaning and maintenance
- 13 Faults
- 14 Warranty
- 15 Documents / Resources
 - 15.1 References
- 16 Related Posts

checkline

CHECKLINE RMS-TD-60-ETHERNET Humidity and Temperature Transmitter



Product Information

Specifications

- Product Name: RMS-TD-60-ETHERNET
- Type: Humidity & Temperature Transmitter
- Components:
 1. Air humidity and temperature sensor
 2. Sensor tube
 3. Aluminium housing
 4. RJ45 socket for Ethernet
 5. Mounting bracket

Product Usage Instructions

Introduction

1. Information about the Operating Manual

The operating manual is essential for safe and effective use of the RMS-TD-60-ETHERNET. It must be stored nearby and easily accessible to all users at all times. Before using the device, carefully read and understand the manual to ensure safety.

2. Limitation of Liability

Checkline Europe BV compiled the information in this manual based on current standards and regulations. Failure to adhere to the manual, improper use, unauthorized modifications, or use of unapproved parts may void the warranty and lead to damage. The manufacturer does not accept liability for incorrect measurements or consequential damage.

For Your Safety

1. Proper Use

For specific applications such as installation in sewage pipes, a remote measuring probe may be necessary for temperature adjustment.

2. Improper Use

The device should not be used in ATEX environments.

3. User Qualifications

Only individuals capable of reliably taking measurements should operate the device. Avoid operation by individuals with impaired reaction times due to substances like drugs, alcohol, or medication.


FAQ

• Q: Can I use the device in ATEX environments?

A: No, the device must not be used in ATEX environments.

RMS-TD-60-ETHERNET

Humidity & Temperature Transmitter

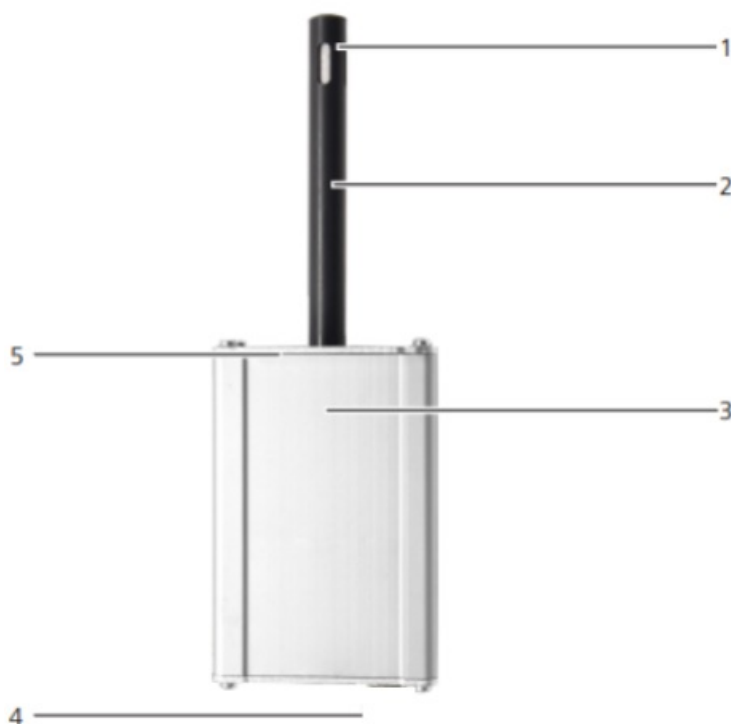

No.	Name
1	Air humidity and temperature sensor
2	Sensor tube
3	Aluminium housing
4	RJ45 socket for Ethernet
5	Mounting bracket

Introduction

1. Information about this operating manual

This operating manual is designed to enable you to use the RMS-TD-60-ETHERNET safely and effectively. It is part of the device, has to be stored nearby and must be easily accessible to users at all times. All users are required to carefully read and make sure that they have understood this operating manual before using the RMS-TD-60-ETHERNET. All of the safety and operating instructions detailed in this manual have to be observed to ensure the safety of the device.

2. Limitation of liability

All of the information and instructions provided in this operating manual have been compiled on the basis of the current standards and regulations, the state of the art, and the extensive expertise and experience of Checkline Europe BV. Checkline Europe BV does not accept any liability for damage associated with the following, which also voids the warranty:

- Non-observance of this operating manual
- Improper use
- Inadequately qualified users
- Unauthorized modifications
- Technical changes
- Use of unapproved spare parts

This fast measuring procedure can be affected by a range of different factors. We, as the manufacturer, do not accept any liability for any incorrect measurements and associated consequential damage.

3. Customer service

For technical advice, please contact our customer service. Your purchased measuring instrument can be calibrated, and the adjustment checked by using suitable test ampoules / calibration ampoules. For this purpose, use only the calibration solutions distributed by Checkline Europe.



For your safety

The device complies with the following European directives:

- Restriction of Hazardous Substances in Electrical and Electronic Equipment (RoHS)
- Electromagnetic compatibility (EMC) The device corresponds to state-of-the-art technology. However, it is still associated with a number of residual hazards. These hazards can be avoided through strict observance of our safety information.

Proper use

- Transducer for measuring and transmitting relative humidity and temperature in fixed installation
- The sensor technology used makes it possible to detect even small fluctuations in humidity and their tendencies quickly and reliably so that preventive actions can be taken.
- For some applications (e.g. installation in sewage pipes) it is necessary to use a remote measuring probe for the reason of temperature adjustment.

Improper use

The device must not be used in ATEX.

User qualifications

- The device must only be operated by people who can be expected to reliably take the measurements. The device must not be operated by people whose reaction times may be slowed due to, e.g. the use of drugs, alcohol or medication.
- All persons using this device must have read, understood and follow the instructions provided in the operating manual.

General safety information

The following safety information has to be observed at all times to avoid damage to objects and injury to people:

- In case of damages or loose parts on the device, contact Checkline Europe.
- All of the device's technical features have been inspected and tested before delivery. Every device has a serial number. Do not remove the tag with the serial number.

Warranty

The warranty does not apply to:

- Damage resulting from non-observance of the operating manual
- Damage resulting from third-party interventions
- Products that have been used improperly or modified without authorisation
- Products with missing or damaged warranty seals
- Damage resulting from force majeure, natural disasters, etc.
- Damage from improper cleaning

On receipt of your device

1. Taking the device out of its packaging

- Take the device out of its packaging.
- Next, make sure that it is not damaged and that no parts are missing.

Making sure that all of the components have been included

Make sure that all of the components have been included by checking the package contents against the following list:

1. Scope of supply

- RMS-TD-60-ETHERNET
- Operating manual
- Optional accessories (not all available for RMS-TD-60-ETHERNET):
 - Mounting bracket for RMS-TD
 - Drip-catcher for RMS-TD
 - RS232 interface – described in a separate operating manual

- Factory calibration certificate, calibration equipment, certified calibration ampoules and reference devices for continuous monitoring


Installation of the transmitter

1. Laying of the supply line or transmission line


- The cable must not be laid in the area of interference fields.
- Do not operate the transmitter in the area of electromagnetic interference fields.
- The permissible cross-sections for the installation must be observed.
- The cable length must be kept as short as possible. » If an extension of the cable is required, the cross-section of the extension must not be below 0,25 mm².
- If the electronics housing and the display electronics are grounded, an appropriate equipotential bonding conductor must be provided.

2. Mounting the transmitter


- The measuring probe must be positioned at a representative location.
- Avoid positions of drought and unnatural temperature fluctuations.
- Do not expose the device to direct sunlight.
- If the sensor tube is twisted, the tightness is no longer guaranteed.
- When there is a possibility of condensation, position the sensor probe slightly upwards (approx. 10 degrees angle).
- The condensation water can then flow away from the sensor probe towards the housing or cable and drain off.
- If it is impossible to place the unit at an upward angle, a drip nose (optional accessory) must be installed.
- Installation inside an air duct (or at mounting locations where temperature differences between sensor probe and sensor housing may occur):
- The sensor must be inserted fully into the opening until it stops, to avoid a temperature drop along the sensor tube. See picture:

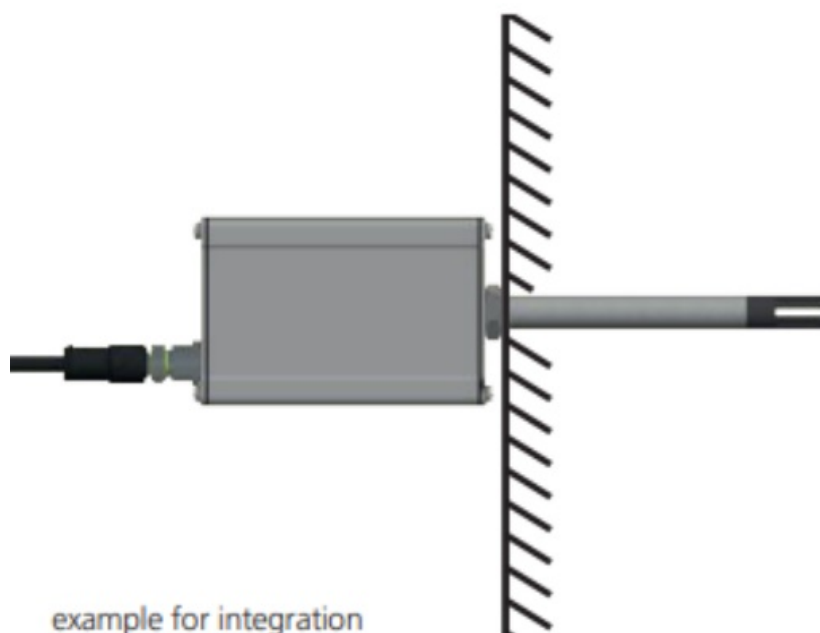


3. Find the transmitter

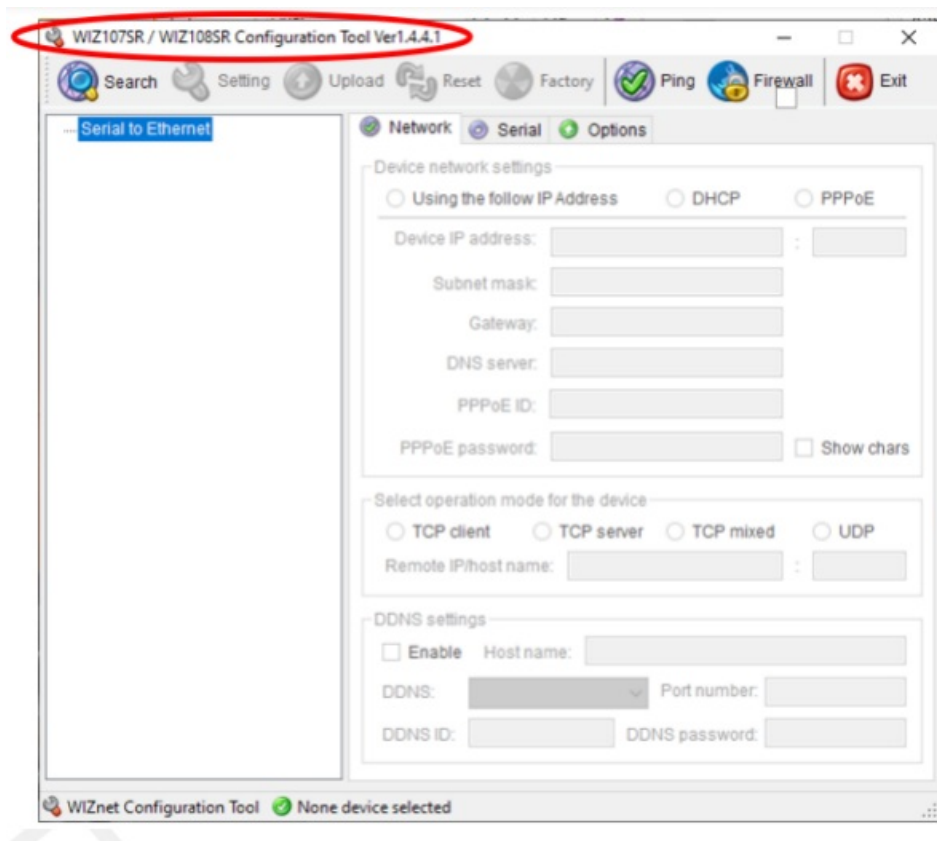

4. Search

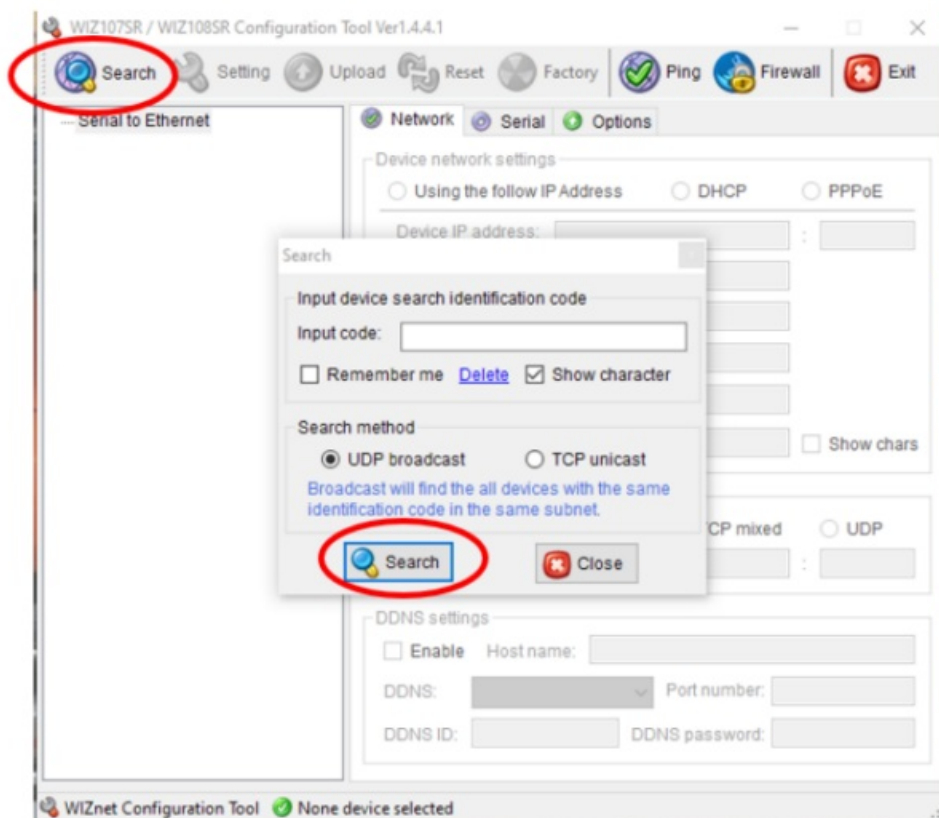


for samples

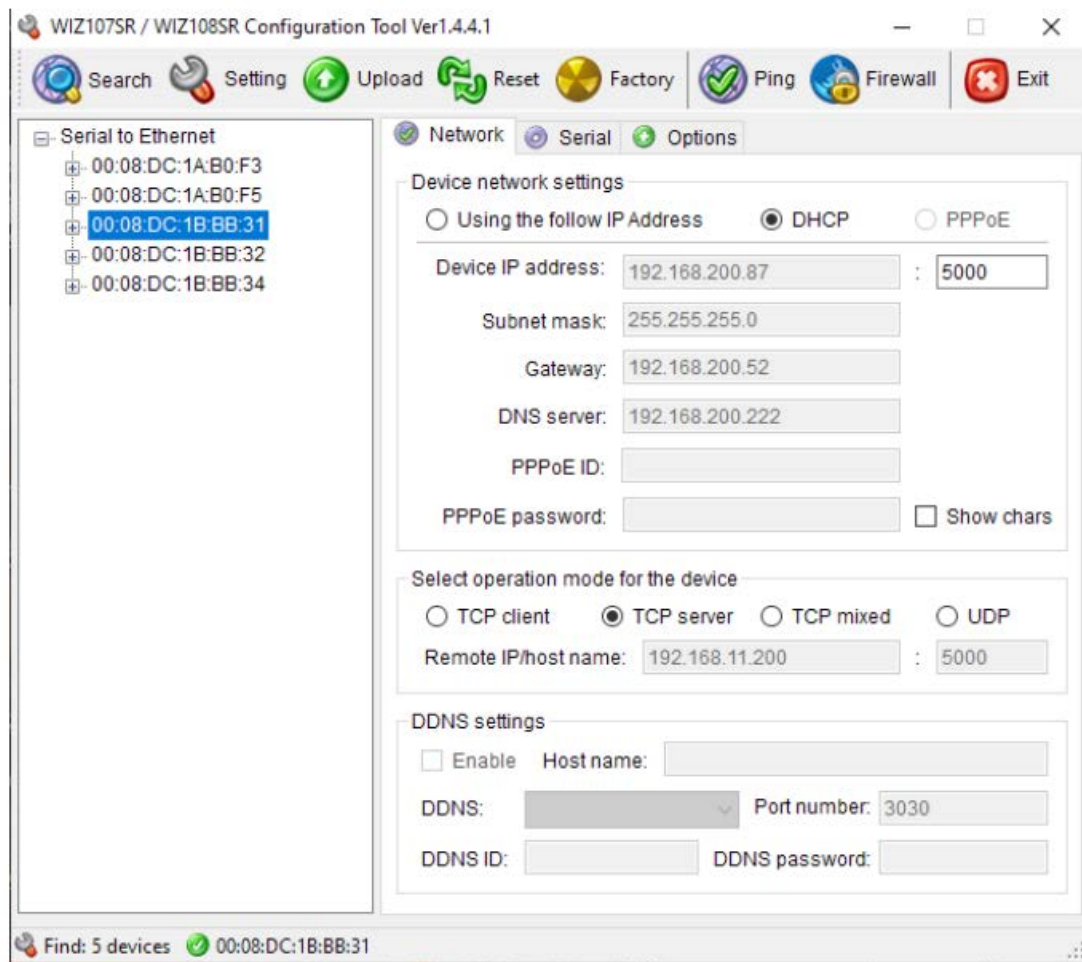


Data protocol for LFT-D -devices to receive data on PC by request


- Version 1.00 Date: 2016.04.28 Author: Ing. J. Anderson *****
- send the measure values *****
- Send Command "m" [char 109] to the device
- For this feature the device has to be in the measure mode (standard after power up)
- It's not recommendet to take measuring values faster than 250ms.
- The device send back all measuring values which are available send "m" and the device answers with
- &SLFTD-60 2008&H 43.97&T 22.96&CF8C4
- [&S][SPACE][&H][43.97][&T] 22.96[&C]F8C4[CR][LF]
- [&S][SPACE]<Serialnumber>
- [&H]= rel. Humidity
- [&T]= Temperature
- [&C]= Checksum
- <\r>= CR
- <\n>= LF

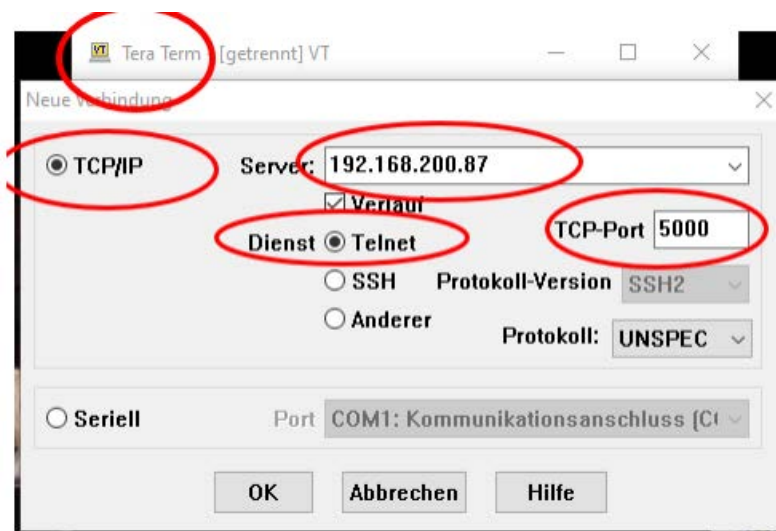

- "m" enter

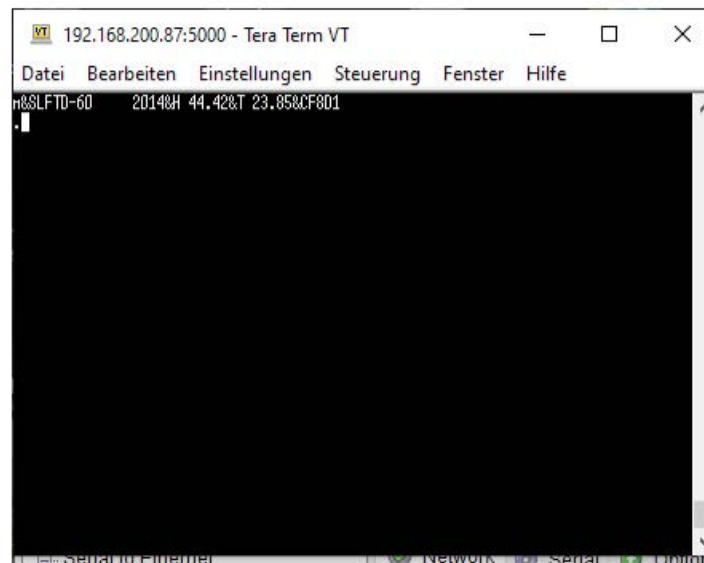


Technical drawing RMS-TD-60-ETHERNET

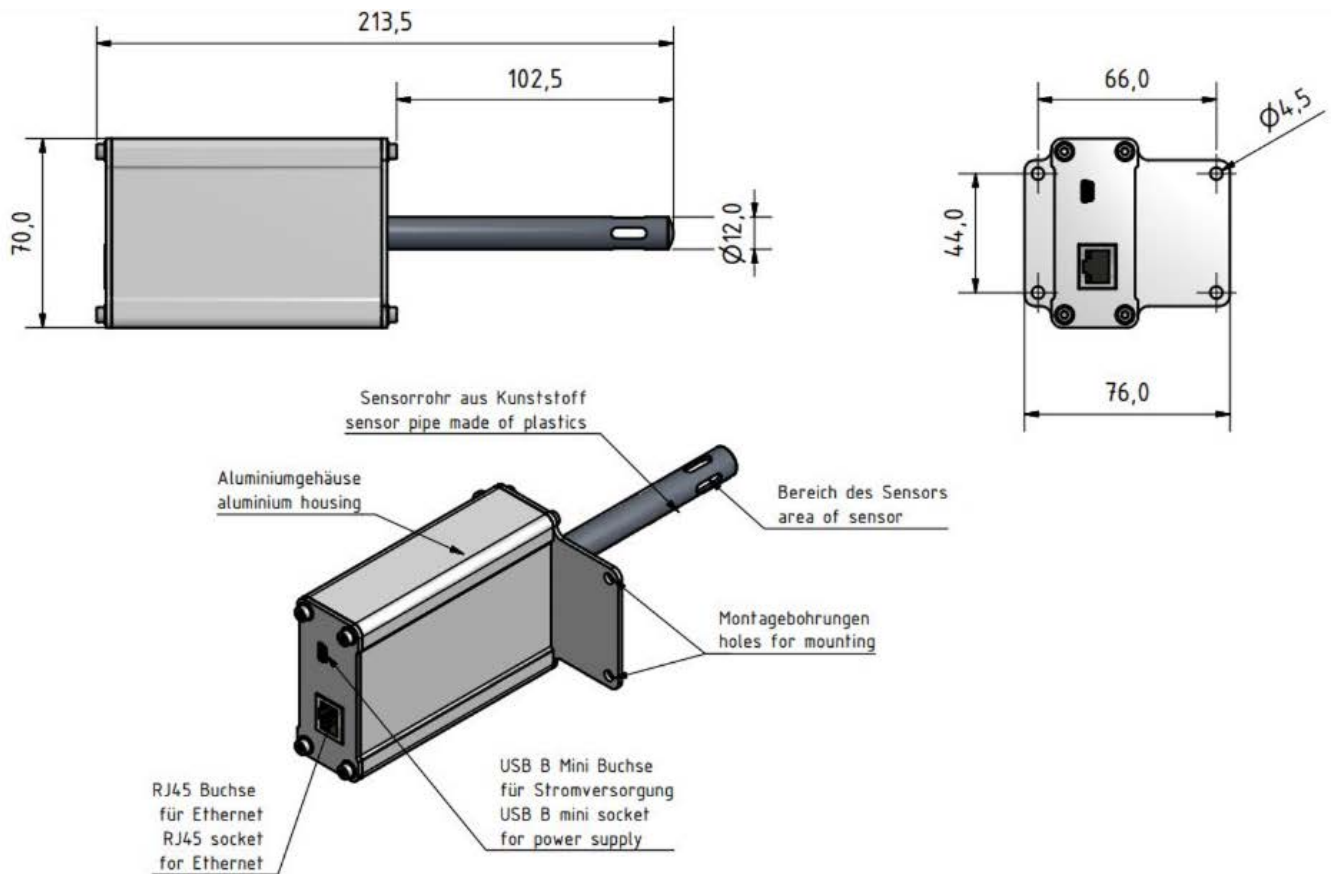

Adjustment behavior of the sensor

- In humidity and temperature measurement, several parameters are responsible for the adjustment behavior (time until the actual measured value is displayed). The parameter responsible for the highest measuring error is a temperature discrepancy between the sensor resp. the whole measuring instrument and the material being measured resp. the air.
- Therefore, let the device adjust until the displayed temperature corresponds to the actual temperature. The graph below shows how long it takes to adjust from 20 °C to 30 °C.

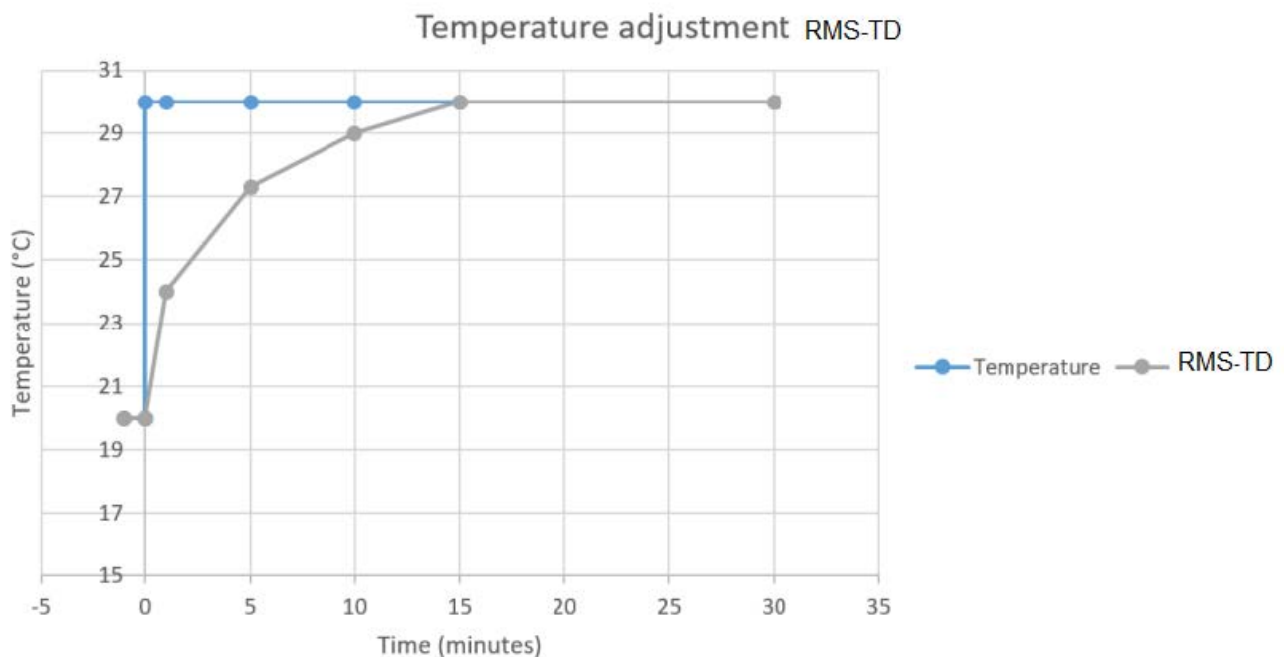

- To demonstrate the importance of temperature adjustment, the table below shows the measuring errors due to a temperature difference between the measuring instrument and the material being measured of only 1 °C, at different ambient temperatures.

	10 °C	20 °C	30 °C
10 % r.h.	+/- 0.7 %	+/- 0.6 %	+/- 0.6 %
50 % r.h.	+/- 3.5 %	+/- 3.2 %	+/- 3.0 %
90 % r.h.	+/- 6.3 %	+/- 5.7 %	+/- 5.4 %

At room temperature (20 °C) and an assumed humidity value of 50 % relative humidity a temperature difference between the measuring sensor and the material being measured of 1 °C causes a measurement error of 3.2 % relative humidity.


A temperature difference of 3 °C would cause a measurement error of more than 10 % relative humidity.

Definition relative humidity

Indicates the relationship between the current water vapor pressure and the maximum possible, the so-called saturation vapor pressure. The relative humidity shows the degree the air is saturated with water vapor. Examples: 50% relative humidity: At the current temperature and pressure, the air is half saturated with water vapour. 100% relative humidity means that the air is totally saturated with water vapor. If the air has more than 100% humidity, the excessive humidity would condense or precipitate as mist.

1. Application range

Within the normal application range (normal range) the accuracy of the device is as indicated. A long-term application beyond the normal application range (max. range), particularly at an air humidity of more than 80%, can lead to higher measuring errors. Back in the normal application range, the sensor will return to the indicated accuracy automatically.

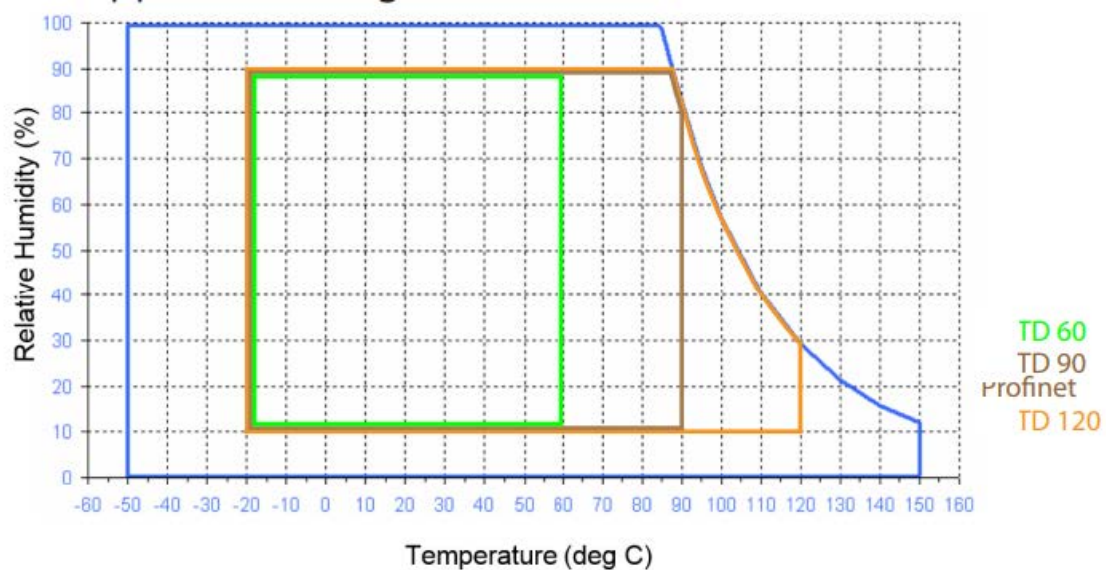

Cleaning and maintenance

Regularly cleaning and maintaining the device will ensure that it will have a long service life and stay in good condition.

1. Care instructions

- Do not leave the device out in the rain.
- Do not immerse the sensor in water.
- Do not expose the device to extreme temperatures.
- Protect the device from strong mechanical shocks and loads.

2. Cleaning the device

ATTENTION Do not clean with fluids Water or cleaning fluid getting inside the device can destroy the device.

- Only clean with dry materials.
- Aluminum housing and sensor tube
- Clean the aluminum housing and the sensor tube with a dry cloth.
- Air humidity and temperature sensor
- The air humidity and temperature sensor cannot be cleaned.
- In case of a polluted sensor please contact Checkline Europe.

Checking the calibration

To do so: Calibration equipment and calibration ampoules are required.

The device, the calibration equipment and the humidity standards must have a temperature between 20.0 °C and 26.0 °C.

It is recommended to store the device, the calibration equipment and the calibration ampoules in a room with little temperature fluctuation for 24 hours.

Assembling the calibration equipment

1. Place the sealing ring over the threads of the lower part like shown in (figure 1).
2. Place the textile pad into the lower part (figure 2) and carefully pour the humidity standard onto the pad, beginning with the humidity standard of 35 % relative humidity.
3. Carefully place the upper part onto the lower part (figure 3) and tighten the upper part clockwise. »
Recommendation: Keep the lower part on the table while screwing on the upper part. » If necessary, only lift the calibration equipment straight up and do not tilt or turn it over.
4. Loosen the fixing nut counterclockwise until the sensor tube of the measuring device can be inserted without excessive pressure.
5. Now carefully push the sensor tube of the measuring device into the upper part until it stops (figure 4).
6. Secure the calibration equipment on the sensor tube by tightening the previously loosened fixing nut.
 - Make sure to lift the device with the calibration equipment only straight up and do not tip or turn it over. Otherwise you could damage the sensor.
 - Do not remove the calibration equipment from the sensor tube until specifically indicated otherwise.
 - Place a distance holder under the device so that the device and the calibration equipment lay horizontally on the table.



ATTENTION Damage to the sensor

By tilting or turning the device with mounted calibration equipment the sensor can be destroyed.
Only lift the device with mounted calibration equipment straight up

Determining the deviation

1. Let the sensor adjust to the humidity standard for at least 2 hours.
2. Then note down the measured relative humidity and temperature.
3. At ideal temperature conditions (device, calibration equipment and humidity standard have a temperature of 23 °C), the value printed on the humidity standard can be used as reference value.
4. In case of deviation from the factory temperature (23.0 °C), the real humidity value must first be determined according to the table below.

Temperature	Humidity standards		
	35 %	50 %	80 %
20 °C	34.6 %	49.8 %	79.9 %
21 °C	34.8 %	49.8 %	80.0 %
22 °C	34.9 %	49.9 %	80.0 %
23 °C	35.0 %	50.0 %	80.0 %
24 °C	35.1 %	50.1 %	80.0 %
25 °C	35.2 %	50.2 %	80.0 %
26 °C	35.4 %	50.2 %	80.1 %

- Note down the real humidity value
- Compare the noted displayed measuring value with the real humidity value.

- If the deviation revealed is below 1.5 % relative humidity, it is not recommended to recalibrate.
- If the deviation revealed is more than 1.5 % relative humidity, please contact Checkline Europe.
- Now remove the calibration equipment from the sensor tube and repeat the procedure from “9.1 Assembling the calibration equipment”, optionally with the humidity standard 50 % relative humidity or the humidity standard 80 % relative humidity

Faults

If the measures listed below fail to remedy any faults or if the device has faults not listed here, please contact Checkline Europe BV.

Fault	Cause	Remedy
Measuring error	The temperature is outside the operating temperature: lower than -20 °C or higher than +60 °C	Only use the device in temperatures between -20 °C and +60 °C
	Measurement error due to too short temperature adjustment time	Let the device adjust to the surroundings (see “6. Adjustment behavior of the sensor”).
	Sources of heat or cold that do not correspond to the surrounding temperature	Reposition your device at a location that is representative for the room climate.
	Dripping water or sprayed water	Direct contact of the sensor with dripping or sprayed water will destroy it.
	Irreversible damage of the sensor due to aggressive gasses	Please contact your Checkline Europe
	Condensation caused by a change in temperature	Condensation on the sensor interferes with the calibration. Let the device adjust to the surrounding temperature
	Polluted air humidity and temperature sensor	Please contact your Checkline Europe
	Foreign particles on the sensor	Please contact your Checkline Europe

Warranty

- Checkline Europe (Checkline) warrants to the original purchaser that this product is of merchantable quality and conforms in kind and quality with the descriptions and specifications thereof. Product failure or malfunction arising out of any defect in workmanship or material in the product existing at the time of delivery thereof which manifests itself within one year from the sale of such product, shall be remedied by repair or replacement of such product, at Checkline’s option, except where unauthorized repair, disassembly, tampering, abuse or misapplication has taken place, as determined by Checkline. All returns for warranty or non-warranty repairs and/or replacement must be authorized by Checkline, in advance, with all repacking and shipping expenses to the address below to be borne by the purchaser.
- THE FOREGOING WARRANTY IS IN LIEU OF ALL OTHER WARRANTIES, EXPRESSED OR IMPLIED,

INCLUDING BUT NOT LIMITED TO, THE WARRANTY OF MERCHANTABILITY AND FITNESS FOR ANY PARTICULAR PURPOSE OR APPLICATION. CHECKLINE SHALL NOT BE RESPONSIBLE NOR LIABLE FOR ANY CONSEQUENTIAL DAMAGE, OF ANY KIND OR NATURE, RESULTING FROM THE USE OF SUPPLIED EQUIPMENT, WHETHER SUCH DAMAGE OCCURS OR IS DISCOVERED BEFORE, UPON OR AFTER REPLACEMENT OR REPAIR, AND WHETHER OR NOT SUCH DAMAGE IS CAUSED BY MANUFACTURER'S OR SUPPLIER'S NEGLIGENCE WITHIN ONE YEAR FROM INVOICE DATE.


- Some State jurisdictions or States do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation may not apply to you. The duration of any implied warranty, including, without limitation, fitness for any particular purpose and merchantability with respect to this product, is limited to the duration of the foregoing warranty. Some states do not allow limitations on how long an implied warranty lasts but, notwithstanding, this warranty, in the absence of such limitations, shall extend for one year from the date of invoice.

CHECKLINE EUROPE



- Dennenweg 225B, 7545 WE, Enschede, the Netherlands
- Tel: +31 (0)53-4356060 // Email: info@checkline.eu
- Every precaution has been taken in the preparation of this manual. Checkline Europe assumes no responsibility for errors or omissions. Neither is any liability assumed for damages resulting from the use of information contained herein. Any brand or product names mentioned herein are used for identification purposes only, and are trademarks or registered trademarks of their respective holders

www.checkline.eu

Documents / Resources

	<p>CHECKLINE RMS-TD-60-ETHERNET Humidity and Temperature Transmitter [pdf] Instructions</p> <p>TD-60-ETHERNET, RMS-TD-60-ETHERNET Humidity and Temperature Transmitter, RMS-TD-60-ETHERNET, RMS-TD-60-ETHERNET Transmitter, Humidity and Temperature Transmitter, Transmitter, Humidity, Temperature, Humidity Transmitter, Temperature Transmitter</p>
---	---

References

-  [Checkline Europe - Your Partner For Measuring Equipment](#)
-  [Checkline Europe - Your Partner For Measuring Equipment](#)
- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.