




# CyberPower LX1325GU3 Battery Backup User Manual

[Home](#) » [CyberPower](#) » CyberPower LX1325GU3 Battery Backup User Manual 

## Contents

- [1 CyberPower LX1325GU3 Battery Backup User](#)
- [2 FUNCTION SETUP GUIDE](#)
- [3 Documents / Resources](#)
- [4 Related Posts](#)

**CyberPower**

CyberPower LX1325GU3 Battery Backup User



## FUNCTION SETUP GUIDE




#### Power On:

Press and hold the POWER Button. You will hear a constant tone for 1 second, followed by a short beep. Release the button after the short beep.

#### Power Off:

Press the POWER button for approximately 2 seconds and you will hear a short steady tone (1 second). Release the button after 2 short beeps.

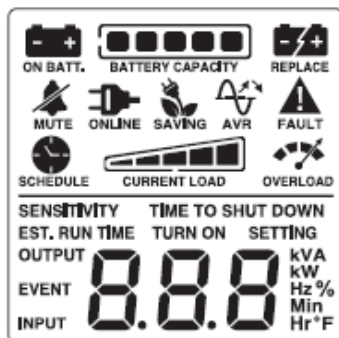

DISPLAY

#### Setup Mode:

Press and hold the DISPLAY Button for approximately 3 seconds to access the setup mode's 11 functions: Utility Quality, High Transfer Voltage, Low Transfer Voltage, Sensitivity, Low Battery Warning, Self-Test, Buzzer, LCD Sleep, Last Fault Reason, Back to Default Settings, and Back to Status Display. Use the same button to select the functions to configure.

#### Select Function:

When a function is selected, press DISPLAY Button for 3 seconds to view the options.

#### Confirm Option:



When an option is selected, press the DISPLAY Button for 3 seconds. After the set has been confirmed, "SETTING" will stop flashing.







#### Escape Option / Function (ESC):


- **Option Menu:** You can select this option and press the DISPLAY Button for 3 seconds to go back to the Function Menu.
- **Function Menu:** You can select this function and press the DISPLAY Button for 3 seconds to go back to the Status Display.
- After this amount of time with no activity during setup, the LCD will leave setup display. The setting will not be confirmed.

DISPLAY





Function/ LCD Display	Default	Options		Description
Utility Quality	Normal	Low (97V~144V)	Normal (100V~139V)	<p>Select the voltage quality of the input utility power. If Good is selected, the UPS will go to the battery mode more often to supply the cleanest power to connected devices. If Poor is selected, the UPS will tolerate more power fluctuations and go to battery mode less often.</p>
		High (103V~135V)	Escape to Function Menu	
		(Customized)		<p>“Customized” shows up when Maximum/Minimum output voltage has been adjusted in Advanced Setup Menu.</p>

Function/ LCD Display	Default	Options	Description
<p>Low Battery Warning</p> 	5 mins	<p>5~8 mins</p> <p>Escape to Function Menu</p> 	<p>The audible alarm will sound and the “ON BATT.” icon will flash when the remaining runtime is less than the value selected.</p>

<p>Self-Test (Battery Test)</p> 	<p>No Action</p>	<p>YES</p> 	<p>Escape to Function Menu</p> 	<p>In Line Mode, if Yes is selected, the UPS will perform a self-test.</p>
<p>Buzzer</p> 		<p>Buzzer on</p> 	<p>Buzzer off (Mute)</p> 	<p>“b.on” (Buzzer On): audible</p>

	b.on	<p>Escape to Function Menu</p> 		<p>alarms are enabled.</p> <p>“b.oF” (Buzzer off): audible alarms are disabled. If b.oF is selected, the unit will mute all alarms except for fault or overload condition.</p>
--	------	--	--	--








Function/ LCD Display	Default	Options	Description
-----------------------	---------	---------	-------------

<p>High Transfer Voltage</p>  <p>* = fine tune the MAX O/P voltage</p>	<p>139V</p>	<p>135V ~ 144V</p> <p>Escape to Function Menu</p> 	<p>In Utility Quality settings, only 3 types of fixed voltage ranges can be chosen. However, you can fine tune the MAX O/P voltage in this function.</p> <p>If the utility voltage is usually high, and the connected equipment can work in this condition, you can set the output voltage range higher to reduce the UPS from going to Battery Mode as often.</p>
<p>Low Transfer Voltage</p>  <p>* = fine tune the MIN O/P voltage</p>	<p>100V</p>	<p>97V ~ 103V</p> <p>Escape to Function Menu</p> 	<p>In Utility Quality settings, only 3 types of voltage ranges can be chosen. However, you can fine tune the MIN O/P voltage in this function.</p> <p>If the utility voltage is usually low, and the connected equipment can work in this condition, you can set the output voltage range lower to reduce the UPS from going to AVR Mode or Battery Mode as often.</p>


Sensitivity	Normal	Low	Normal	<p>If the connected equipment can tolerate more power events (Example: unstable power often associated with stormy weather), select Low Sensitivity. The UPS will go to Battery Mode less often. If the connected equipment is more sensitive</p> <p>to power events, select High Sensitivity. The UPS will go to Battery Mode more often.</p>
		High	Escape to Function Menu	

Function/ LCD Display	Default	Options		Description
LCD Sleep	L.on	LCD sleep is on	LCD sleep is off	<p>“L.on” (LCD Sleep is on): In Line Mode, LCD screen will turn off automatically after 1 min of inactivity; in Battery Mode, LCD screen is always on.</p> <p>“L.oF” (LCD sleep is off): LCD screen is always on.</p>
		Escape to Function Menu		



<p>Event Reset</p> 	No Action	<p>YES</p> 	<p>Escape to Function Menu</p> 	<p>This meter records the number of power outages.</p> <p>If Yes is selected, the EVENT counter will be cleared.</p> <p>E01 : Charger fault (OverCharge) E02 : Charger fault (No Charge) E11 : Battery Fault</p> <p>E21 : Output short. E22 : Over load.</p>
<p>Back to Default Settings</p> 	No Action	<p>YES</p> 	<p>Escape to Function Menu</p> 	<p>If Yes is selected, the UPS will be restored to the factory default settings.</p>
<p>Return to Status Display</p> 	—			<p>Press the DISPLAY Button for approximately 3 seconds to go back to the Status Display.</p>

## Documents / Resources

	<p><a href="#">CyberPower LX1325GU3 Battery Backup</a> [pdf] User Manual LX1325GU3 Battery Backup, LX1325GU3, Battery Backup, Backup</p>
---	--