Home » CyberPower » CyberPower OR1000LCDRM1U Smart App LCD UPS Systems User Manual



CyberPower OR1000LCDRM1U Smart App LCD UPS Systems **User Manual**

Cyber Power® YOUR ULTIMATE ALLY IN POWER


0			nts
	nn	ΙТО	nte
\sim	-	LC	1113

- 1 INTELLIGENT UPS SERIES
 - 1.1 OR1000LCDRM1U / OR1500LCDRM1U
- **2 USER MANUAL**
 - 2.1 FEATURES
 - 2.2 PRODUCT REGISTRATION
 - 2.3 IMPORTANT SAFETY WARNINGS (SAVE THESE INSTRUCTIONS)
 - 2.4 INSTALLING YOUR UPS SYSTEM
 - 2.4.1 UNPACKING
 - 2.4.2 OVERVIEW
 - 2.4.3 AUTOMATIC VOLTAGE REGULATOR
 - 2.4.4 DETERMINE THE POWER REQUIREMENTS OF YOUR
 - **EQUIPMENT**
 - 2.4.5 HARDWARE INSTALLATION GUIDE
 - 2.5 BASIC OPERATION
 - 2.6 REPLACING THE BATTERY
 - **2.6.1 BATTERY REPLACEMENT PROCEDURE:**
 - 2.7 DEFINITIONS FOR ILLUMINATED LCD INDICATORS
 - 2.8 TROUBLESHOOTING
 - 2.9 TECHNICAL SPECIFICATIONS
 - 2.10 SYSTEM FUNCTION BLOCK DIAGRAM
 - 2.11 CYBERPOWER GREENPOWER UPS™ TECHNOLOGY
 - 2.12 FCC COMPLIANCE STATEMENT
 - 2.13 LIMITED WARRANTY AND CONNECTED EQUIPMENT GUARANTEE
- 3 Documents / Resources
 - 3.1 References
- **4 Related Posts**

INTELLIGENT UPS SERIES

OR1000LCDRM1U / OR1500LCDRM1U

USER MANUAL

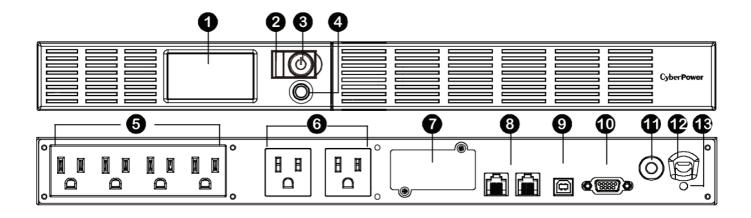

FEATURES

- 1. LCD Module Display
- 2. Power On Indicator
- 3. Power Switch
- 4. LCD Function Selected Switch
- 5. Battery and Surge Protected Outlets
- 6. Full-Time Surge Protection Outlets
- 7. SNMP / HTTP Network Slot
- 8. Communication Protection Ports RJ45
- 9. USB Port to PC
- 10. Dry Contact
- 11. Circuit Breaker
- 12. AC Input
- 13. Electrical Wiring Fault Indicator (Red)

Cyber Power Systems (USA), Inc.

4241 12th Avenue East, Suite 400 | Shakopee, MN 55379 | CyberPowerSystems.com

PRODUCT REGISTRATION

Thank you for purchasing a CyberPower product. This UPS is designed to provide unsurpassed power protection, operation, and performance during the lifetime of the product. Please take a few minutes to register your product at: www.CyberPowerSystems.com/registration.

Registration certifies your product's warranty, confirms your ownership in the event of a product loss or theft, and entitles you to free technical support. Register your product now to receive the benefits of CyberPower ownership.

IMPORTANT SAFETY WARNINGS (SAVE THESE INSTRUCTIONS)

This manual contains important safety instructions. Please read and follow all instructions carefully during

installation and operation of the unit. Read this manual thoroughly before attempting to unpack, install, or operate your UPS.

CAUTION! To prevent the risk of fire or electric shock, install in a temperature and humidity controlled indoor area free of conductive contaminants. (Please see specifications for acceptable temperature and humidity range).

CAUTION! To reduce the risk of electric shock, do not remove the cover except to service the battery. Turn off and unplug the unit before servicing the batteries. There are no user serviceable parts inside except for the battery.

CAUTION! Hazardous live parts inside can be energized by the battery even when the AC input power is disconnected.

CAUTION! The UPS must be connected to an AC power outlet with fuse or circuit breaker protection. Do not plug into an outlet that is not grounded. If you need to de-energize this equipment, turn off and unplug the unit.

CAUTION! To avoid electric shock, turn off the unit and unplug it from the AC power source before installing a computer component.

CAUTION! To reduce the risk of fire, connect only to a circuit provided with 20 amperes maximum branch circuit over current protection in accordance with the National Electric Code, ANSI/NFPA 70.

CAUTION! Not for use in a computer room as defined in the Standard for the Protection of Electronic Computer/Data Processing Equipment, ANSI/NFPA 75.

CAUTION! Do not dispose of batteries in a fire. The batteries may explode.

CAUTION! Do not open or mutilate batteries. Released electrolyte is harmful to the skin and eyes. It may be toxic.

DO NOT USE FOR MEDICAL OR LIFE SUPPORT EQUIPMENT!

CyberPower Systems does not sell products for life support or medical applications. DO NOT use in any circumstance that would affect operation and safety of life support equipment, any medical applications or patient care.

DO NOT USE WITH OR NEAR AQUARIUMS!

To reduce the risk of fire or electric shock, do not use with or near an aquarium. Condensation from the aquarium can cause the unit to short out.

DO NOT USE THE UPS ON ANY TRANSPORTATION!

To reduce the risk of fire or electric shock, do not use the unit on any transportation such as airplanes or ships. The effect of shock or vibration caused during transit and the damp environment can cause the unit to short out.

INSTALLING YOUR UPS SYSTEM

UNPACKING

Inspect the UPS upon receipt.

The box should contain the following:

- (a) UPS unit
- (b) User's manual
- (c) Rack mount brackets
- (d) USB A+B type cable

PowerPanel® Personal software is available on our website. Please visit <u>www.cyberpowersystems.com</u> and go to the Software Section for a free download.

OVERVIEW

The OR1000LCDRM1U/OR1500LCDRM1U UPS provides automatic voltage regulation for inconsistent utility power. The OR1000LCDRM1U/OR1500LCDRM1U features 1150 Joules of surge protection, and provides battery backup during power outages.

The OR1000LCDRM1U/OR1500LCDRM1U ensures consistent power to your computer system and includes software that will automatically save your open files and shutdown your computer system during a utility power loss.

AUTOMATIC VOLTAGE REGULATOR

The OR1000LCDRM1U/OR1500LCDRM1U stabilizes inconsistent utility power. The incoming utility power may be damaging to important data files, but with Automatic Voltage Regulation, the computer will not experience damaging voltage levels. An Automatic Voltage Regulator automatically increases low voltage to a consistent, computer safe 110volts/120volts. The unit's powerful sealed leadacid batteries will provide power only if the incoming voltage drops below 90volts or increases above 140volts.


DETERMINE THE POWER REQUIREMENTS OF YOUR EQUIPMENT


- 1. Ensure that the equipment plugged into the UPS does not exceed the UPS unit's rated capacity. If the rated capacities of the unit are exceeded, an overload condition may occur and cause the UPS unit to shut down or the circuit breaker to trip.
- 2. There are many factors that can affect the amount of power that your electronic equipment will require. For optimal system performance keep the load below 80% of the unit's rated capacity.

HARDWARE INSTALLATION GUIDE

- 1. Your new UPS may be used immediately upon receipt. However, after receiving a new UPS, to ensure the battery's maximum charge capacity, it is recommended that you charge the battery for at least 8 hours. Your UPS is equipped with an auto-charge feature. When the UPS is plugged into an AC outlet, the battery will automatically charge whether the UPS is turned on or turned off.
- 2. If you will use the software, connect the USB cable to the USB port on the UPS.
- 3. With the UPS unit turned off and unplugged, connect your computer, monitor, and any other peripherals requiring battery backup into the battery power supplied outlets. Plug the other peripheral equipment (e.g. printer, scanner, speakers, etc.) into the full-time surge protection outlets. DO NOT plug a laser printer, paper shredder, copier, space heater, vacuum cleaner, sump pump, or other large electrical device into the "Battery and Surge Protected Outlets". The power demands of these devices will overload and possibly damage the unit.

4. Plug the UPS into a 2-pole, 3-wire grounded receptacle (wall outlet). Make sure the wall branch outlet is protected by a fuse or circuit breaker and does not service equipment with large electrical demands (e.g. air conditioner, refrigerator, copier, etc.). The warranty prohibits the use of extension cords, outlet strips, and surge strips in conjunction with the UPS unit.





- 5. Press the power switch to turn the unit on. The Power On indicator light will illuminate green and the unit will "beep" twice.
- 6. If an overload is detected, an audible alarm will sound and the unit will emit one long beep. To correct this, turn the UPS off and unplug at least one piece of equipment from the battery power supplied outlets. Make sure the circuit breaker is depressed and then turn the UPS on.
- 7. To maintain optimal battery charge, leave the UPS plugged into an AC outlet at all times.
- 8. To store the UPS for an extended period of time, cover it and store with the battery fully charged. While in storage, recharge the battery every three months to ensure optimal battery life.
- 9. The socket-outlet shall be installed near the equipment and shall be easily accessible.

BASIC OPERATION

1. LCD module display

LCD shows all the UPS information with icons and messages.

2. Power On Indicator

This LED is illuminated when the utility condition is normal and the UPS outlets are providing power, free of surges and spikes.

3. Power Switch

Master on/off switch for equipment connected to the battery power supplied outlets.

4. LCD function selected switch

The switch can be used to select the LCD display contents Including input/output voltage and estimated run time, etc.

5. Battery and Surge Protected Outlets

The unit has four battery powered/surge suppression outlets for connected equipment to ensure temporary uninterrupted operation of your equipment during a power failure. (DO NOT plug a laser printer, paper shredder, copier, space heater, vacuum cleaner, sump pump or other large electrical devices into the "Battery and Surge Protected Outlets". The power demands of these devices may overload and damage the unit.)

6. Full-Time Surge Protection Outlets

The unit has two surge suppression outlets.

7. SNMP/HTTP Network Slot

Remove the cover panel to install an optional RMCARD provides remote monitoring and management of your UPS over a network.

8. Communication Protection Ports RJ45

Communication protection ports, bi-directional, will protect a 10/100/1000Ethernet connection. (RJ45).

9. USB Port to PC

This port allows connection and communication from the USB port on the computer to the UPS unit. The UPS communicates its status to the PowerPanel® Business Edition software.

10. Dry contact

This port produces information for equipment that can read dry contact signals.

11. Circuit Breaker

Located on the back of the UPS, the circuit breaker serves to provide overload and fault protection. Under normal operating conditions, the circuit breaker is depressed.

12. AC Input

Connect the AC Power cord to a properly wired and grounded outlet.

13. Electrical Wiring Fault Indicator (Red)

This LED indicator will illuminate to warn the user that a wiring problem exists, such as bad ground, missed ground or reversed wiring. If this is illuminated, disconnect all electrical equipment from the outlet and have an electrician check to ensure the outlet is properly wired. The unit will not provide surge protection without being plugged into a grounded and properly wired wall outlet.

REPLACING THE BATTERY

CAUTION! Read and follow the IMPORTANT SAFETY INSTRUCTIONS before servicing the battery. Service the battery under the supervision of personnel knowledgeable of batteries and their precautions.

CAUTION! Use only the specified type of battery. When replacing batteries, replace with the same number of the following battery: CyberPower/RB0670X4 for OR1000LCDRM1U and CyberPower/ RB0690X4 for OR1500LCDRM1U. See your dealer for replacement batteries.

CAUTION! For OR1000LCDRM1U: Risk of Energy Hazard, 24 V, maximum 7 Ampere-hour battery. Before replacing batteries, remove conductive jewelry such as chains, wrist watches, and rings. High energy through conductive materials could cause severe burns.

For OR1500LCDRM1U: Risk of Energy Hazard, 24 V, maximum 9 Ampere-hour battery. Before replacing batteries, remove conductive jewelry such as chains, wrist watches, and rings. High energy through conductive materials could cause severe burns.

CAUTION! Risk of explosion if battery is replaced by an incorrect type. Dispose of used batteries according to the instructions.

CAUTION! The battery may present the risk of electrical shock. Do not dispose of batteries in a fire, as the batteries may explode. Follow all local ordinances regarding proper disposal of batteries.

CAUTION! Do not open or mutilate the batteries. Released material is harmful to the skin and eyes and may be toxic.

CAUTION! A battery can present a high risk of short circuit current and electrical shock. Take the following precautions before replacing the battery:

- 1. Remove all watches, rings or other metal objects.
- 2. Only use tools with insulated handles.
- 3. DO NOT lay tools or other metal parts on top of battery or any battery terminals.
- 4. Wear rubber gloves and boots.


5. Determine if the battery is inadvertently grounded. If inadvertently grounded, remove source of ground.

CONTACT WITH A GROUNDED BATTERY CAN RESULT IN ELECTRICAL SHOCK! The likelihood of such shock will be reduced if such grounds are removed during installation and maintenance (applicable to a UPS and a remote battery supply not having a grounded circuit).

CAUTION – RISK OF EXPLOSION IF BATTERY IS REPLACED BY AN INCORRECT TYPE. DISPOSE OF USED BATTERIES ACCORDING TO LOCAL REGULATIONS


BATTERY REPLACEMENT PROCEDURE:

- 1. Remove the right-side of the faceplate.
- 2. Remove the three retaining screws on the cable protection cover then remove the cover.
- 3. Disconnect the black and red cable.
- 4. Remove the retaining screw of the cable connectors.
- 5. Replace the new battery pack. Assemble the screws, cover, cable and front panel in the reverse sequence of above steps. Recharge the unit for 8 hours to ensure the UPS performs expected runtime.

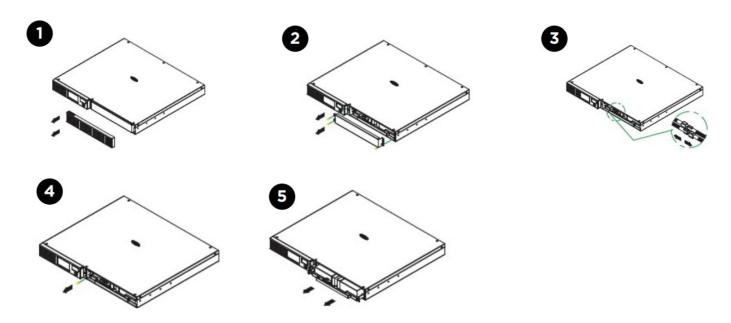

REMINDER: Batteries are considered **HAZARDOUS WASTE** and must be disposed of properly. Most retailers that sell lead-acid batteries collect used batteries for recycling, as required by local regulations.

DEFINITIONS FOR ILLUMINATED LCD INDICATORS



Line Mode

	UPS Status Display			Capacity Displa y		Digital Value Display					
Select SW Press	7	dimi.	×	PX.	Load Cap.	Battery Cap	Input Vol tage	Output Voltage	% of L oad	% of B att.	Run Ti me
Initial	V	Х	_	х	V	Х	V				
1 st	V	Х	_	Х	V	Х		V			
2 nd	V	Х	_	Х	V	Х			V		
3 rd	V	Х	_	Х	X	V				V	
4 th	V	Х	_	X	V	X					V
5 th (Return)	V	Х	_	Х	V	Х	V				
(Overload)	V	х	_	V	_	_	_	_	_	_	_

 $V: Illuminated \ / \ X: Not \ Illuminated \ / \ -\!\!\!-: Either$

Battery Mode

	UPS Status Display			Capacity Displa y		Digital Value Display					
Select SW Press	7	dimin	×	PX.	Load Cap.	Battery Cap	Input Vol tage	Output Voltage	% of L oad	% of B att.	Run Ti me
Initial	V	х	_	х	х	V	V				
1 st	V	x	_	х	х	V		V			
2 nd	V	х	_	Х	V	Х			V		
3 rd	V	Х	_	Х	X	V				V	
4 th	V	Х	_	Х	х	V					V
5 th (Return)	V	Х	_	X	х	V	V				
(Overload)	V	х	_	V	_	_	_	_	_	_	_

V: Illuminated / X: Not Illuminated / —: Either


TROUBLESHOOTING

Problem	Possible Cause	Solution			
Full-time surge protection outlet s stop providing power to equip ment.	Circuit breaker has been tripped due to an overload.	Turn the UPS off and unplug at least one piece of equipment. Wait 10 seconds, res et the circuit breaker by depressing the bu tton, and then turn the UPS on.			
The UPS does not perform exp	Battery not fully charged.	Recharge the battery by leaving the UPS plugged in.			
ected runtime.	Battery is worn out.	Contact CyberPower Systems about repl acement batteries at: cyberpowersystems.com/support.			
	The on/off switch is designed to prevent damage from rapidly turn ing it off and on.	Turn the UPS off. Wait 10 seconds and th en turn the UPS on.			
The UPS will not turn on.	The battery is worn out.	Contact CyberPower Systems about repl acement batteries at: <u>cyberpowersystems.com/support</u> .			
	Mechanical problem.	Contact CyberPower Systems at: cyberpowersystems.com/support.			
PowerPanel® Personal is inacti	The USB cable is not connected.	Connect the USB cable to the UPS unit a nd an open USB port on the back of the c omputer.			
ve (all icons are grey).	The unit is not providing battery power	Shutdown your computer and turn the UP S off. Wait 10 seconds and turn the UPS back on. This should reset the unit.			

Additional troubleshooting information can be found at "Support" at www.CyberPowerSystems.com

Model	OR1000LCDRM1Ua OR1000LC DRM1U	OR1500LCDRM1Ua OR1500L CDRM1U				
Capacity	1000VA / 600W	1500VA / 900W				
Nominal Input Voltage	90 Vac to 140 Vac					
Input Frequency	60 Hz ± 3 Hz (Auto-sensing)					
AVR Function	Ye	Yes				
On-Battery Output Voltage	120Vac ± 5%					
On-Battery Output Wave Form	Simulated Sine Wave Form					
Operating Temperature	+ 32°F to 104° F / 0° C to 40° C					
Size (W x H x D)	1U Rack 17.05 x 1.8 x 15.6 in.					
Net Weight	30.1 lbs	33.0 lbs				
Battery Type	CyberPower / RB0670X4	CyberPower / RB0690X4				
Typical Battery Recharge Time	8 hours					
Typical Battery Life	3 to 6 years, depending on number of discharge/recharge cycles					
Recommended Battery	Sealed Maintenance Free Lead Acid Battery					
Safety Approvals	UL1778 5th, cUL CSA C22.2 No.107.3-05, FCC/DoC Class B					

SYSTEM FUNCTION BLOCK DIAGRAM

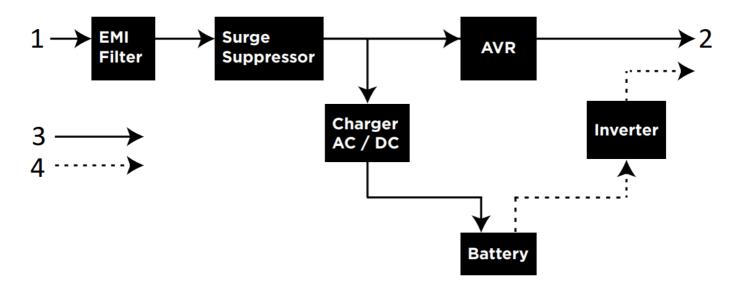

- 1. Input
- 2. Output
- 3. Normal Mode
- 4. Battery Mode

CYBERPOWER GREENPOWER UPS™ TECHNOLOGY

Advanced Energy-Saving Patented Bypass Technology

CyberPower's patented GreenPower UPSTM with Bypass Technology reduces UPS energy costs by up to 75% compared to conventional UPS models. Even when utility power is normal, conventional UPS models constantly pass power through a transformer. By contrast, under normal conditions the advanced circuitry of a GreenPower UPSTM bypasses the transformer. As a result, the power efficiency is significantly increased while decreasing waste heat, using less energy, and reducing energy costs. When an abnormal power condition occurs, the GreenPower UPSTM automatically runs power through its transformer to regulate voltage and provide "safe" power. Since utility



power is normal over 88% of the time, the GreenPower UPS™ operates primarily in its efficient bypass mode. The GreenPower UPS™ is also manufactured in accordance with the Restriction on Hazardous Substances (RoHS) directive making it one of the most environmentally-friendly on the market today.

FCC COMPLIANCE STATEMENT

This device complies with part 15 of the FCC rules. Operation is subject to the following two conditions: (1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

Note: This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio

communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment to an outlet on a circuit different from that to which the receiver is connected.
- Consult the dealer or an experienced radio/TV technician for help.

Warning: Changes or modifications not expressly approved by the party responsible for compliance could void the user's authority to operate the equipment.

Canadian Compliance Statement

CAN ICES-3 (B)/NMB-3(B)

LIMITED WARRANTY AND CONNECTED EQUIPMENT GUARANTEE

Please visit <u>www.CyberPowerSystems.com</u> for a copy of the Limited Warranty and Connected Equipment Guarantee.

Where Can I Get More Information?

The application of the United Nations Convention of Contracts for the International Sale of Goods is expressly excluded. CyberPower is the warrantor under this Limited Warranty. For further information please feel free to contact CyberPower at:

Cyber Power Systems (USA), Inc. 4241 12th Ave E., STE 400, Shakopee, MN 55379; call us at **(877) 297-6937**; or submit a web ticket online at **cyberpowersystems.com/support**.

Cyber Power Systems (USA), Inc. encourages environmentally sound methods for disposal and recycling of its UPS products. Please dispose and/or recycle your UPS and batteries in accordance to the local regulations of your state.

WARNING: This product can expose you to chemicals including bisphenol A (BPA) and styrene, which is known to the State of California to cause reproductive harm and cancer. For more information, go to www.P65Warnings.ca.gov.

© 2022 CyberPower Systems (USA), Inc. PowerPanel® Personal is a trademark of Cyber Power Systems(USA) Inc. All rights reserved. All other trademarks are the property of their respective owners.

Documents / Resources



CyberPower OR1000LCDRM1U Smart App LCD UPS Systems [pdf] User Manual OR1000LCDRM1U, OR1500LCDRM1U, OR1000LCDRM1U Smart App LCD UPS Systems, S mart App LCD UPS Systems, LCD UPS Systems, UPS Systems, Systems

References

- CyberPower UPS Systems, Battery Backup, PDUs, USB Surge Protectors
- Support | CyberPower
- CyberPower UPS Systems, Battery Backup, PDUs, USB Surge Protectors
- Registration | CyberPower
- **P65Warnings.ca.gov**

Manuals+,