



Danfoss AK-HS 1000 Temperature Sensor Installation Guide

[Home](#) » [Danfoss](#) » Danfoss AK-HS 1000 Temperature Sensor Installation Guide 


Danfoss AK-HS 1000 Temperature Sensor Installation Guide



Contents

- [1 Mounting](#)
- [2 Calibration](#)
- [3 CERTIFICATE OF PERFORMANCE](#)
- [4 Description of Equipment](#)
- [5 Technical Summary](#)
- [6 Documents / Resources](#)
 - [6.1 References](#)
- [7 Related Posts](#)


Mounting

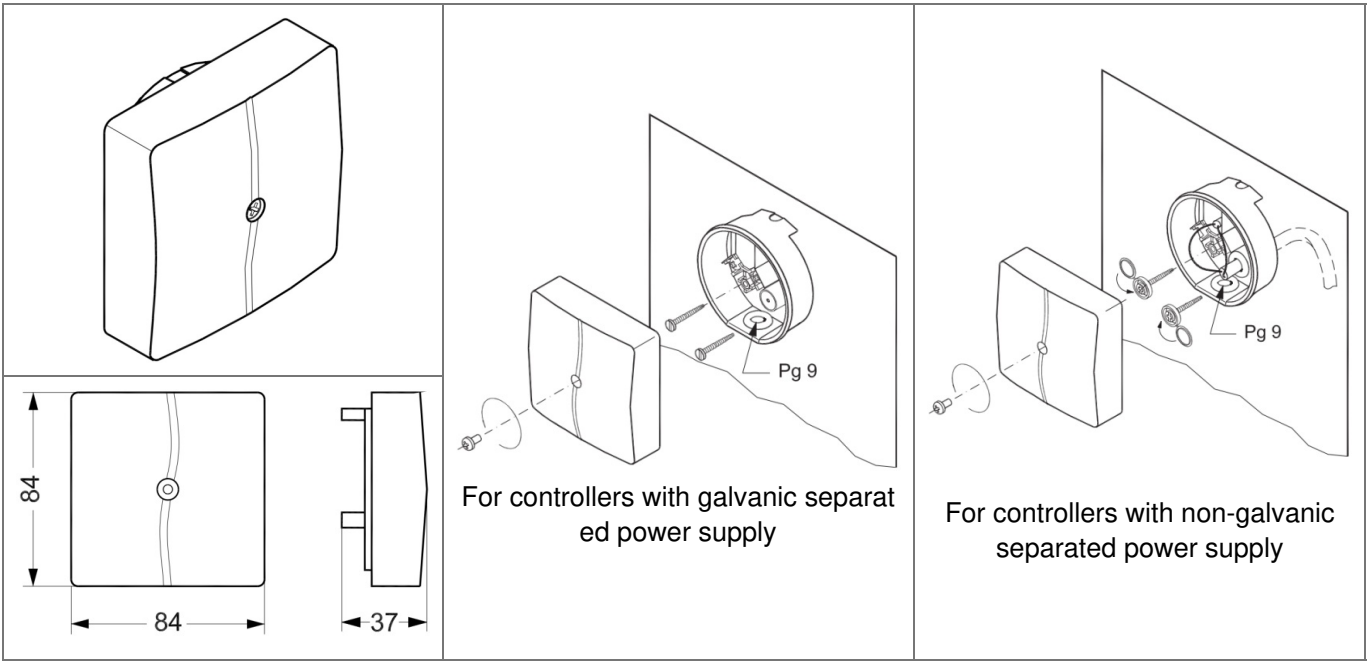

Calibration


In order to achieve an accuracy better than ± 1 K of the temperature controlled, the accuracy of the sensor and the connecting cables must be better than ± 0.6 K.

The cable resistance expressed in Kelvin can be calculated by using the formula below:



R = Cable resistance expressed in Kelvin
 ρ = Specific resistance of the material [$\Omega \cdot \text{m} / \text{mm}^2$] **L** = The length of the wire [in m there and back] **q** = Cross-section of the wire [mm^2]

Example:
 ρ = 0.018
L = 10 m x 2 = 20 m
q = 0.75 mm^2



Pt 1000 ohm / 0 °C

°C	ohm	°C	ohm
0	1000.0	0	1000.0
1	1003.9	-1	996.1
2	1007.8	-2	992.2
3	1011.7	-3	988.3

4	1015.6	-4	984.4
5	1019.5	-5	980.4
6	1023.4	-6	976.5
7	1027.3	-7	972.6
8	1031.2	-8	968.7
9	1035.1	-9	964.8
10	1039.0	-10	960.9
11	1042.9	-11	956.9
12	1046.8	-12	953.0
13	1050.7	-13	949.1
14	1054.6	-14	945.2
15	1058.5	-15	941.2
16	1062.4	-16	937.3
17	1066.3	-17	933.4
18	1070.2	-18	929.5
19	1074.0	-19	925.5
20	1077.9	-20	921.6
21	1081.8	-21	917.7
22	1085.7	-22	913.7
23	1089.6	-23	909.8
24	1093.5	-24	905.9
25	1097.3	-25	901.9
26	1101.2	-26	898.0
27	1105.1	-27	894.0
28	1109.0	-28	890.1
29	1112.8	-29	886.2
30	1116.7	-30	882.2
35	1136.1		
40	1155.4		
45	1174.7		
50	1193.9		

CERTIFICATE OF PERFORMANCE

It is herewith approved that AK-HS 1000 product sensors for temperature logging in combination with the HACCP corticated ADAP-KOOL® controllers comply with EN 13485 in respect to temperature monitoring according to the EC regulation. 2005/37/EC.

Name and Address of Manufacturer within the European Community

Danfoss A/S
Nordborgvej 81
DK 6430 Nord borg
Denmark

Description of Equipment

Product Temperature sensor for refrigerated cabinets and cold rooms requiring monitoring for HACCP documentation and alarm.

Technical Summary

Temperature Range: -30 °C to +20 °C

Accuracy: +/- 0,3 °C at 0 °C and +/- 0,005 °C x temp

Time Constant: T90 = 3–15 mins.

Sensor Type: Platinum-based sensors, Pt-1000 Ohm according to EN 60751 Class B

Cable Connection: AK temperature sensors are two-wire devices, (Cable: 2 x 0.22 ~ 1.5 mm²). All connections are interchangeable

Enclosure: IP54 [**Materials:** **Cover:** ABS / **Base:** Polycarbonate (PC)] thereby protecting the sensor against heat radiation from external ambient

Nordborg 2014-11-20

Place and date of issue



Thomas Matzen n

Production Quality Manager r

To be completed by Installer/Contractor for site HACCP Manager Reference and Documentation

This AK-HS 1000 has been applied to the following application:

Location Name/Address: _____


Cabinet / Cold Room Reference: _____

Installer / Contractor Name: _____

Signed: _____

Date: ____/____/____

Documents / Resources



[Danfoss AK-HS 1000 Temperature Sensor](#) [pdf] Installation Guide
AK-HS 1000, AK-HS 1000 Temperature Sensor, Temperature Sensor, Sensor

References

- [User Manual](#)

[Manuals+](#). [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.