

Danfoss React RA Click Thermostatic Sensors Installation Guide

Home » Danfoss » Danfoss React RA Click Thermostatic Sensors Installation Guide 🖔






ENGINEERING TOMORROW Danfoss React" RA click / 015G3098 015G3088 **Installation Guide** Danfoss React™ RA click thermostatic sensors series




Contents

- 1 Installation
- 2 Uninstall
- **3 Temperature Limitation**
- 4 Theft protection
- 5 Shut of
- 6 Blind mark
- 7 Documents /
- Resources
- **8 Related Posts**


Installation

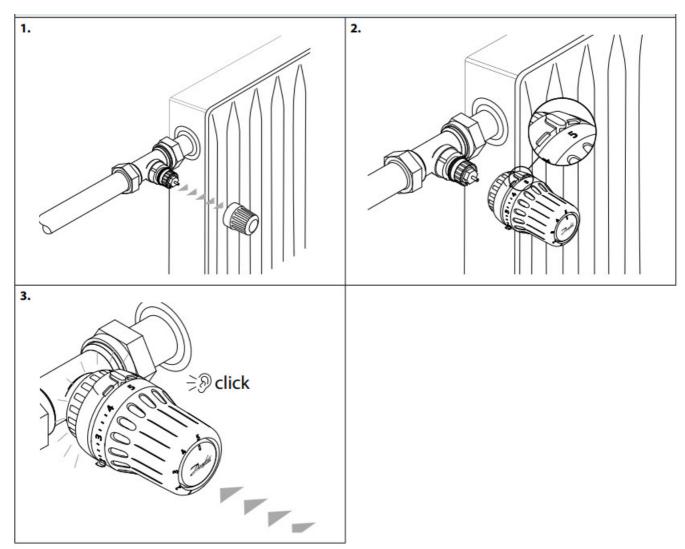


BIV Installation

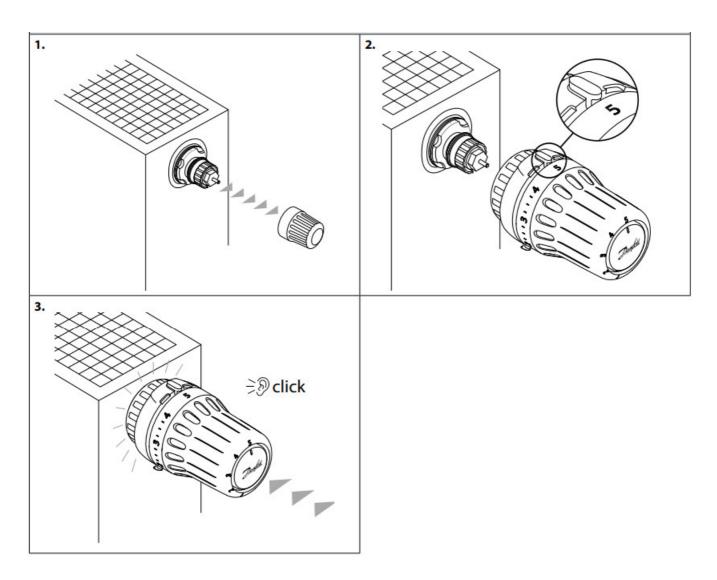


Uninstall

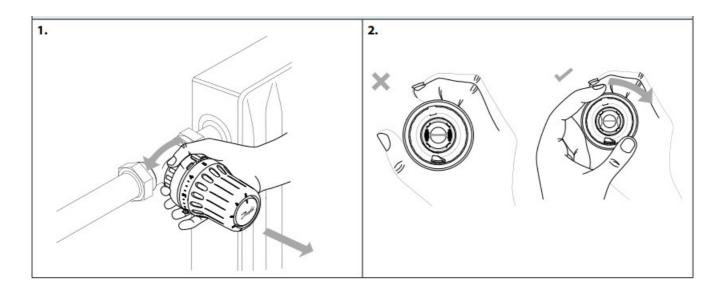



Temperature Limitation

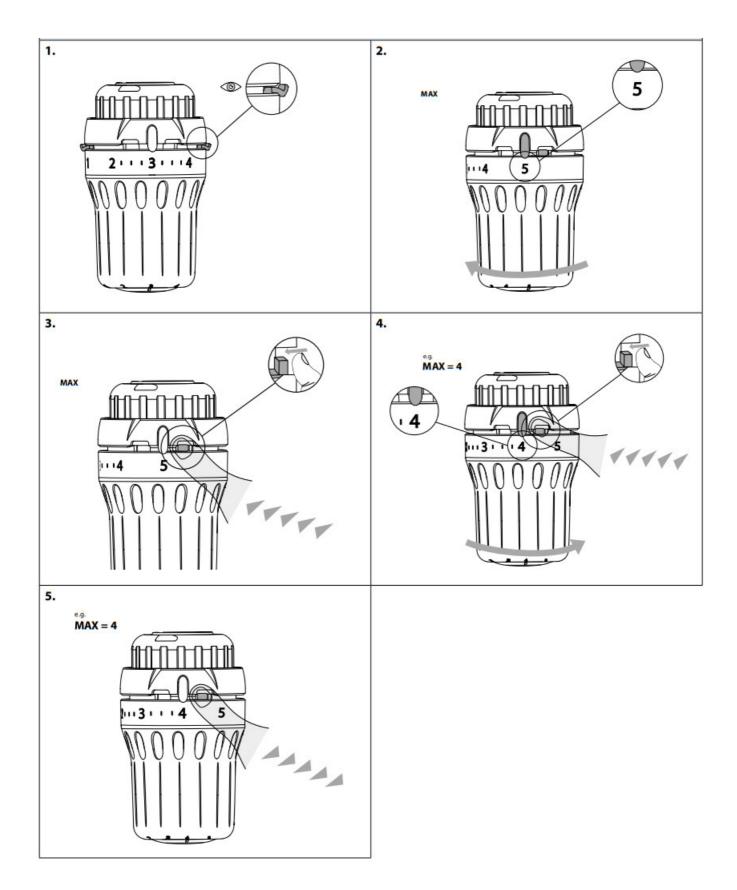

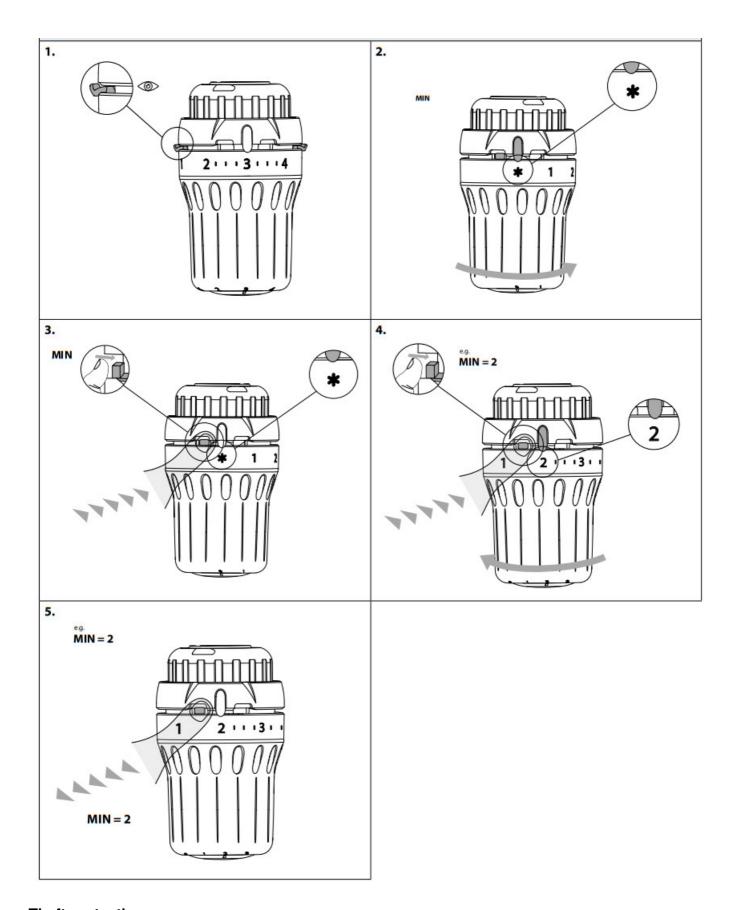


Theft protection

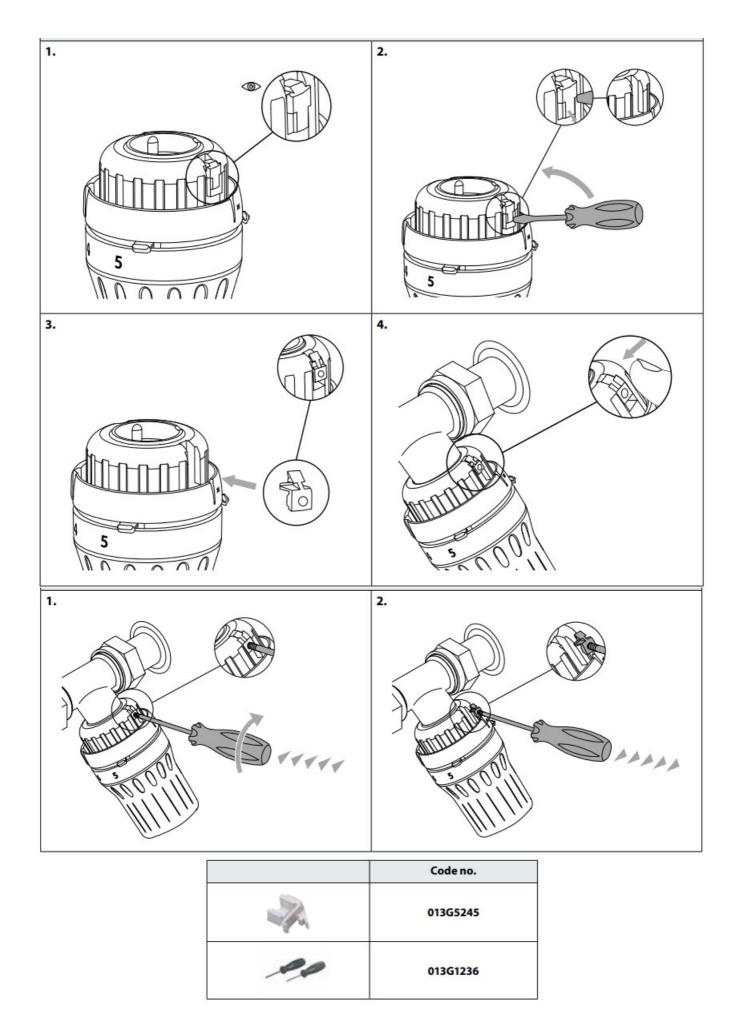

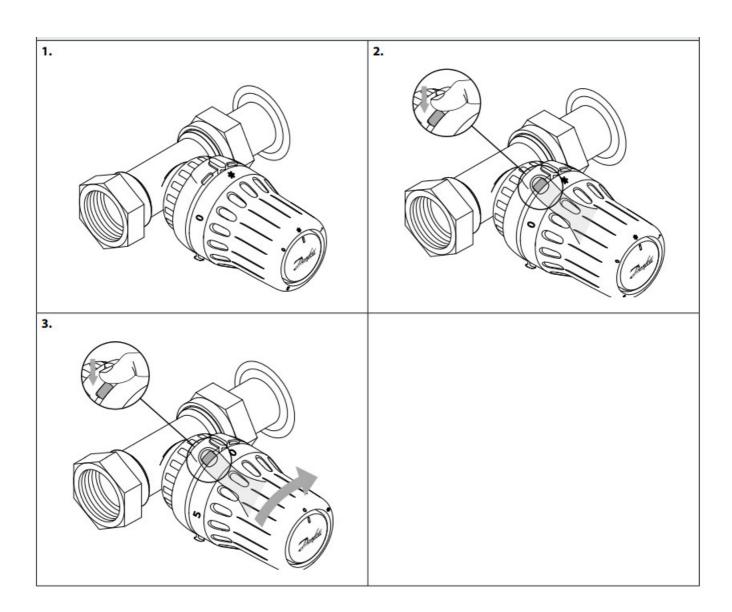

Blind mark

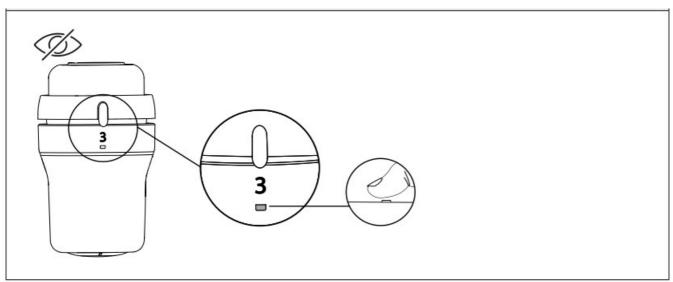

Danfoss A/S Climate Solutions danfoss.com

+45 7488 2222

Any information, including, but not limited to information on selection of product, its application or use, product design, weight, dimensions, capacity or any other technical data in product manuals, catalogues descriptions, advertisements, etc. and whether made available in writing, orally, electronically, online or via download, shall be considered informative, and is only binding if and to the extent, explicit reference is made in a quotation or order


confirmation. Danfoss cannot accept any responsibility for possible errors in catalogues, brochures, videos and other material.

Danfoss reserves the right to alter its products without notice. This also applies to products ordered but not delivered provided that such alterations can be made without changes to form, fit or function of the product.

All trademarks in this material are property of Danfoss A/S or Danfoss group companies. Danfoss and the Danfoss logo are trademarks of Danfoss A/S. All rights reserved.



Documents / Resources

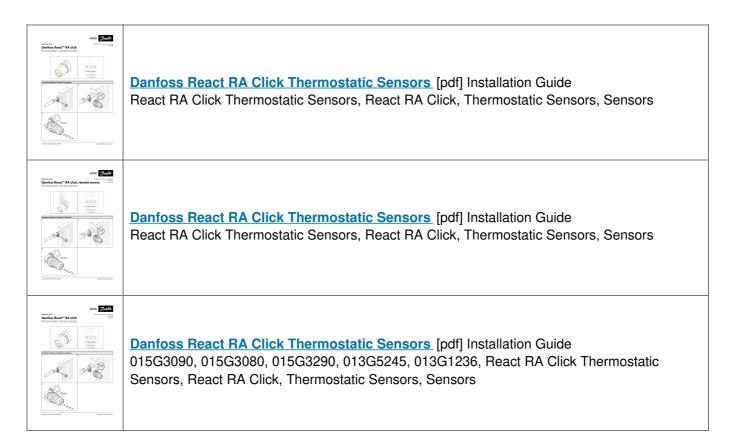

Manuals+,