



Elimko FT-10 Series Filter Timer User Manual

[Home](#) » [Elimko](#) » **Elimko FT-10 Series Filter Timer User Manual** 

Elimko

E-FT-10 USER MANUAL

E-FT-10 device control units are designed for rail mounting and should be used in an industrial environment.

- The package of E-FT-10 device contains;

Device 

User manual

Guarantee certificate

- After opening the package, please check the contents with the above list. If the delivered product is wrong type, any item is missing or there are visible defects, contact the vendor from which you purchased the product.
- Before installing and operating the device, please read the user manual thoroughly.
- The installation and configuration of the controller must only be performed by a person qualified in instrumentation.
- Keep the unit away from feamable gases, that could cause explosion.
- Do not use alcohol or other solvents to clean the device. Use a clean cloth soaked in water tightly squeezed to gently wipe the outer surface of the device.
- The lifetime of device is 10 years.

Contents

- 1 INTRODUCTION
- 2 CONNECTION DIAGRAMS
- 3 WORKING PRINCIPLES
- 4 OUTPUT UNITS
- 5 COMMUNICATION ADDRESSES
- 6 TABLES
- 7 Documents / Resources
 - 7.1 References

INTRODUCTION



Figure 1.1 FT-10 Front Panel

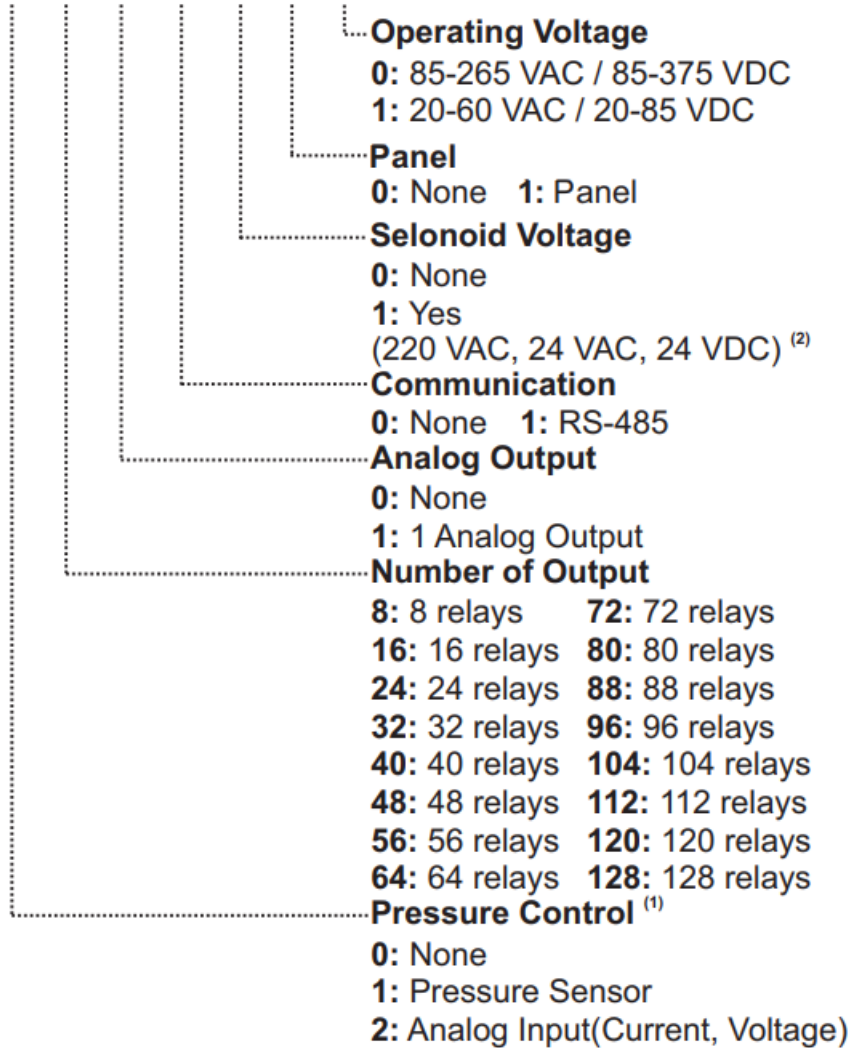
E-FT-10 is a programmable timer which has pressure control unit, is used in filter cleaning system. Device contains a control unit and output units, that are controlled by control unit. Control unit controls the output units on communication line. Operating and solenoid voltages of output units are supplied from control unit. Control unit has 8 outputs, each output unit has up to 16 outputs. Outputs can switch maximum 250 VAC, 1A. Device has 2 alarm relays. These relays can give an alarm to user, if any problem exists on output solenoids. RS-485 communication line on the device works according to Modbus protocol. Configuration parameters and error messages can also be viewed using Modbus. Outputs scanning order is configured by communication line. Device has 2 different kind of pressure input according to device type code, that is explained in

1.1 TYPE CODING

If U (TYPE CODING) is selected as "1", pressure inputs are connected on quick connect, that is shown as LO and HI on the front panel. In this case, differential pressure is measured by internal pressure sensor. If U (TYPE CODING) is selected as "2", an analog signal (current or voltage) is connected to analog input of device. In these two different situation, pressure value is shown on display, retransmitted on analog output. Device can perform ON/OFF or proportional control according to pressure value. These control methods are explained in 4.1 CONTROL TYPES .

1.1. TYPE CODING

E - FT - 10 - T - U - V - W - X - Y - Z




(1) Pressure sensor of device works in 7kPa range. If pressure control is selected as analog input, input type and input range must be defined on order.

(2) When X is selected as "1" (Solenoid Voltage Yes) than Y must be selected as "1". When X is selected as "1" factory default is 24 VDC.

1.2. TECHNICAL SPECIFICATION


| | |
|-----------------------|--|
| Operating Voltage | 85-265 V AC / 85-375 V DC 20-60 V AC / 20-85 V DC |
| Display Type | 2×4 digit 10 mm 7 segment display |
| Alarm Outputs | Relay: SPST-NO 250 V AC, 3 A |
| Retransmission Output | Current: 0-20 mA, 4-20 mA (isolated) |
| Relay Outputs | Minimum 8 Relays, maximum 128 Relays SPST-NO 250 V AC, 1 A |
| Relay Mechanical Life | 10 000 000 operation |
| Relay Electrical Life | Almost same as mechanical life, because the switching is made with s emiconductor. |
| Control Type | On/Off, Proportional(P) |
| Power Consumption | 7W (10 VA) |
| Operating Temperature | 0 °C, +55 tC (With no condensation or icing) |
| Storage Temperature | -25 °C, +55 °C (With no condensation or icing) |
| Memory | EEPROM max. 10000 writing |
| Weight | 400 g |

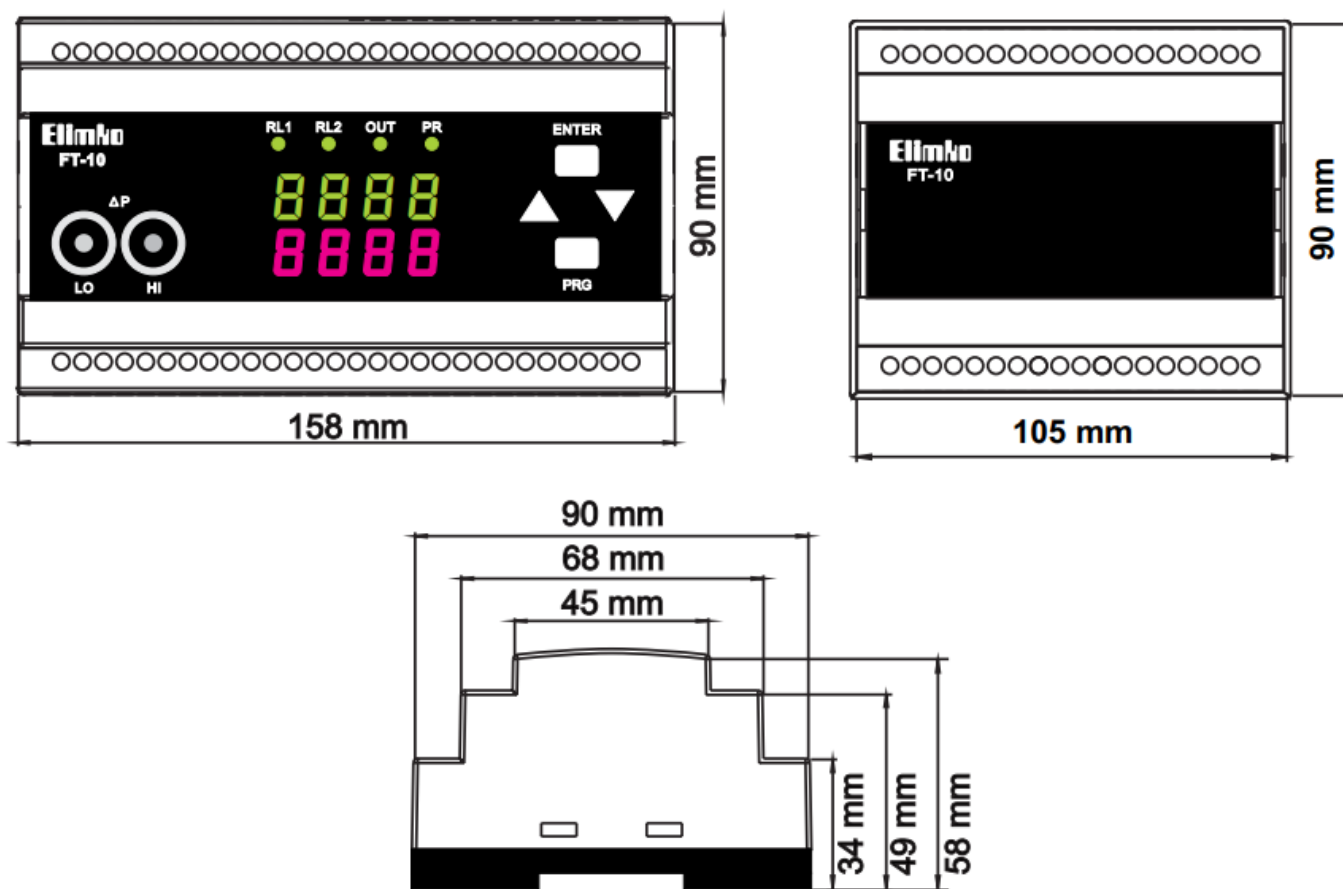1.3. DIMENSIONS




CONNECTION DIAGRAMS

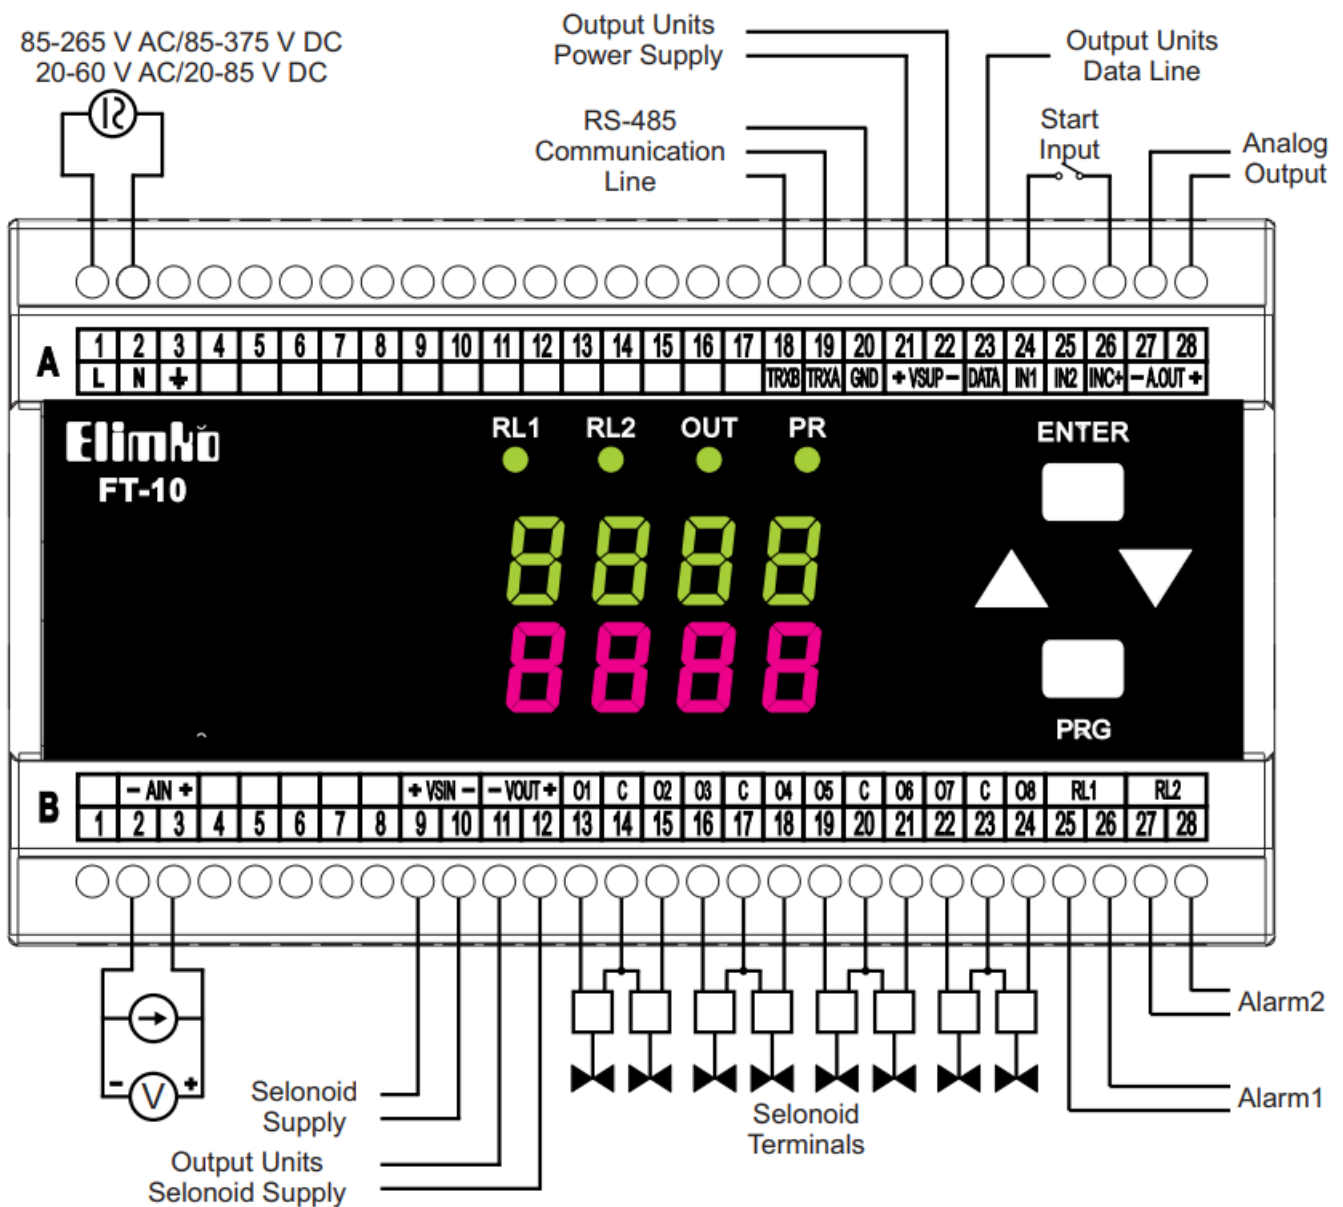
2.1. CONTROL UNIT CONNECTION DIAGRAM



- A21 and A22 (+VSUP-) terminals are power supply of output units and are connected to A2 and A3 terminals of output units. A23 (DATA) terminal is data line of output units, and are connected to A1 terminal of output units. These terminals must be connected in order to power output units.
- Selonoids supply voltage must be connected B9 and B10 (+VSIN-) terminals.
- B11 and B12 (-VOUT+) terminals must be connected to B5 and B6 (+VIN-) terminals of output units for selonoid supply voltage on output units. If these terminals are not connected, all of selonoids on output units are open circuit, so device gives alarm and selonoids are not powered.
- Alarm1 and Alarm2 give alarm according to different alarm source, that is explained 4.2 ALARM RELAYS.

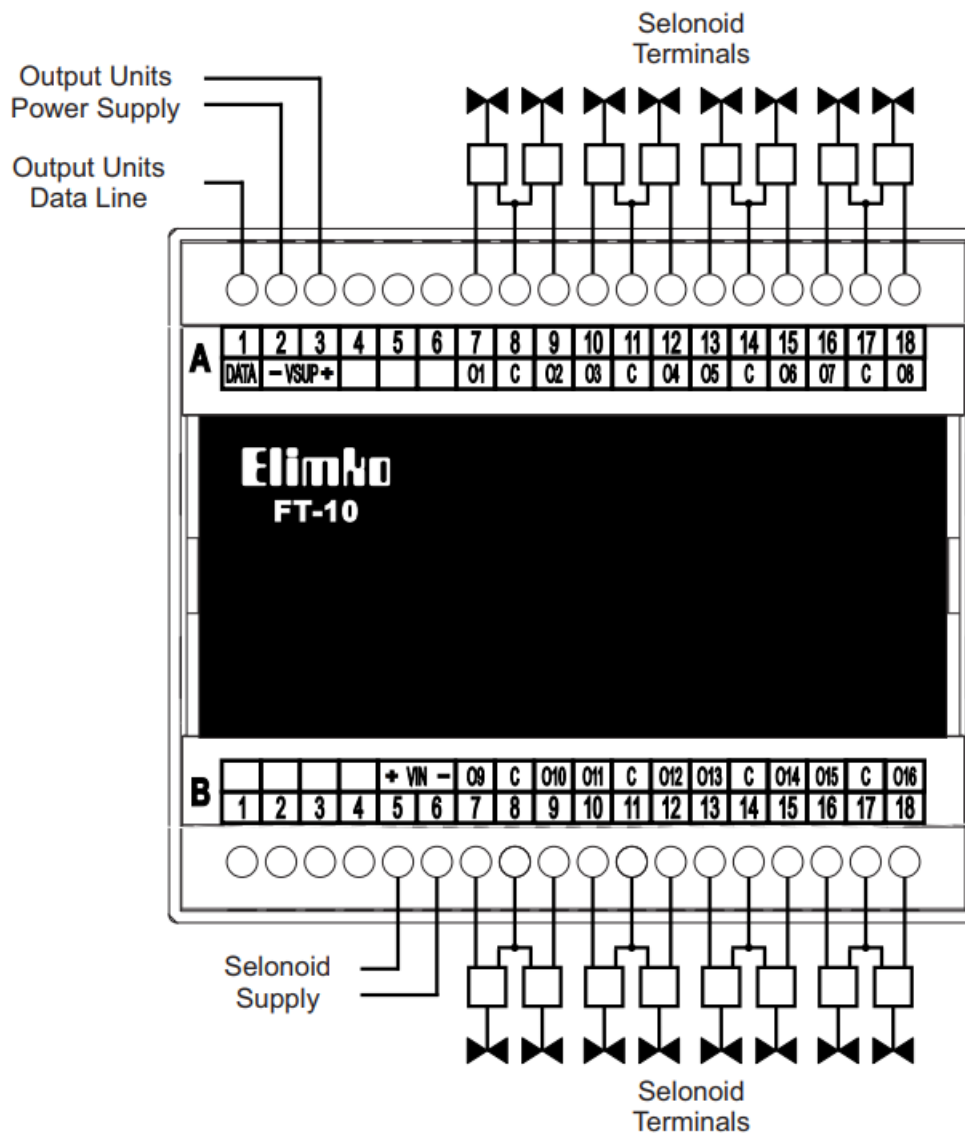2.2. OUTPUT UNIT CONNECTION DIAGRAM



- Control Unit A1-A3, B9-B28, output unit A7-A18, B5-B18 terminals have dangerous voltage. While device is powered, never touch to these terminals .
- Before operating the device, ensure that the device is correctly configured. Incorrect configuration could result malfunction.

3. USAGE

E-FT-10 front panel image is shown in 1.INTRODUCTION part. RL1 led lights when Relay1 (RL1) is powered, led lights when Relay2 RL2 (RL2) is powered, led lights when any selonoid output is powered, OUT and led lights during configuration mode. During normal operation page, active group number (XX) is shown on the top display like as (XX), and active output number (YYY) is shown on the bottom display like as (YYY). During normal operation page, button is used for displaying PR Gr O ENTER SETL differential pressure and set values and changing set values. While and parameters are shown,▲ and ▼ buttons change SETH PRG the set values ▲ and ▼ button reverts to the normal operation page. During normal operation page, if and buttons are pressed together, error message display is opened. During error message display, button is used for scanning outputs that have an error, button reverts to the normal operation page. Except the normal operation page, if any button isn't pressed for more than 25 seconds, device reverts to normal operation page automatically. Configuration page is opened to configure other parameters of device. ENTER PRG

- Pressing PRG button for more over 2 seconds enters the configuration page.
- When the configuration page is entered, COD message is shown on the top display and is shown on the bottom display. Security code must be entered correctly to configure the parameters. If the security code is

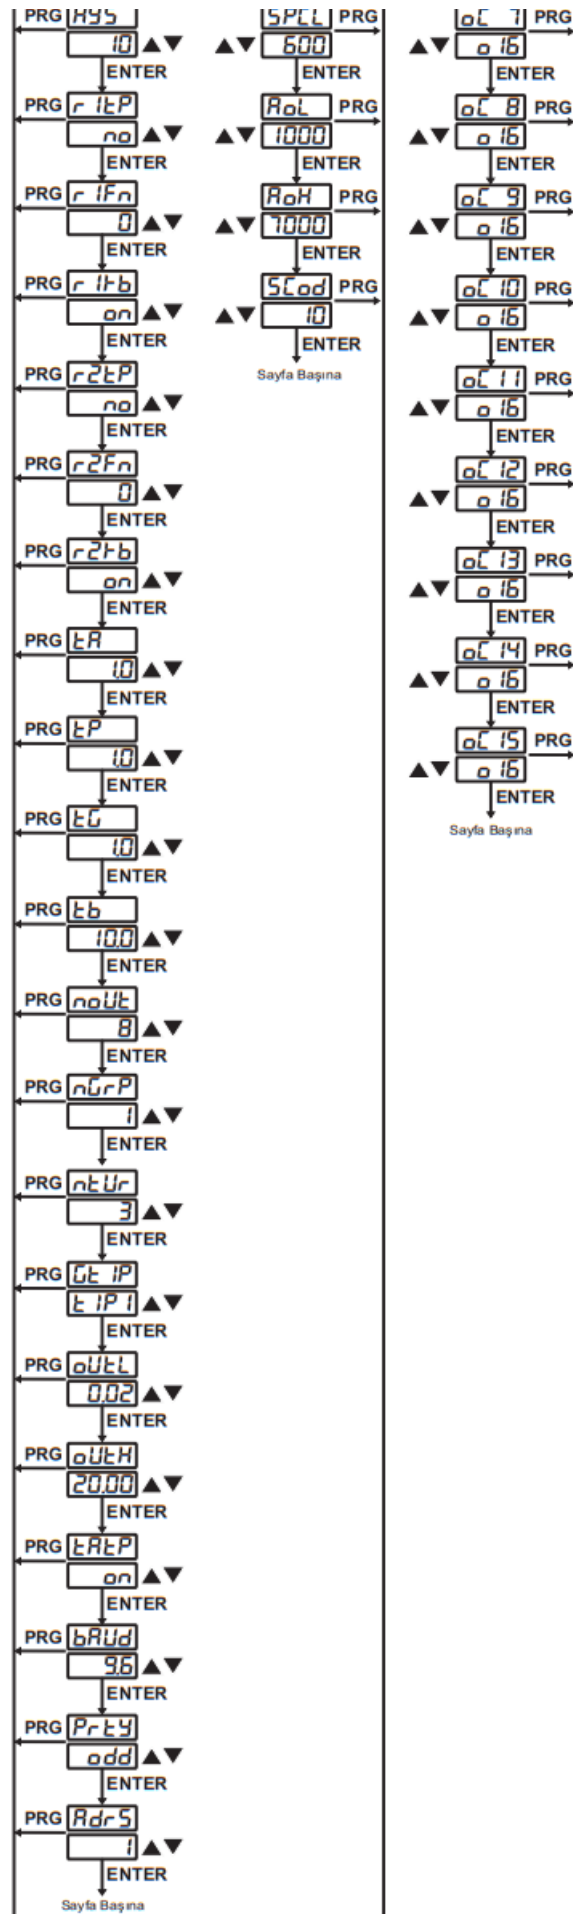
- Factory setting of the security code ▲ and ▼ . The security code can be changed with SCOD parameter. If the security code is forgotten, repower the device and pressing , and buttons together ENTER with in 1 minute after start up. After that security code control isn't made one time to enter configuration page, so the security code can be changed with SCOD parameter.
- When the security code is entered correctly, pressing ENTER button enters the configuration pages.
- During configuration pages, ▲ and ▼ buttons select pages, button enters to the selected page, NTER button reverts to normal PRG operation page.
- While in configuration pages, ENTER button selects parameters ▲ and ▼ buttons change the value of parameters, button is pressed for more over 1 second for revert to configuration pages display, PRG button reverts to normal operation page.

During Alarm



Gr01 → no → Gr01
o i ▲▼ Err PRG o i

[illegible]



PrSS :Differential pressure value.

SEtL : Differential pressure value low set value. Parameter can be set between -1999 and SETH .

SEtH :Differential pressure value high set value. Parameter can be set between **SEtL** and 9999.

ASP :Differential pressure value alarm set value. Parameter can be set between -1999 and 9999.

CoD :Security code value for setting parameters. Security code enters between 0 and 9999.

Parameters of **CoNF** Page

CoTP Control Type. Parameter can set **nonE**, **onoF** or **ProP** (Refer to 4.1. CONTROL TYPES)

dP : Decimal point of differential pressure. Parameter can be set between 0 and 3.

rLL :Analog output retransmission low level. Parameter can be set between -1999 and 9999.

rHL :Analog output retransmission high level. Parameter can be set between -1999 and 9999.

INS :Analog output retransmission current range. Parameter can be set **0-20**, **20-0**, **4-20**, **20-4**

INS : Differential pressure offset value. According to that paramater, differential pressure value has positive or negative offset. Parameter can be set between -1999 and 9999.

HYS : Hysterisis value of differential pressure alarm set value (**ASP**). Parameter can be set between 0 and 9999.

r1tP :Alarm type of RL1 alarm relay. Parameter can be set **no** or **nC** .(see Table 4)

r1Fn :Alarm function of RL1 alarm relay. Parameter can be set between 0 and 15. (see 4.2 ALARM RELAYS)

r1tb :When **r1tb** is selected , in case of an alarm, user must acknowledge the alarm by pressing ▲ and ▼

buttons in order to deactivate alarm output. Parameter can be set **on** or **off** .

r2tP :Alarm type of RL2 alarm relay. Parameter can be set or **nC** .(see Table 4)

r2Fn :Alarm function of RL2 alarm relay. Parameter can be set between 0 and 15. (see 4.2 ALARM RELAYS)

r2tb : When **r2tb** is selected , in case of an alarm, user must acknowledge the alarm by ON pressing ▲

and ▼ buttons in order to deactivate alarm output. Parameter can be set **on** or **off** .

tR : Selonoid outputs break time. This parameter determines the break time between two outputs. Parameter can be set between 0.1 and 999.9 in seconds.

tP : Selonoid outputs pulse time. This parameter determines the pulse time of each outputs. Parameter can be set between 0.1 and 100.0 in seconds.

tG : Selonoid outputs group break time. While **nGrP** parameter is higher than “1”, this parameter determines the break time between each group. Parameter can be set between 0.1 and 999.9 in seconds.

tb : Selonoid outputs waiting time. This parameter determines waiting time, after all outputs are powered. Parameter can be set between 0.1 and 999.9 in seconds.

noUt : Number of outputs. This parameter determines the number of outputs. Parameter can be set between 1 and 128.

nGrP : Number of groups. This parameter determines number of groups while filtering is done with different groups. Parameter can be set between 1 and 16. If this parameter set “1”, filtering is done only one group.

GrIP : Type of group operation. Parameter can be selected **t1P1** and **t1P2**

nUr : Number of selonoids scanning after deactivation of start input. Parameter can be set between 0 and 50.

oUL : Low limit of internal impedance of selonoids. If the impedance measurement of selonoids are lower

than that value, device gives a short circuit alarm. Parameter can be set between 0.00 k Ω and **oUeH**. If this parameter set to "0" the device doesn't control short circuit.

oUeH : High limit of internal impedance of solenoids. If the impedance measurement of solenoids are higher than that value, device gives an open circuit alarm. Parameter can be set between **oUeL** and 30.00 k Ω

tALeP : When **tALeP** is selected as Off, faulty solenoids are skipped immediately, and when **tALeP** is selected as **on**, all the timings work as usual. Parameter can be set or **on** ON **oFF**

bAUd : Communication baud rate. Parameter can be set **4.8, 9.6, 19.2 or 38.4** k Baud. Baud rate of all devices in same communication line should be the same as baud rate of master device.

Prty : Communication parity. Parameter can be set **none, odd or Even**. Parity of all devices in same communication line should be the same as parity of master device.

AdrS : Communication address. Parameter can be set between 1 and 127. All device in same communication line should have a unique address.

Parameters of **CLbr** Page

FLtr : Filter value of differential pressure value. This parameter determines the number of samples to be averaged for calculation of differential pressure value. Parameter can be set between 1 and 16.

oLCr : 0 Ohm calibration value of solenoid resistance measurement. This parameter isn't advised to change. Solenoid supply voltage that is connected to B9 and B10 terminals is broken. B11 and B12 terminals are done short-circuit ▲ and ▼ buttons press together in order to save value.

oHCr : 1000 Ohm calibration value of solenoid resistance measurement. This parameter isn't advised to change. Solenoid supply voltage that is connected to B9 and B10 terminals is broken. 1000 ohm resistance is connected to B11 and B12 terminals. ▲ and ▼ buttons press together in order to save value.

ZEro : This parameter determines pressure value of low calibration of pressure input. Parameter can be set between -1999 and 9999.

ZECL : Zero calibration value of differential pressure. This parameter isn't advised to change. ZERO value differential pressure is applied to differential pressure input of device ▲ and ▼ buttons press together, in order to save value.

Parameters of **CLbr** Page (continuation)

SPAn : This parameter determines pressure value of high calibration of pressure input. Parameter can be set between -1999 and 9999.

SPCL : Span calibration value of differential pressure. This parameter isn't advised to change. SPAN value differential pressure is applied to differential pressure input of device ▲ and ▼ buttons press together, in order to save value.

RoL : Analog output 4 mA calibration value. This parameter isn't advised to change. Connect an ampermeter A27(-) and A28(+) terminals. While the parameter is selected, adjust the parameter with ▲ and ▼ buttons value until the meter reading is equal to 4 mA.











RoH : Analog output 20 mA calibration value. This parameter isn't advised to change. Connect an ampermeter A27(-) and A28(+) terminals. While the parameter is selected, adjust the parameter with ▲ and ▼ buttons value until the meter reading is equal to 20 mA.

SCod : Security code.

Parameters of **oCnF** Page

The parameters between **oC 1** and **oC 15** are used to determine the count of output on the connected output cards. The output cards are produced 8 or 16 outputs in manufacturing period. These parameters are used to define the count of outputs to device. These parameters are set to or **o8** or **o16**.

3.2. DISPLAY FIGURES

| | Normal Operating Display | | Error Messages Display |
|---|--------------------------|---|---------------------------------------|
|  | 1. Group 15. Output |  | No Solenoid Voltage |
|  | 3. Group 8. Output |  | Solenoid on Output 2 Short Circuit |
|  | 3. Group Break Time |  | Solenoid on Output 13 Open Circuit |
|  | Waiting Time |  | High Pressure Alarm |
|  | Wait Start Input |  | No Alarm |

WORKING PRINCIPLES

When **nGrP** parameter is equal to "1", Starting of scanning solenoids, device waits for **tA** break time, after that O1 output is activated. This output is active for **tP** pulse time, after that O1 output is deactivated. Device waits **tA** break time and same process repeats with the next solenoid. This process continues until number of outputs reach to **noUt** parameter. When last output is deactivated at the end of **tP** pulse time, device starts to waiting time. After waiting that time, **tA** break time is started and O1 output is activated at the end of **tA** break time and repeats same process.

If start input of device is active, this process continues. After deactivation of start input, the device repeats this process for **ntUr** times and stop the process.

First of 8 outputs is used on the control unit. Output units must be used for more than 8 outputs.

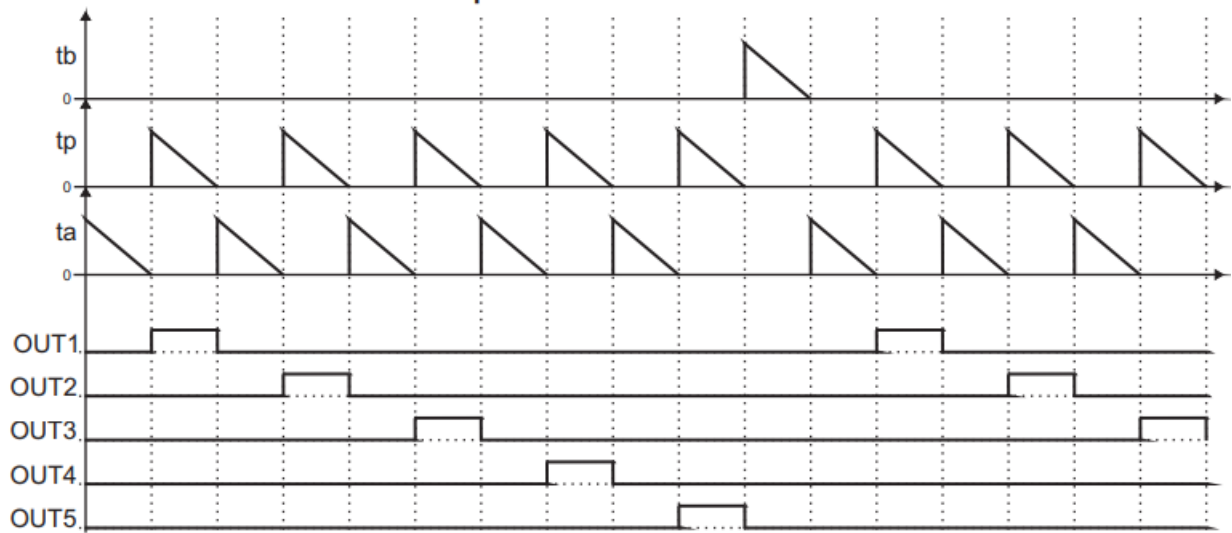


Figure 4.1: Working diagram ($nGrP = 1$, $noUt = 5$)

In case the device $nGrP$ parameter is greater than 1, 2 different operating type is available. This operating type is determined by the GrP parameter. In applications where the number of groups is greater than 1, the group 1 output card is used as the selection card.

When the GrP parameter is set to $GrP1$, the device works as shown in .

Figure 4.2 When scanning starts, O1 output of group card is energized and 1st Group is selected. tP break time is started. O1 output of the device is energized at the end of the break time period and the tP pulse time is started. At the end of the pulse time period, O1 is de-energized and tA break time is started again and the same operation is repeated until the number of output reaches the value of $noUt$ parameter. When the last output is de-energized, O1 output of the group card is de-energized togetherly. group waiting time is started. At the end of the group waiting time period, the O2 output of the GrG group card is energized and the 2nd Group is selected. The operations in the 1st group are repeated exactly. this group operations is repeated until the number of group reaches the value of $nGrP$ parameter. At the end of the last group operation, tB waiting time period starts. After the waiting time period, 1st group is selected again and same operations are repeated.

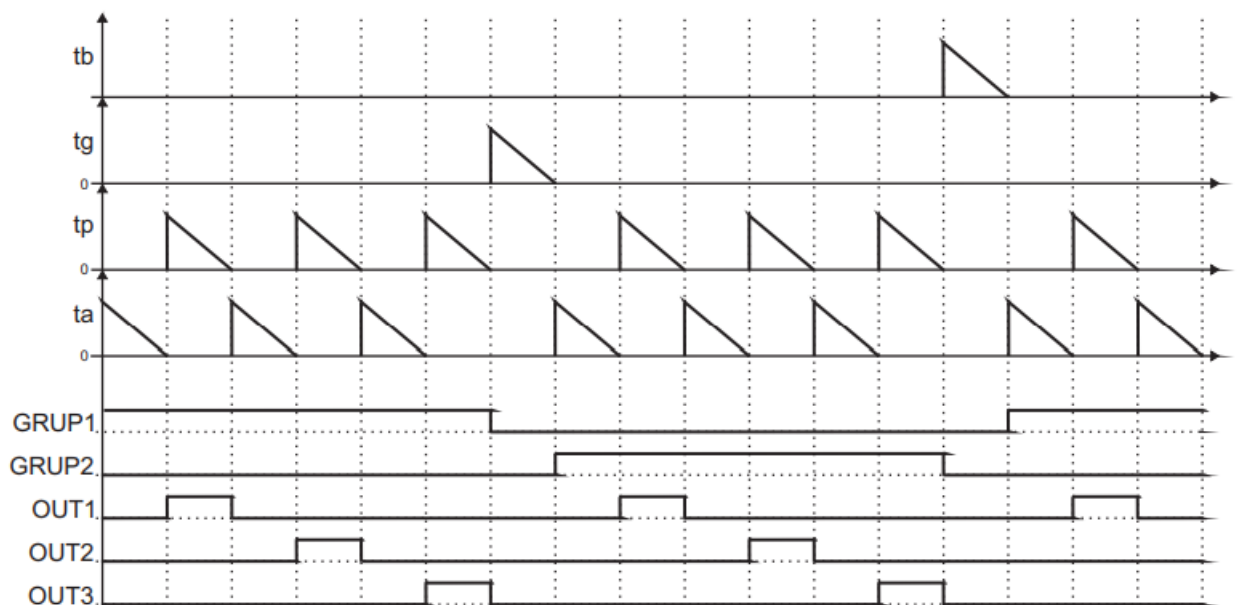


Figure 4.2: Working Diagram ($nGrP = 2$, $noUt = 3$ and $GrP = GrP1$)

When the GrP parameter is set to P1 , the device works as shown in

Figure 4.3 . When scanning starts, O1 output of group card is energized and 1st group is selected. t_A break time is started. O1 output of the device is energized at the end of the t_A break time period and the pulse time is started. At the end of the t_P pulse time period, O1 is de-energized and break time is started again and the same operation is repeated until the number of output reaches the value of parameter. When the last output is de-energized, O1 output of the group card is de-energized togetherly. group waiting time is started. At the end of the t_G group waiting time period, the O2 output of the group card is energized and the 2nd group is selected. The outputs of 2nd group starts from where the last output of 1st group, and scanning operation is repeated until the number of output reaches the value of $nGrP$ parameter. As seen in the example, the last output of 1st group is energized O3 output, and the first output of 2nd group is energized O4 output. This group operations is repeated until the number of group reaches the value of parameter. At the end of the last group operation, t_b waiting time period starts. After the waiting time period, 1st group is selected again and same operations are repeated.

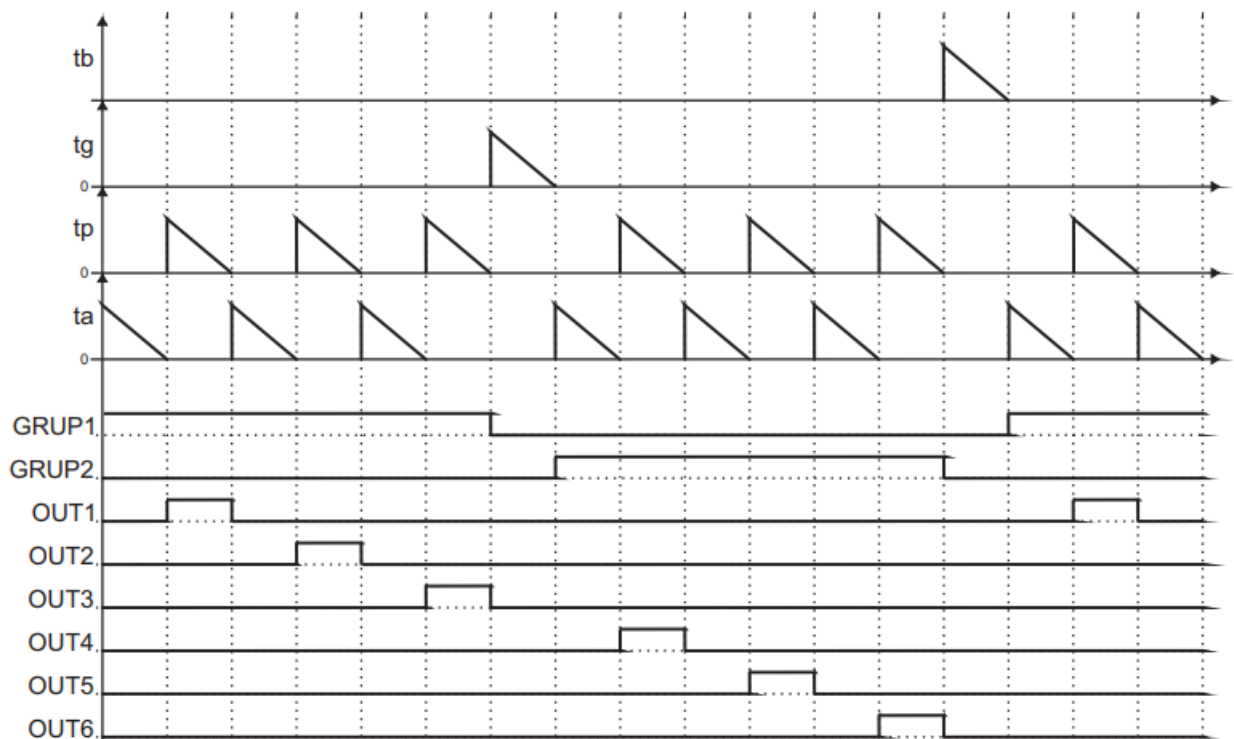


Figure 4.3: Working Diagram ($nGrP = 2$, $nOut = 3$ and $\text{GrP} = \text{P2}$)

If start input of device is active, this process continues. After deactivation of start input, device repeats this process for nGr times and stop the process.

First of 8 outputs is used on control unit. Output units must be used for more than 8 outputs. One output unit is used to group selection unit. Solenoid supply of group selection unit (+VIN-) is connected to control unit (+VSIN-) terminal.

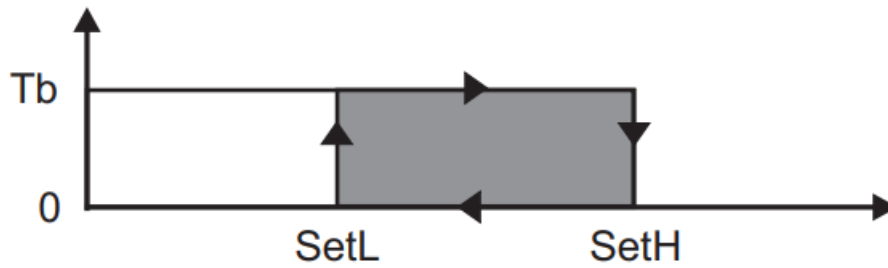
4.1. CONTROL TYPES

CTYP parameter determines control type of the device, is selected as $nonE$, $onoF$ or $ProP$.


If CTYP parameter is selected as $nonE$, device doesn't do any control during t_b waiting times. Entire of t_b waiting time is waited.

If CTYP parameter is selected as $onoF$, if differential pressure value is higher than $SEtH$ parameter, waiting

time is skipped during **SEtL** the process. If differential pressure value is lower than parameter, Entire of **t_b** waiting time is waited during the process. If differential pressure value is between **SEtL** and **SEtH** parameters, device does the same as previous scanning.



If **CLYP** parameter is selected as **Prop**, if differential pressure value is higher than **SEtH** parameter, **t_b** waiting time is skipped **SEtL** during the process. If differential pressure value is lower than parameter, Entire of **t_b** waiting time is waited during the process. If differential pressure value is between **SEtL** and **SEtH** parameters, **t_b** waiting time is set between 0 and **t_b** proportionally.

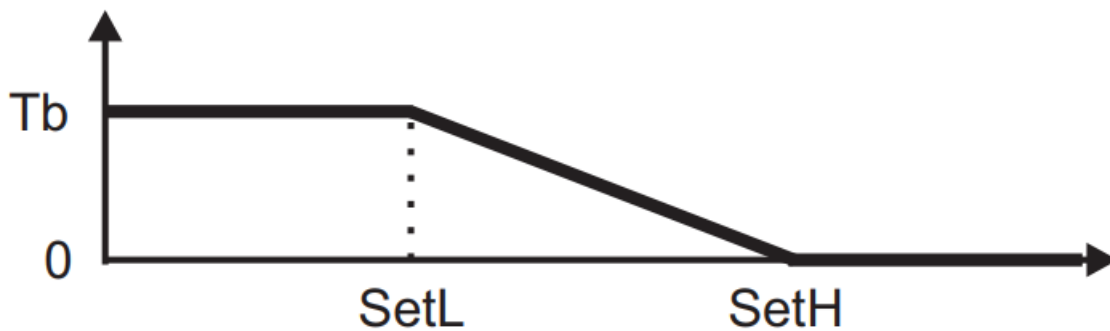

4.2. ALARM RELAYS

RI1 and RL2 are alarm relays, that give alarm according to one or more than one alarm source. Alarm type of these relays are adjusted as normally open or normally closed.

Device gives alarm in case of break selonoid supply, open or short selonoids and high differential pressure value.

These alarm sources are adjusted for both of the relays with **r1Fn** and **r2Fn** parameters, like as Table

4.2 . Alarm types of relays, that is **on** normally open and **nC** normally closed are adjusted for both of the

relays with **r1tP** and **r2tP** parameters, like as Table 4.1

When alarm relays are powered, user can acknowledge the alarm and deactivate the alarm relay according to

r1tb and **r2tb** parameters. If these parameters are selected , user open error message page and deactivates relay, but led of relay continues to light. In this situation, error message of alarm is shown in error

message page. Led of relay fades after alarm state. If these parameters are selected **oFF** , relay and led deactivates after the alarm state ends.

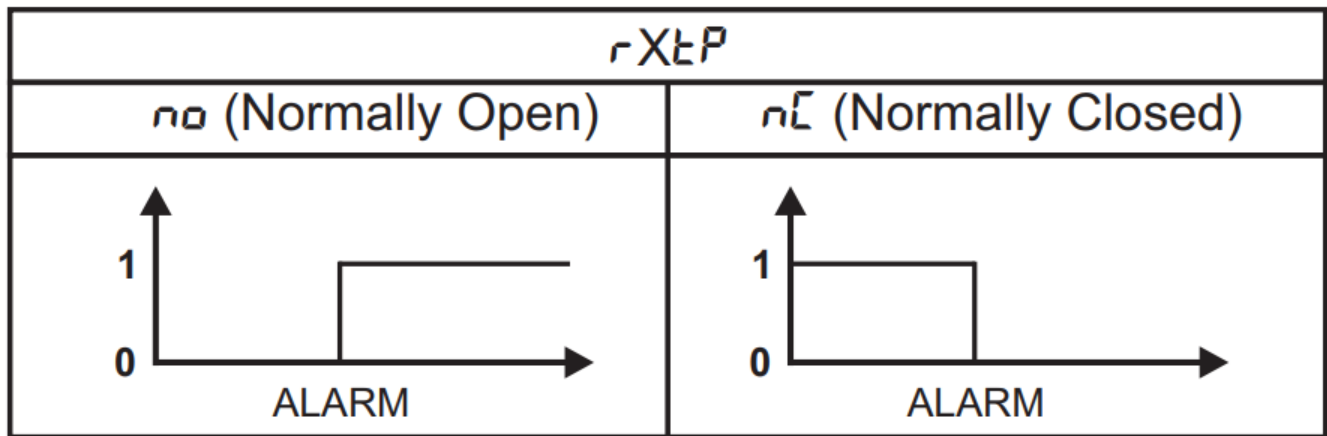


Table 4.1. Alarm Types

| rXF_n | Explanations (SC: Short Circuit, OC: Open Circuit, HP: High Pressure, NSS: No Selonoid Supply, SA: Scan Act ive) | rXF_n | Explanations (SC: Short Circuit, OC: Open Circuit, HP: High Pressure, NSS: No Selonoid Supply SA: Scan Act ive) |
|---------|---|---------|--|
| 0 | No Alarm | 16 | SA |
| 1 | SC | 17 | SA/SC |
| 2 | OC | 18 | SA/ OC |
| 3 | SC/OC | 19 | SA/OC/SC |
| 4 | HP | 20 | SA/ HP |
| 5 | HP/SC | 21 | SA/HP/SC |
| 6 | HP/OC | 22 | SA/HP/OC |
| 7 | HP/OC/SC | 23 | SA/HP/OC/SC |
| 8 | NSS | 24 | SA/NSS |
| 9 | NSS/SC | 25 | SA/NSS/SC |
| 10 | NSS/OC | 26 | SA/NSS/OC |
| 11 | NSS/ OC /SC | 27 | SA/NSS/OC/SC |
| 12 | NSS/HP | 28 | SA/NSS/HP |
| 13 | NSS/ HP/SC | 29 | SA/NSS/HP/SC |
| 14 | NSS/HP/OC | 30 | SA/NSS/HP/OC |
| 15 | NSS / HP / OC/ SC | 31 | SA/NSS/HP/OC/SC |

Table 4.2. Alarm Sources

4.2.1. OPEN / SHORT CIRCUIT ALARM

Device can give alarm, while short or open circuit happen on selonids. Device measures the selonoid line and controls any error on the selonoid line, before device powers the selonoids. If any error is occurred on selonoid,

device doesn't power the solenoid and gives alarm, so that outputs of device don't need any fuses. In the solenoids scanning, while the solenoid has any problem, device works differently according to t_{RtP} parameter. If parameter is selected **on**, device waits t_{RA} and t_{RP} timing for that solenoid, but output doesn't powered. If the parameter is selected **off**, device doesn't wait t_{RA} and t_{RP} timing, and continues next output. $OUTH$ parameter determines open circuit state, $OUTL$ parameter determines short circuit state. $OUTL$ parameter should be set to half of the nominal resistance of the solenoids, $OUTH$ parameter should be set to two times of the nominal resistance of the solenoids.

4.2.2. HIGH PRESSURE ALARM

Device, that has pressure control gives high pressure alarm according to ASP and HYS parameters. If differential pressure is higher than ASP parameter, device gives high pressure alarm. The alarm condition ends when the differential pressure reading decrease to $ASP - HYS$.

4.2.3. NO SOLENOID SUPPLY ALARM

If Solenoid supply of device, that is connected (+VSIN-) terminals is broken, device gives no solenoid supply alarm.

4.2.4. SCAN ACTIVE ALARM

When Start input of device that is in A24 (IN1) terminal is active, the device gives scan active alarm. All of these alarms is shown on display to user. In addition, if device has RS-485 communication, the alarms can be read from Modbus protocol.

4.3. SCANNING ORDER OF OUTPUTS

Scanning order of the device starts with 1, and ends with 128 in factory settings. The scanning order can be configured using Modbus protocol. Register addresses of these order parameters are shown in Table 4.3

| Address | Parameter | Property | Address | Parameter | Property |
|---------|-----------|----------|---------|-----------|----------|
| 100 | OUT 1-2 | R/W | 132 | OUT 65-66 | R/W |
| 101 | OUT 3-4 | RAN | 133 | OUT 67-68 | R/W |
| 102 | OUT 5-6 | R/W | 134 | OUT 69-70 | R/W |
| 103 | OUT 7-8 | R/W | 135 | OUT 71-72 | R/W |
| 104 | OUT 9-10 | R/W | 136 | OUT 73-74 | R/W |
| 105 | OUT 11-12 | RIW | 137 | OUT 75-76 | R/W |
| 106 | OUT 13-14 | R/W | 138 | OUT 77-78 | R/W |
| 107 | OUT 15-16 | R/W | 139 | OUT 79-80 | R/W |
| 108 | OUT 17-18 | R/W | 140 | OUT 81-82 | R/W |
| 109 | OUT 19-20 | RAN | 141 | OUT 83-84 | R/W |
| 110 | OUT 21-22 | R/W | 142 | OUT 85-86 | R/W |
| 111 | OUT 23-24 | R/W | 143 | OUT 87-88 | R/W |
| 112 | OUT 25-26 | R/W | 144 | OUT 89-90 | R/W |
| 113 | OUT 27-28 | R/W | 145 | OUT 91-92 | R/W |
| 114 | OUT 29-30 | R/W | 146 | OUT 93-94 | R/W |

| | | | | | |
|-----|-----------|-----|-----|-------------|-----|
| 115 | OUT 31-32 | R/W | 147 | OUT 95-96 | R/W |
| 116 | OUT 33-34 | R/W | 148 | OUT 97-98 | R/W |
| 117 | OUT 35-36 | R/W | 149 | OUT 99-100 | R/W |
| 118 | OUT 37-38 | R/W | 150 | OUT 101-102 | R/W |
| 119 | OUT 39-40 | R/W | 151 | OUT 103-104 | R/W |
| 120 | OUT 41-42 | R/W | 152 | OUT 105-106 | R/W |
| 121 | OUT 43-44 | R/W | 153 | OUT 107-108 | R/W |
| 122 | OUT 45-46 | R/W | 154 | OUT 109-110 | R/W |
| 123 | OUT 47-48 | R/W | 155 | OUT 111-112 | R/W |
| 124 | OUT 49-50 | R/W | 156 | OUT 113-114 | R/W |
| 125 | OUT 51-52 | R/W | 157 | OUT 115-116 | R/W |
| 126 | OUT 53-54 | R/W | 158 | OUT 117-118 | R/W |
| 127 | OUT 55-56 | R/W | 159 | OUT 119-120 | R/W |
| 128 | OUT 57-58 | R/W | 160 | OUT 121-122 | R/W |
| 129 | OUT 59-60 | R/W | 161 | OUT 123-124 | R/W |
| 130 | OUT 61-62 | R/W | 162 | OUT 125-126 | R/W |
| 131 | OUT 63-64 | R/W | 163 | OUT 127-128 | R/W |

Tablo 4.3. Output Configuration Parameters Modbus Address Table

NOTE1: Parameters, that shown in Table 4.3 are 16-bits. For example low 8-bits of OUT1-2 parameter shows first output, high 8-bit of OUT1-2 parameter shows second output. In below example, output 5 is powered firstly, output3 is powered secondly according to OUT1-2 parameter. Other parameters are configured the same method.

| | |
|---------------|---------------|
| OUT1-2 = 773 | |
| son 8-bit = 3 | ilk 8-bit = 5 |

NOTE2: Low and High 8-bits of parameters must be set between 1 and 128. Otherwise, sent values of these parameters aren't saved according to protocol.

OUTPUT UNITS

Each output unit has 16 outputs. Output units communicate with control unit over DATA terminal. If this connection breaks, output unit doesn't work. Power supply of output units are supplied with (+VSUP-) terminals. Each output unit, that is connected to control unit has an address. These addresses are configured via jumpers on output unit cards. More than one unit mustn't have same addresses. Jumper configuration of addresses are shown in . **Table 5.1**

(+VIN-) terminals of output units must be connected to (-VOUT+) terminals of control unit. If any problem on that connection occurs, all of the solenoids are measured open circuit and any output isn't powered. If filtering system has more than one group, one output unit must be used for group selection unit. Solenoid supply of this unit must be connected (+VSIN-) terminals of control unit.

















| Jumper | Explanations | Jumper | Explanations |
|--|----------------|--|----------------------|
|  | 1. Output Card |  | 9. Output Card |
|  | 2. Output Card |  | 10. Output Card |
|  | 3. Output Card |  | 11. Output Card |
|  | 4. Output Card |  | 12. Output Card |
|  | 5. Output Card |  | 13. Output Card |
|  | 6. Output Card |  | 14. Output Card |
|  | 7. Output Card |  | 15. Output Card |
|  | 8. cikic Karti |  | Group Selection Card |

Table 5.1. Configurations of Jumper

COMMUNICATION ADRESSES

| Address | Parameter | Explanation | Property | Min. | Max. |
|---------|---------------|-------------|----------|------|------|
| 0 | Alarm Data 1 | See Table1 | R | | |
| 1 | Alarm Data 2 | See Table1 | R | | |
| 2 | Alarm Data 3 | See Table1 | R | | |
| 3 | Alarm Data 4 | See Table1 | R | | |
| 4 | Alarm Data 5 | See Table1 | R | | |
| 5 | Alarm Data 6 | See Table1 | R | | |
| 6 | Alarm Data 7 | See Table1 | R | | |
| 7 | Alarm Data 8 | See Table1 | R | | |
| 8 | Alarm Data 9 | See Table1 | R | | |
| 9 | Alarm Data 10 | See Table1 | R | | |

| | | | | | |
|----|---------------|-----------------------------------|-----|-------|------|
| 10 | Alarm Data 11 | See Table1 | R | | |
| 11 | Alarm Data 12 | See Table1 | R | | |
| 12 | Alarm Data 13 | See Table1 | R | | |
| 13 | Alarm Data 14 | See Table1 | R | | |
| 14 | Alarm Data 15 | See Table1 | R | | |
| 15 | Alarm Data 16 | See Table1 | R | | |
| 16 | Alarm Data 17 | See NOTE2 | R | | |
| 17 | PrSS | | R | | |
| 18 | SEtL | | R/W | -1999 | SE H |
| 19 | SEtH | | R/W | SE L | 9999 |
| 20 | RSP | | R/W | -1999 | 9999 |
| 21 | CLYP | 0:nonE, 1:onoF, 2:ProP | R/W | 0 | 2 |
| 22 | dP | | R/W | 0 | 3 |
| 23 | rEtLL | | R/W | -1999 | 9999 |
| 24 | rEtHL | | R/W | -1999 | 9999 |
| 25 | nAr | 0:0-20, 1:20-0, 2:4-20, 3:20-4 | R/W | 0 | 3 |
| 26 | InS | | R/W | -1999 | 9999 |
| 27 | HYS | | R/W | 0 | 9999 |
| 28 | r IfP | 0:no, 1:nE | R/W | 0 | 1 |
| 29 | r Ifn | | R/W | 0 | 15 |

| | | | | | |
|----|-------------|-----------------------------|-----|------|------|
| 30 | <i>rItb</i> | 0:on, 1:off | R/W | 0 | 1 |
| 31 | <i>r2tP</i> | 0:no, 1:n | R/W | 0 | 1 |
| 32 | <i>r2Fn</i> | | R/W | 0 | 15 |
| 33 | <i>r2tb</i> | 0:on, 1:off | R/W | 0 | 1 |
| 34 | <i>tR</i> | | R/W | 1 | 9999 |
| 35 | <i>tP</i> | | R/W | 1 | 1000 |
| 36 | <i>tG</i> | | R/W | 1 | 9999 |
| 37 | <i>tb</i> | | R/W | 1 | 9999 |
| 38 | <i>noUt</i> | | R/W | 1 | 128 |
| 39 | <i>nGrP</i> | | R/W | 1 | 16 |
| 40 | <i>ntUr</i> | | R/W | 0 | 50 |
| 41 | <i>oUtL</i> | | R/W | 0 | OU H |
| 42 | <i>oUtH</i> | | R/W | OU L | 3000 |
| 43 | <i>tRtP</i> | 0:on, 1:off | R/W | 0 | 1 |
| 44 | <i>bRUd</i> | 0:48, 1:96, 2:192, 3:384 | R/W | 0 | 3 |
| 45 | <i>Prty</i> | 0:nonE, 1:odd, 2:Euen | R/W | 0 | 2 |
| 46 | <i>AdrS</i> | | R/W | 1 | 127 |
| 47 | <i>FLtr</i> | | R/W | 1 | 16 |

NOTE1: Device supports 03, 06 and 16 number function of modbus protocol. 03 Read Holding Registers, 06

Write Single Register and 16 Write Multiple Registers.

NOTE2: No Selonoid Voltage alarm is saved in first bit of Alarm Data 17, high pressure alarm is saved in second bit of Alarm Data 17.


NOTE3: In table, parameters, whose address is between 17 and 47 is explained in 3.1 PARAMETERS EXPLANATION.

TABLES

Table1: Bits of Alarm Data

| | S | O | S | O | S | O | S | O | S | O | S | O | S | O | S | O |
|---------------|------|----|------|----|------|----|------|---|------|---|------|---|------|---|------|---|
| Bit Number | 16 | 15 | 14 | 13 | 12 | 11 | 10 | 9 | 8 | 7 | 6 | 5 | 4 | 3 | 2 | 1 |
| Alarm Data 1 | O8 | | O7 | | O6 | | O5 | | O4 | | O3 | | O2 | | O1 | |
| Alarm Data 2 | O16 | | O15 | | O14 | | O13 | | O12 | | O11 | | O10 | | O9 | |
| Alarm Data 3 | O24 | | O23 | | O22 | | O21 | | O20 | | O19 | | O18 | | O17 | |
| Alarm Data 4 | O32 | | O31 | | O30 | | O29 | | O28 | | O27 | | O26 | | O25 | |
| Alarm Data 5 | O40 | | O39 | | O38 | | O37 | | O36 | | O35 | | O34 | | O33 | |
| Alarm Data 6 | O48 | | O47 | | O46 | | O45 | | O44 | | O43 | | O42 | | O41 | |
| Alarm Data 7 | O56 | | O55 | | O54 | | O53 | | O52 | | O51 | | O50 | | O49 | |
| Alarm Data 8 | O64 | | O63 | | O62 | | O61 | | O60 | | O59 | | O58 | | O57 | |
| Alarm Data 9 | O72 | | O71 | | O70 | | O69 | | O68 | | O67 | | O66 | | O65 | |
| Alarm Data 10 | O80 | | O79 | | O78 | | O77 | | O76 | | O75 | | O74 | | O73 | |
| Alarm Data 11 | O88 | | O87 | | O86 | | O85 | | O84 | | O83 | | O82 | | O81 | |
| Alarm Data 12 | O96 | | O95 | | O94 | | O93 | | O92 | | O91 | | O90 | | O89 | |
| Alarm Data 13 | O104 | | O103 | | O102 | | O101 | | O100 | | O99 | | O98 | | O97 | |
| Alarm Data 14 | O112 | | O111 | | O110 | | O109 | | O108 | | O107 | | O106 | | O105 | |
| Alarm Data 15 | O120 | | O119 | | O118 | | O117 | | O116 | | O115 | | O114 | | O113 | |
| Alarm Data 16 | O128 | | O127 | | O126 | | O125 | | O124 | | O123 | | O122 | | O121 | |

NOTE: In table, S letter is shown short circuit state, O letter is shown open circuit state.

Table2: 

| | |
|----------------|----------------------|
| no nE | No Control |
| o n o F | ON/OFF Control |
| P r o P | Proportional Control |

Table3: **nAr**

| | |
|-------------|---------|
| 0-20 | 0-20 mA |
| 20-0 | 20-0 mA |
| 4-20 | 4-20 mA |
| 20-4 | 20-4 mA |

Table4: **rXtP**

| | |
|------------|-----------------|
| o n | Normally open |
| n c | Normally closed |

Table5: **rXtb**

| | |
|--------------|--------------------------------|
| o n | Acknowledge alarm is active |
| o F F | Acknowledge alarm isn't active |

Table6: **tAtP**

| | |
|--------------|-------------------------------|
| o n | Wait break and pulse time |
| o F F | Not wait break and pulse time |


Table7: **PrtY**

| | |
|-------------|-------------|
| <i>nonE</i> | No parity |
| <i>odd</i> | Odd parity |
| <i>EuEn</i> | Even parity |

Manufacturer / Technical Support:

Elimko Elektronik Production and Control Co. Ltd.
8. Cadde 21. Sokak No:16 Emek- Ankara / TURKEY
Phone: + 90 312 212 64 50 Fax: + 90 312 212 41 43
www.elimko.com.tr e-mail:elimko@elimko.com.tr
KY-FT10-0423-1

Documents / Resources

| | |
|--|---|
|  | Elimko FT-10 Series Filter Timer [pdf] User Manual FT-10 Series Filter Timer, FT-10, Series Filter Timer, Filter Timer |
|--|---|

References

- [E Elimko - Otomatik Kontrol'da Güvenilir İsim](#)