

ELPRO 215U-2 Gateway With MQTT Sparkplug Installation Guide

Home » ELPRO 215U-2 Gateway With MQTT Sparkplug Installation Guide 🖺



INSTALLATION GUIDE



Contents

- **1 STATUTORY REQUIRMENTS**
- 2 WARNING EXPLOSION

HAZARD

- **3 INSTALL GUIDE**
- **4 CONTACT**
- **5 HOW TO ORDER**
- 6 Documents / Resources
 - **6.1 References**

STATUTORY REQUIRMENTS

The 215U-2 is suitable for use in hazardous locations that are rated Class | Division 2, Groups A, B, C, D. The 215U-2 must be installed in an enclosure that maintains an ingress protection rating of IP54 and meets the enclosure requirements of EN50014 or EN60079-0.

The RF coaxial cable must be installed in a metallic conduit, per the US National Electrical Code (NEC) or NFPA. SUP+ and SUP- terminals must only be powered from an NEC Class 2 circuit.

WARNING – EXPLOSION HAZARD

Do not disconnect equipment while the circuit is live unless the area is known to be free of ignitable concentrations.

Substitution of any component may impair suitability for Class 1 Division 2.

NOTE

The 215U-2 modaule ships from the factory configured for global frequency and power. Set the radio region to access country specific radio options.

Models


215U-2-BGN — 2.4Chz Wikl band

Antenna installation

When selecting an antenna, consider radio proximity.

Use Figure 1 as a guide for installing an antenna and attaching it to the 215U-2.

Figure 1. Antenna installation

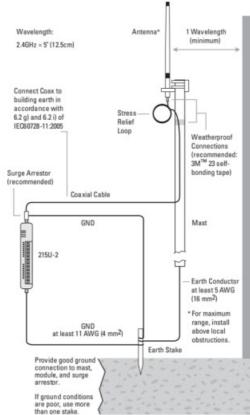


Connecting to the module for configuration

- Download and install configuration utility software, available from the Elpro Technolgies website.
 - www.elprotech.com
- Connect to PC using supplied USB cable.
- Connect to the device by selecting USB connection and using the IP address 192.168.111.1 or 1.1.1.1 for older firmware (pre V2.28)
- The PC will automatically be assigned an IP address from the module via DHCP. A new network adaptor will be created using IP address 192.168.1.2 (or 1.1.1.2)


Username: userPassword: user

The following illistrations show the port connections on the 215U-2.

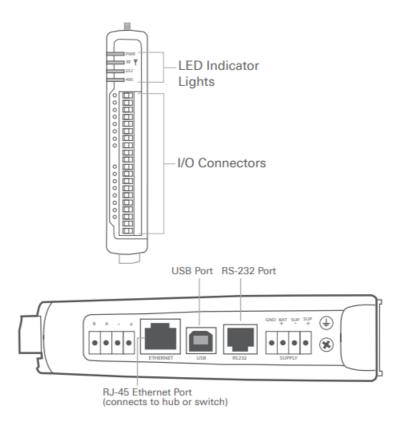


Power Supply Wiring

The ground (GND) and "SUP -" terminals are connected internally to the ground (Earth) terminal. Connect the screw terminal on the end plate to ground (Earth) for surge protection.



Expansion I/O Power and RS485 serial connection


An on-board RS-485 terminating resistor provides line termination for long runs. Only enable terminating resistor on the last device connected on the RS-485 cable.




INSTALL GUIDE

Configuration Switches

Use the DIP switches in the side access panel to select analog input voltage or current, and to enable default configuration




DIP	Description	OFF	ON
1	Al3 Current / Voltage	Voltage	Current
2	Al3 Current / Voltage	Voltage	Current
3	Al4 Current / Voltage	Voltage	Current
4	Al4 Current / Voltage	Voltage	Current
5	Unused	Off	On
6	Default configuration	Normal	Enabled




Input and Output connections

The digital input/output channels can be wired as inputs or outputs.

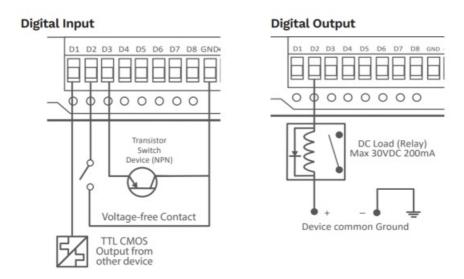

Al1, Al2 - Differential 4-20mA inputs Al3, Al4 - Single Ended 4-20mA inputs Al3, Al4 - Single Ended 4-20mA inputs Al3, Al4 - Single Ended 4-20mA inputs Al4 - Single Ended 4-20mA inputs Al5 - Single Ended 4-20mA inputs Al6 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al8 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al8 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al8 - Single Ended 4-20mA inputs Al7 - Single Ended 4-20mA inputs Al8 - Single Ended 4

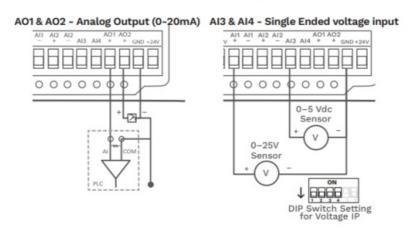

CONTACT

Australia

ELPRO Technologies 29 Lathe Street Virginia QLD 4014 **T**+617 3352 8600

E sales@elprotech.com

W elprotech.com

USA

ELPRO Technologies inc 2028 East Ben White Boulevard #240-5656 Austin, TX 78741-6931

T+1 855 443 5776


E sales@elprotech.com

W elprotech.com

HOW TO ORDER

Simply send us an email at sales@elprotech.com, contact your local distributor, or phone +61 7 3352 8600 An envirada group company

Documents / Resources



ELPRO 215U-2 Gateway With MQTT Sparkplug [pdf] Installation Guide 215U-2 Gateway With MQTT Sparkplug, 215U-2, Gateway With MQTT Sparkplug, MQTT Sparkplug

References

- Industrial Wireless Communication & Control Systems
- © One moment, please...
- User Manual

Manuals+, Privacy Policy

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.