




# EMERSON 1F83C-11NP Single Stage Thermostat Owner's Manual

[Home](#) » [Emerson](#) » EMERSON 1F83C-11NP Single Stage Thermostat Owner's Manual 

## EMERSON 1F83C-11NP Single Stage Thermostat Owner's Manual

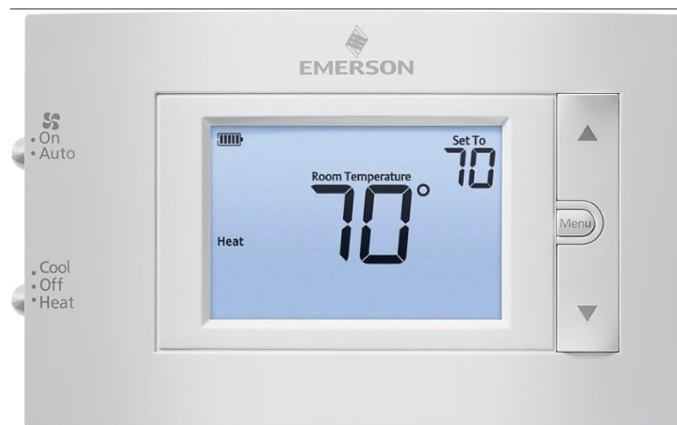

### Contents

- [1 INDEX](#)
- [2 SPECIFICATIONS](#)
- [3 THERMOSTAT INSTALLATION](#)
- [4 USING THE THERMOSTAT](#)
- [5 TROUBLESHOOTING](#)
- [6 White-Rodgers](#)
- [7 Documents / Resources](#)
  - [7.1 References](#)
- [8 Related Posts](#)

## INDEX

Thermostat Installation	2-4
Wiring	2
Installer Menu	3-4
Using the Thermostat	5-7
Thermostat Overview	5
User Menu	6
Thermostat Operation	6
Troubleshooting	7-8
Homeowner Help Line	8

Thermostat Applications	Maximum Stages Heat/Cool
Conventional Gas, Oil, Electric (mV and 24V), Heat Only, Cool Only or Heat/ Cool Systems	1/1
Heat Pump (air source or geothermal) with no Aux. Heat	1/1

## SPECIFICATIONS

### Electrical Rating:

**Battery Power** ..... mV to 30 VAC, NEC Class II, 50/60 Hz

**Input-Hardwire** ..... 20 to 30 VAC, NEC Class II, 50/60 Hz

**Terminal Load** ..... 1.0 A per terminal, 1.5A maximum all terminals combined

**Setpoint Range** ..... 45° to 99° F (7° to 37° C)

**Rated Differentials:** Fast Med Slow

**Heat (@ 6°F/ Hr)** ..... 0.5°F 0.75°F 1.9°F

**Cool (@ 6°F/ Hr)** ..... 0.9°F 1.2°F 1.7°F

**Operating Ambient** ..... 32°F to +105°F (0° to +41°C)

**Display Temperature Range** ..... 32°F to +99°F (0 to 37°C)

**Operating Humidity** ..... 90% non-condensing max

**Shipping Temperature Range** ..... -20°F to + 150°F (-29° to +65°C)

**Thermostat Dimensions** ..... 3-3/4" H x 6" W x 1-1/8" D

## THERMOSTAT INSTALLATION

### WIRING

Refer to equipment manufacturer's instructions for specific system wiring information. After wiring, see INSTALLER MENU for proper thermostat configuration. Wiring table shown are for typical systems and describe the thermostat terminal functions


Terminal Designations	Terminal Function
RC*	Power for Cooling
RH*	Power for Heating
O/B	Changeover Terminal-Energized in Heat (B) or Cool (O) f or Heat Pump or Damper Systems
Y**	Cooling Relay
G	Fan Relay
W**	Heating Relay
C	Common wire for 24V (optional with batteries)

When both RC and RH wires are present, cut RC/RH jumper (see next page).

\*\*For heat pump systems, add a jumper wire to connect terminals Y and W

### Leveling Thermostat

Leveling is for appearance only and will not affect thermostat operation

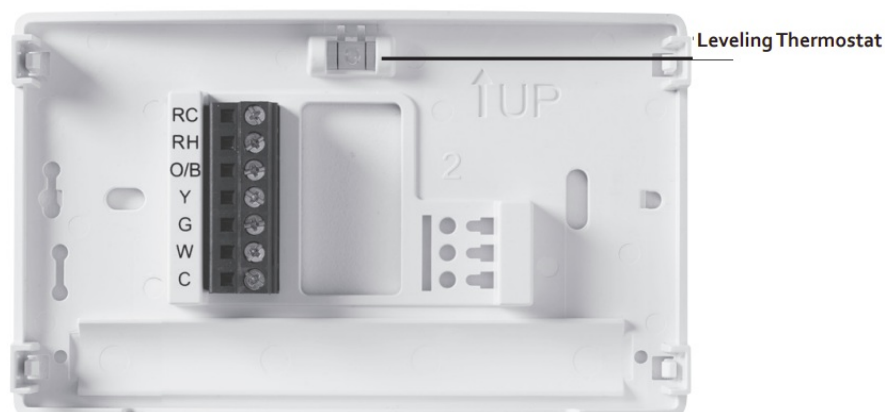

### Precautions

- Do not exceed the specification ratings.
- All wiring must conform to local and national electrical codes and ordinances.
- This control is a precision instrument, and should be handled carefully. Rough handling or distorting components could cause the control to malfunction



#### WARNING

Do not use on circuits exceeding specified voltage. Higher voltage will damage control and could cause shock or fire hazard.

Do not short out terminals on gas valve or primary control to test. Short or incorrect wiring will burn out thermostat and could cause personal injury and/or property damage.




#### CAUTION

To prevent electrical shock and/or equipment damage, disconnect electrical power to system, at main fuse or circuit breaker box, until installation is complete.

## Battery Location

Premium AA alkaline batteries are required when C-wire is not available. When C-wire is available, the batteries provide a back-up source of power (this will maintain the clock in the event of a power outage).

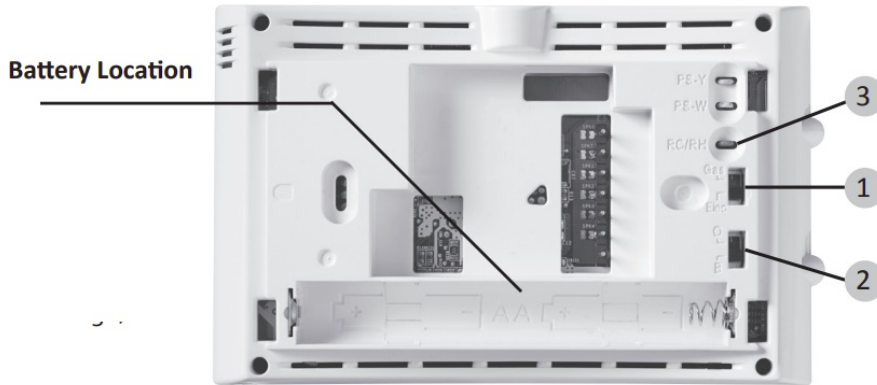

### 1. Gas/Elec Switch

If the system is a heat pump or electric furnace, the GAS/ELEC Switch must be set to Elec. If your system is a gas or oil furnace, the switch must be set to Gas.

### 2. O/B Terminal Switch




The O/B switch on this thermostat is factory set to the O position. This will accommodate the majority of heat pump applications, which require the changeover relay to be energized in Cool. If the heat pump being installed requires a B terminal, to energize the changeover relay in Heat, the O/B switch must be moved to the B position.

### 3. RC/RH Jumper Wire

This thermostat electrically connects the RC and RH terminals so a jumper wire is not required. If the application provides a separate wire for RC and RH, clip the RC/RH jumper. This will isolate both terminals so they can be independently used.



## INSTALLER MENU

To prevent changes that may affect system performance, this thermostat has an INSTALLER'S MENU and an USER MENU. The INSTALLER'S MENU provides access to every option, while the USER MENU provides access to items that will not affect system performance. To access the INSTALLER'S MENU press the Menu button for 8 seconds. The display will show item 30 in the table below. Use Next and Back to navigate through menu items. Press or to change a menu setting.

Installer's Menu # (Hold Menu 8 Seconds)	Description	Default Setting (flashing icons)	Settings (Press or)
30 	Heat Cycle Rate (how often the heat will turn on)	MEd	SLO – slow MEd – medium FAS – fast
35 	Cool Cycle Rate (how often the cooling will turn on)	MEd	SLO – slow MEd – medium FAS – fast
50 	Compressor Lockout (protects the compressor from short cycling)	OFF	On – 5 minute display OFF – no delay
65	Maximum Heat Limit (maximum set point for heat mode)	99	47 to 99
66	Minimum Cool Limit (minimum set point for cool mode)	45	45 to 97

(Installer Menu continued on next page)

#### INSTALLER MENU (Continued)

Installer's Menu # (Hold Menu 8 Seconds)	Description	Default Setting (flashing icons)	Settings
79	Fahrenheit or Celsius	°F	°F – Fahrenheit °C – Celsius
81	Temperature Display Adjustment (adjust the displayed "Room Temperature")	0	-5 to +5
83 	Continuous Display Light (keep the backlight always on – "C" wire required)	OFF	On – always on OFF – momentarily
99 	Keypad Lock (prevent unwanted changes to the thermostat)	OFF	On – disable buttons OFF – all buttons reactive

#### TEST EQUIPMENT

Turn on power to the system.

## Fan Operation

If your system does not have a G terminal connection, skip to Heating System.

1. Move fan switch to On position. The blower should begin to operate.
2. Move fan switch to Auto position. The blower should stop immediately.

## Heating System

1. Move System Switch to Heat position.
2. Press to adjust thermostat setting to 1° above room temperature. The system should begin to operate and the thermostat will indicate Heat On.
3. Press to adjust thermostat setting 1° below room temperature. The heating system should stop operating and the thermostat should indicate Heat.

## Cooling System

1. Move System Switch to Cool position.
2. Press to adjust thermostat setting 1° below room temperature. The blower should come on immediately on high speed, followed by cold air circulation. The thermostat will indicate Cool On. There can be up to a 5 minute delay. (see INSTALLER MENU, item 50)
3. Press to adjust thermostat setting to 1° above room temperature. The cooling system should stop operating and the thermostat will indicate Cool.

**Note:** If Starting Soon is shown on the display, the compressor lockout feature is operating. There will be up to a 5 minute delay before the compressor turns on.(see INSTALLER MENU, item 50)



## CAUTION

To prevent compressor and/or property damage, if the outdoor temperature is below 50°F,

### **DO NOT operate the cooling system.**


Do not allow the compressor to run unless the compressor oil heaters have been operational for 6 hours and the system has not been operational for at least 5 minutes.




## USING THE THERMOSTAT

### **THERMOSTAT OVERVIEW**

Before you begin using your thermostat, you should be familiar with its features, display and the location/operation of the thermostat buttons and switches.

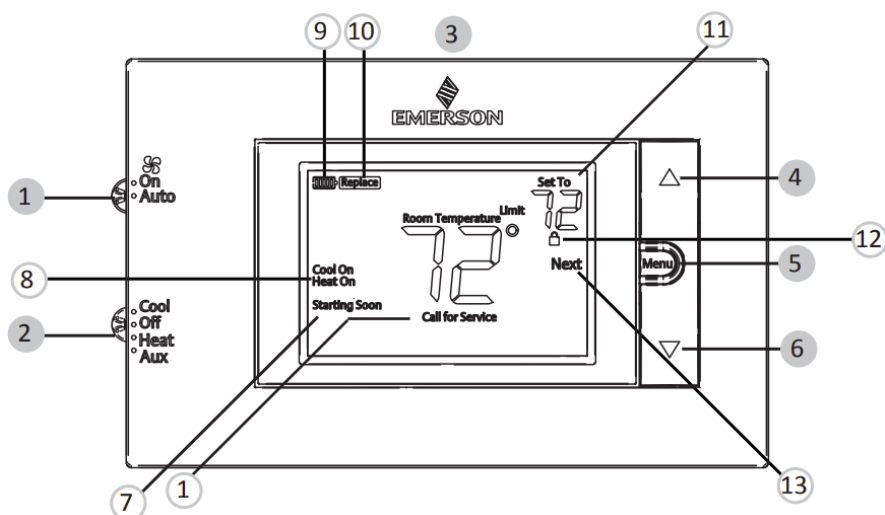


THERMOSTAT BUTTONS AND SWITCHES	THE DISPLAY
1.) Fan Switch	7.) Thermostat is protecting the equipment from short cycling (5-minute delay)
2.) System Switch	8.) Indicates that the system is running in cool or heat
3.) Backlight Button (located on the top of the thermostat)	9.) Battery status indicator
4.) Raises Temperature Setting	10.) Low battery indicator *
5.) Access Menu Options	11.) Temperature setpoint
6.) Lowers Temperature Setting	12.) Appears when the keypad is locked (to prevent unwanted changes)
	13.) Next (Menu button) is used to navigate within a menu
	14.) SEE TROUBLESHOOTING



Whenever “ Replace” appears in the display, new premium brand AA alkaline batteries should be installed. If the house will be unoccupied for an extended period and either “ ” or “ ” is displayed, install new batteries before leaving

## USER MENU

To customize thermostat settings, press the Menu button from the home screen. Use the Next button to advance through menu items. Press or to change the setting.

User's Menu # (Press Menu button and release)	Description	Default Setting (flashing icons)	Settings (Press  or  )
01	Fahrenheit or Celsius	°F	°F – Fahrenheit – Celsius
02	Temperature Display Adjustment (adjust the Room Temperature)	0	-5 to +5
03 	Continuous Display Light (keep the backlight always on – “C” wire required)	OFF	On – always enough – momentarily
04	Keypad Lock (prevent unwanted changes to the thermostat)	OFF	On – disable buttons OFF – all buttons are active

Keypad Lockout – To prevent unwanted changes, the buttons can be disabled. To turn this feature On, press and hold the Menu button until the icon appears (this can also be turned on in the menu). To turn Off, press and hold the Menu button for 3 seconds.

## TROUBLESHOOTING

Symptom	Possible Cause	Corrective Action
No Heat/ No Cool/ No Fan (common problem)	<ol style="list-style-type: none"> <li>1. Blown fuse or tripped circuit breaker</li> <li>2. Furnace power switch to OFF</li> <li>3. Furnace blower compartment door panel loose or not properly installed</li> <li>4. Loose connection to thermostat or system</li> </ol>	<ol style="list-style-type: none"> <li>1. Replace fuse or reset breaker</li> <li>2. Turn switch to ON</li> <li>3. Replace door panel in proper position to engage safety interlock or door switch</li> <li>4. Tighten Connections</li> </ol>
No Heat	<ol style="list-style-type: none"> <li>1. System Switch not set to Heat</li> <li>2. Loose connection to thermostat or system</li> <li>3. Heating System requires service or thermostat requires replacement</li> </ol>	<p>Verify thermostat and system wires are securely attached.</p> <p>Diagnostic: Set System Switch to Heat and raise the setpoint above room temperature. Within five minutes the thermostat should make a soft click sound and “Heat On” should appear on display. This sound indicates the thermostat is operating properly. If the thermostat does not click, try the reset operation listed below. If the thermostat does not click after being reset, contact your heating and cooling service person or place of purchase for a replacement. If the thermostat clicks, contact the furnace manufacturer or a service person to verify the heating system is operating correctly.</p>



No Cool	<ol style="list-style-type: none"> <li>1. System Switch not set to Cool</li> <li>2. Loose connection to thermostat or system</li> <li>3. Cooling System requires service or thermostat requires replacement</li> </ol>	<p>Verify thermostat and system wires are securely attached.</p> <p>Diagnostic: Set System Switch to Cool and lower setpoint below room temperature. Same procedures as diagnostic for “No Heat” condition except set the thermostat to Cool and lower the setpoint below the room temperature. There may be up to a five minute delay before the thermostat clicks in Cooling if the compressor lock-out option is selected in the installer menu. (see INSTALLER MENU, item 50)</p>
Heat, Cool or Fan Runs Constantly	Possible short in wiring, thermostat, heat, cool or fan system	Check each wire connection to verify they are not shorted or touching other wires. Try resetting the thermostat. If the condition persists contact your HVAC service person.
Thermostat Display & Thermometer Disagree	Thermostat display requires adjustment	Display can be adjusted +/-5°. See User Menu item 04
Furnace (Air Conditioner) Cycles Too Fast or Slow (narrow or wide temperature swing)	The location of the thermostat and/or the size of the Heating System may be influencing the cycle rate	Digital thermostats provide precise control and cycle faster than older mechanical models. The system turns on and off more frequently but runs for a shorter time. If you would like to increase cycle time, choose SLOW or slow cycle in the Installer menu. (Reference menu items 30 & 35) If an acceptable cycle rate is not achieved, contact your HVAC service person.
Call for Service” icon appears on display	<ol style="list-style-type: none"> <li>1. Heating system is not able to heat the space to within 10 degrees of the setpoint within 2 hours</li> <li>2. Cooling system is not able to cool the space to within 10 degrees of the setpoint within 2 hours</li> <li>3. If “—” is displayed for the Room Temperature, a replacement thermostat is needed</li> <li>4. None of the buttons operate on the thermostat</li> </ol>	<ol style="list-style-type: none"> <li>1. See corrective action for “No Heat”</li> <li>2. See corrective action for “No Cool”</li> <li>3. Replace thermostat</li> <li>4. Make sure keypad lockout is not turned on (denoted by icon)</li> </ol>

## Resetting the Thermostat or Thermostat Settings

If the thermostat has good batteries, but has a blank display or does not respond to key presses, the thermostat should be reset by removing the batteries for 2 minutes. This reset will not change the menu settings. If the condition persists after reinstalling the batteries replace the thermostat.

To conveniently reset only the user settings back to factory defaults, press Menu and Backlight buttons at the same time and hold until the display goes blank and resets.

HOMEOWNER HELP LINE: 1-800-284-2925

Emerson and White-Rodgers are  
trademarks of Emerson Electric Co.  
©2017 Emerson Electric Co.  
All rights reserved


## White-Rodgers

white-rodgers.com  
emerson.com








---

## Documents / Resources

	<a href="#">EMERSON 1F83C-11NP Single Stage Thermostat</a> [pdf] Owner's Manual 1F83C-11NP Single Stage Thermostat, 1F83C-11NP, Single Stage Thermostat, Stage Thermostat, Thermostat
---	--

## References

-  [Emerson Global | Emerson](#)
-  [Thermostats | Copeland US](#)
-  [White-Rodgers Brand | Copeland US](#)
-  [Home - Thermostat Recycling Corporation \(TRC\)](#)
-  [Manual-Hub.com - Free PDF manuals!](#)

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.