

ems kontrol KT-601 Temperature Humidity and Carbon Dioxide Transmitter User Manual

<u>Home</u> » <u>ems kontrol</u> » ems kontrol KT-601 Temperature Humidity and Carbon Dioxide Transmitter User Manual



- 1 ems kontrol KT-601 Temperature Humidity and Carbon Dioxide Transmitter
- **2 RULES TO BE CONSIDERED FOR SAFETY**
 - 2.1 INSTALLATION
 - 2.2 MODBUS RTU COMMUNICATION STRUCTURE
 - 2.3 DECLARATION OF CONFORMITY
 - 2.4 WARRANTY TERMS
 - 2.5 FAQS
- 3 Documents / Resources
 - 3.1 References



ems kontrol KT-601 Temperature Humidity and Carbon Dioxide Transmitter



Product Code	Output Signal	
KT-601	0-10 V	
KT-641	4-20 mA	
KT-661	Modbus RTU	

WHAT IS IT?

The temperature, humidity and carbon dioxide transmitter measures temperature, relative humidity and carbon dioxide values precisely and outputs them analog.

HOW DOES IT WORK?

It can operate with a supply between 12 V DC and 24 V DC. Measurement values are taken from the analog output terminals and transferred to the desired location,

GENERAL FEATURES

Accurate and Precise Measuring, Analog Output, Durable and Handy Design, Long Operating Life, Cleanable Filter, Easy Assembling, IP 67 Plastic Case (Excluding Sensor)


AREAS OF USE

HVAC Applications, Poultry Automation and Poultry Farms, Cold Storage, Incubation Rooms, Food Storage, Air Conditioning Cabinets, Clean Rooms and Laboratories.

RULES TO BE CONSIDERED FOR SAFETY

- 1. Always read the user manual before using the device and its apparatus.
- 2. Damages caused by opening, breaking or misuse of the plastic parts of the device and its apparatus are considered out of warranty.

- 3. Keep the device and its apparatus away from external influences such as liquid, high dust, high temperature, etc. and protect them,
- 4. Do not expose the device cables to any jamming and pressure.
- 5. Disconnect the electrical power when your device is not used for a long time.
- 6. Our devices and apparatus should be used by paying attention to the points in the user manual. In case of damages and malfunctions arising from external use (liquid contact, falling to the ground, etc.) ask for help from the service.
- 7. Failures due to electrical connection errors and electrical voltage or current errors are not covered by the warranty.

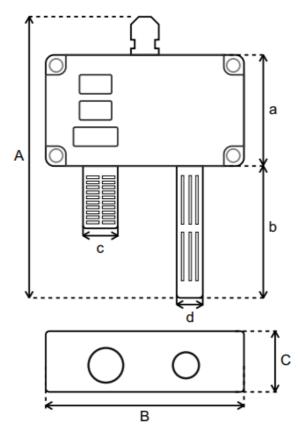


Sizes	
A	164 mm
В	115 mm
С	40 mm
а	65 mm
b	78 mm
С	20 mm
d	16 mm

Technical Data		
Product Name:	Temperature, Humidity and Carbon Dioxide Transmitter	
Supply Voltage:	12-24 V DC	
Output:	0-10 V / 4-20 mA / Modbus	
Measurement Range(Temp.):	0 – 50°C / (-20) – (+80)°C	
Precision (Temp.):	± 0,1 °C	
Accuracy (Temp.):	± 0,3 °C	
Measurement Range(Hum.):	0 – 100 %	
Precision (Hum.):	± % 1	
Accuracy (Hum.):	± % 3	
Measurement Range(CO2):	0-5.000 ppm / 0-10.000 ppm	
Precision (CO2):	± 10 ppm	
Accuracy (CO2):	± 50 ppm + %2	
Operating Temperature:	(-10°C) – (+55°C)	
Storage Temperature:	(-20°C) – (+60°C)	
Protection Class:	IP 67 (Excluding Sensor)	

• If the device is to be used outside the operating temperature, the manufacturer must be informed and approval must be obtained.

INSTALLATION

- 1. Unpack the product and open the top cover.
- 2. Make cable connections accordingly.

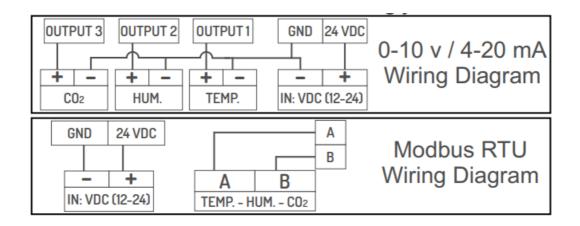

- 1. If the product will be mounted on the wall, you can use the screws and dowels in the package. It starts measuring 30 seconds after the product is energized. It is recommended that the product remains in the environment for at least 5 minutes to get healthy measurement values..
- 2. It is recommended to use shielded cable as communication cable as it will prevent communication signals from being affected by external influences.
- 3. Since the communication cable will create resistance, check the measurement values again after cable installation.

MODBUS RTU COMMUNICATION STRUCTURE

RS485 Baud rate value in Modbus communication is 9600 by default. Stop bit: 1, Parity: NONE. Default Slave ID is 88. Temperature value is stored in the holding register at address 2 (40003), humidity value at address 3 (40004), carbon dioxide value at address 4 (40005) Temperature, humidity and carbon dioxide information can be obtained by reading these registers. Register map and default values table:

Register	Address	Default Value	Read Write	Min. Value	Max. Value
Slave ID	0 (40001)	88	R/W	1	247
Baud rate	1 (40002)	3	R/W	0	8
Temp. Val.	2 (40003)	_	R	_	_
Hum. Val.	3 (40004)	_	R	_	_
Co ₂ Val.	4 (40005)	_	R	_	_

Slave ID and Baud rate can be changed via Modbus communication. For this, the desired Slave ID is written to the register with address 0 (40001), which is the register where the Slave ID is located. Likewise, if the Baud rate is to be changed, the Baud rate can be changed by writing the value for the desired Baud rate according to the table below in the register with address 1 (40002). Press and hold the "Calibration" button to reset the changes made to the Slave Id or Baud rate to the default values. Wait until the Status (green) LED turns off (approx. 30 seconds). After the LED turns off, the button is released. Thus, Slave ID and Baud rate are returned to their default values.

Min. Value	Max. Value
0	1200
1	2400
2	4800
3	9600
4	14400
5	19200
6	38400
7	57600
8	115200

LED Meanings			
Power	On	Normal Operating	
(Red)	Off	No Energy (Error)	
Status (Green) On Off	Measurement Preperation		
	On	Normal Measurement	
	Error - Fault		

BEFORE CALIBRATION

- 1. The product is sold as calibrated. Plase do not calibrate unless necessary.
- 2. Perform calibration only when it is certain that the product is measuring
- 3. Only carbon dioxide can be calibrated.
- 4. Compare the measurement value of the device with another device or with a dean and open air control.
- 5. If the device measures values outside tt-E range of 350 ppm 450 ppm in dean and open air, calibration æn be performed.

CALIBRATION

- 1. A clean and open area away from any carbon dioxide source should be selected for carbon dioxide calibration.
- 2. The amount of carbon dioxide in clan and open area varies between 350 ppm 450 ppm. When ælibration is done, the product takes the value at the time of calibration as 400 ppm.
- 3. When the "Calibration" button in the product is pressed and held for 5 seconds, the calibrationproæss starts. CAL is written on the screen, ælibration is completed with a 10 minute

DECLARATION OF CONFORMITY

Headquarters and place of production, Halkapnar Mah. 1376 Sok. Boran Plaza No:1/L Konak / IZMIR – TÜRKiYE, EMS KONTROL ELEKTRONIK VE MAKINE SAN. Tic. A.s. declares that the product marked with CE, whose name and specifications are given below, covers the specified directives and provisions.

Brand: EMS KONTROLProduct Name: KT- 6X1

Product Type: Temperature and Humidity, Carbon

Dioxide Transmitter

Compatible Directives

Elektromagnetic Compatibility Directive 2014/30/EIJ (EMC EN 61000-6-3:2007 + A1: 2011, EN 61000-6-1:2007) Low Voltage Directive 2014/35/EIJ (LVD EN 60730-2-9:2010, EN 60730-1:2011)

Additional information

This product can be used in combination with other devices, and compliance with the directives covers only the product. EMS KONTROL is not responsible for the compliance of the entire system with the directives. This declaration is not valid if the product is modified without our approval.

WARRANTY TERMS

- 1. The warranty period of the devices and apparatus starts from the invoice date and is guaranteed for 2 years against manufacturing defects.
- 2. Devices and apparatus are delivered to the customer in working condition in our company. On-site commissioning is subject to service fee.
- 3. The repair of the devices and apparatus under warranty is carried out in our company as a result of sending them with the transportation company contracted by our company. In on-site services, transportation and accommodation expenses of the service personnel belong to the customer. The cost of the working time spent on the road is added to the service fee and the collection is made in advance.
- 4. Maintenance of devices and apparatus is done in our company. Transportation and transportation fees of the devices and apparatus to and from our company for maintenance belong to the customer.
- 5. In case of malfunction of the devices and apparatus whose warranty period continues, whether the malfunction is caused by the fault of the customer or the manufacturer, is tested in our company and the report is issued by our company.
- 6. In case of detection of manufacturer-induced faults of the devices and apparatus whose warranty period continues, the customer may request a replacement or may request that the repair costs of the devices and apparatus be fully covered by the manufacturer, provided that it does not exceed the product price.
- 7. In the event that the faults of the devices and apparatus whose warranty period continues are determined to be caused by the customer, all costs belong to the customer.
- 8. If the customer does not indicate that he/she is aware of the defects in the devices and apparatus from the date the warranty period starts or in cases where he/she is expected to be aware, he/she cannot benefit from Article 6.
- 9. Failures arising from the use of devices and apparatus contrary to the points in the user manual are not covered by the warranty.
- 10. Devices and apparatus are not covered by the warranty if they are beaten, broken or scratched by the customer.

- 11. Damages caused by the use of devices and apparatus of other brands and models without the approval of the manufacturer are not covered by the warranty.
- 12. Errors caused by rusting, oxidation, and liquid contact due to working in dusty/acidic/humid environments are not covered by the warranty.
- 13. Damages that may occur during transportation of devices and apparatus are not covered by the warranty f the customer wishes, he/she can have transportation insurance.
- 14. Damages caused by mains voltage / faulty electrical installation are not covered by the warranty.
- 15. Devices and apparatus are not covered by the warranty in case of malfunctions caused by force majeure such as fire, flood, earthquake, etc.
- 16. All parts of the devices and apparatus, including all parts, are covered by our company's warranty.
- 17. If the devices and apparatus malfunction within the warranty period, the time spent in repair shall be added to the warranty period. The repair period of the goods shall not exceed 20 working days. This period starts from the date of notification of the malfunction of the goods to the service station, in the absence of a service station, to the seller, dealer, agent, representative, importer or manufacturer manufacturer of the goods. It is possible for the consumer to notify the malfunction by telephone, fax, e-mail, registered letter with return receipt or similar means. However, in case of dispute, the burden of proof belongs to the consumer. If the malfunction of the goods is not resolved within 20 business days, the manufacturer, manufacturer or importer; until the repair of the goods is completed, another good with similar characteristics must be allocated to the use of the consumer.
- 18. Despite the consumer's right to repair the goods;
 - Provided that it is within the warranty period from the date of delivery to the consumer, it fails at least four
 times within a year or six times within the warranty period determined by the manufacturer-manufacturer
 and/or importer, as well as the fact that these failures make the inability to benefit from the goods
 continuous.
 - Exceeding the maximum time required for repair,
 - If it is determined that it is not possible to repair the malfunction with the report to be issued by the service station of the company's service station, if the service station is not available, respectively by one of its dealer, dealer, agency, representative, importer or manufacturer- manufacturer, it may request a refund or a price reduction at the rate of defect.
- 19. Customer may file complaints and objections to consumer courts or consumer arbitration committees.
- 20. The warranty certificate must be kept by the customer during the warranty period. In case of loss of the document, a second document will not be issued. In case of loss, repair and replacement of devices and apparatus will be made for a fee.

Manufacturer's

• Title: EMS KONTROL ELEKTRONIK VE MAKINE SAN. VE TIC. A.\$.

• Address: Halkapinar Mah. 1376 Sokak Boran

• Plaza No:1/L Konak / Izmir-TÜRKiYE

Telephone: 0 (232) 431 2121E-Mail: info@emskontrol.com

Company Stamp:

Product's

• Type: Temperature and Humidity, Carbon Dioxide Transmitter

· Brand: EMS Kontrol

• Model: KT-6X1

· Warranty Duration: 2 Years

• Maximum Repair Time: 20 Days

· Banderol and Serial Number:

Vendor Company

- · Title:
- · Address:
- Telephone:
- · Faks.
- E-Mail:...
- · Invoice Date and Number:
- · Delivery Date and Place:
- Signature of Authorised Person:
- · Company Stamp:

Product's

- Type: Temperature and Humidity, Carbon
- · Dioxide Transmitter
- Brand: EMS KONTROL
- Model: KT-6X1

EMS Kontrol reserves the right to make changes and improvements to the product specifications and user manual.

• For all changes, please visit emskontrol.com.

FAQS

Q: What is the default Slave ID for Modbus communication?

A: The default Slave ID is 88.

Q: How can I reset the changes made to the Slave ID or Baud rate?

A: Press and hold the Calibration button until the Status LED turns off (approximately 30 seconds) to reset the changes back to default values.

Documents / Resources



ems kontrol KT-601 Temperature Humidity and Carbon Dioxide Transmitter [pdf] User Man

KT-601, KT-641, KT-661 Temperature Humidity and Carbon Dioxide Transmitter, KT-60 1, Temperature Humidity and Carbon Dioxide Transmitter, Humidity and Carbon Dioxide Transmitter, Carbon Dioxide Transmitter, Dioxide Transmitter, Transmitter

References

User Manual

Manuals+, Privacy Policy

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.