



## ENGO CONTROLS EONEBATW Internet Controlled Thermostat User Guide

[Home](#) » [ENGO CONTROLS](#) » ENGO CONTROLS EONEBATW Internet Controlled Thermostat User Guide 



Quick Guide  
EONEBATW EONEBATB  
Ver. 1  
Release date: II 2023

## Contents

- 1 Product Compliance
- 2 SAFETY INFORMATION:
- 3 Product advantages:
- 4 INTRODUCTION:
- 5 Technical Informations
- 6 Wireless communication diagram
- 7 Connection description
- 8 LCD Icon Description + Button Description
- 9 Button description
- 10 Installation thermostat in the app
- 11 Binding thermostat with the ECB62ZB wireless control box
- 12 Installer settings
- 13 Installer parameters
- 14 Factory reset
- 15 Documents / Resources
  - 15.1 References

## Product Compliance

This product complies with the following EU Directives: 2014/30/EU, 2014/35/EU, 2014/53/ EU, 2011/65/EU

## SAFETY INFORMATION:






Use in accordance with national and EU regulations. Use the device only as intended, keeping it in a dry condition. The product is for indoor use only. Please read the entire manual, before installation or use.



### **WARNING:**

This product must be used with a ZigBee EGATEZB gateway (purchased separately). Thermostat programming is done by ENGO Smart app.

## Product advantages:

	Built-in Li-Ion 3,7V Battery
	Communication in the ZigBee 3.0 standard
	A multitude of functions available from ENGO Smart / Tuya Smart application
	S1-S2 Input for additional sensor
	ENGO binding function (devices connection in Online and Offline mode)


## INTRODUCTION:

ONEBAT is a surface-mounted room thermostat which works over ZigBee technology. It has a built-in humidity sensor and a minimum/maximum setpoint temperature limiting function. The ONEBAT has the ability to work in heating or cooling modes. The unique feature of this thermostat is the possibility of wireless control over ENGO binding function. In order to have the ability to controll wirelessly, ONEBAT needs to be used with ENGO Smart / TUYA Smart mobile application and EGATEZB internet gateway (sold separately). „ENGO binding” function provides wireless and direct connection to the receivers (e.g. ECB62ZB control box, EMODZB module or EREL1ZB12A relay) over the EGATEZB gateway. After adding to the mobile app, thermostat offer more functions, e.g. push notifications or possibility of programming time schedules.


## Technical Informations

Power supply	Built-in Li-Ion 3,7V Battery
Charging connector	USB type C, 5V DC
Temperature range	5,0°C – 45,0°C
Display temperature accuracy	0,5°C
Control algorithm	TPI or Histeresis (from $\pm 0,1^{\circ}\text{C}$ to $\pm 2^{\circ}\text{C}$ )
Communication	ZigBee 3.0 2,4GHz
S1/S2 multifunctional input	Floor temp sensor, external air sensor, occupancy sensor
IP protection class	IP30
Dimension [mm]	90 x 90 x 14 mm

## Wireless communication diagram

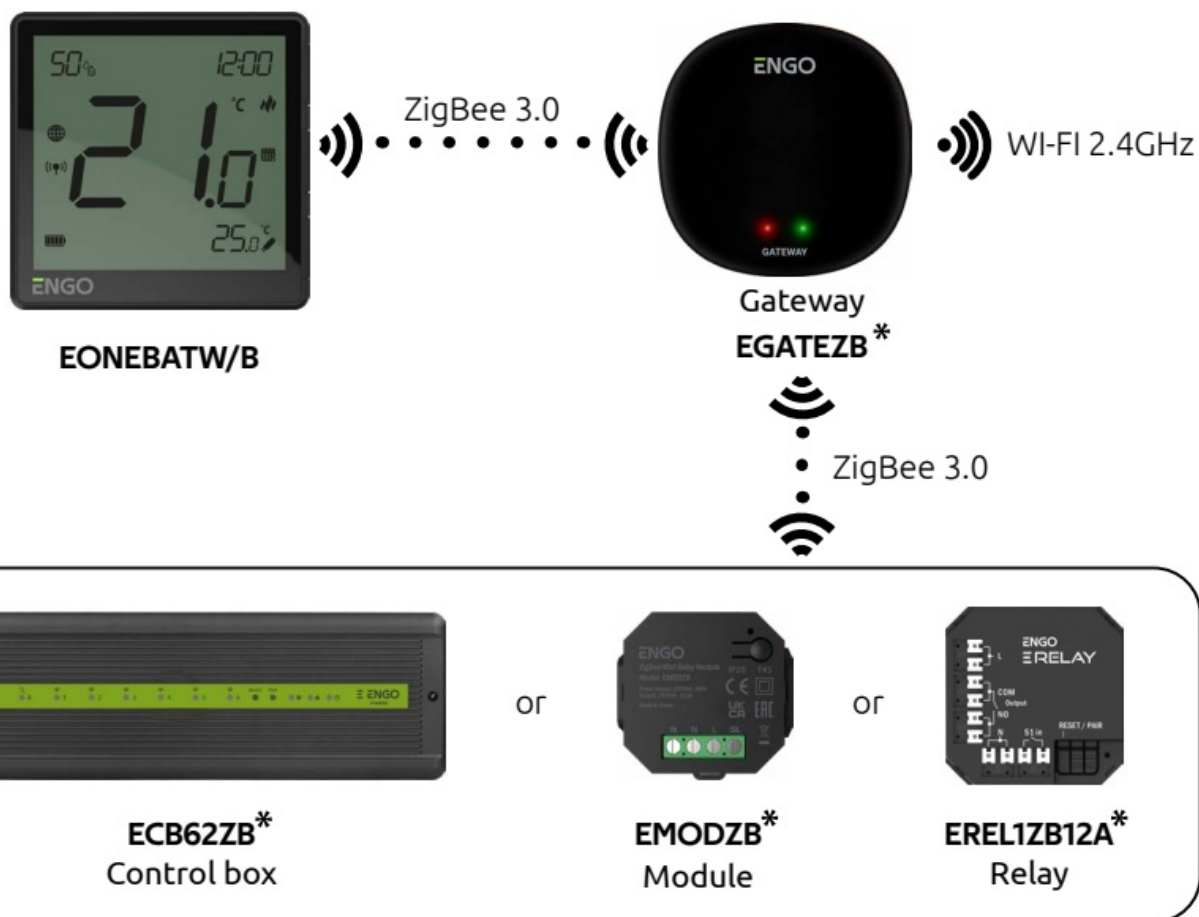

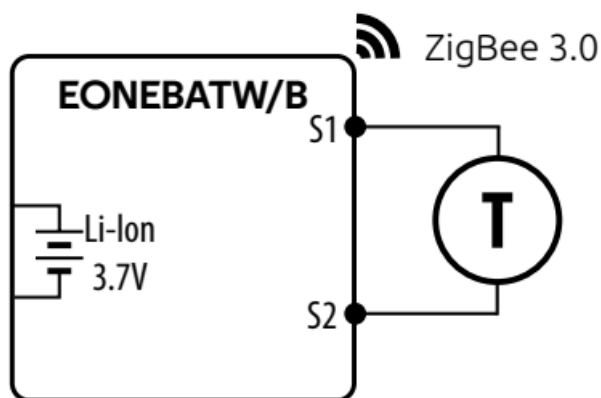


## Connection description




Products sold separately

## Legend:

	Temperature sensor
<b>S1, S2</b>	Thermostat input for ext. temperature sensor
	Connection with ZigBee 3.0 network
	Connection with WiFi 2.4GHz network



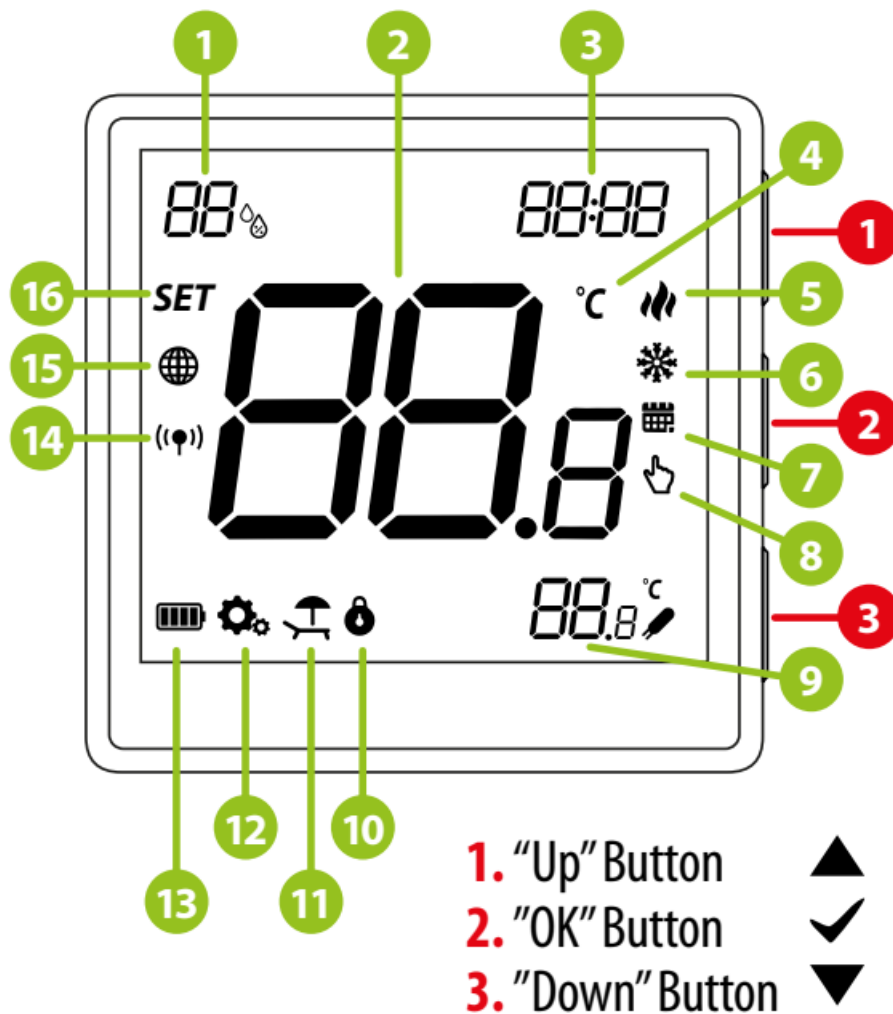






### LCD Icon Description + Button Description



1. Current humidity reading
2. Current/Setpoint temperature
3. Clock
4. Temperature unit
5. Heating indicator (icon is animating when there is heating demand)
6. Cooling indicator (icon is animating when there is cooling demand)
7. Schedule mode icon
8. Temporary override mode

9. External/Floor or Occupancy sensor
10. Button lock
11. Holiday mode
12. Settings icon
13. Battery indicator
14. Receiver pairing indicator
15. ZigBee network connection indicator
16. Settings icon / temperature settings

## Button description

	Change the parameter value up
	Change the parameter value down
	Manual/Schedule mode – short button press (Online mode)
	Enter the installer parameters- hold 3 seconds
	Turn OFF/ON thermostat – hold 5 seconds
 + 	Enter the pairing mode – hold 5 seconds
	Enter binding mode – hold 10 seconds
	Thermostat factory reset – hold 15 seconds
 + 	Lock/Unlock thermostat keys – hold 3 seconds
 + 	Heating/Cooling mode change – hold 3seconds

## Installation thermostat in the app

Make sure your router is within range of your smartphone. Make sure you are connected to the Internet. This will reduce the pairing time of the device.

### STEP 1 – DOWNLOAD ENGO SMART APP

Download the ENGO Smart app from Google Play or Apple App Store and install it on your smartphone.



<https://play.google.com/store/apps/details?id=com.engo.smartlife>


<https://apps.apple.com/us/app/>

## STEP 2 – REGISTER THE NEW ACCOUNT

To register a new account, please follow the steps below:

<p><b>1</b></p>	<p><b>2</b></p>	<p><b>3</b></p>	<p><b>4</b></p>
<p>Click „Register” to create new account.</p>	<p>Enter your e-mail address to which the verification code will be sent.</p>	<p>Enter the verification code received in the email. Remember that you only have 60 seconds to enter the code!!</p>	<p>Then set the login password.</p>

## STEP 3 – CONNECT THE THERMOSTAT TO ZigBee

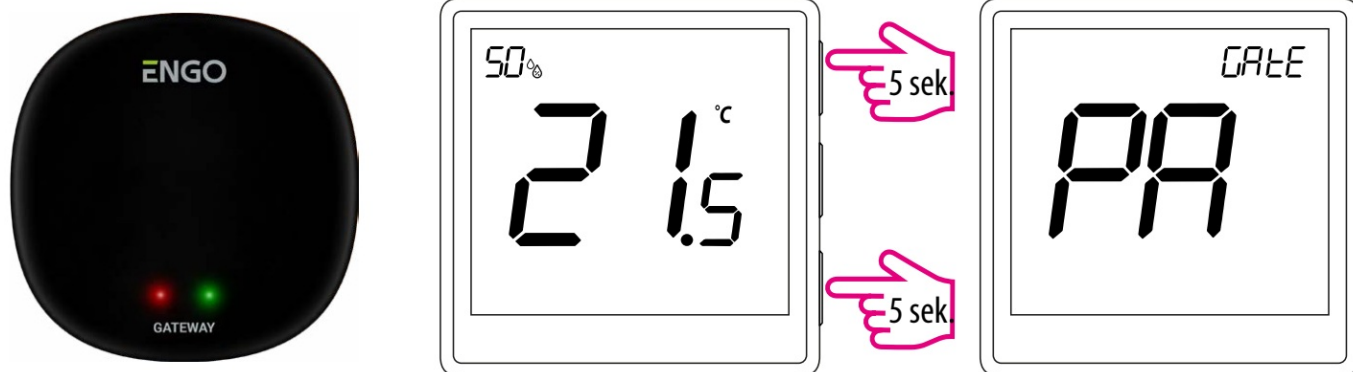


Make sure ZigBee gateway has been added to the Engo Smart app. Press ▲ and ▼ hold the and buttons on the thermostat for approx. 5 seconds until the display shows „PA“. Then release the keys. The pairing mode will be started up and counts the time back (180s).

<p>In the app, click on upper right corner.</p>	<p>Select: „Add Device“.</p>	<p>When the ZigBee gateway finds thermostat click the „Add“ button.</p>
<p>Name the device and click „Done“.</p>	<p>The thermostat has been installed and displays the main interface.</p>	<p>On the controller screen globe icon appeared stating that he has been he added to the ZigBee network.</p>

### Binding thermostat with the module/relay



Make sure that the module/relay and thermostat are in the same ZigBee network (they are added to the same gateway EGATEZB).



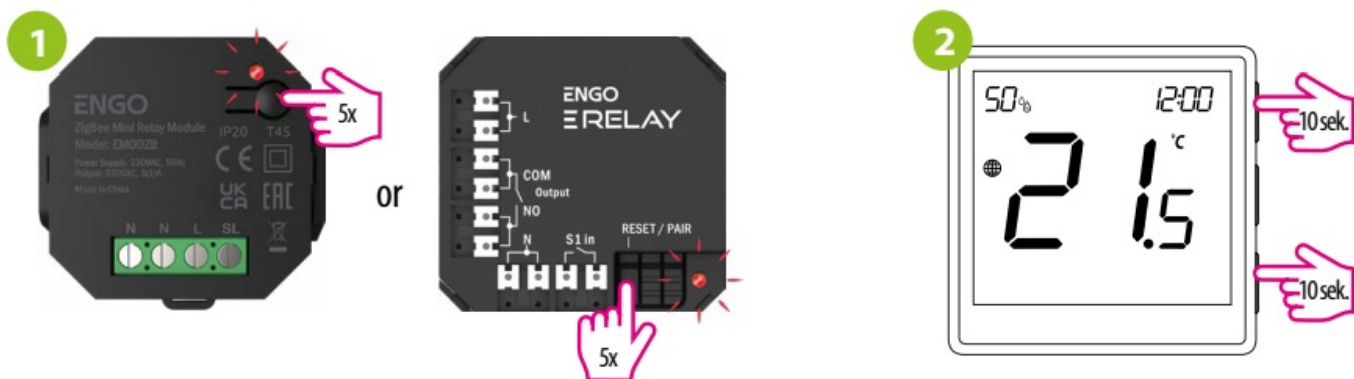


To properly link thermostat with the module/relay first click the button on the device 5 times.  
The LED diode will start flashing slowly on red, which means the device is in binding mode.

On the EONE thermostat, hold ▲ and ▼ buttons until the “bind” message appears.

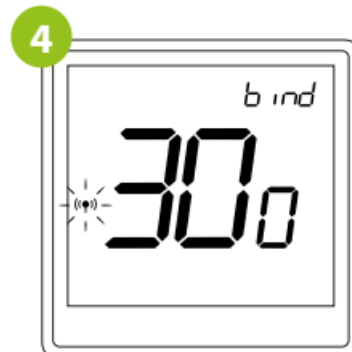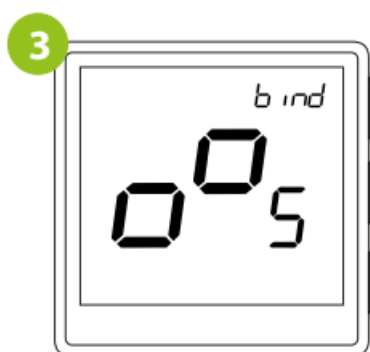

Release the keys, binding function process of linking thermostat with control box is active.  
The “binding” process takes up to 300 seconds.

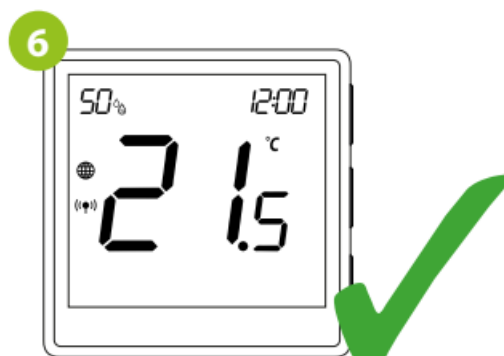

After successful binding operation „End” message will be displayed. LED on the module will stop flashing.  
Both devices have been successfully linked. Thermostat displays the main screen, icon ” ” appeared on the screen indicating connection with the receiver (module/relay in this case).



#### ATTENTION:

If the binding process fails, it must be repeated taking into account the distances between devices, obstacles and local radio signal interferences.




#### Remember:


Radio range can be increased by Engo ZigBee repeaters.

### Binding thermostat with the ECB62ZB wireless control box



Make sure that the ECB62ZB control box and thermostat are in the same ZigBee network (they are added to the same gateway EGATEZB) and the POWER LED lights up blue.

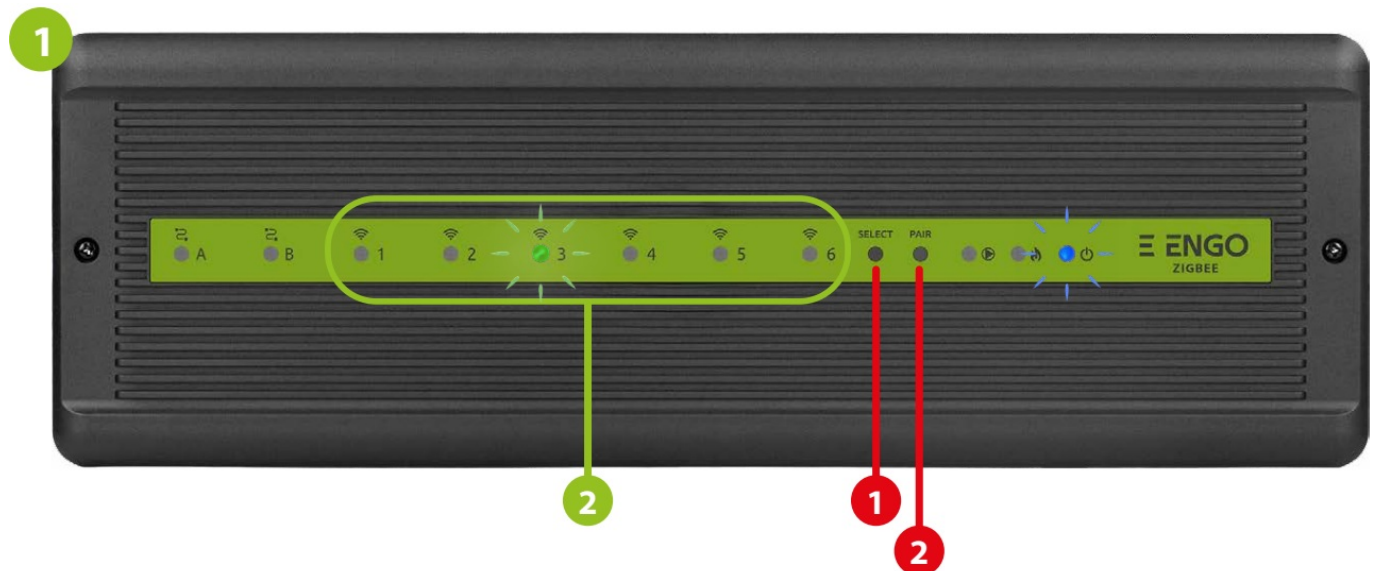

In order to correctly link thermostat with the control box, first select the zone in the control box with the SELECT button (1) (zone which you want to link with thermostat). The LED (2) will flash 3 times for the selected zone. Confirm your selection by clicking PAIR button (2). The LED (2) will flash green with the previously selected zone – binding process has started, it is active for 10 minutes and during this time you can link thermostat with the selected zone.

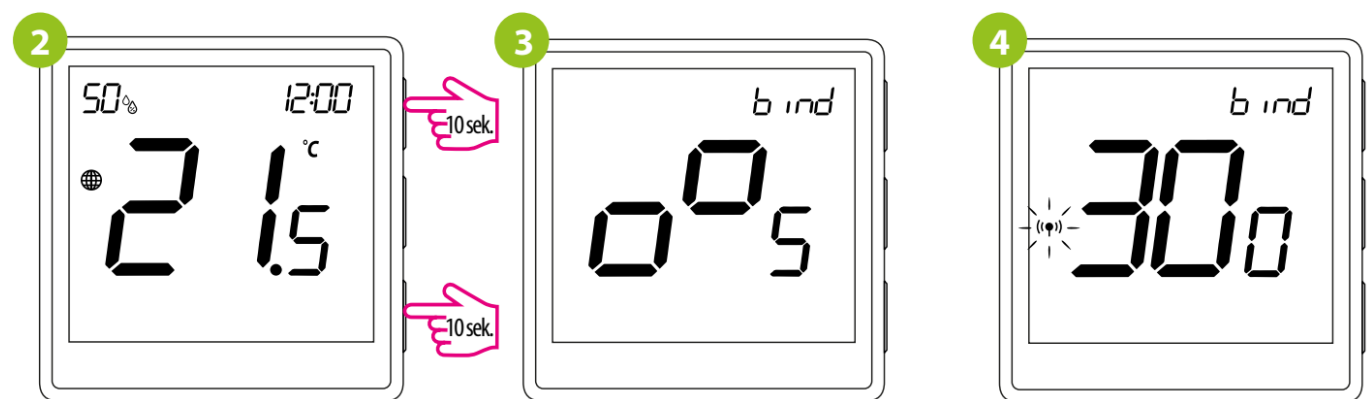

On the EONE thermostat, hold ▲ and ▼ buttons until the “bind” message appears. Release the keys, binding function process of linking thermostat with control box is active. The “binding” process takes up to 300 seconds.

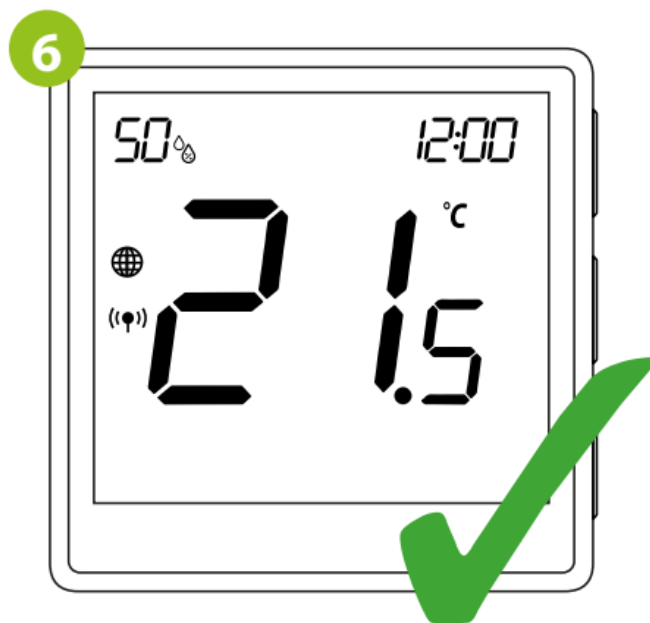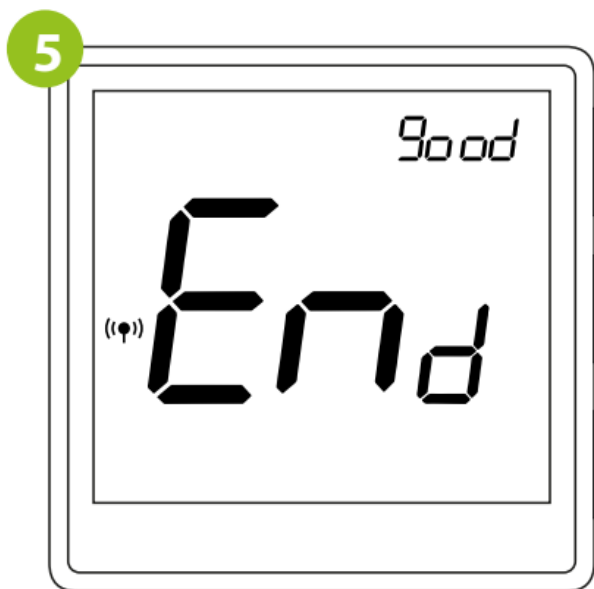

After successful binding operation „End” message will be displayed.

Both devices have been successfully linked. Thermostat displays the main screen, icon ” ” appeared on the screen indicating connection with the receiver (ECB62ZB in this case).



#### ATTENTION:


If the binding process fails, it must be repeated taking into account the distances between devices, obstacles and local radio signal interferences.











#### Remember:

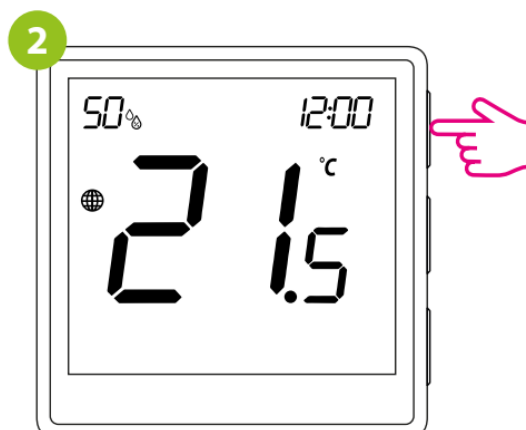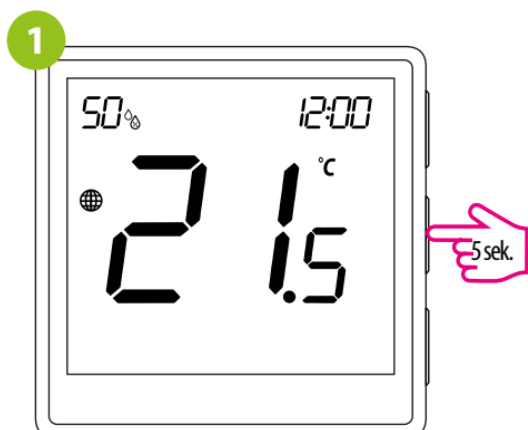Radio range can be increased by Engo ZigBee repeaters.



### Installer settings

To enter installer parameters press and hold  button for 3 seconds.



Use  or  button to move between parameters. Enter the parameter by . Edit the parameter using  or . Confirm the new parameter value with the button .


### Installer parameters

Pxx	Function	Value	Description	Default value
P01	Clock format	12h	12 hour	24h
		24h	24 hour	
P02	Heating/Cooling Selection		Heating	
			Cooling	
		TPI UFH	TPI for Underfloor Heating	TPI UF H for h eating HIS 1.0 for cooling
		TPI RAD	TPI for Radiators	
		TPI ELE	TPI for Electrical Heating	
		HIS 0.2	SPAN +/-0,1°C	
		HIS 0.4	SPAN +/-0,2°C	
P03	Control algorithm	HIS 0.6	SPAN +/-0,3°C	
		HIS 0.8	SPAN +/-0,4°C	
		HIS 1.0	SPAN +/-0,5°C	
		HIS 2.0	SPAN +/-1,0°C	
		HIS 3.0	SPAN +/-1,5°C	
		HIS 4.0	SPAN +/-2,0°C	
P04	Offset temperature	-3.5°C do +3.5°C	If the thermostat indicates wrong temperature, you can correct it by max $\pm 3.5^{\circ}\text{C}$	0°C
P05	“Minimum setpoint”	5°C – 45°C	Minimum heating / cooling temperature that can be set	5°C
P06	“Maximum setpoint”	5°C – 45°C	Maximum heating / cooling temperature that can be set	35°C
P07	S1/S2 Input	1	Disable	1
		2	External sensor as a floor sensor	
		3	External sensor as an air sensor	

		4	Occupancy sensor (ON/OFF volt free input)	
P08	Maximum floor temperature for heating (function active when P07=2)	5°C – 45°C	In order to protect the floor, the heating will be turned off, when the temperature of the floor sensor rises above the maximum value.	35°C
P09	Minimum floor temperature for heating (function active when P07=2)	5°C – 45°C	In order to protect the floor, the heating will be switched on, when the temperature of the floor sensor drops below the minimum value.	10°C
P10	Maximum floor temperature for cooling (function active when P07=2)	5°C – 45°C	In order to protect the floor, cooling will be switched on, when the temperature of the floor sensor exceeds the maximum value.	15°C
P11	Minimum floor temperature for cooling (function active when P07=2)	5°C – 45°C	In order to protect the floor, cooling will be turned off, when the temperature of the floor sensor drops below the minimum value	7°C
P12	Comfort warm floor	OFF Level 1 = 7min Level 2 = 11min Level 3 = 15min Level 4 = 19min Level 5 = 23min	This function helps to keep the floor warm, even if there is no heating demand from the room thermostat. This feature is available only for Heating Mode. User can select 5 levels of warm floor feature. Note that comfort warm floor function will activate heating for specified amount of time (in relation to Level setting chosen by user). Heating will be activated only if in the past 1 hour heating was OFF.	OFF
P13	Valve protection	ON OFF	Function disabled Function enabled	OFF
P14	Backlight brightness	10% – 100%	Adjustable in the range from 10 to 100%	50%
P15	PIN Code for settings access	NO PIN	Function disabled Function enabled	NO
P16	Require a PIN to unlock the keys every time (function active when P15=PIN)	NO YES	Function disabled Function enabled	NO
CLR	Clear settings factory reset	NO YES	No action Factory Reset	NO

## Factory reset

To RESET thermostat to factory settings, hold the ▲ and ▼ buttons for approx. 15 seconds. FA will be displayed. Then release the keys. Thermostat will restart, restore default (factory) settings and displays the home screen. The device will be removed from the ZigBee network you will need to add/pair it again.

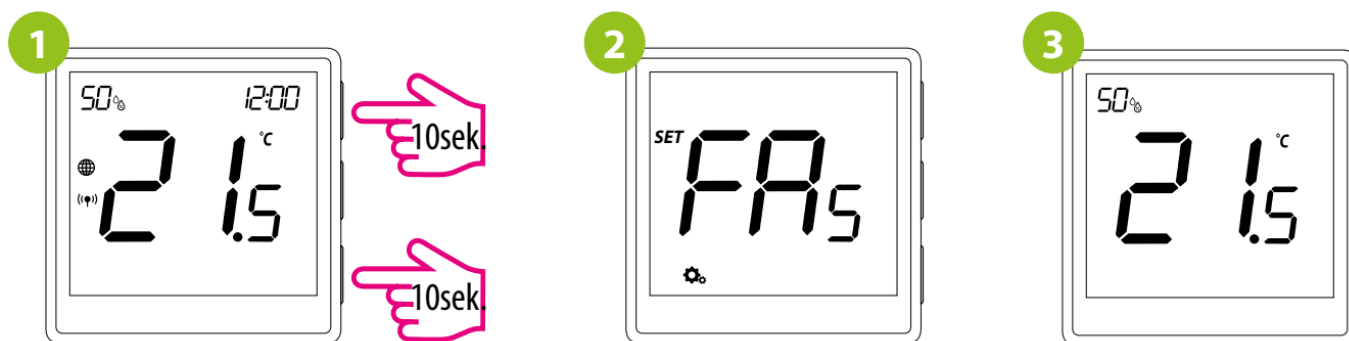

Producer:

Engo Controls S.C.

43-200 Pszczyna 3E Górnośląska St.


Poland Distributor:

QL CONTROLS Sp z o.o. Sp. k.

43-262 Kobielice 4 Rolna St. Poland

[www.engocontrols.com](http://www.engocontrols.com)

## Documents / Resources



[ENGO CONTROLS EONEBATW Internet Controlled Thermostat](#) [pdf] User Guide  
EONEBATW, EONEBATB, EONEBATW Internet Controlled Thermostat, Internet Controlled Thermostat, Thermostat

## References

- [ENGO Controls - Sterowanie ogrzewaniem](#)