



firecell FCX-191 Combined Sounder Detector Visual Indicator User Manual

[Home](#) » [firecell](#) » firecell FCX-191 Combined Sounder Detector Visual Indicator User Manual 

Contents

- [1 firecell FCX-191 Combined Sounder Detector Visual Indicator](#)
- [2 Pre-installation](#)
- [3 Components](#)
- [4 Fix mounting plate](#)
- [5 Power device](#)
- [6 Optional device locking](#)
- [7 Configuration](#)
- [8 IMPORTANT](#)
- [9 Specification](#)
- [10 Regulatory Information](#)
- [11 Documents / Resources](#)
 - [11.1 References](#)
- [12 Related Posts](#)

FireCell

firecell FCX-191 Combined Sounder Detector Visual Indicator




Pre-installation

Installation must conform to applicable local installation codes and should only be installed by a fully trained competent person.

- Ensure that the device is installed as per the site survey.
- The use of a non-metallic spacer should be considered if mounting the device on to a metal surface.
- Do NOT Press the Log On button on a pre-programmed device, as this will cause communication with the Control Panel to be lost. Should this happen, delete the device from the system and add it back on.
- This device contains electronics that may be susceptible to damage from Electrostatic Discharge (ESD). Take appropriate precautions when handling electronic boards.

Components

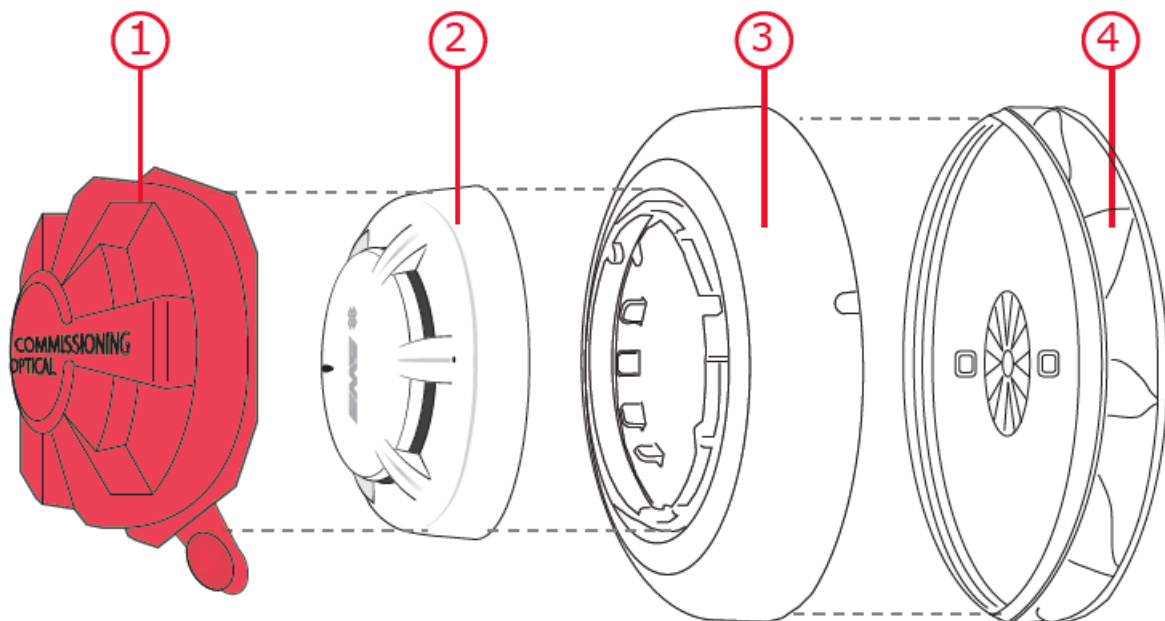


1. Dust cover
2. Detector
3. Wireless module
4. Mounting plate

Fix mounting plate


Remove the mounting plate by turning the device ANTICLOCKWISE, to release it from the mounting plate.

- Use both mounting holes to ensure a firm fixing.
- Use suitable fasteners and fixings.

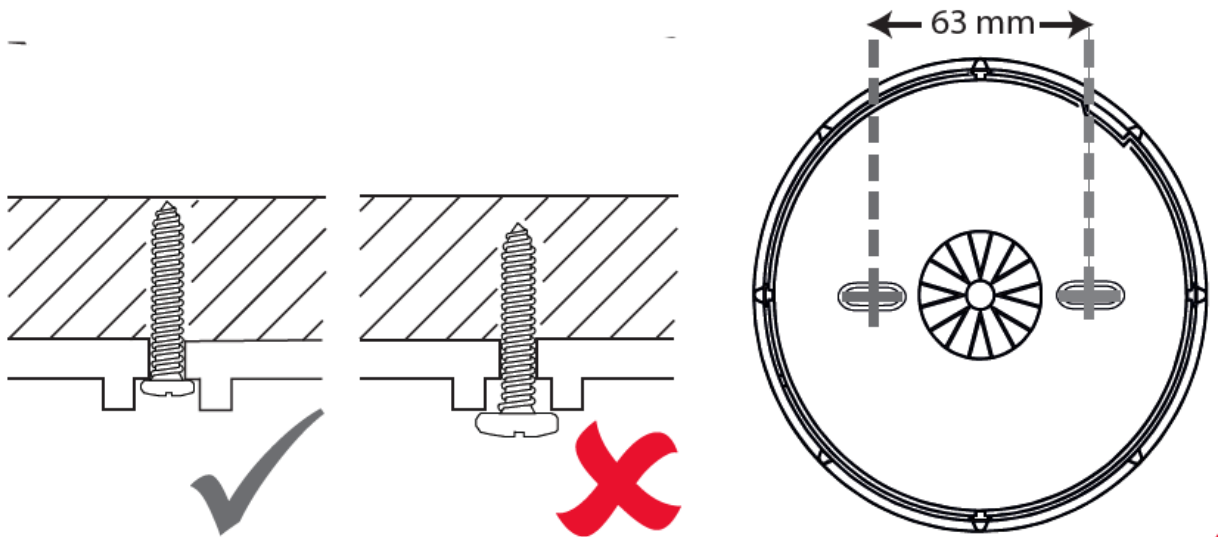

Power device


- When fitting / replacing batteries; observe correct polarity, using only specified batteries.
- Set switch 1 to the ON position to power the device. See the configuration section for other available switch settings.

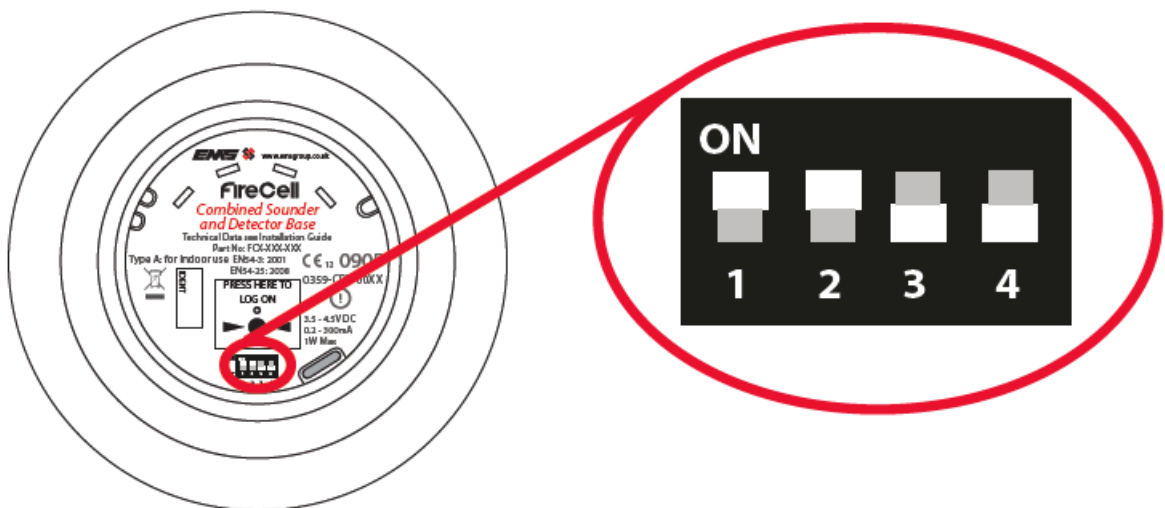

- Once powered, reassemble the device.

Optional device locking

- To lock the detector into the wireless module, remove the cut out (shaded) section as shown.

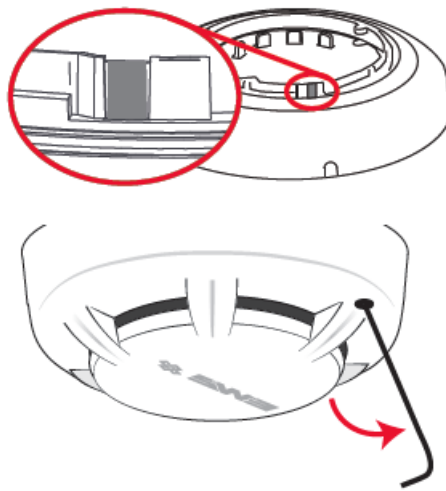

- To unlock the detector, insert a 1.5 mm Allen key and lever the Allen key towards the outside of the device and turn the detector anticlockwise to release.



- The wireless module can also be locked into the mounting plate by removing the shaded section shown and fitting a 5/16 Phillips pan head screw.

Configuration

The device's loop address is configured within the user interface's menu structure.

- Refer to the programming manual for full programming details.



FireCell = MK98


Fusion = TSD062





WZM = TSD143

Free to download from www.emsgroup.co.uk

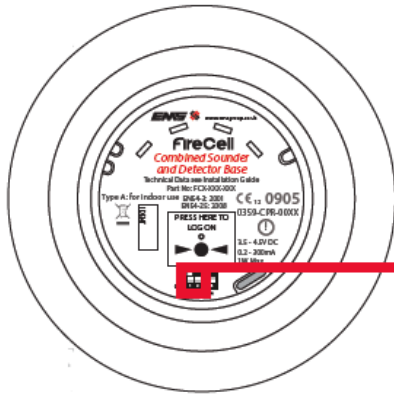Device powering/Sounder volume (Set on wireless module)

Switches 1-2 on the 4 way switch are used to power the device and to change the sounder volume.




SWITCHES 1 & 2	DEVICE POWERED?	SOUNDER VOLUME
ON  ON	✓	HIGH 87dB A (+/- 1dB)
ON  OFF	✓	LOW 74 dB A (+/- 1dB)
OFF  ON	✗	HIGH 87dB A (+/- 1dB)
OFF  OFF	✗	LOW 74 dB A (+/- 1dB)








Default setting: supplied unpowered with high sounder volume.

Sounder tone

(Set on wireless module)

Switches 3-4 on the 4 way switch are used to configure the sounder tone.



SWITCHES 3 & 4	PRIMARY TONE	TONE TYPE	TONE DESCRIPTION / APPLICATION	SECONDARY TONE	TONE TYPE	TONE DESCRIPTION / APPLICATION
ON  OFF	1	—	970Hz	18	—	2400Hz
OFF  ON	2		800Hz/970Hz @ 2Hz	1	—	970Hz
ON  ON	3		800Hz - 970Hz @ 1Hz	1	—	970Hz
OFF  OFF	5		970Hz, 0.5s / 630Hz, 0.5s	4	—	970Hz 1s OFF / 1s ON

Default setting: primary tone 5

IMPORTANT

- Remove dust cover before use.
- The device should be tested upon installation and in accordance with local requirements.
- Testing should only be carried out by a fully trained competent person.
- The Manufacturer recommends regular functional testing of at least once per annum or in accordance with local codes of practice.
- Cleaning and repairs must be undertaken by the Manufacturers authorized representative.
- Do not open the case to clean inside the detector.

Specification

- **Operating temperature**
 - -10 to +55 °C
- **Storage temperature**
 - 5 to 30 °C
- **Humidity**

- 0 to 95% non-condensing
- **Supply**
 - 3x AA alkaline (Panasonic LR6AD Powerline / Varta 4006 Industrial) & 3x C alkaline (Panasonic LR14AD Powerline / Varta 4014 Industrial)
 - CAUTION!** Fitting of an incorrect battery type invalidates the product certification and may result in poor performance.
- **IP rating**
 - IP23
- **Operating frequency**
 - 868 MHz
- **Output transmitter power**
 - Auto adjusting 0 to 14 dBm (0 to 25 mW)
- **Sounder output [4]**
 - 87 dB(A) at 1m (as dispatched).
 - Low setting reduces volume by 13 dB.
 - Refer to the sounder data document (MK187) for full details. Free to download from www.emsgroup.co.uk
- **Dimensions (Ø x D)**
 - 146 x 53 mm (no detector)
 - 146 x 89 mm (with smoke detector)
 - 146 x 94 mm (with heat detector)
 - 146 x 100 mm (with multisensor detector)
- **Weight**
 - 0.70 kg (with detector)
- **Location**
 - Type A: For indoor use

Regulatory Information

- **Manufacturer**
 - Carrier Manufacturing Polska Sp. Z o.o. Ul. Kolejowa 24. 39-100 Ropczyce, Poland
- **Year of manufacture**
 - See devices serial number label
- **Certification**

CE 20^[1] CE 10^{[2][3]} CE12^[4]

- **Certification body**
 - 0905
- **CPR DoP**
 - See part listing for associated products:
[1]0905-CPR-202126, [2]0359-CPR-0015,
[3]0359-CPR-0017 & [4]0359-CPR-0121
- **Approved to** See part listing for associated products:
 - EN54-3:2001. Incorporating Amendments Nos. 1 and 2. Fire detection and fire alarm systems. Part 3: Fire alarm devices – Sounders. [4]

- EN54-5:2001. Incorporating Amendment No. 1. Fire detection and fire alarm systems. Part 5: Heat detectors – Point Detectors. [2]
- EN54-7:2001. Incorporating Amendment No. 1. Fire detection and fire alarm systems. Part 7: Smoke detectors – Point detectors using scattered light, transmitted light or ionization. [1][3]
- EN54-25:2008. Incorporating corrigenda September 2010 and March 2012. Fire detection and fire alarm systems. Part 25: Components using radio links. [4]

• European Union directives

- EMS declares that this device is in compliance with Directive 2014/53/EU. The full text of the EU declaration of conformity is available at the following internet address: www.emsgroup.co.uk



2012/19/EU (WEEE directive): Products marked with this symbol cannot be disposed of as unsorted municipal waste in the European Union. For proper recycling, return this product to your local supplier upon purchase of equivalent new equipment, or dispose of it at designated collection points. For more information see www.recyclethis.info Dispose of your batteries in an environmentally friendly manner according to your local regulations.

Documents / Resources

	<p>firecell FCX-191 Combined Sounder Detector Visual Indicator [pdf] User Manual FCX-191 Combined Sounder Detector Visual Indicator, FCX-191, Combined Sounder Detector Visual Indicator, FCX-191 Detector Visual Indicator, FCX-191 Visual Indicator</p>
--	--

References

-  [Leading brand of Wireless Fire alarms systems - EMS Firecell](#)
-  [HOME](#)