




FLOMEC 1-4-2022 QSI Module Owner's Manual

[Home](#) » [Flomec](#) » FLOMEC 1-4-2022 QSI Module Owner's Manual 

Contents

- [1 FLOMEC 1-4-2022 QSI Module](#)
- [2 INTRODUCTION](#)
- [3 SPECIFICATIONS](#)
- [4 INSTALLATION](#)
- [5 TEMPERATURE PROBES](#)
- [6 MAINTENANCE](#)
- [7 TWO-YEAR LIMITED WARRANTY](#)
- [8 Documents / Resources](#)
 - [8.1 References](#)
- [9 Related Posts](#)



FLOMEC 1-4-2022 QSI Module



INTRODUCTION

The QSI communications module is a multiple-capability electronics package. For the QSE meter, the module is available with the plain cover plate only. The QSI module has three versions (QSI1, QSI2, or QSI3) available; each with its own mix of capabilities to better serve the customer (See Versions below).

- QSI1 is equipped with Bluetooth®, **coil/digital pulse input, pulse output (flow or energy & scalable), RS485 (Modbus® RTU), temperature inputs, and BTU calculator.
- QSI2 is equipped with Bluetooth®, **coil/digital pulse input, pulse output (flow or energy & scalable), data logger, temperature inputs, and BTU calculator.
- QSI3 is equipped with Bluetooth®, **coil/digital pulse input, pulse output (flow scalable), data logger, and 4-20mA output.

NOTE: The coil/digital input connections are for use with equipment other than a QSE meter. QSE meters automatically provide coil/digital pulse input via the 10-pin ribbon cable from the AFE PC board. This manual contains information and meter wiring diagrams for the three different QSI electronics modules.

IMPORTANT NOTICE

QSI module electronics are very sensitive to electric noise if operated within 6 inches of some electric motors, relays, transformers or other sources of electronic noise.

If the QSI electronics are used in a manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

GENERAL INFORMATION

QSI electronics are available integrated into the meter you ordered, and converts the voltage (or pulses) from the meter into usable information.

The QSI module electronics is powered by customer- supplied external power.

SAFETY

- This product is not approved for use in hazardous locations.
- Be sure O-rings and seals are kept in good repair.

- When applying power, adhere to specifications in this manual.
- Disconnect external power before attaching or detaching input or output wires.

SPECIFICATIONS

MECHANICAL	
Cover Plate Port Threads	Female 1/2-20 UNF-2B (Compatible with PG7 thread)
Port Strain Relief	Hubble PG7
Grip Range	0.11"-0.26" (2.79 – 6.6mm)
Operation Temperature	+32°F to +140°F (0°C to +60°C)
Ambient Air Operation Temp	0°F to +140°F (-18°C to +60°C)

Port Conduit Adapter	GPI PG7 x 1/2 in. NPT Male
Operation Temperature	+32°F to +140°F (0°C to +60°C)
Ambient Air Operation Temperature	0°F to +140°F (-18°C to +60°C)
Recommended Cable	Belden #9501 (2-Conductor w/Drain Wire, Shielded)
POWER SUPPLY	
Voltage Requirement	Min. 12 VDC (voltages below 12V will result in meter accuracy issues)

	<p>Max. 36 VDC</p> <p>(higher voltage may damage unit)</p>
Battery Backup (QSI2, QSI3 Only)	Coin cell lithium, 3V (CR2032)
MAX POWER CONSUMPTION	
QSE Meter with QSI	<p>170mA</p> <p>4 watts @ 24VDC 6 watts @ 36VDC</p>

ELECTRICAL	
Pollution Degree	2
Installation Category	1
Altitude	2000m Max.

Indoor use only

OUTPUTS & COMMUNICATION

QSI Version 1:

Bluetooth

Coil/Digital Pulse Input**

Pulse Output

RS485

Temperature Inputs

BTU Calculator

QSI Version 2:

Bluetooth

Coil/Digital Pulse Input**

Pulse Output

Data Logger

Temperature Inputs

BTU Calculator
QSI Version 3:
Bluetooth
Coil/Digital Pulse Input**
Pulse Output
Data Logger
4-20mA output

NOTE:

The coil/digital input connections are for use with equipment other than a QSE meter. QSE meters automatically provide coil/digital pulse input via the 10-pin ribbon cable from the AFE PC board.

INSTALLATION

CAUTION: Installation near high electromagnetic fields and high current fields is not recommended and may result in inaccurate readings.

If you ordered your QSI module electronics with a QSE meter, it is installed at the factory. If you ordered your QSI module electronics separately (i.e. repair part), follow the instructions below to install them on a QSE meter. If you ordered your QSI module with one of our several types of meter adapter kits, follow the separate instructions enclosed with the kit to install the unit. In every case, please review and thoroughly understand all manuals and installation instructions before proceeding.

To mount your QSI module to a QSE meter:

- Install the cover plate seal.
- Connect the QSI module PC board connector to the AFE module PC board connector inside the meter housing with the ribbon cable. The ribbon cable connectors are polarized and cannot be incorrectly connected (see Figure 1).
- Install the cover plate with screw holes aligned.
- Install the (6) cover plate screws and tighten them. Make sure the cover plate seal is fully seated before tightening the screws.

A ribbon cable connects the QSI electronics within the cover plate to the AFE electronics within the meter body and allows 180 degrees of movement in either direction (see Figure 2).

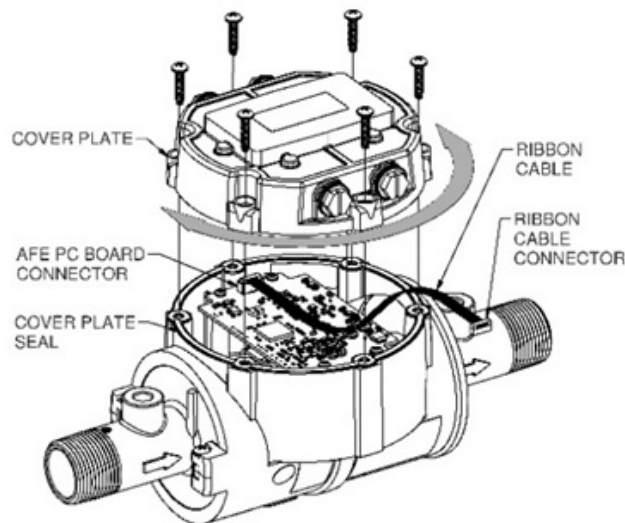


Figure 1

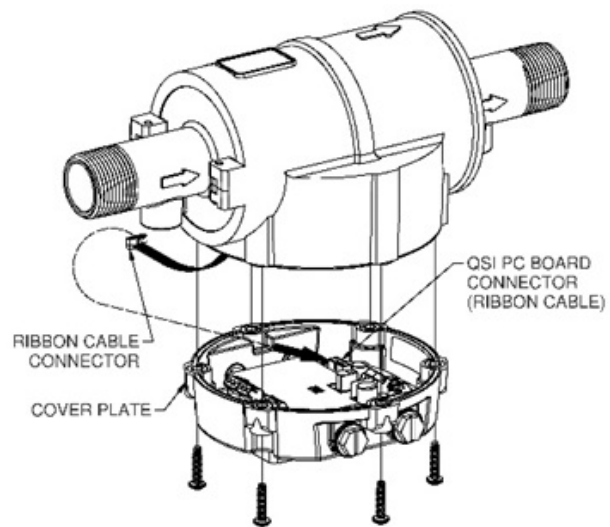


Figure 2

WIRING

The cover plate has four threaded ports, compatible with PG7 threads, for gaining wiring access to the electronics inside the cover plate. The meter is shipped with the ports environmentally sealed with a threaded plug and seal. Remove one or more of these plugs as required to install the supplied port fittings below.

Each meter is supplied with cable gland strain reliefs with O-rings and 1/2 NPT adapters with seals for use in the threaded ports of the meter cover plate. Select the port fittings that fit your process and replace the threaded plugs in the cover plate with the fittings as required. The threaded plugs installed at the factory may be left in any unused cover plate port indefinitely.

It is recommended that a “removable” thread-locker (fluid, stick, tape, spray, etc.) be used when installing the strain reliefs or adapters into the cover plate ports.

Strain Reliefs

The cable gland strain reliefs will accommodate a cable diameter of 0.11 – 0.26 inches (2.79 – 6.6mm) and provide an environmental seal around the cable when the dome-nut is tightened.

NPT Adapters

The 1/2 NPT adapter fittings are used for attaching flex conduit to the meter, for those applications that require cable runs to be enclosed in conduit.

NOTE: Cable to be provided by customer to accommodate job requirements. Cable is not included with meter.

ISOLATED POWER SUPPLY WIRING

The QSE meter has an internal connection to the conductive fluid through one of the electrodes. The fluid and/or plumbing in most applications should be earth grounded to prevent any static buildup and provide a proper grounding for the system. Therefore, the power supply connection to the QSI should have an earth ground isolated output to prevent ground loop currents. Failure to use an isolated power supply could result in ground

faults and could cause accuracy issues caused by stray voltages due to the ground loop currents. Proper grounding is a requirement.

The wire gauge for the power supply cable should be between 16 to 26 AWG to properly fit in the wire termination connector. The external power supply used for supplying power to the QSI should be rated for a minimum of 0.25 Amps.

The power supply polarity is not a requirement for the DC supply as long as the supply is properly earth ground isolated.

TERMINAL CONNECTIONS CHART

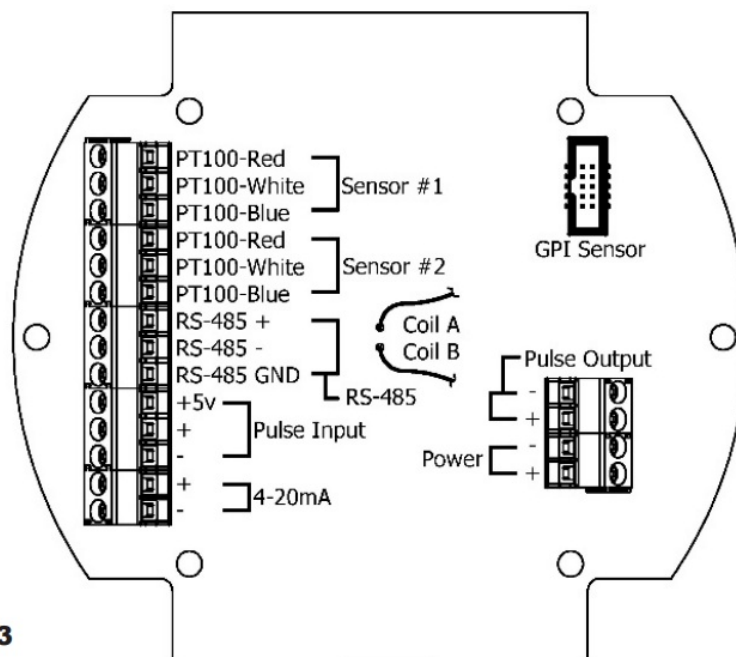


Figure 3

TEMP SENSOR	
PT100-Red	Sensor VCC Output
PT100-White	Input High Side
PT100-Blue	Input Return
RS-485 (Galvanically Isolated)	
RS485 (+)	Positive Signal
RS485 (-)	Negative Signal

RS485 GND	Circuit Ground*
PULSE INPUT	
+5V	5VDC output to power external sensor
(+)	Digital Pulse Frequency Input, up to 3kHz
(-)	Digital Pulse Return
4-20mA (Galvanically Isolated)	
(+)	4 to 20mA current loop- current in to transmitter
(-)	4 to 20mA current loop- current out of transmitter*


Coil A	Low level sine wave input
Coil B	Low level sine wave input
GPI SENSOR	

Ribbon cable connection to GPI custom sensor designs	
PULSE OUTPUT (Galvanically Isolated)	
(-)	Pulse Output return current*
(+)	Pulse Output frequency output. This is a “current sinking open collector” output ***
POWER INPUT	
(-)	12-36VDC Input A**
(+)	12-36VDC Input B**


NOTE: It is not recommended to connect isolated ground connections together or to board common. Polarity of voltage for AC/ DC is not important. However, an earth ground isolated power supply is required to prevent earth ground loop currents and ground fault conditions. This output may require an external pull up resistor if interfacing equipment does not include one.

QSI1 WIRING

QSI VERSION 1 PC BOARD
RS-485
BTU

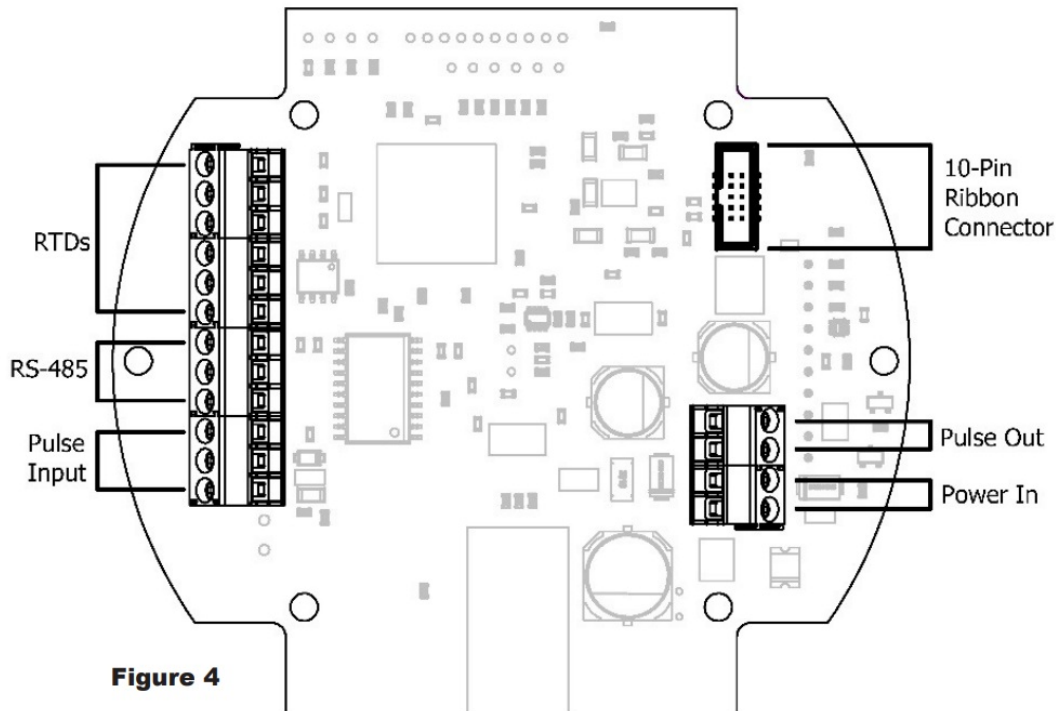

Inputs: Temperature Sensors, GPI Custom Sensor Outputs: RS-485, Pulse Output

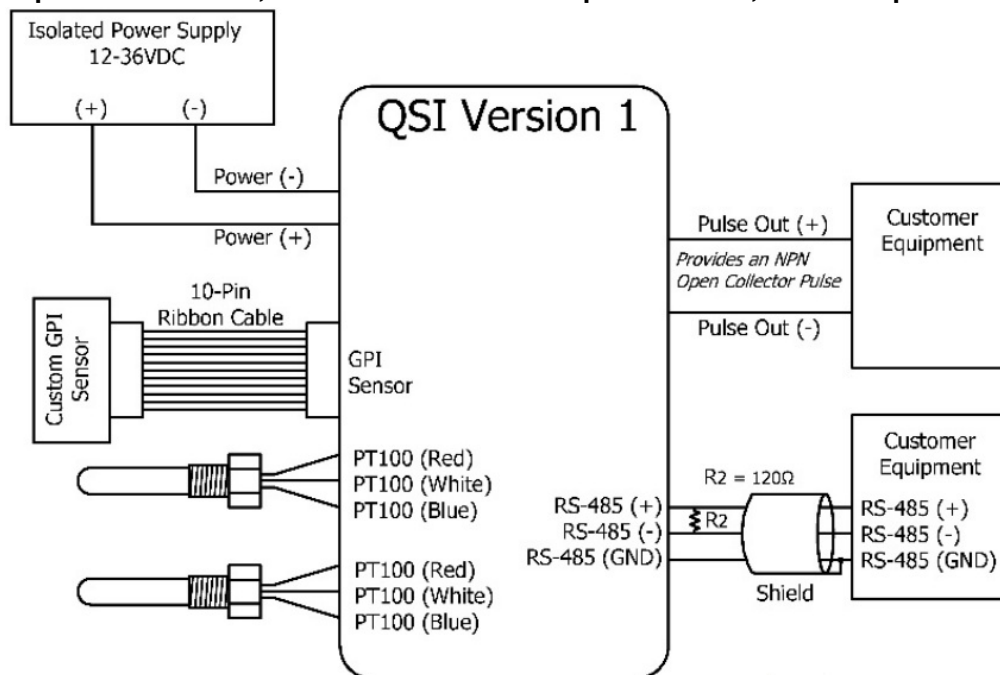

R2 NOTE: The QSI does not contain an internal termination resistor. Refer to Customer Equipment documentation for proper installation and the resistance value of the external R2 resistor.

QSI2 WIRING

QSI VERSION 2 PC BOARD Pulse In

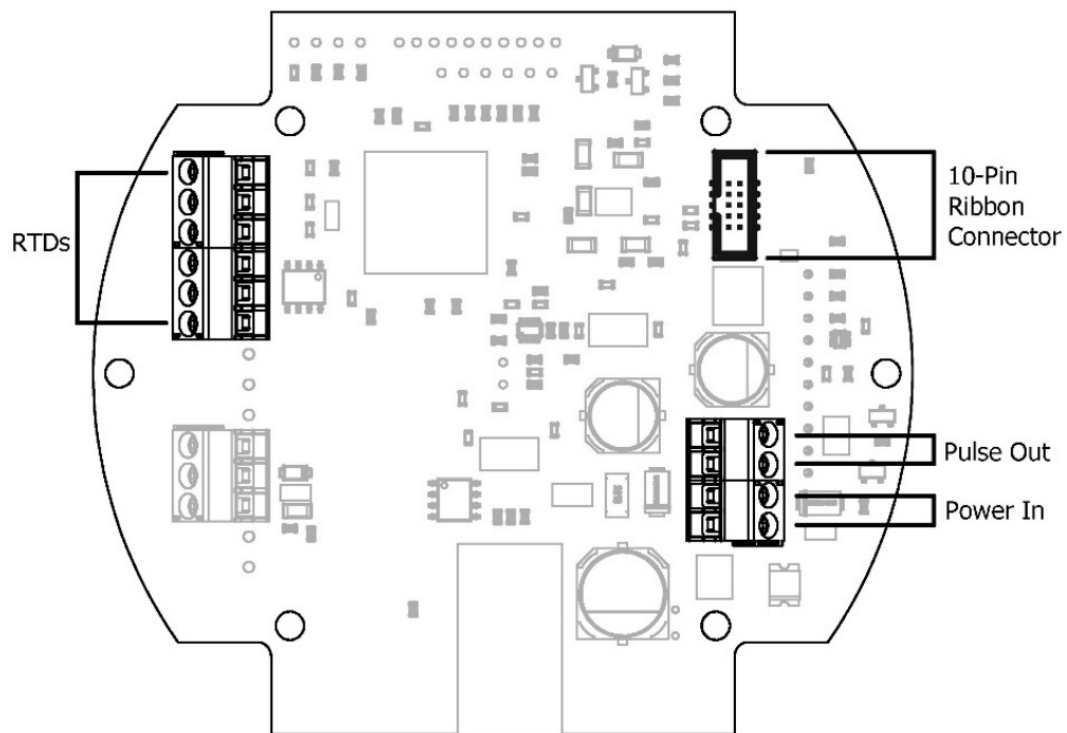


Figure 6

Inputs: Temperature Sensors, GPI Custom Sensor Outputs: Pulse Output

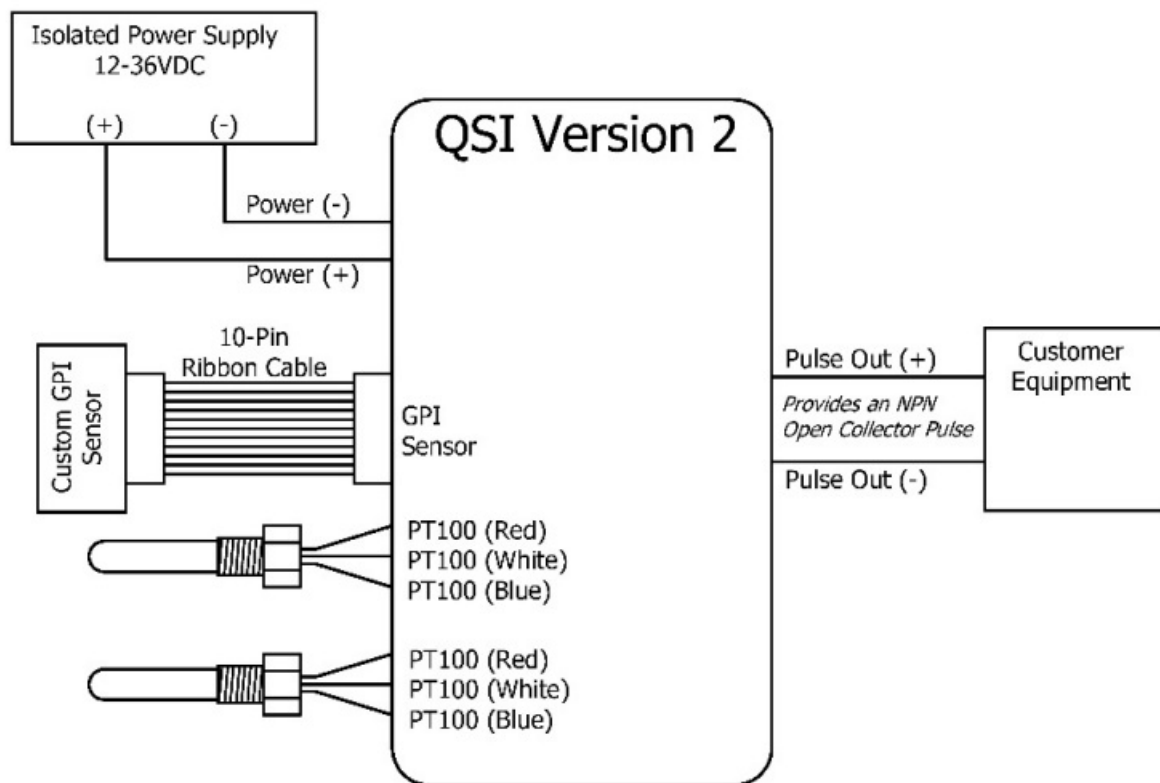


Figure 7

QSI3 WIRING

QSI VERSION 3 PC BOARD

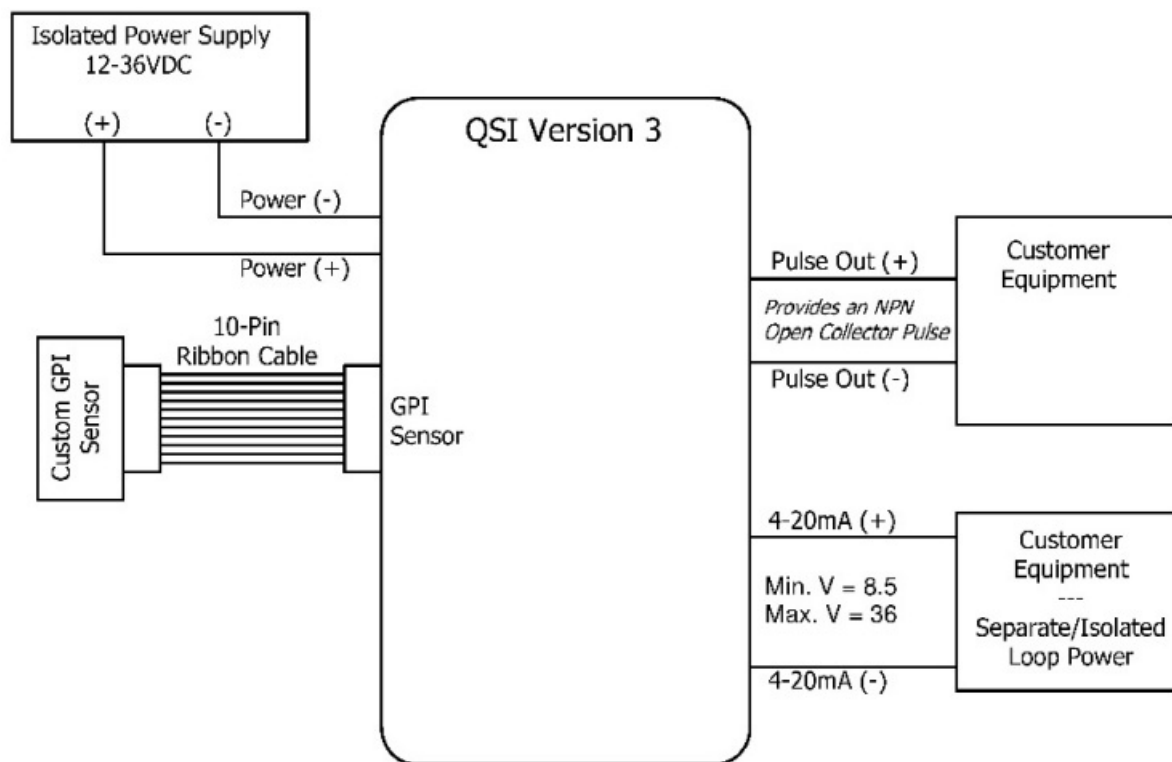


Figure 9

Inputs: GPI Custom Sensor Outputs: 4-20mA, Pulse Output Customer Equipment without Built-in Power Supply 4-20mA Output with Separate Power Supply

Note: Either of the wiring diagrams below (Low Side Negative Wiring-Figure 10A) or (High Side Positive Wiring-Figure 10B) are valid, as long as the current direction arrows and the (+) and (-) connections on all of the equipment in the loop are correct.

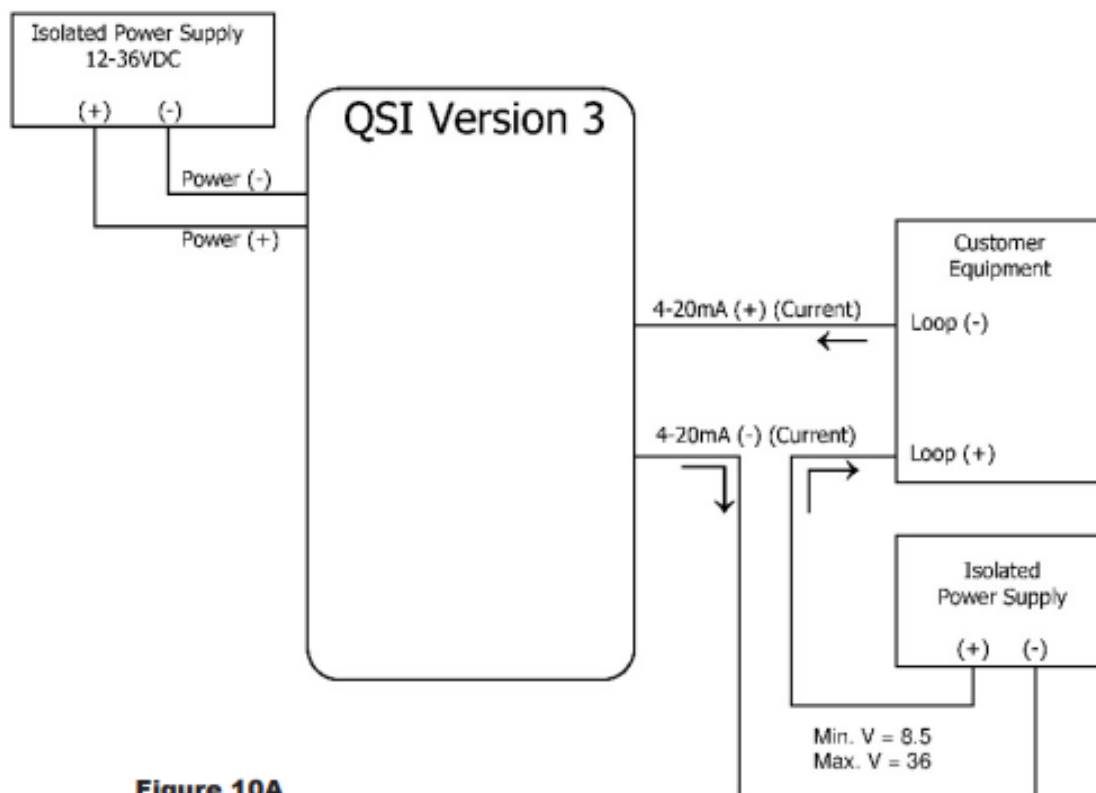


Figure 10A
Low Side (Negative) Wiring

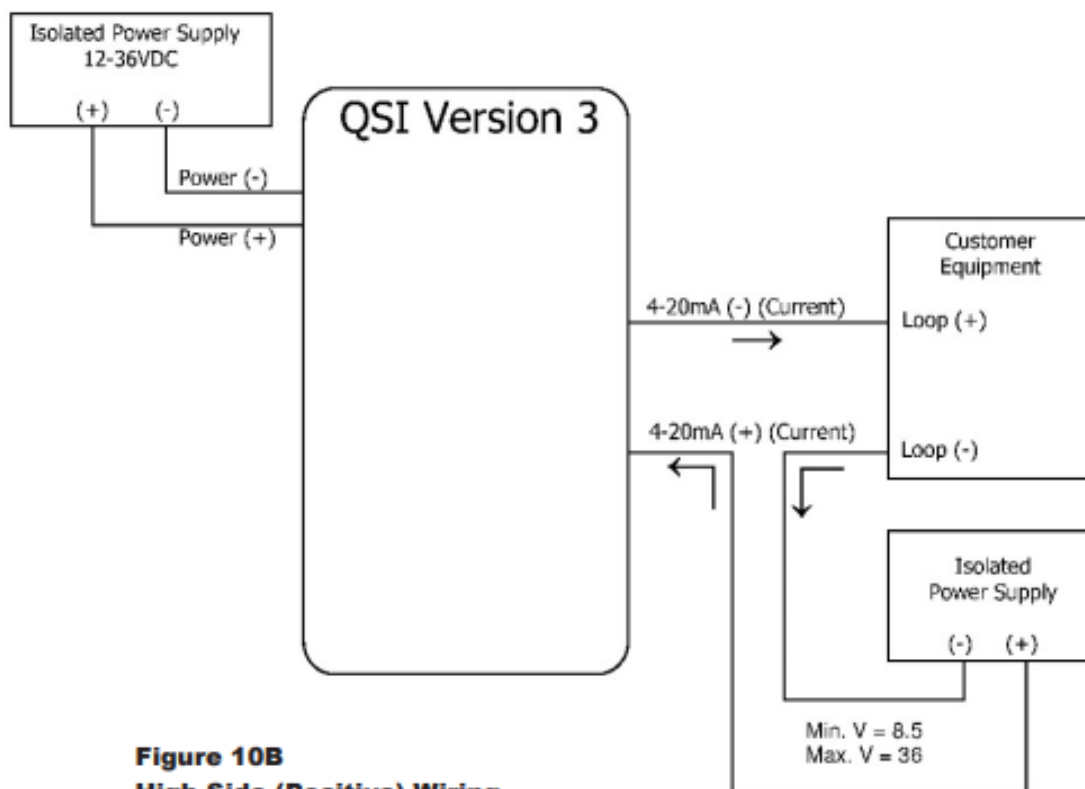


Figure 10B
High Side (Positive) Wiring

FLOMEC APP FOR ANDROID

To learn how to get started using the FLOMEC App, visit: flomecmeters.com/downloads/flomec-app-quickstart.pdf



TEMPERATURE PROBES

If you ordered a QSI1 or QSI2 electronic choice with the temperature probe option, the correct length probes with cables are installed near the inlet and outlet ends of the meter. The cables are not connected to the QSI PC board. If you are installing a temperature probe retrofit kit, you will need to install the probes on the meter.

CAUTION: The temperature probes are not NSF certified. Installation of temperature probes will invalidate NSF approval.

Enclosed with your meter is a stainless steel pipe plug. It will be used during the set-up process.

INSTALLATION


- **NOTE:** The meter should be installed in the system return line for accurate BTU calculations.
- Each of the (2) temperature probes has a 10 ft. cable. The threaded body of the probe has 1/8" NPT threads to fit a standard 1/8" NPT port (see Figure 11).
- The cable used with the probes has a smaller diameter than the standard strain reliefs (black), installed on the meter at the factory, will allow. Therefore, (2) reduced fit strain reliefs (gray) are included with the probes. For probe cable entry through the ports of the meter cover plate (to wire the system) replace (2) of the (black) strain reliefs in the cover plate with these reduced fit strain reliefs. The entire cable length is used for each probe installation. Both cables require a matched length.
- Typically, a temperature probe is installed initially in each of the 1/8" NPT ports of the meter to calculate the differential between the two probes, if any.
- The differential is captured and shown in the Android application as "Temp 1" and "Temp 2" and is used in the BTU calculations to ensure an accurate calculation.
- For clarity, one probe is considered PT100 #1 and is connected to the meter PC board in that location. It is shown as "Temp 1" in the Android application.
- The other probe is then considered PT100 #2 and is connected to the meter PC board in that location. It is shown as "Temp 2" in the Android application.
- To perform the differential check, the probe installed in the 1/8" NPT port near the meter outlet end should be considered PT100 #1.
- The probe installed in the 1/8" NPT port near the meter inlet end should be considered PT100 #2.
- See Figures 5 and 7 for wiring diagrams.
- After wiring the probes to the correct terminal of the PC board, perform the differential check.
- **NOTE:** Use thread sealant on the male threads of the probes when installing in either the meter ports or system port.
- After performing the differential check, remove the PT100 #2 probe near the inlet end of the meter and install the pipe plug, received with your meter, in the open meter port. Install the removed probe in the system supply

line.

- **NOTE:** Use thread sealant on the male threads of the pipe plug when installing it in the meter port.
- During normal system operation, probe PT100 #1 is installed at the meter outlet end and probe PT100 #2 is installed in the system supply line. Accurate system BTU usage is calculated between the (2) probes.
- The excess cable from the PT100 #1 probe (on the meter) to the cover plate may be coiled and secured using plastic quick ties.

WIRING

See Figures 5 and 7 for wiring diagrams.

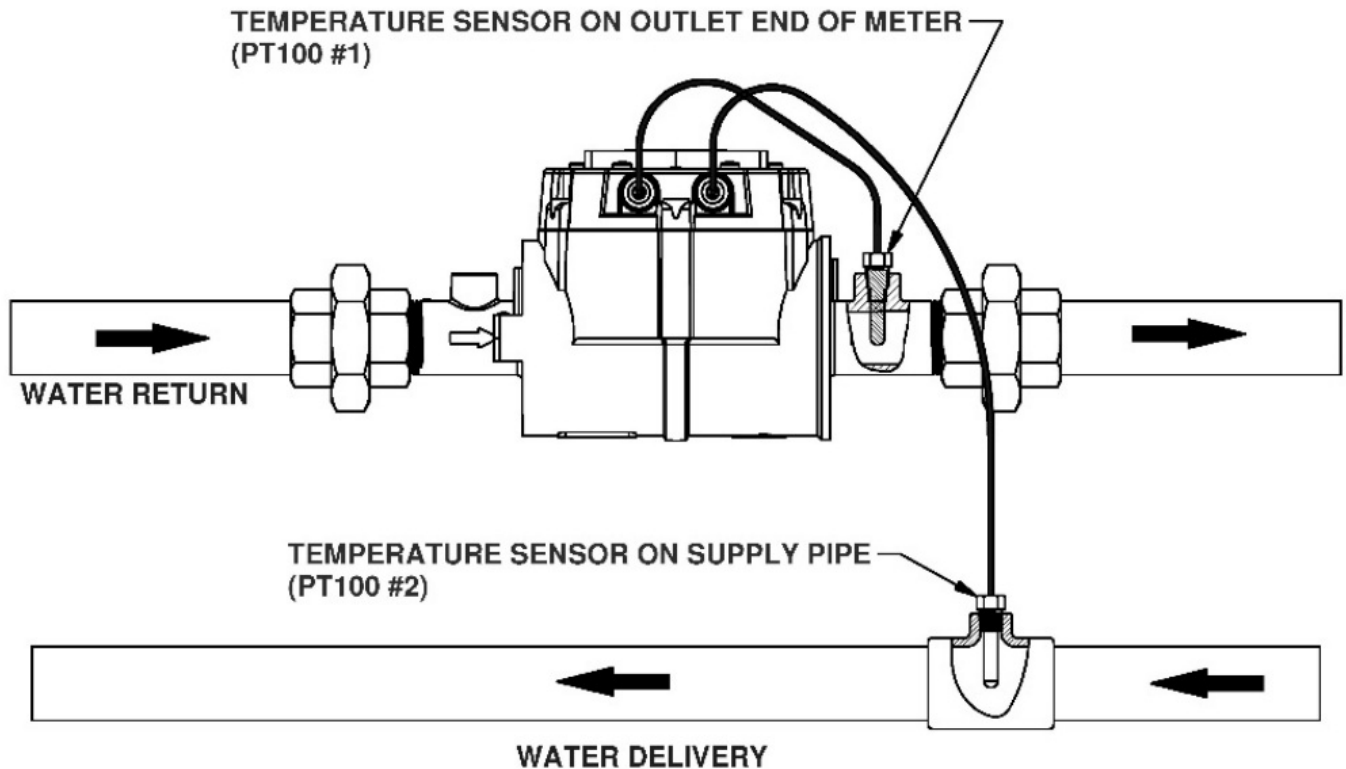

MAINTENANCE

Check cable-entry seals periodically. Tighten and/or apply sealant if needed. This is especially important in environments containing heavy concentrations of dust, oil mist, or other residue.

Check all wiring connections occasionally for oxidation or corrosion. Clean and re-seat if such conditions are noted.

If necessary, check and re-seat any connections that may have been subjected to strain (during rework or construction, for example).

REPLACING BATTERY

The QSI2 and QSI3 communications module has a 3V lithium coin cell battery installed on the PC board. In case of power failure, the battery functions as power backup to maintain the internal system time. Any QSI2 or QSI3 feature that uses a time reference as part of its functionality will be immediately accurate to the current time when power is restored. To Replace Battery:

DISCONNECT POWER TO METER

- Remove (6) screws retaining the cover plate to the meter body and lift the cover plate free of the meter body (see Figure 12).
- Flip the cover plate over and remove (4) screws retaining the PC board assembly (see Figure 13).

- Remove and replace the coin cell battery (CR2032) on the backside of PC board (see Figure 14).
- Reverse the procedure to reassemble the cover plate to the meter. Make sure the cover plate seal is seated before tightening the (6) cover plate screws.

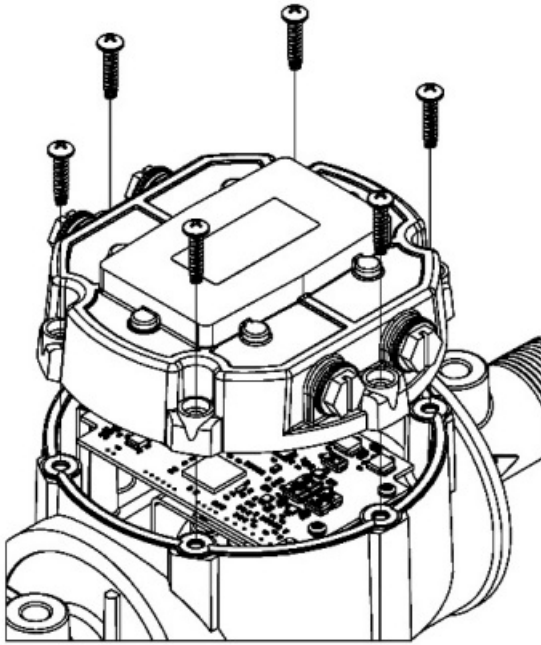


Figure 12

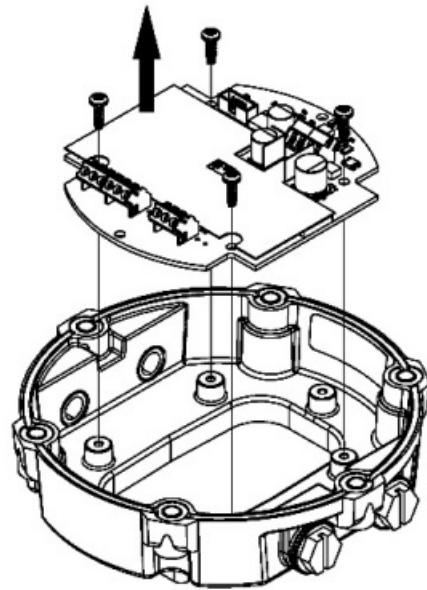


Figure 13

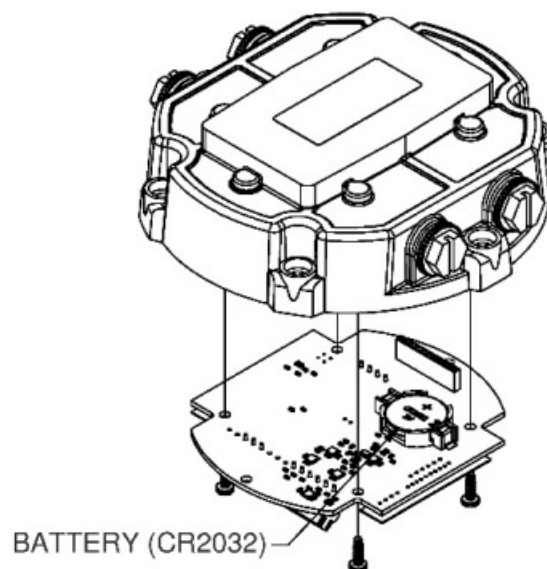


Figure 14

SERVICE

For warranty consideration, contact your local distributor. If you need further assistance, contact the GPI Customer Service Department at: **1-888-996-3837**

You will need to:

- Provide information from the decal on your meter.
- Receive a Return Authorization number.
- Flush any fluid from the meter before shipping to the factory.

RETURNING PARTS

Please contact the factory before returning any parts. It may be possible to diagnose the trouble and identify needed parts in a telephone call. GPI can also inform you of any special handling requirements you will need to follow covering the transportation and handling of equipment which has been used to transfer hazardous or flammable liquids.

CAUTION: Do not return equipment without specific authority from the GPI Customer Service Department. Due to strict regulations governing transportation, handling, and disposal of hazardous or flammable liquids, GPI will not accept equipment for rework unless it is completely free of liquid residue.

APPROVALS & RATINGS



RoHS Compliant (2011/65/EU)

This product is in compliance with the RoHS Directive of the European Parliament and of the Council on the Restriction of the Use of Certain Hazardous Substances in Electrical and Electronic Equipment.

TWO-YEAR LIMITED WARRANTY

Great Plains Industries, Inc. 5252 E. 36th Street North, Wichita, KS USA 67220-3205, hereby provides a limited warranty against defects in material and workmanship on all products manufactured by Great Plains Industries, Inc. This product includes a 2-year warranty. Manufacturer's sole obligation under the foregoing warranties will be limited to either, at Manufacturer's option, replacing or repairing defective Goods (subject to limitations hereinafter provided) or refunding the purchase price for such Goods theretofore paid by the Buyer, and Buyer's exclusive remedy for breach of any such warranties will be enforcement of such obligations of Manufacturer. The warranty shall extend to the purchaser of this product and to any person to whom such product is transferred during the warranty period.

The warranty period shall begin on the date of manufacture or on the date of purchase with an original sales receipt. This warranty shall not apply if:

- A. the product has been altered or modified outside the warrantor's duly appointed representative;
- B. the product has been subjected to neglect, misuse, abuse or damage or has been installed or operated other than in accordance with the manufacturer's operating instructions.

To make a claim against this warranty, or for technical assistance or repair, contact your FLOMEC distributor or contact FLOMEC at one of the locations below.

- **In North or South America contact**

- Great Plains Industries, Inc. 5252 East 36th St. North Wichita, **KS 67220-3205**
- **USA 888-996-3837**
- www.flomecmeters.com
- **(North America)**
- Outside North or South America contact
- **GPI Australia**
- (Trimec Industries Pty. Ltd.)
- 12/7-11 Parraweena Road
- **Caringbah NSW 2229**
- **Australia**

- +61 02 9540 4433
- www.flomec.com.au

The company will step you through a product troubleshooting process to determine appropriate corrective actions. GREAT PLAINS INDUSTRIES, INC., EXCLUDES LIABILITY UNDER THIS WARRANTY FOR DIRECT, INDIRECT, INCIDENTAL AND CONSEQUENTIAL DAMAGES INCURRED IN THE USE OR LOSS OF USE OF THE PRODUCT WARRANTED HEREUNDER.


The company herewith expressly disclaims any warranty of merchantability or fitness for any particular purpose other than for which it was designed.

This warranty gives you specific rights and you may also have other rights which vary from U.S. state to U.S. state.

NOTE: In compliance with MAGNUSON MOSS CONSUMER WARRANTY ACT – Part 702 (governs the resale availability of the warranty terms).

© 2021 Great Plains Industries, Inc., All Rights Reserved. Great Plains Industries, Inc. / 888-996-3837 / flomecmeters.com

Documents / Resources

	<p>FLOMEC 1-4-2022 QSI Module [pdf] Owner's Manual 1-4-2022 QSI Module, 1-4-2022, QSI Module, Module</p>
--	--

References

- [Home - FLOMEC](#)
- [FLOMEC® - Flow Meter & Instrumentation Manufacturer](#)
- [Home - FLOMEC](#)