



GE current LPL Gen C Series Lumination LED Luminaire Installation Guide

[Home](#) » [GE current](#) » GE current LPL Gen C Series Lumination LED Luminaire Installation Guide 

Contents

- [1 GE current LPL Gen C Series Lumination LED Luminaire](#)
- [2 Save These Instructions](#)
- [3 Prepare Electrical Wiring](#)
- [4 Luminaire Installation](#)
- [5 Electrical Connections](#)
- [6 Optional Installation: 0-10V Volt Dimming](#)
- [7 Documents / Resources](#)
- [8 Related Posts](#)



GE current LPL Gen C Series Lumination LED Luminaire



BEFORE YOU BEGIN

Read these instructions completely and carefully.

WARNING

- **RISK OF ELECTRIC SHOCK**
 - Turn power off before inspection, installation or removal.
 - Properly ground electrical enclosure.
- **RISK OF FIRE**
 - Follow all NEC and local codes.
 - Use only UL approved wire for input/output connections. Minimum size 18 AWG (0.75mm²).
 - Do not install insulation within 3 inches (76 mm) of luminaire top.

Save These Instructions

Use only in the manner intended by the manufacturer.

If you have any questions, contact the manufacturer.

This device complies with Part 15 of the FCC Rules. Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation. CAN ICES-005(A)/NMB-005(A)

Note: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

Prepare Electrical Wiring

• Electrical Requirements



- The LED luminaire must be connected to the mains supply according to its ratings on the product label.
- Class 1 wiring should be in accordance with NEC.

• Grounding Instructions



- The grounding and bonding of the overall system shall be done in accordance to local electric code of the country where the luminaire is installed.

Luminaire Installation


- Carefully unpack unit from its packaging. Properly inspect for defects before installing. Wear work gloves to prevent dirt and oil from being transferred to the luminaire.
- Remove the fixture from the package. Default lumen level is H(high), default CCT is 4000K. If a lumen level other than H(high) is desired, or CCT other than 4000K is preferred, remove switch cover and set to the desired lumen level, or preferred CCT by screwdriver, then re-attach cover.

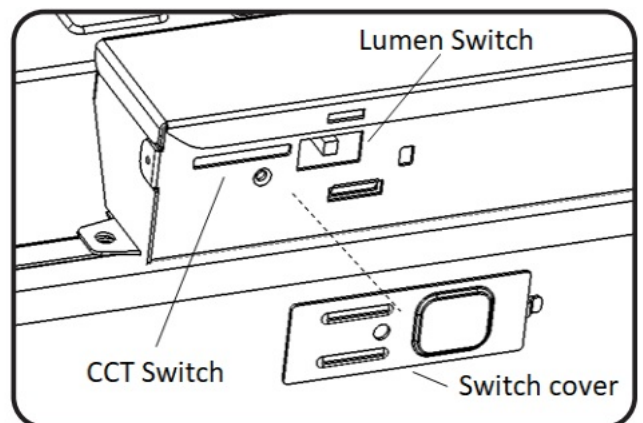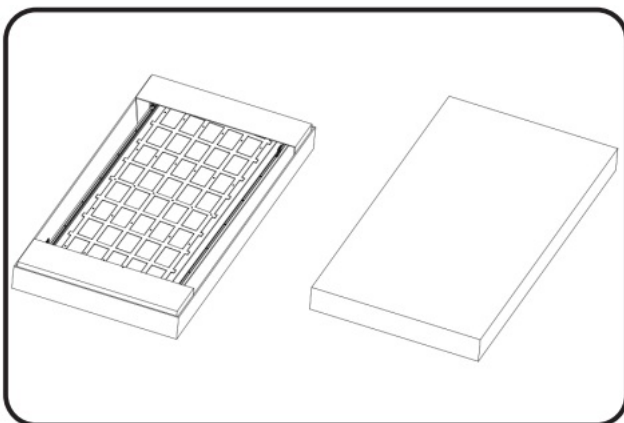

- Insert luminaire into T-bar ceiling grid. Unit should not move freely within the ceiling grid. To ensure a consistent appearance, align fixtures in the same orientation throughout the ceiling pattern.

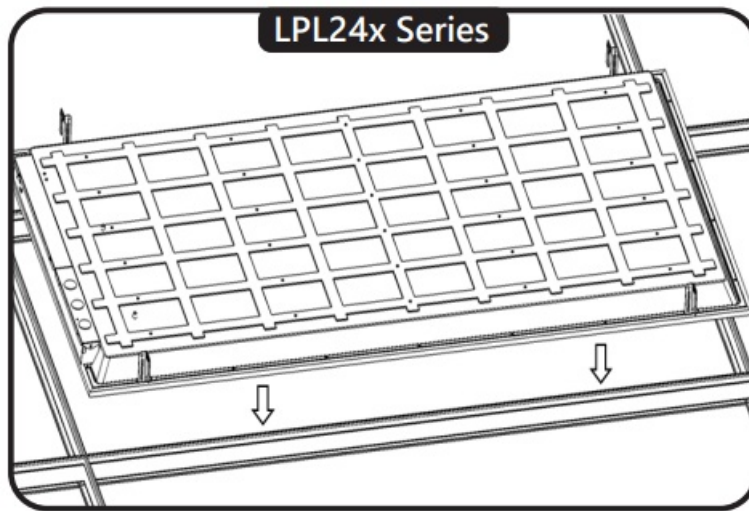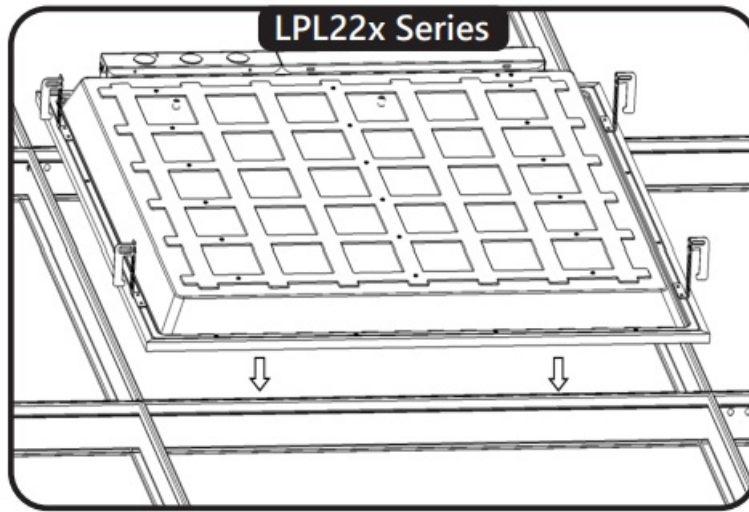



- Bend the brackets on the back plate to make sure they hook to T-Bar.
Secure safety cable to connection hole as needed to meet local seismic requirements. Safety cable and method of attachment to the building are provided by contractor according to local building codes.

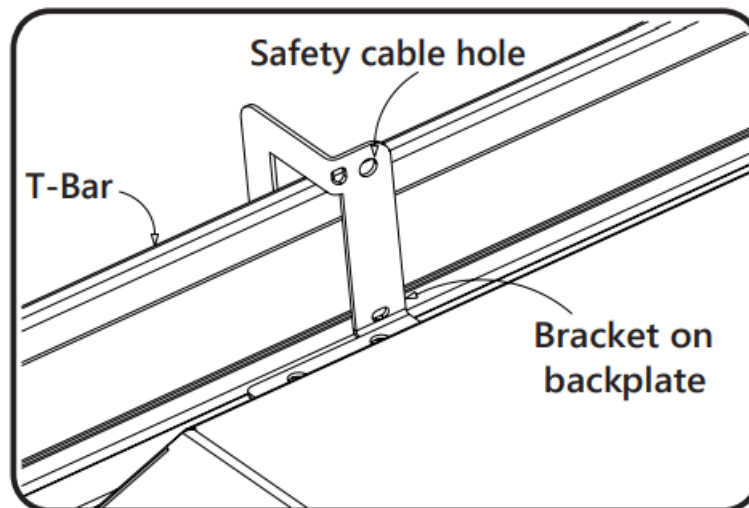


	L	M	H	CCT
2BY2:	2360lm	3670lm	4290lm	3500k/4000k
2BY4:	3180lm	4190lm	4830lm	3500k/4000k

Electrical Connections

- Remove electrical enclosure cover. Carefully remove knockout for AC line input wires. Install listed electrical fittings in the knockout holes for wire protection.
- Connect the AC line to the black (line) and white (neutral) input wires of the LED driver using 18-14 AWG twist-on wire connectors. Connect the ground wire to the green-yellow ground wire of the LED driver. When connecting dimming controller, wires must run through a separate knockout hole equipped with an appropriate wire restraint or cable gland. Then, re-attach and fix enclosure cover with screw by screw driver.

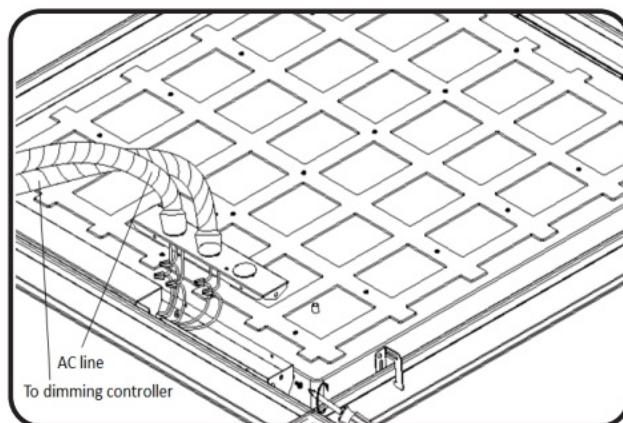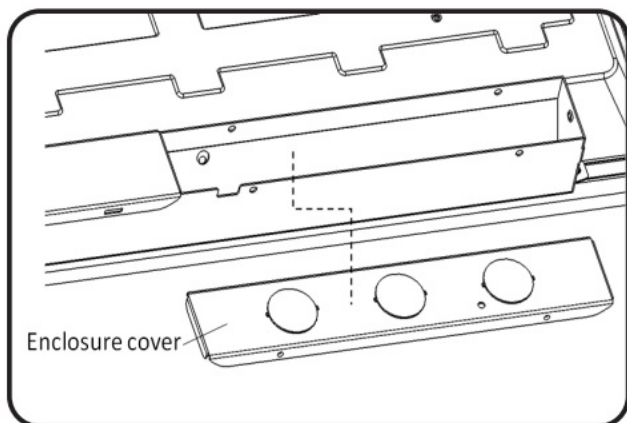

Optional Installation: 0-10V Volt Dimming

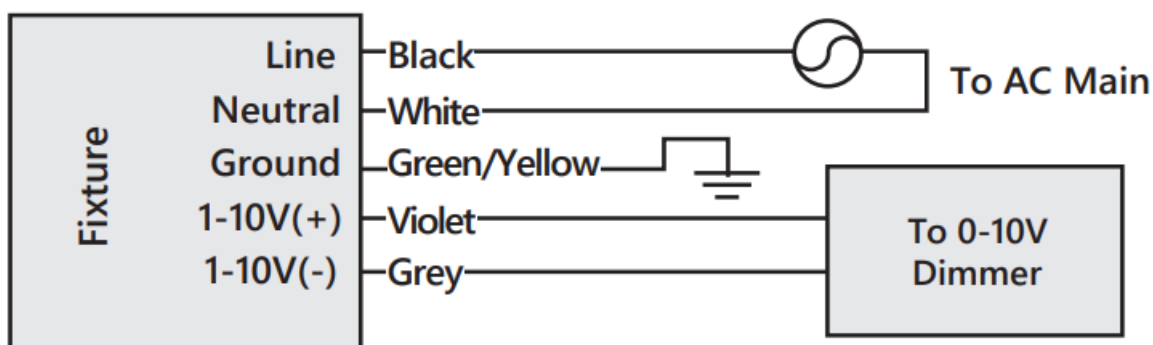

Option for Step 2: Follow diagram for 0-10V. Run wires from controller through a different knockout than the AC input wire. At output side of fixture, make appropriate connections using twist-on wire connectors. To combine with LFAMBA0VQFAEL, LCAMBA0NRFAEL, LCAMBA0TSFAEL, LCAMBA0TQFAEL, LFAMBADVQFA, LCAMBA0NRFAB2, LCAMBA0TSFAB2, LCAMBA0TQFAB2, LCAMBA0NRFA, LCAMBA0TSFA or LCAMBA0TQFA, please follow the install instructions provided with those products.


NOTE: Please cover dimming leads with wire nuts if you will not connect with dimming leads.

www.gecurrent.com

© 2021 Current Lighting Solutions, LLC. All rights reserved. GE and the GE monogram are trademarks of the General Electric Company and are used under license. Information provided is subject to change without notice. All values are design or typical values when measured under laboratory conditions.

IND572 (Rev 02/15/21) A-1027244

Documents / Resources



[GE current LPL Gen C Series Lumination LED Luminaire](#) [pdf] Installation Guide
IND572, A-1027244, LPL Gen C Series Lumination LED Luminaire, LPL Gen C Series, Lumina
tion LED Luminaire, LED Luminaire, Lumination Luminaire, Luminaire