



Home » GOODWE » GOODWE MPD Series Automatic Backup Device Installation Guide 📆



MPD Series Automatic Backup Device Installation Guide



Contents [hide]

- 1 IMPORTANT SAFETY INSTRUCTIONS
- 2 Product Introduction
- 3 Installation
- 4 Electrical Connection
- 5 Equipment Commissioning
- 6 Maintenance
- 7 Technical Parameters
- 8 Documents / Resources
 - 8.1 References

IMPORTANT SAFETY INSTRUCTIONS

SAVE THESE INSTRUCTIONS

You shall follow all the safety precautions mentioned in this manual when working on the device.

WARNING

The product is designed and tested to strictly comply with related safety rules. Read and follow all the safety instructions and cautions before any operations. Improper operations might cause personal injury or property damage as the device is electrical equipment.

1.1 Hazard Level Definition

Different levels of warning messages in this manual are defined as follows:

⚠ DANGER

Indicates a high-level hazard that, if not avoided, will result in death or serious injury.

A WARNING

Indicates a medium-level hazard that, if not avoided, could result in death or serious injury.

A CAUTION

Indicates a low-level hazard that, if not avoided, could result in minor or moderate injury.

NOTICE

Highlights key information and supplements other text. It may include skills and methods to solve product-related problems.

1.2 General Safety

NOTICE

- The information in this manual is subject to change due to product updates or other reasons. This guide cannot replace the product labels or other safety precautions unless otherwise specified. All descriptions here are for guidance only.
- Before installation, read through this manual to learn about the product and the precautions.
- All operations should be performed by trained and knowledgeable technicians who are familiar with local standards and safety regulations.
- Use insulating tools and wear personal protective equipment when operating the device to ensure personal safety. Wear anti-static gloves, cloths, and wrist strips when touching electronic devices to protect the device from damage.
- Strictly follow the installation, operation, and configuration instructions in this manual.

The manufacturer shall not be liable for device damage or personal injury if you do not follow the instructions. Visit https://en.goodwe.com to get more information about product warranty.

1.3 Device Safety



The voltage and frequency at the connecting point should meet the on-grid requirements.

Make sure that the current rating of this product's main breaker meets the specifications of the household power distribution unit.

The PE (equipment grounding) cable of the device must be connected firmly (1.6N·m). For AC circuit connections, copper (CU) conductors are recommended.

A DANGER

All labels and warning marks should be visible after the installation. Do not scrawl on, damage, or cover any label on the device.

Unauthorized dismantling or modification may damage the equipment. Such action may damage the equipment and is not covered under the warranty. Warning labels on the device are as follows.

	DANGER High voltage hazard. Disconnect all incoming power and turn off the product before working on it.
[]i	Read through the user manual before working on this device.
	High-temperature hazard. Do not touch the product under operation to avoid being burnt.
Z	Do not dispose of the device as household waste. Discard the product in compliance with local laws and regulations, or send it back to the manufacture r.
4 C. Smin	Delayed discharge. Wait 5 minutes after power off until the components are completely discharged.
\wedge	Potential risks exist. Wear proper PPE before any operations.



1.4 Personal Requirements

NOTICE

- Personnel who install or maintain the device must be strictly trained, learn about safety precautions and correct operations.
- Only qualified professionals or trained personnel are allowed to install, operate,
 maintain, and replace the device or parts.

Product Introduction

2.1 Product Introduction

Function Description

The device transfers between on-grid mode and backup mode with an integrated switch.

The device connects the main panel, the utility grid, and the AC output of the inverter to form an on-grid system when the utility grid works normally. Once the utility grid fails, the device will connect loads and the AC output of the inverter only to form a backup system.

The ABD supports one inverter and the MPD supports up to three inverters. Model Description

This manual covers listed device below:

ABD Series

- ABD200-40-US10
- ABD200-63-US10
- ABD100-40-US10
- ABD100-63-US10

MPD Series

- MPD200-40-US10
- MPD200-63-US10


Model Explanation



No.	Meaning	Description
1	Product	ABD: Automatic Backup Device MPD: Multi-inverter Parall el Device
2	Main breaker ratin	200: Applies to the main service panel whose main breake r rating is smaller than or equal to 200A and larger than 10 0A. 100: Applies to the main service panel whose main breake r rating is smaller than or equal to 100A.
3	Protection current of the inverter bre aker	40/63: The protection current of the inverter breaker is 40A or 63A, which matches with the following inverters: Hybrid inverters: GW5000/6000/7600/9600/11K-ES-US20 AC-coupled inverters: GW5000/6000/7600/9600/11K-SBP-U520
4	Region code	US: the U.S.
5	Generation code	10: generation 1.0

Supported Grid Type

The inverter supports 120/240V split phase grid type.




2.2 Application Scenarios

Add an ABD (Automatic Backup Device) in the system to realize the whole home backup. Once the utility grid fails, the ABD will disconnect the main service panel from the utility grid, and the inverter will switch to off-grid working mode to supply power to


the loads.

2.2.1 Application Scenarios - ABD


• Whole Home Backup System

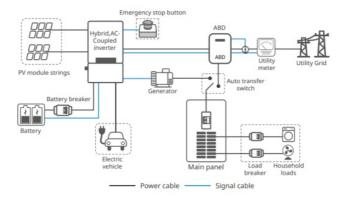

Microgrid System

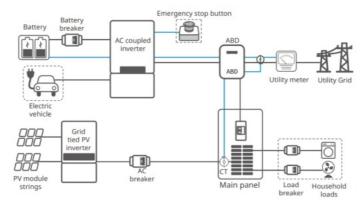


2.2.2 Application Scenarios - MPD

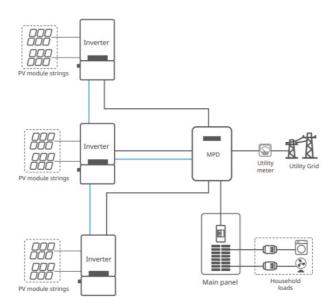


2.3 Electrical Diagram

2.3.1 Electrical Diagram - ABD

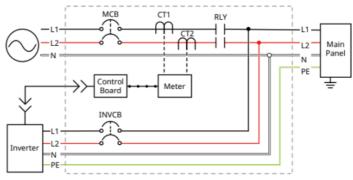


2.3.2 Electrical Diagram - MPD

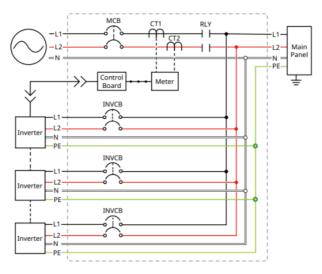

2.4 Appearance


2.4.1 Parts

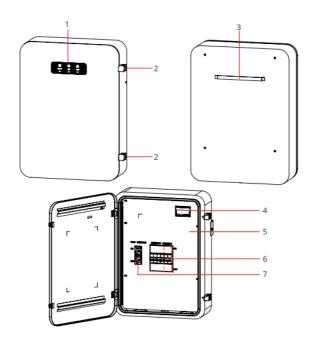

No.	Part	Description		
1 LED indicator Ir		Indicates the working status of the device.		
2	Lock	To lock the device's door (key included).		

3	Hanging bracket	Hangs the device on the mounting support.			
4	Smart meter	Contact after-sales service for support or replacement.			
5	Insulation board	Ensures personal safety and protects the device.			
6	Inverter breaker	Provides overcurrent protection for the inverter. Recommended specifications: 40A or 63A (or 60A when the ALT of the installation site is less than 2000m) Breaker, UL489 certified. ABD: 1 x inverter breaker. MPD: 3 x inverter breakers. Actual product may vary.			
7	Main Breaker	This breaker is optional when the main panel is also equipp ed with a breaker. Provides overcurrent protection from utilit y grid.			

2.4.2 Dimensions




2.4.3 Indicators

Indicator	Status	Explanation
		ON= The grid is abnormal and the system is in Back-u p mode.
•		BLINK = The grid is normal and the system is in On-gri d mode.

		OFF = With no input source, the system is in waiting m ode.
		ON = The communication with the inverter is normal, a nd the 12V power supply from the inverter is normal.
		BLINK 1= The communication with the inverter is norm al, and the 12V power supply from the inverter is abnormal.
((p))	11 11	BLINK 2= The communication with the inverter is abno rmal, and the 12V power supply from the inverter is normal.
		Off = The communication with the inverter is abnormal, and the 12V power supply from the inverter is abnormal.
		On = Fault has occurred.
<u> </u>		Off = No fault.

2.5 Deliverables

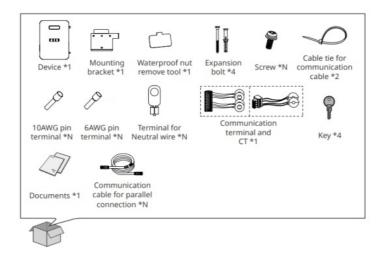

NOTICE


- N = Quantity depends on the device model.
- The number of pin terminals and communication terminal are various depending on different devices. The actual accessories may differ.

• The communication cable for parallel connection is only for MPD.


Installation

3.1 Installation Requirements

Installation Environment Requirements

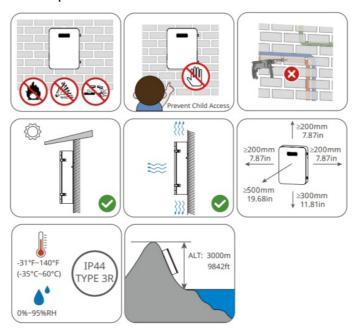

Installation Angle Requirements

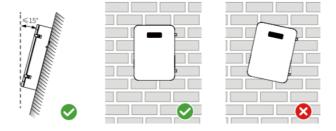

3.2 Device Installation

NOTICE

- Avoid the water pipes and cables buried in the wall when drilling holes.
- Wear goggles and a dust mask to prevent the dust from being inhaled or contacting eyes when drilling holes.


Step 1 Put the mounting bracket on the wall or the support horizontally and mark positions for drilling holes.

Step 2 Drill holes to a depth of 80mm(3.15in) using the hammer drill. The diameter of the drill bit should be 10mm(0.39in).

Step 3 Secure the mounting bracket using the expansion bolts.

Step 4 Install the device on the mounting bracket.

Step 5 Screw to secure the device and the mounting bracket.

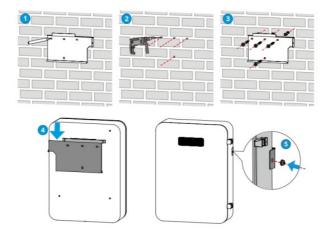

Electrical Connection

4.1 Safety Precaution

△ DANGER

INSTRUCTIONS PERTAINING TO A RISK OF FIRE OR ELECTRIC SHOCK

- Perform electrical connections, including operations, cables, and component specifications in compliance with local laws and regulations ANSI/NFPA 70.
- The input and output circuits are isolated from the enclosure and that system grounding, if required by the National Electric Code, ANSI/NFPA 70, is the responsibility of the installer.
- Power off the device before any electrical connections. Otherwise, an electric shock may occur.
- Tie the cables of the same type together, and place cables of different types apart. Do not place the cables entangled or crossed.
- If the tension is too large, the cable may be poorly connected. You have to reserve a
 certain length of the cable before connecting it to the device cable port.
 Make sure
 that the cable conductor is in full contact with the terminal and the cable insulation part
 is not crimped with the terminal when crimping the terminal. Otherwise, the device
 may not be able to work properly, or the connection may be unreliable during working,
 which may cause terminal block damage, etc.

NOTICE


• Cable colors in this document are for reference only. The cable specifications shall meet local laws and regulations.

4.2 Preparing Conductor Conduit & Fittings

4.2.1 Conduit Holes


WARNING

- Wiring conduits are additionally required, not included in the scope of delivery. The conduit must be UL514B listed and meet the specifications of the waterproof nut.
- To avoid influencing the protection class or damaging the equipment, check the wiring conduit to make sure that the conduit is installed properly and the holes are sealed.

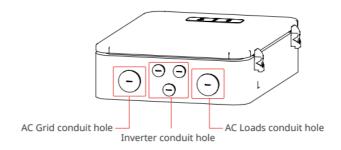

Conduit Hole Description		Conduit
AC Grid Install the wiring conduit and run Grid-L1, and Neutral wire through the cable hole.		2 inch conduit
AC Loads	Install the wiring conduit and run Load-L1, Load-L2, Neutral wire, and PE through the cable hole.	2 inch conduit
Inverter	Install the wiring conduit and run Inverter-L1, Inverter-L2, Neutral wire, PE cable, and communica tion cable through the cable hole.	1 inch conduit

4.2.2 Wiring Specifications

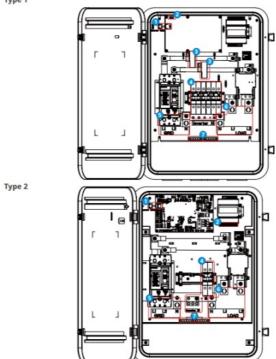

No.	Parts	Labeling	Description		
1.	Inverter com munication te rminal	Inverter COM	 Terminal for connecting the communication cable of the inverter. Recommended specification: RJ45 cable, 24AWG, CAT5e or better. 		
2.	CT terminal f or solar inverter	_	Terminal for connecting the CT for the sol ar inverter.		
3.	СТ	_	_		
4.	Inverter termi nal	Inverter A-L1 / L2, Inverter B-L 1 / L2, Inverter C-L1 / L2, Inver ter-N	 Terminal for connecting the AC conductor of the inverter. Inverter B and Inverter C are only for MP D series products. Recommended specification: 6-8AWG, co pper conductor, 90°C. 		


5.	AC Grid termi nal	Grid-L1, Grid-L 2, Grid-N	 Terminal for connecting the Grid conduct or. Recommended specification: 4/0AWG, copper conductor, 90°C for ABD2 00- 40-US10, ABD200-63-US10, MPD200-4 0-US10, and MPD200-63-US10. 3AWG, copper conductor, 90°C for ABD10 0-40- US10 and ABD100-63-US10.
6.	AC Loads ter minal	Load-L1, Load- L2, Load-N	 Terminal for connecting the AC conductor of the load. Recommended specification: 4/0AWG, copper conductor, 90°C for ABD2 00- 40-US10, ABD200-63-US10, MPD200-4 0-US10, and MPD200-63-US10. 3AWG, copper conductor, 90°C for ABD10 0-40- US10 and ABD100-63-US10.
7.	Grounding busbar		 Busbar for connecting the PE cable. Recommended specification: Load-PE: 4-6AWG, copper conductor, 90 °C. Inverter-PE: 10AWG, copper conductor, 90 °C.

4.3 Opening the Cabinet Door

Step 1 Unlock the cabinet door using the included key.

Step 2 Remove the six screws fixing the insulation board(torque: 0.8Nm).

Step 3 Remove the insulation board.

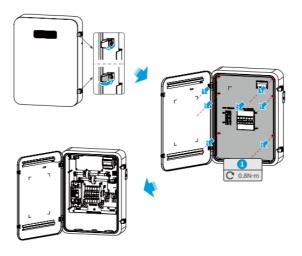

4.4 Connecting the Conductors

WARNING


- Connect the conductors to the right terminals like L1, L2, and N. The device may be damaged if the conductors are connected inappropriately.
- Make sure that the whole conductors are inserted into the terminal holes. No part of the conductor can be exposed.
- Make sure that the conductors are connected securely. Otherwise, the terminal may get too hot and damage the device.

4.4.1 Connecting the AC Conductors (Grid)

⚠ WARNING


The ac output (neutral) is not bonded to ground.

- Step 1 Strip the conductor wiring.
- Step 2 Remove the waterproof cover using the included cap removal tool.
- Step 3 Insert the desired conduit and corresponding adaptors, fittings, and bushings.
- Step 4 Insert the conductors into the device and tighten the conduit.

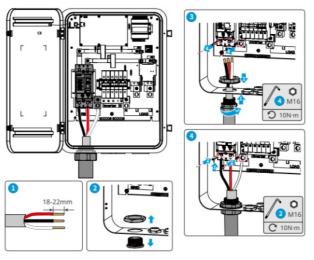


4.4.2 Connecting the AC Conductors (Load)

- Step 1 Strip the conductor wiring.
- Step 2 Remove the waterproof cover using the included cap removal tool.
- Step 3 Insert the desired conduit and corresponding adaptors, fittings, and bushings.
- Step 4 Insert the conductors into the device and tighten the conduit.

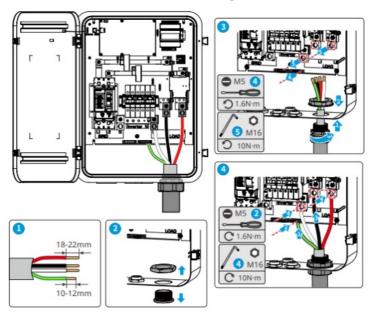

4.4.3 Connecting the AC Conductors (Inverter)


- Step 1 Strip the conductor wiring, crimp the conductor with appropriate wire connector.
- Step 2 Remove the waterproof cover using the included cap removal tool.
- Step 3 Insert the desired conduit and corresponding adaptors, fittings, and bushings.
- Step 4 Insert the conductors into the device and tighten the conduit.

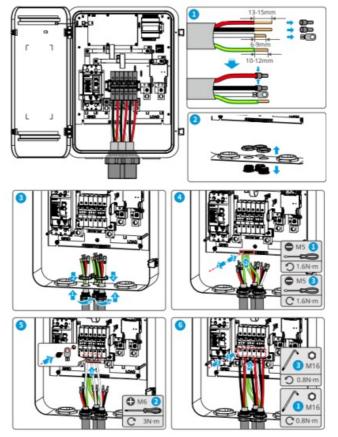

4.4.4 Connecting the Communication Cable

Step 1 Prepare a RJ45 network cable and insert it into the terminal.

Step 2 Run the cable through the cable clip and the conduit.

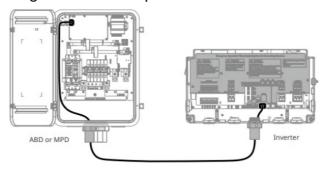

4.4.5 Connecting the CT Cable (Optional)


NOTICE

• Only for AC coupled inverters.


Step 1 Clamp the CT around the cable to be measured.

Step 2 Insert the CT cable into the terminal block.

Type 1

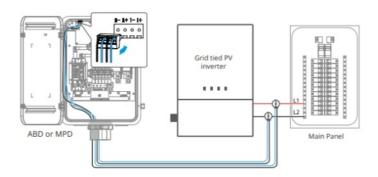

Type 2

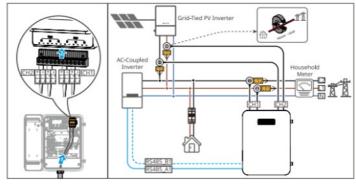


4.5 Closing the Cabinet Door

Step 1 Install the insulation board.

Step 2 Tighten the six screws fix the insulation board (torque: 0.8Nm).

Step 3 Optional. Lock up the device using the cabinet key. Keep the key properly for future use.

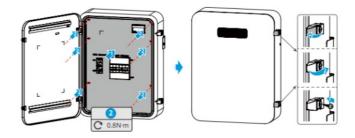

Equipment Commissioning

5.1 Check Before Power ON

No.	Check Item
1	The product is firmly installed at a clean place that is well-ventilated and easy-t o- operate.
2	The PE, power, and communication cables are connected correctly and secure ly.
3	Cable ties are intact, routed properly and evenly.
4	Unused ports and terminals are fitted using the waterproof caps.
5	The insulation board is installed properly.
6	The voltage and frequency at the connection point meet the grid connection re quirements.
7	The electrical conduit holes are sealed.

5.2 Power ON the Device

Step 1 Turn on the main breaker of the device.

Step 2 Turn on the inverter breaker of the device.

Maintenance

6.1 Power OFF the Device



INSTRUCTIONS PERTAINING TO A RISK OF FIRE OR ELECTRIC SHOCK

- Power off the device before operations and maintenance. Otherwise, the device may be damaged or electric shocks may occur.
- Delayed discharge. Wait until the components are discharged and the LED indicators are off after power off.
- Step 1 Turn off the main breaker of the device.
- Step 2 Turn off the inverter breaker of the device.
- Step 3 Turn off the breaker of the main panel.
- Step 4 Power off the inverter.

6.2 Replacing the Inverter Breaker

⚠ WARNING

- Make sure that the device is powered off.
- Wear proper personal protective equipment before any operations.
- Step 1 Loosen the screws and cables of the breaker.
- Step 2 Pull the plastic slot under the breaker.
- Step 3 Replace the breaker with a new one, the new breaker shall be AC40A or 63A(60A) and UL489 certified.
- Step 4 Place the breaker properly and push the plastic slot. Make sure that the breaker is securely installed.
- Step 5 Tighten the cables.

Technical Parameters

7.1 ABD Series Technical Parameters

Technical Data	ABD200- 40-US10	ABD200- 63-US10	ABD100- 40-US10	ABD100- 63-US10
Electrical Data				
Nominal Output Voltage (V)	240			
Output Voltage Range (V)	211~264			

Feed-in Type	Split Phase				
Nominal AC Voltage of Line Conductor (V)	120/240				
Nominal AC Frequency (Hz)	60				
AC Frequency Range (Hz)	58.5~61.2				
Current Rating (From Grid)(A)	200				
Max. Continuous Current From Inverter (A)	32	32 47.5 32 47.5			
Maximum Overcurrent Protection o f Main Breaker (A)*1	200	200 100			
Maximum Overcurrent Protection o f Circuit Breaker of Inverter (A)	40	40 63		63	
General Data					
Operating Temperature Range (°F)	-13°F~+140	13°F~+140°F (-25°C~+60°C)*2			
Max. Operating Altitude (ft)	9842ft (300	0m)			
Cooling Method	Natural Convection				
Communication with Inverter	RS485				
Weight (lb)	26lb (12kg)				
Dimension (W×H×D in)	17.7×24×5.9 in (450×610×150 mm)				
Mounting Method	Wall Mounted				
Ingress Protection Rating Type 3R, IP44					
Certification					

Safety Regulation	UL1741, CSA 22.2 No. 107-01	
EMC	FCC part15 CLASS B	
*1: The main breaker is optional.		
*2: Derating temperature: 113°F(45°C).		

7.2 MPD Series Technical Parameters

Technical Data	MPD200-40-US10	MPD200-63-US10		
Electrical Data				
Nominal Output Voltage (V)	240			
Output Voltage Range (V)	211~264			
Feed-in Type	Split Phase			
Nominal AC Voltage of Line Conductor (V	120/240			
Nominal AC Frequency (Hz)	60			
AC Frequency Range (Hz)	58.5~61.2			
Current Rating (From Grid)(A)	200			
Max. Continuous Current From Inverter (A)	32	47.5		
Max. Amount of Inverters in Parallel	3			
Maximum Overcurrent Protection of Main Breaker (A)*1	200			
Maximum Overcurrent Protection of Circu it Breaker of Inverter (A)	40	63		

General Data				
Operating Temperature Range (°F)	-13°F~+140°F (-25°C~+60°C)*2			
Max. Operating Altitude (ft)	9842ft (3000m)			
Cooling Method	Natural Convection			
Communication with Inverter	RS485			
Weight (lb)	30lb (13.5kg)			
Dimension (W×H×D in)	17.7×24×5.9 in (450×610×150 mm)			
Mounting Method	Wall Mounted			
Ingress Protection Rating	Type 3R, IP44			
Certification				
Safety Regulation	UL1741, CSA 22.2 No. 107-01			
EMC	FCC part15 CLASS B			

*1: The main breaker is optional.

*2: Derating temperature: 113°F(45°C).



https://en.goodwe.com/



https://en.goodwe.com/contact-us.asp



GoodWe Technologies Co., Ltd.

No. 90 Zijin Rd., New District, Suzhou, 215011, China

www.goodwe.com

<u>service@goodwe.com</u>

Documents / Resources



GOODWE MPD Series Automatic Backup Device [pdf] Installation Guide ABD200-40-US10, ABD200-63-US10, ABD100-40-US10, ABD100-63-US 10, MPD200-40-US10, MPD200-63-US10, MPD Series Automatic Backup Device, MPD Series, Automatic Backup Device, Backup Device

References

- User Manual
- GOODWE
- ◆ ABD100-40-US10, ABD100-63-US10, ABD200-40-US10, ABD200-63-US10, Automatic Backup Device, Backup Device, GOODWE, MPD Series, MPD Series Automatic Backup Device, MPD200-40-US10, MPD200-63-US10

Leave a comment

Your email address will not be published. Required fields are marked *

Comment *

Name		
Email		
<u> </u>		
Website		
☐ Save my name, email, and website in this browser for the next time I com	ment.	
Post Comment		
Search:		
e.g. whirlpool wrf535swhz	Search	

Manuals+ | Upload | Deep Search | Privacy Policy | @manuals.plus | YouTube

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.