



Contents [[hide](#)]

[1 HEMOMATIK ITP17 Universal Process Indicator](#)

[2 Introduction](#)

[3 Terms and abbreviations](#)

[4 Overview](#)

[5 Functions](#)

[6 Specifications](#)

[7 Environmental conditions](#)

[8 Input signals](#)

[9 Safety](#)

[10 Mounting](#)

[11 Connection](#)

[12 Indication and control](#)

[13 Error indication and remedy](#)

[14 Alarm settings](#)

[15 Service menu](#)

[16 Maintenance](#)

[17 Transportation and storage](#)

[18 Scope of delivery](#)

[19 Documents / Resources](#)

[19.1 References](#)





Introduction

This manual describes the functions, configuration, mounting and operating instructions of the ITP17 universal process indicator (hereinafter referred to as the device).

Connection, setup and maintenance of the device must be performed only by fully qualified personnel after reading this user guide.

Terms and abbreviations

PC – personal computer akYtec Tool Pro – configuration software

USB (Universal Serial Bus) – serial communication interface

Overview

The device is designed to measure and indicate signals of resistance temperature detectors (RTD), thermocouples (TC), pyrometers, DC voltage and DC signals (U / I signals).

Functions

- measuring and displaying a measured value on the digital display;
- signalling by color-coded indication about exceeding the set thresholds of the measured value;
- signalling when the value is in the critical zone;
- setting of the measured value according to the on/off- law using a discrete output based on a transistor switch;
- indication of a break or short circuit in the “device-sensor” communication line.

Specifications

Table 1 Specifications

Parameter	Value
Electrical	
Power supply	24 (10..30) VDC
Power consumption, max.	1 W
Appliance class	III
Galvanic isolation between domain of combined power and output interface and input domain	500 V
Input signals	
Number	1
Input resistance at voltage measuring, min.	100 k Ω
Input voltage drop (at current measuring), max.	1.6 V
Input signals supported	see <i>Section 6</i>
Sampling time, max.	1 s
Full-scale accuracy , max. RTD, U / I signals	$\pm 0,25$ %
TC, pyrometers	$\pm 0,5$ %
Temperature influence	0,2 of full-scale accuracy limit/ 10 °C
Output	
NPN transistor, loading capacity	200 mA, 42 VDC
Length of signal line, max.	30 m

Configuration interface	
Connector for configuration with akYtec Tool Pro	micro-USB
Display	
Indicator	one 4–digit and 7–segment indicator
Colors	3
Character height	14 mm
Mechanical	
Dimensions	48 × 26 × 72 mm
IP code (front / rear)	(IP65 / IP20)
MTBF	100000 hours
Average service life	12 years
Weight	approx. 150 g

Environmental conditions

The device is designed for natural convection cooling which should be taken into account when choosing the installation site.

The following environmental conditions must be observed:

- clean, dry and controlled environment, low dust level;
- closed non-hazardous areas, free of corrosive or flammable gases.

Table 2 Environmental conditions

Condition	Permissible range
-----------	-------------------

Ambient temperature	-40...+60 °C
Relative humidity	30...80 % (non-condensing)
Transportation and storage temperature	-25 ... +55 °C
Transportation and storage relative humidity	5...95 % (non-condensing)
Altitude	up to 2000 m ASL
EMC emission / immunity	conforms to IEC 61000-6-3-2016

NOTE

When operating the device at an altitude above 1000 m above sea level, it is necessary to take into account the reduction of the electrical insulation as well as the reduction in the cooling effect of the air.

Input signals

Table 3 Signals and sensors

Indication	Description	Measurement range*
RTD		
<i>C 50</i>	Cu50 ($\alpha = 0,00426 \text{ }^{\circ}\text{C}^{-1}$)	-50...+200 °C
<i>50 C</i>	50M ($\alpha = 0,00428 \text{ }^{\circ}\text{C}^{-1}$)	-180...+200 °C
<i>P 50</i>	Pt50 ($\alpha = 0,00385 \text{ }^{\circ}\text{C}^{-1}$)	-200...+850 °C
<i>50P</i>	50P ($\alpha = 0,00391 \text{ }^{\circ}\text{C}^{-1}$)	-200...+850 °C
<i>C100</i>	Cu100 ($\alpha = 0,00426 \text{ }^{\circ}\text{C}^{-1}$)	-50...+200 °C
<i>100C</i>	100M ($\alpha = 0,00428 \text{ }^{\circ}\text{C}^{-1}$)	-180...+200 °C
<i>P100</i>	Pt100 ($\alpha = 0,00385 \text{ }^{\circ}\text{C}^{-1}$)	-200...+850 °C

<i>100P</i>	100P ($\alpha = 0,00391 \text{ }^{\circ}\text{C}^{-1}$)	−200...+850 °C
<i>100n</i>	100N ($\alpha = 0,00617 \text{ }^{\circ}\text{C}^{-1}$)	−60...+180 °C
<i>P500</i>	Pt500 ($\alpha = 0,00385 \text{ }^{\circ}\text{C}^{-1}$)	−200...+850 °C
<i>500P</i>	500P ($\alpha = 0,00391 \text{ }^{\circ}\text{C}^{-1}$)	−200...+850 °C
<i>C500</i>	Cu500 ($\alpha = 0,00426 \text{ }^{\circ}\text{C}^{-1}$)	−50...+200 °C
<i>500C</i>	500M ($\alpha = 0,00428 \text{ }^{\circ}\text{C}^{-1}$)	−180...+200 °C
<i>500n</i>	500N ($\alpha = 0,00617 \text{ }^{\circ}\text{C}^{-1}$)	−60...+180 °C
<i>C 1.0</i>	Cu1000 ($\alpha = 0,00426^{\circ}\text{C}^{-1}$)	−50...+200 °C
<i>1.0 C</i>	1000M ($\alpha = 0,00428 \text{ }^{\circ}\text{C}^{-1}$)	−180...+200 °C
<i>P 1.0</i>	Pt1000 ($\alpha = 0,00385 \text{ }^{\circ}\text{C}^{-1}$)	−200...+850 °C
<i>1.0 P</i>	1000P ($\alpha = 0,00391 \text{ }^{\circ}\text{C}^{-1}$)	−200...+850 °C
<i>1.0 n</i>	1000N ($\alpha = 0,00617 \text{ }^{\circ}\text{C}^{-1}$)	−60...+180 °C
TC		
<i>tC.L</i>	L	−200...+800 °C
<i>tP.HA</i>	K	−200...+1300 °C
<i>tC.J</i>	J	−200...+1200 °C
<i>tC.n</i>	N	−200...+1300 °C
<i>tC.t</i>	T	−200...+400 °C
<i>tC.S</i>	S	0...+1750 °C
<i>tC.r</i>	R	0...+1750 °C
<i>tC.b</i>	B	+200...+1800 °C

<i>tC.A1</i>	A-1	0...+2500 °C
<i>tC.A2</i>	A-2	0...+1800 °C
<i>tP.A3</i>	A-3	0...+1800 °C
TC in accordance with DIN 43710		
<i>tC.dL</i>	L	-200...+900 °C
I signals**		
<i>I 0.5</i>	0...5 mA	0...100 %
<i>I 0.20</i>	0...20 mA	0...100 %
<i>I 4.20</i>	4...20 mA	0...100 %
U signals**		
<i>U-5.5</i>	-50...+50 mV***	0...100 %
<i>U 0. 1</i>	0...1 V	0...100 %
<i>U 0.10</i>	0...10 V	0...100 %
<i>U 2.10</i>	2...10 V	0...100 %
Pyrometers		
<i>Plr.1</i>	RK-15	+400...+1500 °C
<i>Plr.2</i>	RK-20	+600...+2000 °C
<i>Plr.3</i>	RS-20	+900...+2000 °C
<i>Plr.4</i>	RS-25	+1200...+2500 °C

At the temperature over 999,9 and under -199,90C the value of the least significant digit equals 10C.

The values depend on the di.Lo and di.Hi parameters.

Accuracy is not standardized.

Safety

WARNING

Dangerous voltage!

Electric shock could kill or seriously injure.

- All work on the device must be performed by a fully qualified electrician.
- Ensure that the mains voltage matches the voltage marked on the device.
- Ensure that the device is provided with its power supply line and electric fuse.
- The device may not be used in aggressive environments, in atmospheres in which there are chemically active substances.
- The output port and internal electrical elements of the device must be protected from the humidity.

NOTICE

- De-energize the device before working on it. Switch on the power supply only after completing all work on the device.

Mounting

To mount the device:

- Prepare the mounting cutout with Ø of 22.5 mm in the switchboard where the device should be mounted (see Fig. 2).
- Carefully position the supplied gasket (see Fig.
- Place the device with the installed gasket in the prepared mounting cutout and tighten the nut (included in the scope of delivery) to fix the device.

NOTICE

Do not use any tools to tighten the nut. Tighten the nut only by hand.

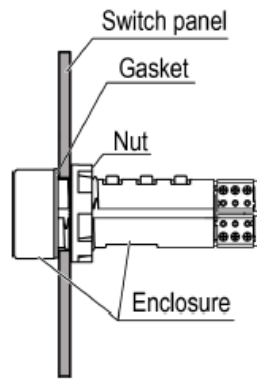


Fig. 1 *Mounting*

Removing proceeds in the reverse order.

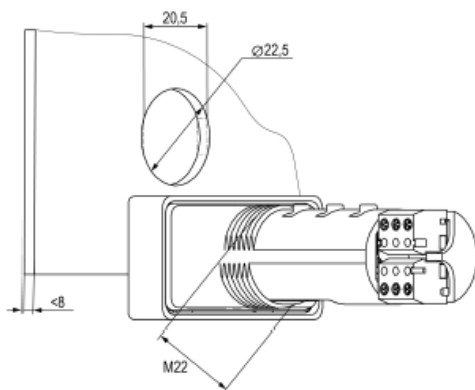


Fig. 2 *Mounting cutout*

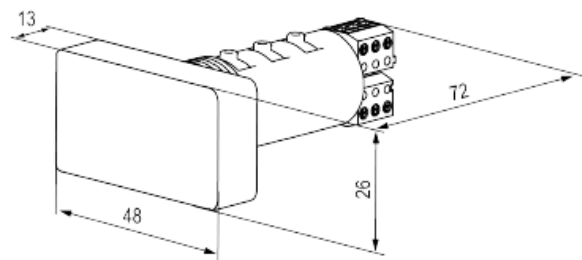


Fig. 3 *Dimensions*

Connection

General information

Signal cables should be routed separately from the power supply cables as well as from the cables which are sources of high-frequency and impulse interference.

- For high-quality clamping and reliable electrical connections, it is recommended to use:
- copper multicore wires, diameter after tinning – 0.9 mm (17 cores, AWG 22) or 1.1 mm (21 cores, AWG 20);
- copper wires with single-wire cores, diameter from 0.51 to 1.02 mm (AWG 24-18).
- The ends of the wires should be stripped of insulation by 8 ± 0.5 mm (see Fig. 4) and, if necessary, tinned.

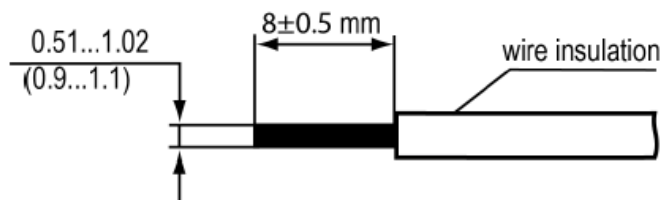


Fig. 4 Wire preparation

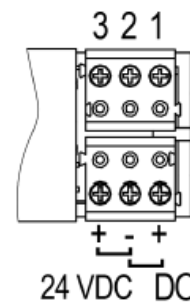


Fig. 5 Terminal assignments

Wiring

CAUTION

To protect the device input from the influence of industrial electromagnetic interference, the “device-sensor” communication lines should be shielded. To protect the device input circuits from possible breakdown by static electricity charges accumulated on the “device-sensor” communication lines, their wires should be connected to the shield ground screw for 1–2 s before connecting to the device terminal block.

Connect the “device – sensor” communication lines to the primary converter and the device input and connect the device to the power supply (see Fig. 6).

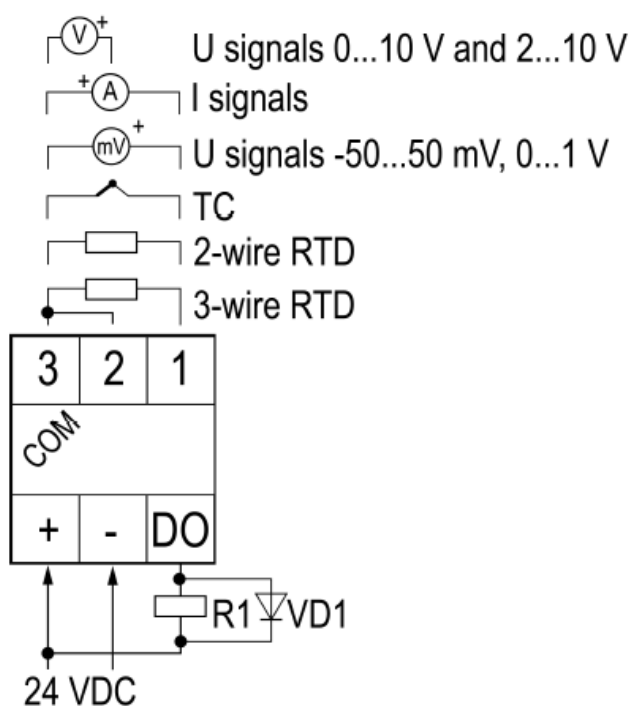


Fig. 6 Wiring diagram

Fig. 6 Wiring diagram

To protect the device against microseconds’ impulse noise of the output device (open collector) on the terminals “DO” and “-“, it is recommended to use connecting lines no longer than 30 meters or install devices for protection against impulse noise on the DC line. The VD1 diode should be located as close as possible to the terminals of the relay winding. The parameters of the diode are selected in accordance with the following rules:

The forward current of the diode must be at least 1.3 R1 (1.3 of the relay coil current).

Indication and control

- The 4– digit and 7– segment indicator on the front panel is designed to display measured values, alarms and device parameters. The segments of the digital indicator can light up in one of the following colors (see Section 13):
 - green;
 - red;
 - yellow.

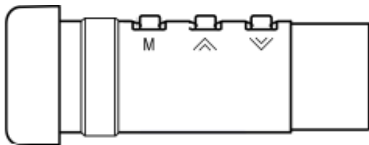





Fig. 7 Control buttons

Table 4 Function buttons

Button	Description
M+  together	Press for 3 s to enter the service menu
 or 	<ul style="list-style-type: none"> • Select parameter; • Change the parameter value Press and hold the button to speed up the process of change

There is a micro-USB connector on the bottom of the enclosure.

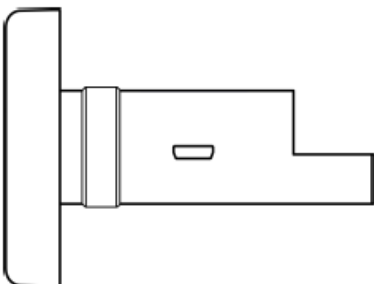


Fig. 8 Micro-USB connector

Error indication and remedy

Being powered the device starts to operate. If the indicated values do not correspond to the real measured values, check the following:

- sensor function and communication line integrity;
- correctness of sensor connection;
- settings of scaling parameters (di.Lo and di.Hi).

Table 5 Error indication and remedy

Indication	Description	Remedy
<i>HHHH</i>	The measured input value is above the upper limit	Check the sensor code and measured value compliance
<i>LLLL</i>	The measured input value is below the lower limit	
<i>Hi</i>	The calculated value exceeds the maximum possible positive value that can be displayed on 4 digits of the indicator	Readjust the <i>dP.t</i> parameter
<i>Lo</i>	The calculated value is less than the minimum possible negative value that can be displayed on 4 digits of the indicator	
<i> — </i>	Sensor break	Check the signal line. If the signal line isn't broken and the connection is correct, contact akYtec service staff
<i>Er.[]</i>	Cold junction sensor (CJS) failure	Contact akYtec service staff

Indication	Description	Permissible values	Factory settings
<i>in.t</i>	Input signal	see <i>section 6</i>	4...20 mA
<i>td</i>	Digital filter time constant	0...10 s	0
<i>SQrt</i>	Square root function (for U signals)	<i>on/oFF</i>	<i>oFF</i>
<i>di.Lo</i>	Signal lower limit (for I / U signals)	–1999...9999	0
<i>di.Hi</i>	Signal upper limit (for I / U signals)	–1999...9999	100
<i>dP.T</i>	Decimal point position	-a-u-to- -.-.- -	- - - .-
<i>2u3u</i>	RTD connection: 2–wire or 3–wire	<i>2-Ln</i> <i>3-Ln</i>	<i>3-Ln</i>
<i>Corr</i>	Offset correction of the measured input value	–1999 ...9999	0
<i>Cnt</i>	Control function: OFF / Heating / Cooling / Alarm within limits (Π) / Alarm outside limits (U) (see <i>Fig. 10</i>)	<i>oFF/HEAt/ Cool</i> <i>L/Π/U</i>	<i>U</i>
<i>SP.Lo</i>	Setpoint lower limit	–1999...9999	0


<i>SP.Hi</i>	Setpoint upper limit	–1999...9999	30
<i>A.HYS</i>	Hysteresis. When “Alarm within limits (Π)” or “Alarm outside limits (U)” are selected, the hysteresis blocks the actuation of the output unit with minor fluctuations at the SP.Lo and SP.Hi boundary. The parameter is not displayed when <i>Cnt</i> = oFF/HEAt/Cool	0...9999	0
<i>di.Sh</i>	Characteristics offset	–1999 ...9999	0
<i>out.E</i>	Output device state in case of sensor failure	<i>on/oFF</i>	<i>oFF</i>
<i>d.FnC</i>	Flashing function	<i>on/oFF</i>	<i>oFF</i>
<i>Zon.1</i>	Thresholds for changing the color of indicator zones	1999...9999	0
<i>Zon.2</i>			50
<i>Zon.3</i>			80
<i>Zon.4</i>			100
<i>Zon.5</i>			100
<i>CoL.1</i>	Indicator zone color	<i>GRN/RED/YEL</i>	<i>GRN</i>
<i>CoL.2</i>			<i>YEL</i>
<i>CoL.3</i>			<i>RED</i>
<i>CoL.4</i>			<i>RED</i>

<i>CoL.D</i>	Basic indication color outside color zones	<i>GRN/RED/YEL</i>	<i>GRN</i>
<i>Br.R</i>	Brightness of red*	0...100	100
<i>Br.G</i>	Brightness of green*	0...100	100
<i>Br.Y</i>	Brightness of yellow*	0...100	100
<i>BL.YR</i>	Balance of red/green in yellow*	0...100	100
<p>NOTE</p> <p>* The parameter doesn't change by resetting to factory settings.</p>			

Alarm settings

Color indication

You can set the indicator color modes depending on the input value using Zon.n and COL.n parameters. Zon. n parameters must be recorded sequentially from the lowest to the highest.

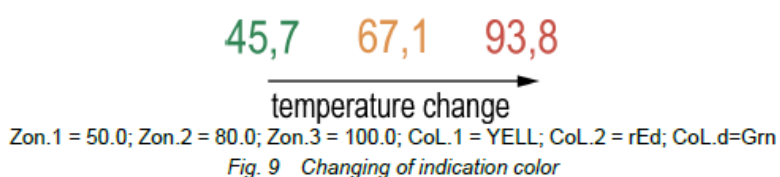

Zon.1 = 50.0; Zon.2 = 80.0; Zon.3 = 100.0; CoL.1 = YELL; CoL.2 = rEd; CoL.d=Grn

Fig. 9 Changing of indication color

Alarm logic

The output device can be used for control or alarm indication.

You can select the alarm logic with the Cnt parameter (see Table 6) in accordance with Fig. 10.

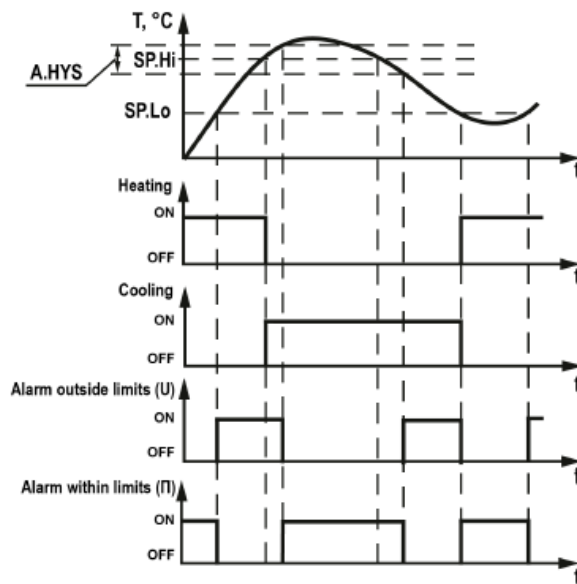


Fig. 10 Output device logic

Service menu

Table 7 Service menu

Indication	Description
<i>DEV.t</i>	Device type
<i>VEr.F</i>	Firmware version
<i>CJS.E</i>	Cold junction sensor on/ off
<i>d.rSt</i>	<p>Reset to factory settings:</p> <p>Current state: 0.</p> <p>When it is set to 1, all device settings are reset to default values and the device restarts</p>

Configuration using akYtec Tool Pro

You can configure the device using akYtec Tool Pro software.

To connect the device to akYtec Tool Pro:

1. Connect the device to a PC with the USB — micro USB cable.

2. Start akYtec Tool Pro.
3. Click Add devices.
4. Select the COM port assigned to the device in the Interface drop-down menu of the Network parameters tab. You can check the port number and name in Windows Device Manager.
5. Select Modbus RTU in the Protocol drop-down menu.
6. Select the necessary device in the Measuring devices category of the Devices drop-down menu.
- 7.

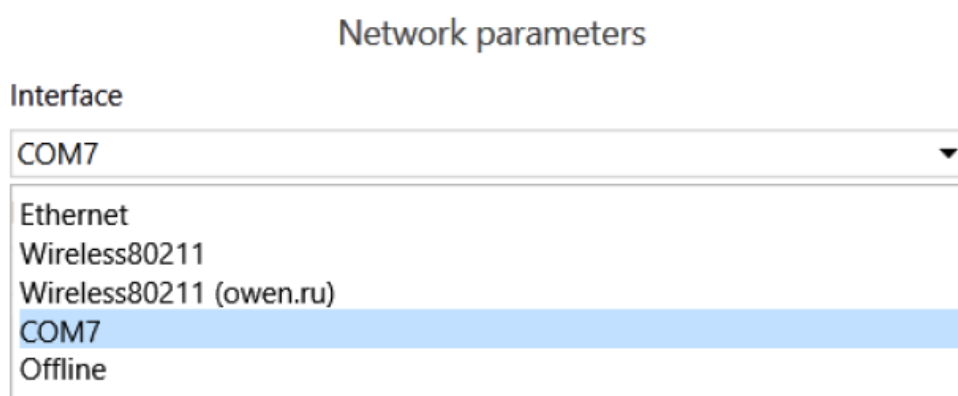


Fig. 11 Interface selection

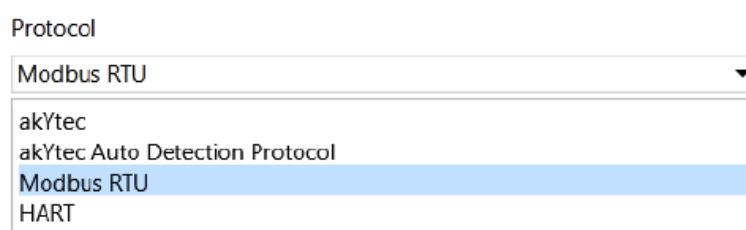


Fig. 12 Protocol selection

If the device is connected for the first time, select Manually in the Connection setup tab and set the following values:

Devices

Search bar

Name
Category: Measuring devices
Category: Sensors

Fig. 13 Device selection

Connection setup

Manually

Baud rate

9600

Data bits

8

Parity

None

Stop bits

1

Fig. 14 Connection setup

8. Select Find device.
9. Enter the address of the connected device (default address — 16).

NOTE

The device is available under addresses from 1 up to 255.

10. Click Search. The device with the address will be displayed in the window.
11. Select the checkbox next to the device and click the OK button.

To get more information about the connection and operation of the device, use the HELP menu of akYtec Tool Pro or press F1 to call up HELP in the program.

Maintenance

The safety requirements must be observed when the maintenance is carried out.

WARNING

Cut off all power before maintenance.

The maintenance includes:

- cleaning of the housing and terminal blocks from dust, dirt and debris
- checking the device fastening
- checking the wiring (connecting wires, terminal connections, absence of mechanical damages).

NOTICE

The device should be cleaned with a dry or slightly damp cloth only. No abrasives or solvent-containing cleaners may be used.

Transportation and storage

Pack the device in such a way as to protect it reliably against impact for storage and transportation. The original packaging provides optimum protection. If the device is not taken immediately after delivery into operation, it must be carefully stored at a protected location. The device should not be stored in an atmosphere with chemically active substances.

The environmental conditions must be taken into account during transportation and storage.

NOTICE

The device may have been damaged during transportation.

Check the device for transport damage and completeness!

Report the transport damage immediately to the shipper and akYtec GmbH!

Scope of delivery


- ITP17 universal process indicator 1 pc.
- User guide 1 pc.
- Set of mounting elements 1 pc.

NOTE

The manufacturer reserves the right to make additions to the scope of delivery.

Tel: +46 (0)8 771 02 20

Documents / Resources

	<p>HEMOMATIK ITP17 Universal Process Indicator [pdf] User Guide</p> <p>ITP17, HM 2503, ITP17 Universal Process Indicator, ITP17, Universal Process Indicator, Process Indicator, Indicator</p>
---	--

References

- [User Manual](#)

■ HEMOMATIK

◆ HEMOMATIK, HM 2503, Indicator, ITP17, ITP17 Universal Process Indicator, Process Indicator, Universal Process Indicator



Leave a comment

Your email address will not be published. Required fields are marked *

Comment *

Name

Email

Website

☐ Save my name, email, and website in this browser for the next time I comment.

Post Comment

Search:

e.g. whirlpool wrf535swhz

Search

[Manuals+](#) | [Upload](#) | [Deep Search](#) | [Privacy Policy](#) | [@manuals.plus](#) | [YouTube](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.