

HK INSTRUMENTS
PTL Series
Pressure
Transmitters
for Liquids



HK INSTRUMENTS PTL Series Pressure Transmitters for Liquids Installation Guide

[Home](#) » [HK INSTRUMENTS](#) » HK INSTRUMENTS PTL Series Pressure Transmitters for Liquids Installation Guide 

Contents

- [1 HK INSTRUMENTS PTL Series Pressure Transmitters for Liquids](#)
- [2 FAQs](#)
- [3 INTRODUCTION](#)
- [4 APPLICATIONS](#)
- [5 SPECIFICATIONS](#)
- [6 DIMENSIONS](#)
- [7 ELECTRICAL CONNECTIONS](#)
- [8 WARRANTY POLICY](#)
- [9 MORE INFORMATION](#)
- [10 Documents / Resources](#)
 - [10.1 References](#)

HK INSTRUMENTS

HK INSTRUMENTS PTL Series Pressure Transmitters for Liquids



FAQs

- **Q: What are the differences between PTL-Heat and PTL-Cool?**
 - A: PTL-Heat is designed for non-condensing applications, while PTL-Cool is suitable for extreme conditions with condensation, featuring two-layer protection for electronics.
- **Q: What is the warranty policy?**
 - A: For warranty information, visit www.hkinstruments.fi or refer to the warranty policy provided with the product.

INTRODUCTION

Thank you for choosing an HK Instruments PTL series pressure transmitter for liquids. PTL series pressure transmitters are used for pressure detection in liquids in heating and cooling systems. PTL-Heat is used for pressure detection in non-condensing applications, whereas PTL-Cool is designed for extreme conditions where condensation is a common problem. PTL-Cool has a two-layer protection for electronics. This is why the possible condensation does not harm the product. PTL series products are also suitable for refrigerants and non-aggressive gases.

ATTENTION! The device may be damaged by overpressure if installation is made against fluid and closed valve.

APPLICATIONS

- PTL-Heat series devices are commonly used in HVAC/R systems for:
 - Liquid heat exchangers
 - Heating substation
 - Air compressor systems
- PTL-Cool series devices are commonly used in HVAC/R systems for:
 - District cooling
 - Fan coil units (FCU)

- Chilled beams

WARNING

- READ THESE INSTRUCTIONS CAREFULLY BEFORE ATTEMPTING TO INSTALL, OPERATE OR SERVICE THIS DEVICE.
- Failure to observe safety information and comply with instructions can result in PERSONAL INJURY, DEATH AND/OR PROPERTY DAMAGE.
- To avoid electrical shock or damage to equipment, disconnect power before installing or servicing and use only wiring with insulation rated for full device operating voltage.
- To avoid potential fire and/or explosion do not use it in potentially flammable or explosive atmospheres.
- Retain these instructions for future reference.
- This product, when installed, will be part of an engineered system whose specifications and performance characteristics are not designed or controlled by HK Instruments. Review applications and national and local codes to ensure that the installation will be functional and safe. Use only experienced and knowledgeable technicians to install this device.

SPECIFICATIONS

- **Performance**
 - Accuracy (typ. %/FS):
 - (temperature: -20...85 °C) ± 1.0 %
- **Overload range:**
 - 1.5 times full scale
- **Bursting pressure:**
 - 3.0 times full scale

Technical Specifications

- **Pressure type:**
 - relative pressure
- **Measuring units:**
 - bar
- **Environment:**
 - **Ambient temperature:**
 - PTL-Heat: 0...105 °C, non-condensing
 - PTL-Cool: -40...60 °C
- **Temperature of medium:**
 - PTL-Heat 0...85 °C
 - PTI-Cool: -40...50 °C

Physical

- **Measuring element:**

- Ceramic sensing element
- **Pressure connectors:**
 - pressure G1/4", coupling G1/4"-G1/2"
- **Protection class:**
 - IP65
 - PTL-Heat: one-layer protection
 - PTL-Cool: two-layer protection against condensation

Electrical


- **PTL with current output:**
 - Supply voltage: 10...30 VDC
 - Output signal: 4...20 mA, max load 800 Ω / 24 VDC
- **PTL with voltage output:**
 - Supply voltage: 15..24 VDC / 24 VAC (± 10 %)
 - Output signal: 0...10 V, min load 5 k Ω
- **Conformance**
 - Meets requirements for CE marking:
 - EMC Directive 2014/30/EU
 - RoHS Directive 2011/65/EU
 - WEEE Directive 2012/19/EU

COMPANY WITH


- MANAGEMENT SYSTEM
- CERTIFIED BY DNV GL
- = ISO 9001 = ISO 14001 =

DIMENSIONS

PTL-xx-V

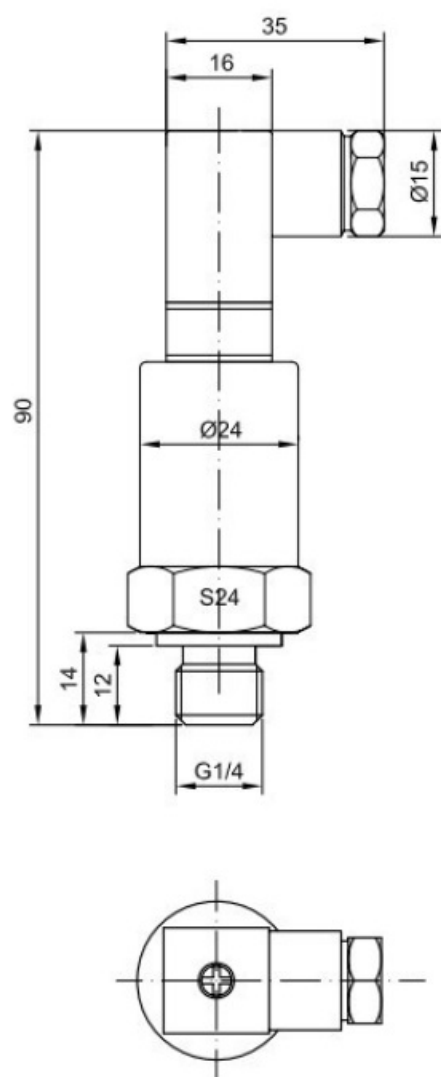


PTL-xx-A

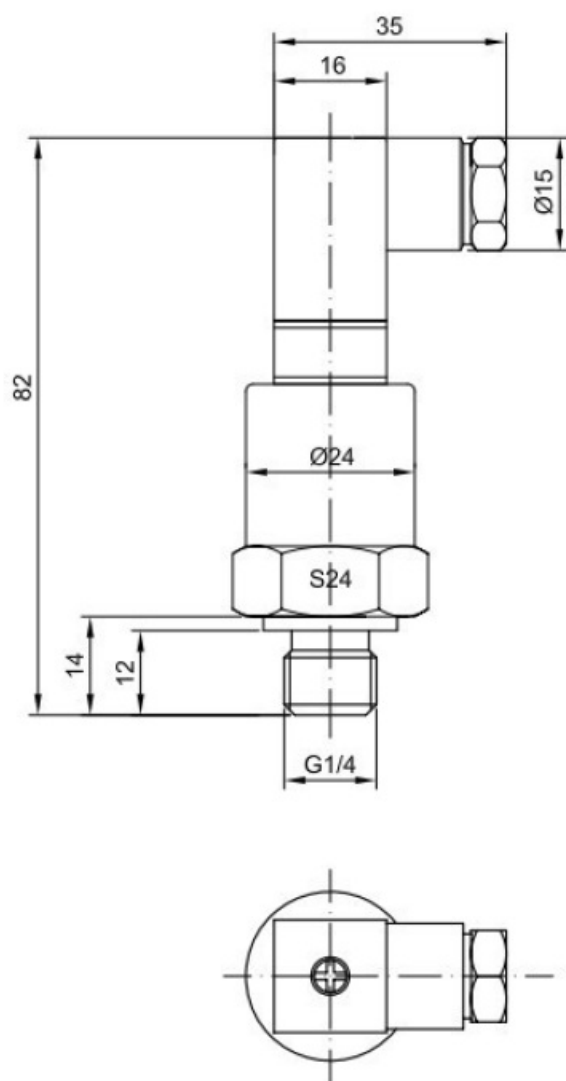

ELECTRICAL CONNECTIONS

PTL-xx-V

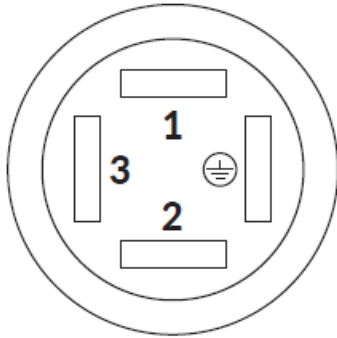


1: Uv: 15–24 VDC / 24 VAC ($\pm 10\%$) (Red)

2: Out 0–10 V (Green)

3: GND (Black)

⊕ Shield (Yellow)

PTL-xx-A

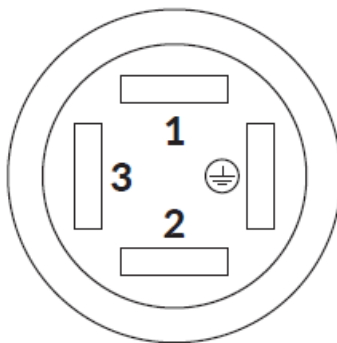

1: Uv: 10–30 VDC (Red)

2: Out 4–20 mA (Green)

⊕ Shield (Black)

RECYCLING/DISPOSAL

The parts left over from installation should be recycled according to your local instructions. Decommissioned devices should be taken to a recycling site that specializes in electronic waste.

WARRANTY POLICY

The seller is obligated to provide a warranty of five years for the delivered goods regarding material and manufacturing. The warranty period is considered to start on the delivery date of the product. If a defect in raw materials or a production flaw is found, the seller is obligated, when the product is sent to the seller without delay or before the expiration of the warranty, to amend the mistake at his/her discretion either by repairing the defective product or by delivering free of charge to the buyer a new flawless product and sending it to the buyer. Delivery costs for the repair under warranty will be paid by the buyer and the return costs by the seller. The warranty does not comprise damages caused by accident, lightning, flood, or other natural phenomenon, normal wear and tear, improper or careless handling, abnormal use, over-loading, improper storage, incorrect care or reconstruction, or changes and installation work not done by the seller. The selection of materials for devices prone to corrosion is the buyer's responsibility unless otherwise is legally agreed upon. Should the manufacturer alter the structure of the device, the seller is not obligated to make comparable changes to devices already purchased. Appealing for warranty requires that the buyer has correctly fulfilled his/her duties arising from the delivery and stated in the contract. The seller will give a new warranty for goods that have been replaced or repaired within the warranty, however only to the expiration of the original product's warranty time. The warranty includes the repair of a defective part or device, or if needed, a new part or device, but not installation or exchange costs. Under no circumstance is the seller liable for damages compensation for indirect damage.

MORE INFORMATION

- www.hkinstruments.fi

Documents / Resources

	HK INSTRUMENTS PTL Series Pressure Transmitters for Liquids [pdf] Installation Guide PTL Series, PTL Series Pressure Transmitters for Liquids, Pressure Transmitters for Liquids, Transmitters for Liquids
---	---

References

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.