



# homematic IP HmIP-WTH-1 Wall Thermostat with Humidity Sensor Instruction Manual



## Contents

- 1 Wall Thermostat with Humidity Sensor**
  - 1.1 HmIP-WTH-1 | HmIP-WTH-A**
    - 1.1.1 Installation and operating manual**
  - 1.2 1 Package contents**
  - 1.3 2 Information about this manual**
  - 1.4 3 Hazard information**
  - 1.5 4 Function and device overview**
  - 1.6 5 General system information**
  - 1.7 6 Start-up**
    - 1.7.1 6.1 Pairing the Homematic IP Access Point**
    - 1.7.2 6.2 Installation**
      - 1.7.2.1 6.2.1 Adhesive strip mounting**
      - 1.7.2.2 6.2.2 Screw mounting**
      - 1.7.2.3 6.2.3 Mounting on flush-mounted boxes**
      - 1.7.2.4 6.2.4 Installation in multiple combinations**
  - 1.8 7 Operation**
  - 1.9 8 Changing the batteries**
  - 1.10 9 Troubleshooting**
    - 1.10.1 9.1 Low battery**
    - 1.10.2 9.2 Command not confirmed**
    - 1.10.3 9.3 Duty Cycle**
    - 1.10.4 9.4 Error codes and flashing sequences**
  - 1.11 10 Restoring factory settings**
  - 1.12 11 Maintenance and cleaning**
  - 1.13 12 General information about radio operation**
  - 1.14 13 Disposal**
  - 1.15 14 Technical specifications**
- 2 Documents / Resources**
  - 2.1 References**
- 3 Related Posts**

## Wall Thermostat with Humidity Sensor

### HmIP-WTH-1 | HmIP-WTH-A



## Installation and operating manual

---

Documentation © 2022 eQ-3 AG, Germany

All rights reserved. Translation from the original version in German. This manual may not be reproduced in any format, either in whole or in part, nor may it be duplicated or edited by electronic, mechanical or chemical means, without the written consent of the publisher.

Typographical and printing errors cannot be excluded. However, the information contained in this manual is reviewed on a regular basis and any necessary corrections will be implemented in the next edition. We accept no liability for technical or typographical errors or the consequences thereof.

All trademarks and industrial property rights are acknowledged.

Changes may be made without prior notice as a result of technical advances.

158463 (web) | Version 1.4 (02/2024)

## 1 Package contents

- 1x Wall Thermostat with Humidity Sensor
- 1x Wall mounting bracket
- 1x Double-sided adhesive strips
- 2x Screws 3.0 x 30 mm
- 2x Plugs 5 mm
- 2x 1.5 V LR6/mignon/AA batteries
- 2x operating manuals
- 1x Supplement sheet with safety instructions

## 2 Information about this manual

Please read this manual carefully before operating your Homematic IP components. Keep the manual so you can refer to it at a later date if you need to. If you hand over the device to other persons for use, please hand over this manual as well.

### Symbols used:



#### **Attention!**

This indicates a hazard.



**Note.** This section contains important additional information!

### 3 Hazard information



Caution! There is a risk of explosion if the batteries are not replaced correctly. Replace only with the same or equivalent type. Never recharge non-rechargeable batteries. Do not throw the batteries into a fire. Do not expose batteries to excessive heat. Do not short-circuit batteries.

Doing so will present a risk of explosion.



Contact with batteries that are dead or damaged can cause skin irritation. Use protective gloves in this case.



Do not open the device. It does not contain any parts that need to be maintained by the user. In the event of an error, please have the device checked by an expert.



For safety and licensing reasons (CE), unauthorized change and/or modification of the device is not permitted.



The device may only be operated in dry and dust-free environment and must be protected from the effects of moisture, vibrations, solar or other methods of heat radiation, cold and mechanical loads.



The device is not a toy: do not allow children to play with it. Do not leave packaging material lying around. Plastic films/bags, pieces of polystyrene, etc. can be dangerous in the hands of a child.



We accept no liability for damage to property or personal injury caused by improper use or failure to observe the hazard warnings. In such cases, all warranty claims are void. We accept no liability for any consequential damage.



The device must only be operated within residential buildings.



Using the device for any purpose other than that described in this operating manual does not fall within the scope of intended use and will invalidate any warranty or liability.

### 4 Function and device overview

The Homematic IP Wall Thermostat offers time-controlled regulation of floor heating systems in connection with Homematic IP Floor Heating Actuators or conventional radiators using Homematic IP Radiator Thermostats according to individually tailored heating phases. The wall thermostat serves to measure the temperature and humidity in a room. The data is cyclically transmitted to a floor heating actuator or radiator thermostats in order to regulate the room temperature precisely. You can pair the wall thermostats with a Homematic IP CCU3 or connect it to the Homematic IP access point in order to control the device comfortably via the Homematic IP app. Thanks to battery operation, the device is highly flexible where mounting and selecting a mounting location are concerned.


The device is mounted and removed very easily with the supplied clip-on frame using screws or adhesive strips. It is compatible with a number of different surfaces including furniture, brick walls, tiles or glass. It is also possible to integrate the wall thermostat into existing switches.

#### Device overview:

- (A) Clip-on frame
- (B) Electronic unit (thermostat)
- (C) Display
- (D) System button (pairing button and LED)
- (E) Control wheel
- (F) Mounting plate

#### Display overview:

- °C Set/actual temperature
- % Humidity
- Warning about condensation
- Open window symbol
- Battery symbol
- Radio transmission
- BOOST** Boost function
- MANU** Manual mode
- AUTO** Automatic mode
- Holiday mode
- Heat
- Cool
- Operating lock
- SET** Setpoint temperature

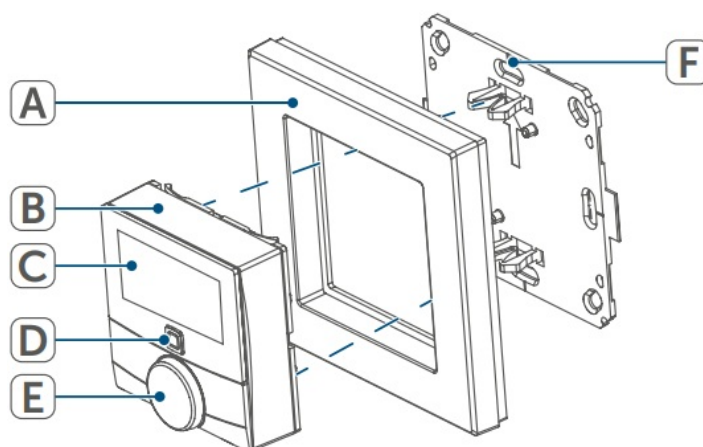

## 5 General system information

This device is part of the climate control solution of Homematic IP and works with the Homematic IP radio protocol. All devices of the climate control solution can be configured comfortably and individually with a smartphone via the Homematic IP app. The available functions provided by the Homematic IP system in combination with other components are described in the Homematic IP User Guide. All current technical documents and updates are provided at [www.homematic-ip.com](http://www.homematic-ip.com).

## 6 Start-up



Please read this entire section before starting the pairing procedure.



For more information on teaching and setting up the wall thermostat using a CCU3, please refer to the WebUI manual on our homepage at [www.homematic-ip.com](http://www.homematic-ip.com).

The wall thermostat must first be added in order to be able to communicate with other devices in your system. To control your heating, you can teach the wall thermostat to the Homematic IP Access Point as described in (see „6.1 Pairing the Homematic IP Access Point” on page 19).


### 6.1 Pairing the Homematic IP Access Point



First set up your Homematic IP Access Point via the Homematic IP app to enable operation of other Homematic IP devices within your system. For further information, please refer to the Access Point operating manual.

To add your wall thermostat to the access point, please proceed as follows:


- Open the Homematic IP app on your smartphone.
- Select “Add device”.
- To remove the electronic unit **(B)** from the frame, take hold of the sides of the electronic unit and pull it out.

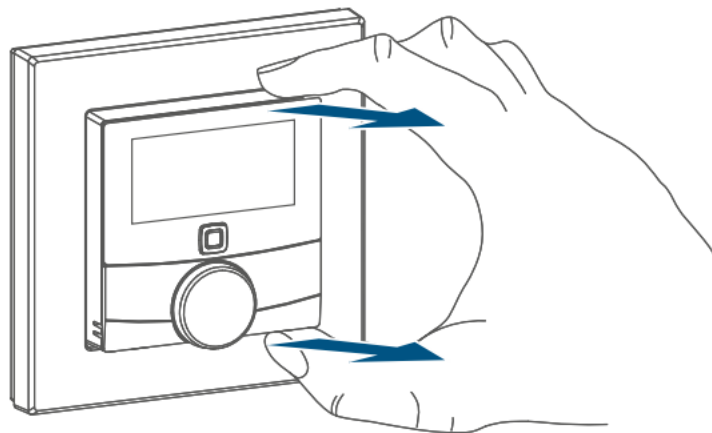

- Turn over the electronic unit **(B)**.
- Remove the insulation strip from the battery compartment of the wall thermostat.
- The pairing mode is active for 3 minutes.



You can manually start the pairing mode for another 3 minutes by pressing the system button (D) briefly.

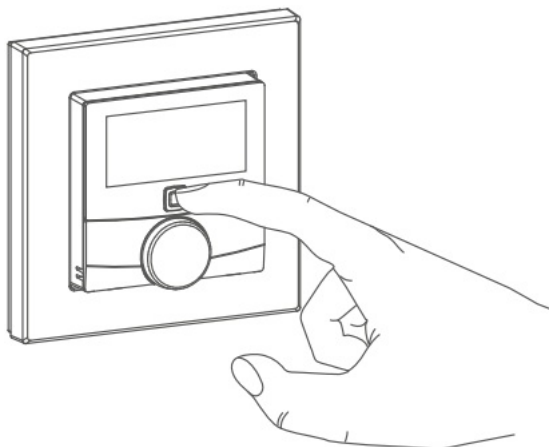

Your device will automatically appear in the Homematic IP app.

- To confirm, enter the last four digits of the device number (SGTIN) in your app, or scan the QR code. The device number can be found on the sticker supplied or attached to the device.
- Wait until pairing is completed.
- If pairing was successful, the LED lights up green. The device is now ready for use.
- If the LED lights up red, please try again.
- Select the desired solution for your device.
- Allocate the device to a room and give the device a name.
- The configuration is then carried out in the Homematic IP app.

## 6.2 Installation



Please read this entire section before starting the installation.

You can use the supplied clip-on frame (**A**) to mount the wall thermostat or easily integrate it into an existing switch (see “6.2.4 Installation in multiple combinations” on page 23).

If you want to mount the wall thermostat with the supplied clip-on frame, you can use

- the supplied double-sided adhesive strips or
- the supplied screws

to fix it to a wall.

You can also mount the wall thermostat on a flush-mounting box.

### 6.2.1 Adhesive strip mounting


For mounting the assembled wall thermostat with the adhesive strips, please proceed as follows:

- Choose a site for installation.



Make sure that the mounting surface is smooth, solid, non-disturbed, free of dust, grease and solvents and not too cold to ensure long-time adherence.

- Fix the adhesive strips (**G**) on the back side of the mounting plate (**F**) in the provided area. Make sure that you can read the letters on the back side (**H**) and that the clips on the mounting plate latch into the openings on the wall thermostat.

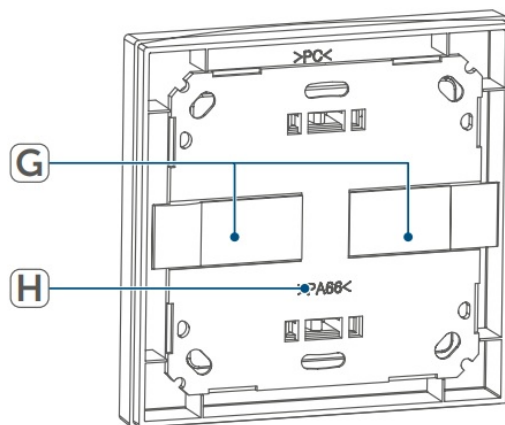

- Remove the protective film from the adhesive strips.
- Press the assembled wall thermostat with the back side to the wall in the position where it should subsequently be attached.

#### 6.2.2 Screw mounting


For mounting the wall thermostat by screws, please proceed as follows:

- Choose a site for installation.



Make sure that no electricity or similar lines run in the wall at this location!

- Position the mounting plate (**F**) on the desired site on the wall. Make sure that the arrow on the mounting plate is pointing upwards.
- Use a pen to mark the positions of bore holes (**J**) (diagonally opposite) in the mounting plate on the wall.

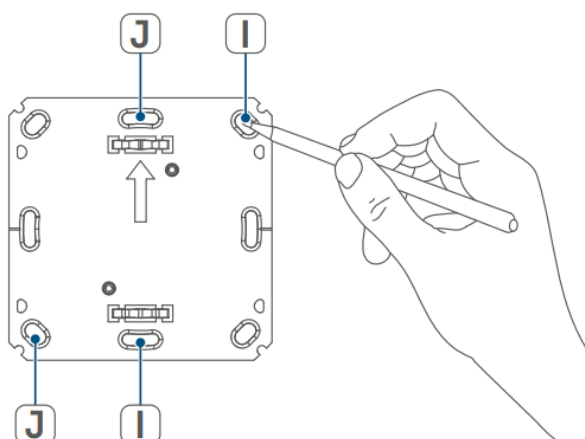


- Now drill the bore holes.




If you are working with a stone wall, use a 5 mm drill bit for the wall plugs supplied. If you are working with wooden walls, you can use a 1.5 mm drill bit to make it easier to screw in the screws.

- Use the supplied screws and plugs (K) to fasten the mounting plate to the wall.

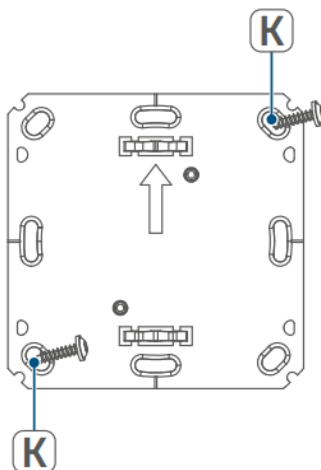

- Attach the clip-on frame (A) to the mounting plate.
- Place the electronic unit (B) back into the frame. Make sure that “TOP” and the arrows on the back side point upwards and that the clips on the mounting plate latch into the openings on the electronic unit.

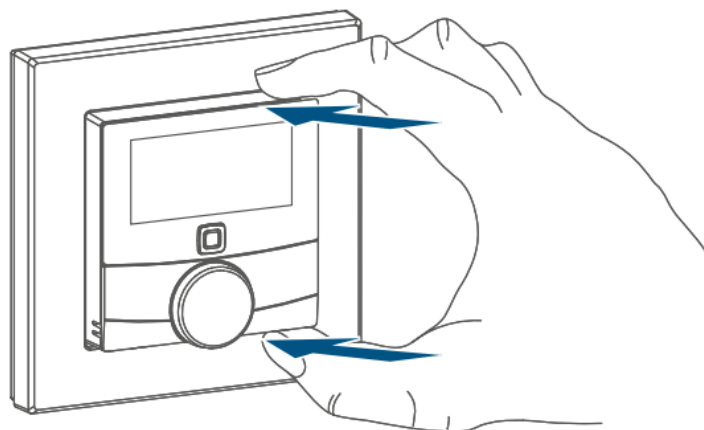

### 6.2.3 Mounting on flush-mounted boxes

You can mount the wall thermostat on flush-mounting/installation boxes using the holes **(I)** (→see figure).



If the device is mounted to a flush-mounting box, there may be no open conductor ends.



If changes or works have to be made on the house installation (e.g. extension, bypass of switch-or socket inserts) or the low-voltage distribution for mounting or installing the device, the following safety instruction must be considered:





Please note! Only to be installed by persons with the relevant electro-technical knowledge and experience!\*

Incorrect installation can endanger

- your own life,
- and the lives of other users of the electrical system.

Incorrect installation also means that you are running the risk of serious damage to property, e.g. from fire. You risk personal liability for personal injury and property damage.

Consult an electrician!

\*Specialist knowledge required for installation:

The following specialist knowledge is particularly important during installation:

- The “5 safety rules” to be used: disconnect from mains; safeguard from switching on again; check that no voltage is present in system; earth and short circuit; cover or cordon off neighbouring live parts;
- Select suitable tool, measuring equipment and, if necessary, personal safety equipment;
- Evaluation of measuring results;
- Selection of electrical installation material for safeguarding shut-off conditions;
- IP protection types;
- Installation of electrical installation material;
- Type of supply network (TN system, IT system, TT system) and the resulting connecting conditions (classical zero balancing, protective earthing, required additional measures etc.).

#### 6.2.4 Installation in multiple combinations

You can mount the wall thermostat with the attachment frame **(A)** provided or use it with frames of other manufacturers as well as integrate the electronic unit **(B)** into a multi-gang frame. You can flexibly fix the mounting plate **(F)** to the wall using adhesive strips or screws. For mounting with multiple combinations, make sure that the mounting plate of the wall thermostat is seamlessly aligned to the already fixed mounting plate/retaining ring.

The wall thermostat is designed to fit into frames supplied by the following manufacturers:

Manufacturer	Frame
Berker	S.1, B.1, B.3, B.7 glass
ELSO	Joy
GIRA	System 55, Standard 55, E2, E22, Event, Esprit
merten	1-M, Atelier-M, M-Smart, M-Arc, M-Star, M-Plan
JUNG	A 500, AS 500, A plus, A creation

## 7 Operation


After configuration, simple operations are available directly on the device.



If the wall thermostat is in standby mode, please press the control wheel **(E)** once before operation to activate the device.


- **Temperature:** Turn the control wheel **(E)** to the right or to the left to manually change the temperature. In automatic mode, the manually set temperature will remain the same until the next point at which the schedule changes. Afterwards, the defined heating schedule will be activated again. During manual operation, the temperature remains activated until the next manual change.
- **Boost function for Homematic IP Radiator Thermostats:** Press the control wheel **(E)** of the wall thermostat briefly to activate the boost function for heating up the radiator quickly and briefly by opening the valve. There will be a pleasant room temperature right away because of the radiated heat.

## 8 Changing the batteries

If the symbol for empty batteries () appears in the display or in the app, please replace the used batteries by two new LR03/micro/AAA batteries. You must observe the correct battery polarity.

To replace the batteries of the wall thermostat, please proceed as follows:

- Once mounted, the electronic unit **(B)** can easily be pulled out of the frame **(A)** and removed from the mounting plate **(F)**. To remove the electronic unit from the frame, take hold of the sides of the electronic unit and pull it out (→see figure). You do not need to open the device.
- Turn the electronic unit over to remove or insert the batteries.
- Insert two new 1.5 V LR03/micro/ batteries into the battery compartment, making sure that you insert them the right way round.

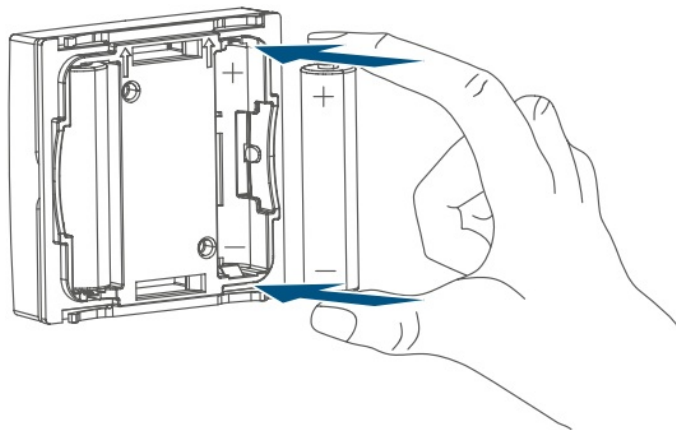


- Put the electronic unit back into the frame. Make sure that “TOP” and the arrows on the back side of the electronic unit point upwards and that the clips on the mounting plate latch into the openings on the electronic unit.
- Please pay attention to the flashing signals of the device LED while inserting the batteries (see “9.4 Error codes and flashing sequences” on page 26).

Once the batteries have been inserted, the wall thermostat will perform a self-test/restart (approx. 2 seconds). Afterwards, initialisation is carried out. The test display will indicate that initialisation is complete: orange and green lighting.

## 9 Troubleshooting

### 9.1 Low battery

Provided that the voltage value permits it, the wall thermostat will remain ready for operation also if the battery voltage is low. Depending on the particular load, it may be possible to send transmissions again repeatedly once the batteries have been allowed a brief recovery period.

If the voltage drops too far during transmission, the empty battery symbol () and the corresponding error code will be displayed on the device (see “9.4 Error codes and flashing sequences” on page 26). In this case, replace the empty batteries by two new batteries (see “8 Changing the batteries” on page 24).

### 9.2 Command not confirmed

If at least one receiver does not confirm a command, the device LED lights up red at the end of the failed transmission process. The failed transmission may be caused by radio interference (see “12 General information about radio operation” on page 28). This may be caused by the following:






- Receiver cannot be reached.
- Receiver is unable to execute the command (load failure, mechanical blockade, etc.).
- Receiver is faulty.

### 9.3 Duty Cycle

The duty cycle is a legally regulated limit of the transmission time of devices in the 868 MHz range. The aim of this regulation is to safeguard the operation of all devices working in the 868 MHz range.

In the 868 MHz frequency range we use, the maximum transmission time of any device is 1% of an hour (i.e. 36 seconds in an hour). Devices must cease transmission when they reach the 1% limit until this time restriction comes to an end. Homematic IP devices are designed and produced with 100% conformity to this regulation. During normal operation, the duty cycle is not usually reached. However, repeated and radio-intensive pairing processes mean that it may be reached in isolated instances during start-up or initial installation of a system. If the duty cycle is exceeded, this is indicated by three slow flashes of the device LED, and may manifest itself in the device temporarily working incorrectly. The device starts working correctly again after a short period (max. 1 hour).

### 9.4 Error codes and flashing sequences

Error and flashing codes	Meaning	Solution
Battery symbol (  )	Battery voltage too low	Replace the batteries of the device (see "8 Changing the batteries" on page 24).
Antenna symbol flashing (  )	Communication error with Homematic IP access point/floor heating actuator	Please check the connection to the Homematic IP access point/floor heating actuator.
Flashing humidity symbol (  )	Humidity limit (60 %) in the room is exceeded	Ventilate the room and switch from cooling to heating mode, if required
Flashing condensation and cooling symbol (  )	Humidity input of Multi IO Box has been activated	Ventilate the room and switch from cooling to heating mode, if required
Lock symbol (  )	Operating lock activated	Deactivate the operating lock via the app.
Short orange flashes	Radio transmission/attempting to transmit/data transmission	Wait until the transmission is completed.
1x long green flash	Operation confirmed	You can continue operation.
1x long red flash	Operation failed	Try again (see "9.2 Command not confirmed" on page 25).
Short orange flashes (every 10 seconds)	Pairing mode active	Please enter the last four numbers of the device serial number for confirmation (see "6.1 Pairing the Homematic IP Access Point" on page 19).
Short orange lighting (after green or red confirmation)	Batteries empty	Replace the batteries (see "8 Changing the batteries" on page 24).
1x long red flash	Transmission failed or duty cycle limit is reached	Please try again (see "9.2 Command not confirmed" on page 25) or (see "9.3 Duty Cycle" on page 25).
6x long red flashes	Device defective	Please see your app for error message or contact your retailer.
1x orange and 1x green light (after inserting batteries)	Test display	After the test display has stopped, you can continue.

## 10 Restoring factory settings



The factory settings of the device can be restored. If you do this, you will lose all your settings.

To restore the factory settings of the wall thermostat, please proceed as follows:

- To remove the electronic unit **(B)** from the frame, take hold of the sides of the electronic unit and pull it out (→see figure).
- Remove one battery.
- Insert the battery ensuring that the polarity is correct (→see figure) and press and hold down the system button

(D) for 4s at the same time, until the LED will quickly start flashing orange (→see figure).

- Release the system button.
- Press and hold down the system button again for 4 seconds, until the LED lights up green.
- Release the system button again to conclude the procedure.

The device will perform a restart.

## 11 Maintenance and cleaning



The device does not require you to carry out any maintenance other than replacing the battery when necessary. Enlist the help of an expert to carry out any maintenance or repairs.

Clean the device using a soft, lint-free cloth that is clean and dry. You may dampen the cloth a little with lukewarm water in order to remove more stubborn marks. Do not use any detergents containing solvents, as they could corrode the plastic housing and label.

## 12 General information about radio operation

Radio transmission is performed on a non-exclusive transmission path, which means that there is a possibility of interference occurring. Interference can also be caused by switching operations, electrical motors or defective electrical devices.



The range of transmission within buildings can differ greatly from that available in the open air. Besides the transmitting power and the reception characteristics of the receiver, environmental factors such as humidity in the vicinity have an important role to play, as do on-site structural/screening conditions.

eQ-3 AG, Maiburger Straße 29, 26789 Leer, Germany hereby declares that the radio equipment type Homematic IP HmIP-WTH-1, HmIP-WTH-A is compliant with Directive 2014/53/EU. The full text of the EU declaration of conformity is available at the following internet address:

[www.homematic-ip.com](http://www.homematic-ip.com)

## 13 Disposal

### Instructions for disposal



This symbol means that the device and the batteries or accumulators must not be disposed of with household waste, the residual waste bin or the yellow bin or yellow bag. For the protection of health and the environment, you must take the product, all electronic parts included in the scope of delivery, and the batteries to a municipal collection point for old electrical and electronic equipment to ensure their correct disposal. Distributors of electrical and electronic equipment or batteries must also take back obsolete equipment or batteries free of charge.

By disposing of it separately, you are making a valuable contribution to the reuse, recycling and other methods of recovery of old devices and old batteries.

You must separate any old batteries and accumulators of old electrical and electronic devices from the old device if they are not enclosed by the old device before handing it over to a collection point and to dispose of them separately at the local collection points. Please also remember that you, the end user, are responsible for deleting personal data on any old electrical and electronic equipment before disposing of it.

### Information about conformity

The CE mark is a free trademark that is intended exclusively for the authorities and does not imply any assurance of properties.

For technical support, please contact your retailer.

## 14 Technical specifications

Device short description:	HmIP-WTH-1, HmIP-WTH-A
Supply voltage:	2x 1.5 V LR03/micro/AAA
Current consumption:	50 mA max.
Battery life:	2 years (typical)
Protection rating:	IP20
Ambient temperature:	0 to 35 °C
Dimensions (W x H x D):	
Without frame:	55 x 55 x 23.5 mm
Including frame:	86 x 86 x 25 mm
Weight:	100 g (including batteries)
Radio frequency:	868.3 MHz/869.525 MHz
Receiver category:	SRD category 2
Typical range in open space:	250 m
Duty cycle:	< 1 % per h/< 10 % per h
Method of operation:	Type 1
Pollution degree:	2

**Subject to technical changes.**

Free download of the  
Homematic IP app!



Manufacturer's authorised representative:



**eQ-3 AG**  
Maiburger Straße 29  
26789 Leer / GERMANY  
[www.eQ-3.de](http://www.eQ-3.de)

## Documents / Resources



[homematic IP HmIP-WTH-1 Wall Thermostat with Humidity Sensor](#) [pdf] Instruction Manual  
HmIP-WTH-1, HmIP-WTH-A, HmIP-WTH-1 Wall Thermostat with Humidity Sensor, Wall Thermostat with Humidity Sensor, Thermostat with Humidity Sensor, Humidity Sensor

## References

-  [Home page | Homematic IP](#)
- [User Manual](#)

### Manuals+. [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.