

ICON
PROCESS CONTROLS
**TK3S Series Paddle
Wheel Flow Meter
Sensor**



ICON PROCESS CONTROLS TK3S Series Paddle Wheel Flow Meter Sensor User Guide

[Home](#) » [ICON PROCESS CONTROLS](#) » [ICON PROCESS CONTROLS TK3S Series Paddle Wheel Flow Meter Sensor User Guide](#) 

Contents

- [1 ICON PROCESS CONTROLS TK3S Series Paddle Wheel Flow Meter Sensor](#)
- [2 Safety Information](#)
- [3 Product Description](#)
- [4 Technical Specifications](#)
- [5 Exploded View](#)
- [6 Wiring Diagram](#)
- [7 Programming](#)
- [8 Alarm Mode Selection](#)
- [9 Model Selection](#)
- [10 Dimensions](#)
- [11 Procedure to Rotate Display](#)
- [12 Installation Position](#)
- [13 Warranty](#)
- [14 FAQ](#)
- [15 contact](#)
- [16 Documents / Resources](#)
 - [16.1 References](#)
- [17 Related Posts](#)



ICON PROCESS CONTROLS TK3S Series Paddle Wheel Flow Meter Sensor



Safety Information

- De-pressurize and vent system prior to installation or removal
- Confirm chemical compatibility before use
- DO NOT exceed maximum temperature or pressure specifications
- ALWAYS wear safety goggles or face-shield during installation and/or service
- DO NOT alter product construction



Warning | Caution | Danger

- Indicates a potential hazard. Failure to follow all warnings may lead to equipment damage, injury, or death.



Note | Technical Notes

- Highlights additional information or detailed procedure.



Personal Protective Equipment (PPE)

- Always utilize the most appropriate PPE during the installation and service of TruFlo® products.



Pressurized System Warning

A sensor may be under pressure. Take caution to vent the system before installation or removal. Failure to do so may result in equipment damage and/or serious injury.

- Please ensure that the Instruments are not to be subject to water hammer or pressure spikes! Always Pressure the Test System with H₂O Before the Initial Start-Up
- Before installation be certain the appropriate instrument has been selected considering operating pressure, full-scale pressure, wetted material requirements, media compatibility, operating temperature, vibration, pulsation, desired accuracy, and any other
- instrument component related to the service application including the potential need for protective attachments and/or special installation requirements. Failure to do so could result in equipment damage, failure, and/or personal injury. Ensure only qualified
- personnel are permitted to install and maintain this instrument.

Pressurize System Warning


- The sensor may be under pressure, take caution to vent the system prior to installation or removal. Failure to do so may result in equipment damage and/or serious injury.

Please Ensure Full Pipe

- TK Series can be installed in a horizontal or vertical direction. Please ensure enough length of straight pipe to avoid intensified turbulent flow that can affect readings.
- Min 10x Pipe Diameters Upstream 3x Pipe Diameters Downstream (See Page 10)
- A Bag Filter or Y Strainer Filtering Device upstream to Avoid the Paddle Wheel from being damaged by the solids or fibers – max 10% Particle Size – Not to Exceed .5mm Cross Section or Length. Please do not flush the pipe after the Flow Meter is installed with compressed air this may damage the ceramic shaft and will void the warranty.

Product Description

The TK Series in-line plastic paddle wheel flow meter has been engineered to provide long-term accurate flow measurement in tough industrial applications. The paddle wheel assembly consists of an engineered Tefzel® paddle and micro-polished zirconium ceramic rotor pin and bushings. High-performance Tefzel® and Zirconium materials have been selected due to their excellent chemical and wear-resistant properties.

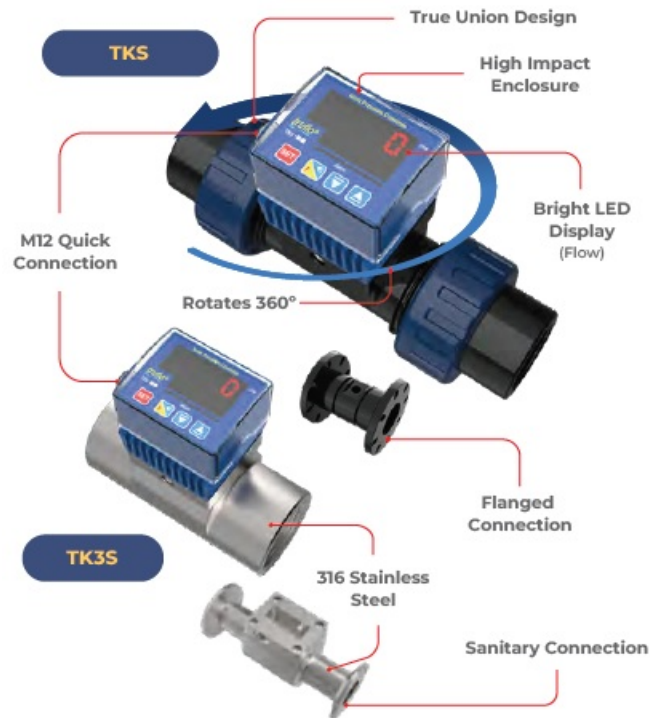

New ShearPro® Design

- Contoured Flow Profile
- Reduced Turbulence = Increased Longevity
- 78% Less Drag than Old Flat Paddle Design*
- Ref: NASA "Shape Effects on Drag"

Tefzel® Paddle Wheel


- ✓ Superior Chemical And Wear Resistance vs PVDF

Zirconium Ceramic Rotor | Bushings

- ✓ Up to 15x the Wear Resistance vs Regular Ceramic
- ✓ Integral Rotor Bushings Reduce Wear and Fatigue Stress

ShearPro® Through-Pin Design

- ✓ Eliminates Finger Spread
- ✓ No Lost Paddles
- ✓ Increased Temp. Rating
- ✓ 360° Housing Protects Rotor

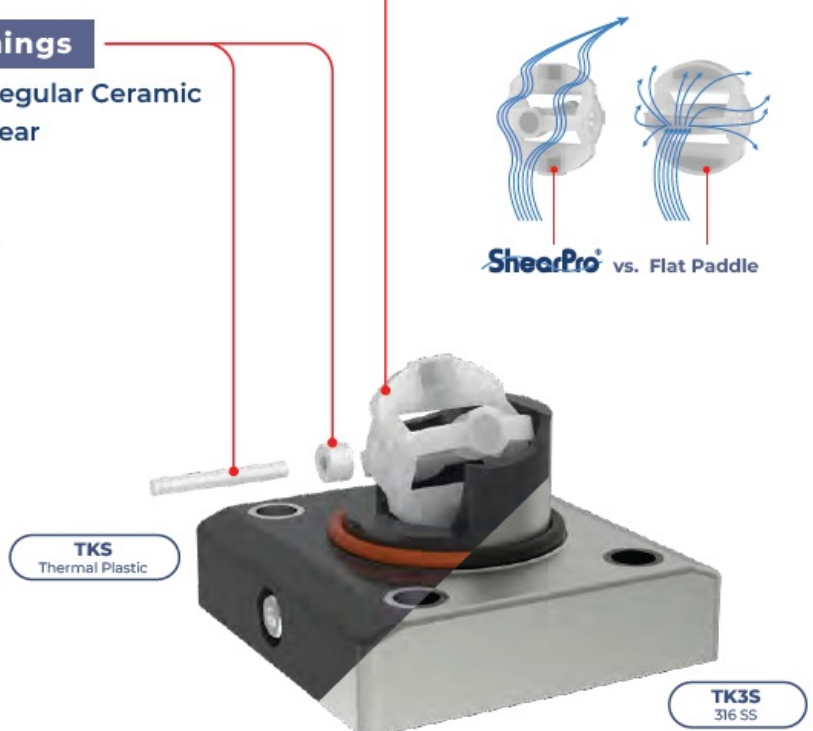


Technical Specifications


General		
Operating Range	0.3 to 33 ft/s	0.1 to 10 m/s
Pipe Size Range	¼ to 4" **	DN08 to DN100
Linearity	±0.5% of F.S @ 25°C 77°F	
Repeatability	±0.5% of F.S @ 25°C 77°F	
Fluid	Water or Chemical Liquid-Viscosity Range: .5-20 centistokes	
Flow Velocity	10 m/s max.	
Low Cut	0.3 m/s min.	
Operating Pressure	150 Psi (10 Bar) @ Ambient Temp Non-Shock	
Range Ability	10 : 1	
Response Time	Real Time	
Flow Total Meter	Range = 0~999999 ; Unit = Gallon or Liter or Ton (KL) Selectable	
Repeatability	Range = 0.0~999.9 ; Unit = GPM or LPM or CMH Selectable	
Accuracy	± 0.5% of F.S. @ 25°C	
Wetted Materials		
Sensor Body	PVC (Dark) PP (Pigmented) PVDF (Natural) 316 SS	
O-Rings	FKM EPDM* FFKM*	
Rotor Pin Bushings	Zirconium Ceramic ZrO2	
Paddle Rotor	ETFE Tefzel®	
Electrical		
Frequency	49 Hz per m/s nominal	15 Hz per ft/s nominal
Supply Voltage	9 to 30 VDC ±10% regulated	
Supply Current	<1.5 mA @ 3.3 to 6 VDC	<20 mA @ 6 to 24 VDC
Max. Temperature/Pressure Rating – Standard and Integral Sensor Non-Shock		

PVC	180 Psi @ 68°F 40 Psi @ 140°F	12.5 Bar @ 20°C 2.7 Bar @ 60°C
PP	180 Psi @ 68°F 40 Psi @ 190°F	12.5 Bar @ 20°C 2.7 Bar @ 88°C
PVDF	200 Psi @ 68°F 40 Psi @ 240°F	14 Bar @ 20°C 2.7 Bar @ 115°C
316 SS	200 Psi @ 180°F 40 Psi @ 300°F	14 Bar @ 82°C 2.7 Bar @ 148°C
Operating Temperature		
PVC	32°F to 140°F	0°C to 60°C
PP	-4°F to 190°F	-20°C to 88°C
PVDF	-40°F to 240°F	-40°C to 115°C
316 SS	-40°F to 300°F	-40°C to 148°C
Outputs		
NPN Pulse 1 Amp Relay		
Display		
LED Flow Rate		
Standards and Approvals		
UL CE FCC RoHS Compliant		

Exploded View

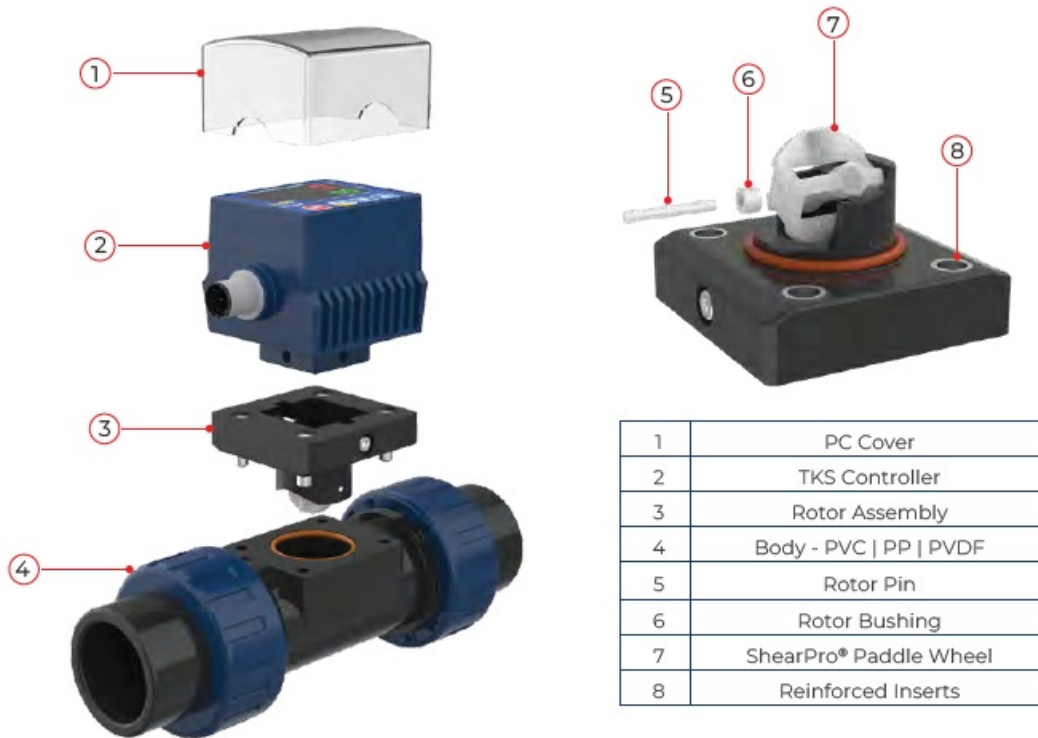

Wiring Diagram

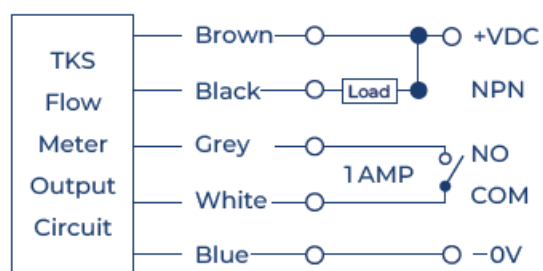

Wire Color	Description
Brown	+ 10~30VDC
Blue	-VDC
Black	Flow Rate Pulse Output (OP1)
White	COM
Grey	NO







Programming

<div> <div>SET</div> <div>Select/Save/Continue</div> </div> <div> <div>F</div> <div>Move Selection Left</div> </div> <div> <div>▲</div> <div>▼</div> <div>Change Digit Value</div> </div>		
STEPS	DISPLAY	OPERATION
<div>1</div> <div>Home Screen</div> <div> <div>SET</div> <div> <div>3 SEC</div> </div> </div>		Home Screen
<div>2</div> <div>Lock Settings</div> <div> <div>SET</div> </div>		Lock Settings Factory Default: Lk = 10 Otherwise meter will enter Lockout Mode*
<div>3</div> <div>K Factor</div> <div> <div>SET</div> </div>		K Factor Value Enter K Factor value depending on pipe size. Refer to Page 7 for K-Factor Values
<div>4</div> <div>Flow Unit</div> <div> <div>SET</div> </div>		Flow Unit Ut.0 = Liter Ut.1 = Gallon (Factory Default) Ut.2 = Kiloliters
<div>5</div> <div>Pulse Output Control</div> <div> <div>SET</div> </div>		Pulse Output Control Con.E = One Pulse/Gal (Factory Default) Con.F = Paddle Pulse ▶ Frequency Max 5 KHZ
<div>6</div> <div>Alarm Mode Setting</div> <div> <div>SET</div> </div>		Alarm Mode Setting Factory Default: ALt = 0 Range: 0~3 Refer to Alarm Mode Selection (See below)
<div>7</div> <div>Alarm Output Delay</div> <div> <div>SET</div> </div>		Alarm Output Delay Factory Default: t = 20 Range: 01 ~ 99 Secs

Alarm Mode Selection

ALt No.	Description
ALt = 0	$CV \geq SV \rightarrow \text{Relay ON} \mid CV < [SV - d] \rightarrow \text{Relay OFF}$
ALt = 1	$CV \leq SV \rightarrow \text{Relay ON} \mid CV > [SV + d] \rightarrow \text{Relay OFF}$
ALt = 2	$[SV + d] \geq CV \geq [SV - d] \rightarrow \text{Relay ON} \mid CV > [SV + d] \text{ or } CV < [SV - d] \rightarrow \text{Relay OFF}$
ALt = 3	$[SV + d] \geq CV \geq [SV - d] \rightarrow \text{Relay OFF} \mid CV > [SV + Hys] \text{ or } CV < [SV - d] \rightarrow \text{Relay ON}$
d = Hysteresis — Acts like a buffer \pm around Alarm Set Point	
CV: Current Value (Flow Rate) SV = Set Value	

Programming Relay

STEPS	DISPLAY	OPERATION
1 Home Screen 		Home Screen
2 Relay Set Point 		Enter Relay Set Point Factory Default: 100 Range: 0 ~ 999.9
3 Hysteresis 		Enter Hysteresis Value Factory Default: 1.0 Range: 0 ~ 99.9

K-Factors for TK Series (V1)

- SS Only
- SS Only

Size	LPM	GPM
1/4"	547	2079
3/8"	300	1140
1/2"	127.6	484.9
3/4"	81.8	310.8
1"	55.1	209.4
1 1/2"	18.8	71.4
2"	10.2	38.8
3"	4.7	18
4"	2.1	8
⚠ K-Factor is Pre-Programmed		

Min/Max Flow Rates

Pipe Size	(O.D.)	LPM	GPM	LPM		GPM
		0.3m/s	min.	10m/s		max.
DN08	(1/4")	0.6	0.16	12		3
DN10	(3/8")	1.8	0.48	50		13
DN15	(1/2")	3.5	1.0	120		32
DN20	(3/4")	5.0	1.5	170		45
DN25	(1")	9.0	2.5	300		79
DN40	(1 1/2")	25.0	6.5	850		225
DN50	(2")	40.0	10.5	1350		357
DN65	(2 1/2")	60.0	16.0	1850		357
DN80	(3")	90.0	24.0	2800		739
DN100	(4")	125.0	33.0	4350		1149


K-Factors for TK Series (V2)

Size	K-Factor
1/2"	127.6
3/4"	81.8
1"	55.1
1 1/2"	18.8
2"	10.2
2 1/2"	6.0

Temperature | Pressure Graphs | Non-Shock

Note: The Pressure/Temperature graphs are specifically for the Truflo® Flow Meter Sensors. During system design the specifications of all components must be considered.

■ = PVC ■ = PP ■ = PVDF

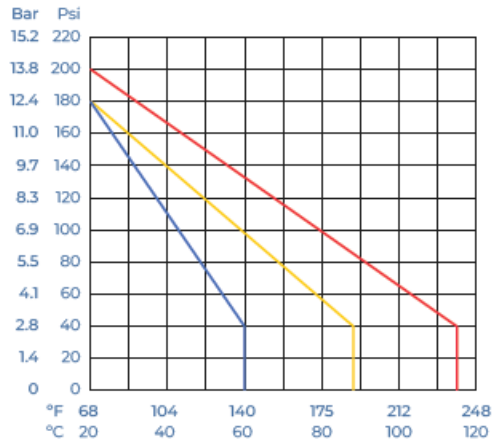

Model Selection

PVC		
Size	End Connections	Part Number
½"	Sch 80 Soc	TKS-15-P
¾"	Sch 80 Soc	TKS-20-P
1"	Sch 80 Soc	TKS-25-P
1 ½"	Sch 80 Soc	TKS-40-P
2"	Sch 80 Soc	TKS-50-P
3"	Flanged	TKS-80-P
4"	Flanged	TKS-100-P

Add 1st Suffix (end connection):

- T ▶ NPT End Connectors (on PVC)
- B ▶ Butt Fused End Connections for PP or PVDF
- F ▶ Flange ANSI 150lb - Consult Factory

PP		
Size	End Connections	Part Number
½"	NPT	TKS-15-PP
¾"	NPT	TKS-20-PP
1"	NPT	TKS-25-PP
1 ½"	NPT	TKS-40-PP
2"	NPT	TKS-50-PP
3"	Flanged	TKS-80-PP
4"	Flanged	TKS-100-PP

Add 2nd Suffix (seals):

- FKM (std, no suffix required)
- E ▶ EPDM Seals
- K ▶ FFKM | Kalrez® Seals

PVDF		
Size	End Connections	Part Number
½"	NPT	TKS-15-PF
¾"	NPT	TKS-20-PF
1"	NPT	TKS-25-PF
1 ½"	NPT	TKS-40-PF
2"	NPT	TKS-50-PF

Note: PVC Socket Ends (Std)
PP/PVDF NPT Ends (Std)

316 SS		
Size	End Connections	Part Number
¼"	NPT	TK3S-08-SS
⅜"	NPT	TK3S-10-SS
½"	NPT	TK3S-15-SS
¾"	NPT	TK3S-20-SS
1"	NPT	TK3S-25-SS
1 ½"	NPT	TK3S-40-SS
2"	NPT	TK3S-50-SS
3"	NPT	TK3S-80-SS
4"	NPT	TK3S-100-SS


Add 1st Suffix (end connection):

- T ▶ NPT End Connectors
- SE ▶ Sanitary - Consult Factory for Pricing
- F ▶ Flange ANSI 150lb - Consult Factory

Add 2nd Suffix (seals):


- FKM (std, no suffix required)
- E ▶ EPDM Seals
- K ▶ FFKM | Kalrez® Seals

Dimensions

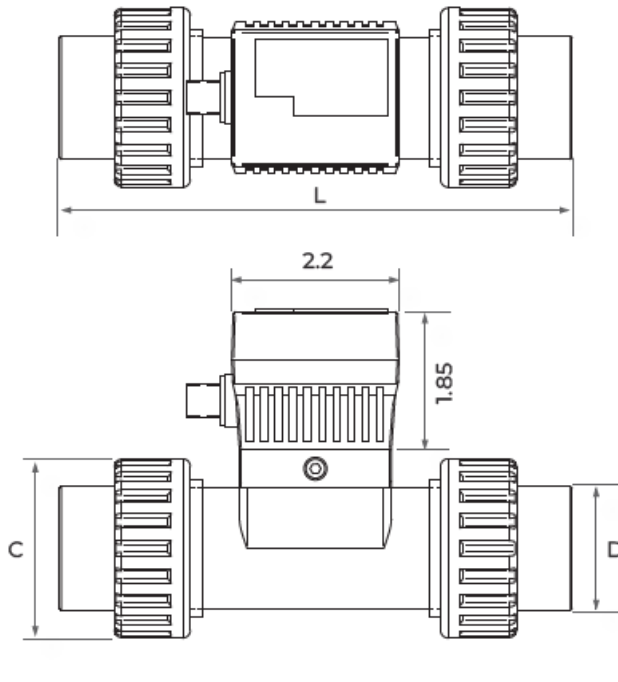


Pipe Size	L (inch)	D (inch)	C (inch)
½" DN (15)	5.48	1.07	1.61
¾" DN (20)	6.12	1.36	2.08
1" DN (25)	6.76	1.68	2.36
1½" DN (40)	7.66	2.33	3.26
2" DN (50)	8.40	2.86	4.33

Procedure to Rotate Display

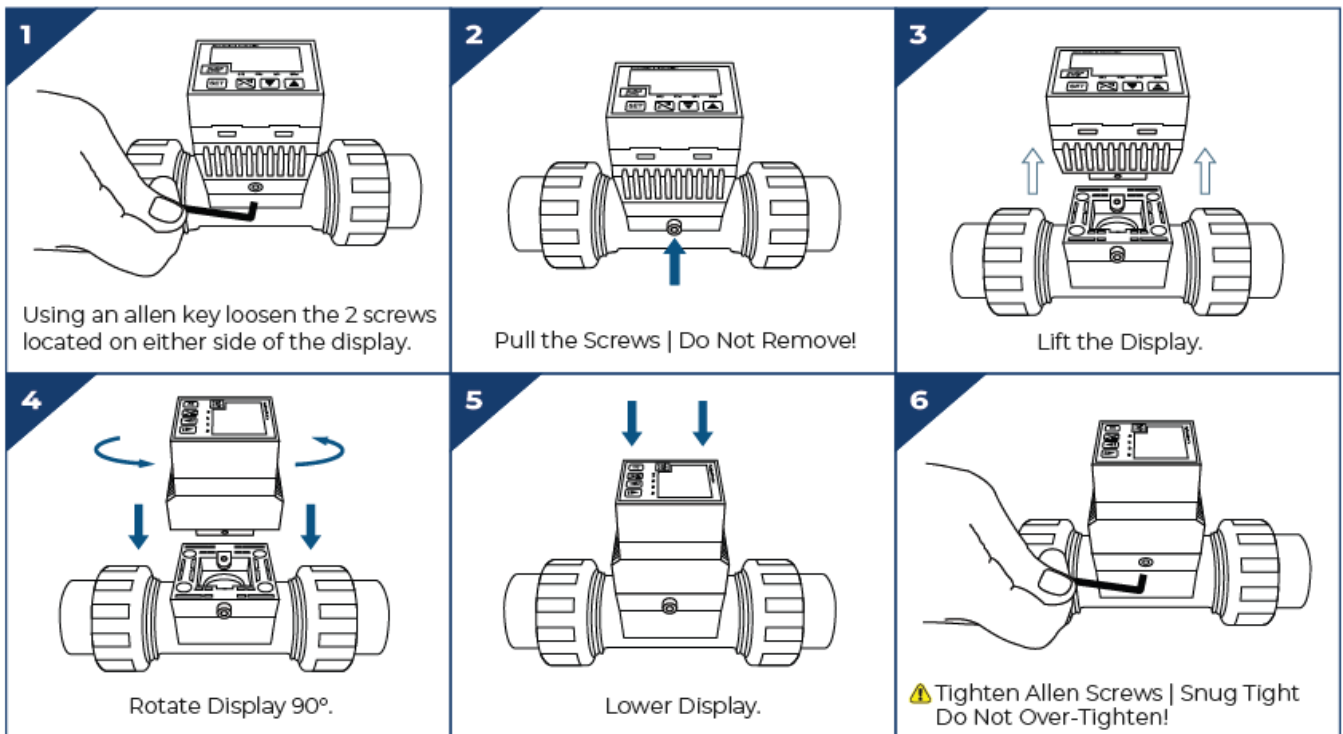

Installation Position

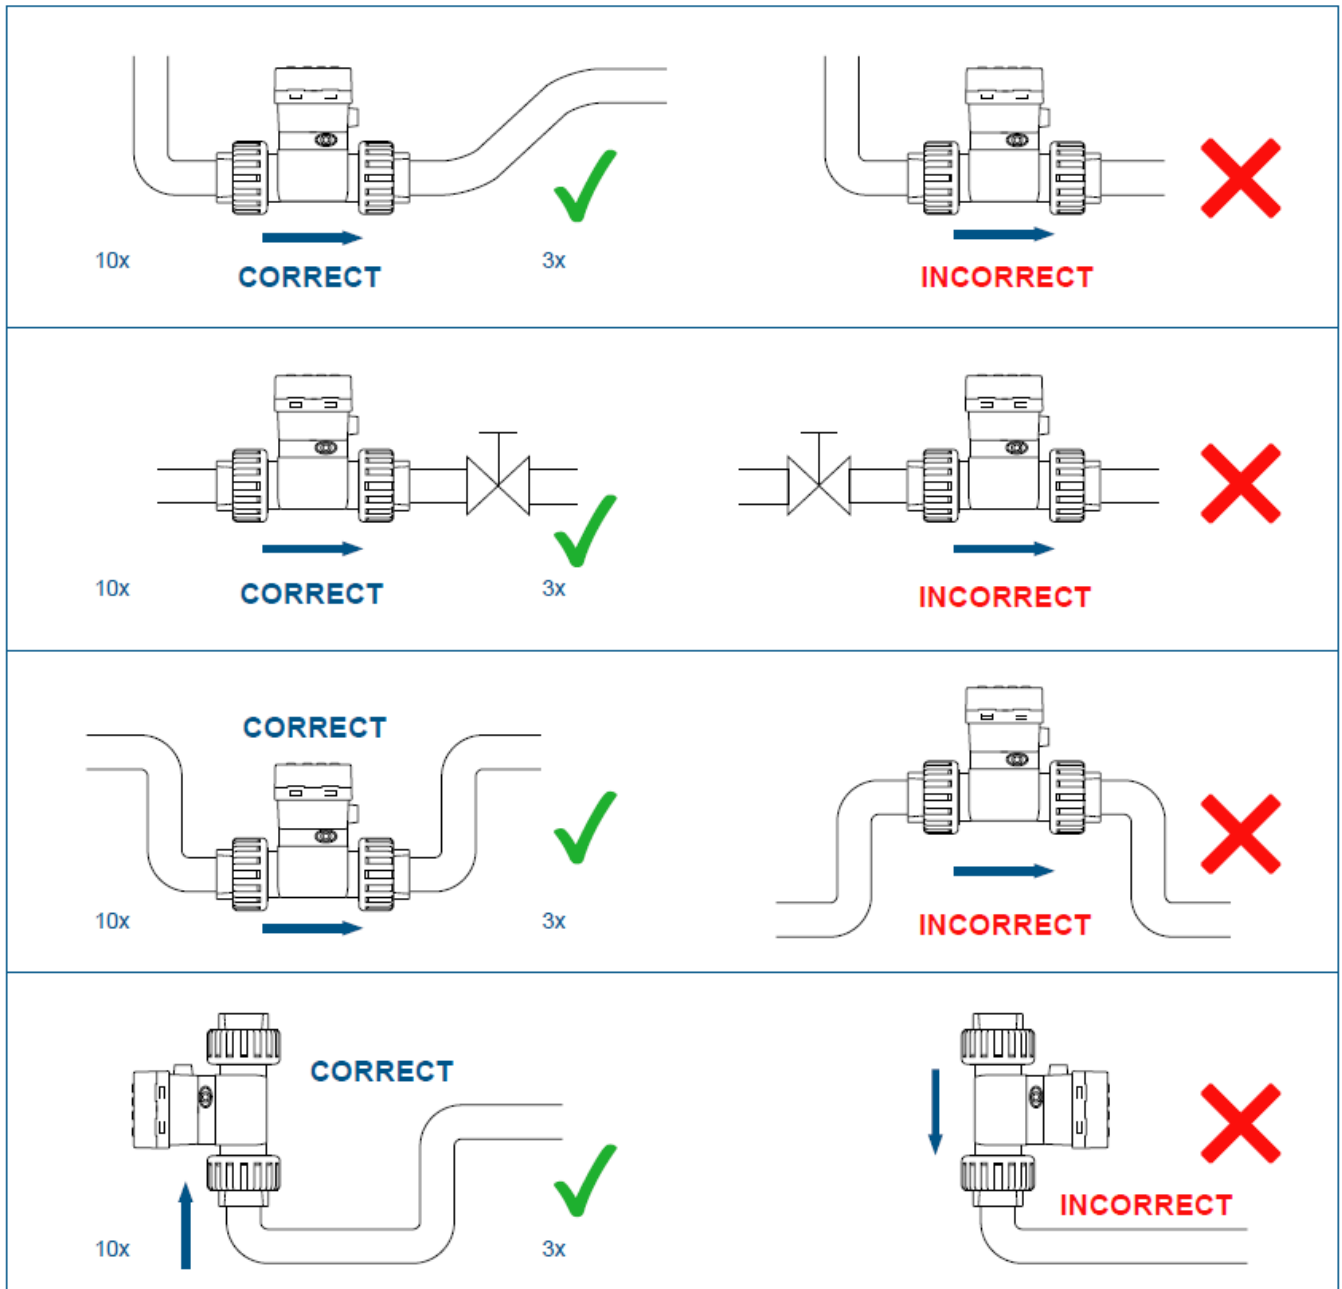

Please Ensure Full Pipe

- TK Series can be installed in a horizontal or vertical direction.
- Please ensure enough length of straight pipe to avoid turbulence that can effect readings.

Note: Min 10x Pipe Diameters Upstream 3x Pipe Diameters Downstream.

- A Plastic Basket Strainer, Bag Filter or Y Strainer Filtering Device upstream to Avoid the Paddle Wheel from being damaged by the solids or
- fibers – max 10% Particle Size – Not to Exceed .5mm Cross Section or Length.

Please do not flush the pipe after the Flow Meter is installed with Compressed Air this may damage the ceramic shaft and will Void Warranty.

Warranty

Warranty, Returns and Limitations

Warranty

- Icon Process Controls Ltd warrants to the original purchaser of its products that such products will be free from defects in material and workmanship under normal use and service following instructions furnished by Icon Process Controls Ltd for a
- period of one year from the date of sale of such products.
- Icon Process Controls Ltd's obligation under this warranty is solely and exclusively limited to the repair or replacement, at Icon Process Controls Ltd option, of the products or components, which Icon
- Process Controls Ltd examination determines to its satisfaction to be defective in material or workmanship within the warranty period.
- Icon Process Controls Ltd must be notified according to the instructions below of any claim under this warranty within thirty (30) days of any claimed lack of conformity of the product.
- Any product repaired under this warranty will be warranted only for the remainder of the original warranty period. Any product provided as a replacement under this warranty will be warranted for the one year from the date of replacement.

Returns

- Products cannot be returned to Icon Process Controls Ltd without prior authorization. To return a product that is thought to be defective submit a customer return (MRA) request form and follow the instructions therein. All warranty and non-warranty
- product returns to Icon Process Controls Ltd must be shipped prepaid and insured. Icon Process Controls Ltd will not be responsible for any products lost or damaged in shipment.

Limitations

This warranty does not apply to products which:

1. are beyond the warranty period or are products for which the original purchaser does not follow the warranty procedures outlined above;
2. have been subjected to electrical, mechanical or chemical damage due to improper, accidental or negligent use;
3. have been modified or altered;
4. anyone other than service personnel authorized by Icon Process Controls Ltd have attempted to repair;
5. have been involved in accidents or natural disasters; or
6. are damaged during return shipment to Icon Process Controls Ltd

Icon Process Controls Ltd reserves the right to unilaterally waive this warranty and dispose of any product returned to Icon Process Controls Ltd where:

1. there is evidence of a potentially hazardous material present with the product;
2. or the product has remained unclaimed at Icon Process Controls Ltd for more than 30 days after Icon Process Controls Ltd has dutifully requested disposition.

This warranty contains the sole express warranty made by Icon Process Controls Ltd in connection with its products. ALL IMPLIED WARRANTIES, INCLUDING WITHOUT LIMITATION, THE WARRANTIES OF MERCHANTABILITY AND FITNESS FOR A PARTICULAR PURPOSE, ARE EXPRESSLY DISCLAIMED. The remedies of repair or replacement as stated above are the exclusive remedies for the breach of this warranty. IN NO EVENT SHALL Icon Process Controls Ltd BE LIABLE FOR ANY INCIDENTAL OR CONSEQUENTIAL DAMAGES OF ANY KIND INCLUDING PERSONAL OR REAL PROPERTY OR FOR INJURY TO ANY PERSON. THIS WARRANTY CONSTITUTES THE FINAL, COMPLETE AND EXCLUSIVE STATEMENT OF WARRANTY TERMS AND NO PERSON IS AUTHORIZED TO MAKE ANY OTHER WARRANTIES OR REPRESENTATIONS ON BEHALF OF Icon Process Controls Ltd. This warranty will be interpreted pursuant to the laws of the province of Ontario, Canada.

If any portion of this warranty is held to be invalid or unenforceable for any reason, such finding will not invalidate any other provision of this warranty.

FAQ

- **Q:** Can the flow meter be used with chemicals other than water?
- **A:** The flow meter is suitable for use with water or chemical liquids within the viscosity range of 0.5-20 centistokes. Ensure chemical compatibility before use.
- **Q:** What is the maximum operating pressure of the flow meter?
- **A:** The flow meter can operate at a maximum pressure of 150 Psi (10 Bar) at ambient temperature without shock.

contact

- Valuetesters.com
- info@valuetesters.com

Documents / Resources



[ICON PROCESS CONTROLS TK3S Series Paddle Wheel Flow Meter Sensor](#) [pdf] User Guide
TK3S Series Paddle Wheel Flow Meter Sensor, TK3S Series, Paddle Wheel Flow Meter Sensor, Wheel Flow Meter Sensor, Flow Meter Sensor, Meter Sensor

References

- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.