


iSMACONTROLLI iSMA-B-AAC20 Sedona Advanced Application Controller Instruction Manual

[Home](#) » [iSMACONTROLLI](#) » iSMACONTROLLI iSMA-B-AAC20 Sedona Advanced Application Controller Instruction Manual 


iSMACONTROLLI iSMA-B-AAC20 Sedona Advanced Application Controller Instruction Manual

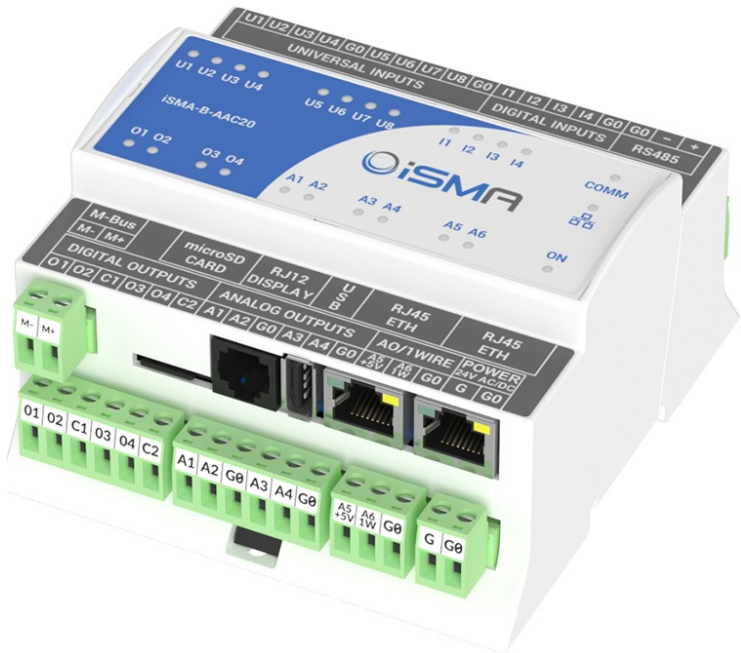

Contents


- 1 TOP PANEL
- 2 UNIVERSAL INPUTS
- 3 DIGITAL INPUTS
 - 3.1 COMMUNICATION
- 4 POWER SUPPLY
 - 4.1 ANALOG OUTPUTS
 - 4.2 DALI
 - 4.3 M-Bus
 - 4.4 WARNING
- 5 BLOCK DIAGRAM
- 6 1-WIRE
- 7 RS485 CONFIGURATION
- 8 FCC COMPLIANCE NOTE
- 9 WIRING
- 10 INSTALLATION GUIDELINE
- 11 Contact Us
- 12 Documents / Resources
 - 12.1 References
- 13 Related Posts

TOP PANEL

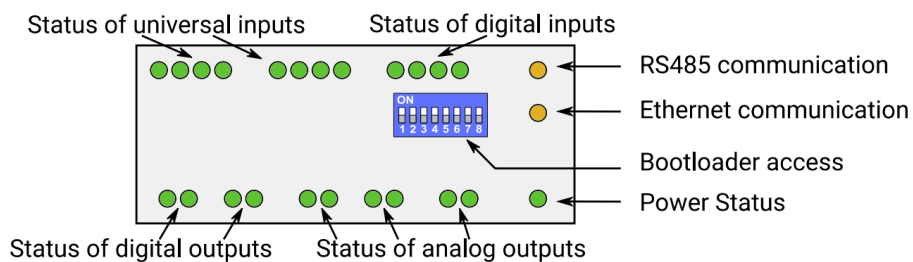


UNIVERSAL INPUTS


- Voltage measurement

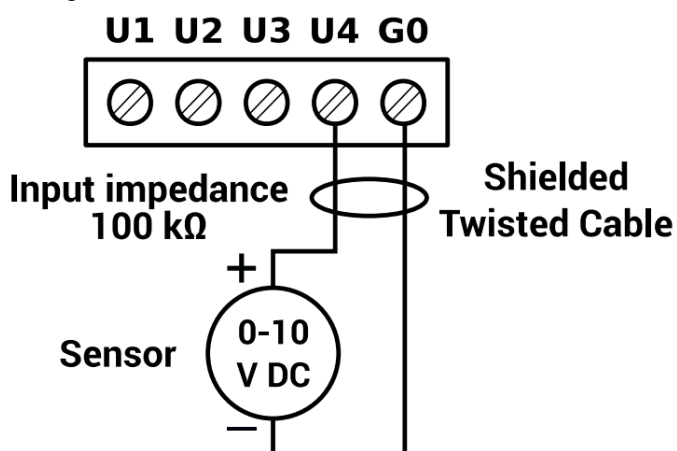


- Current measurement

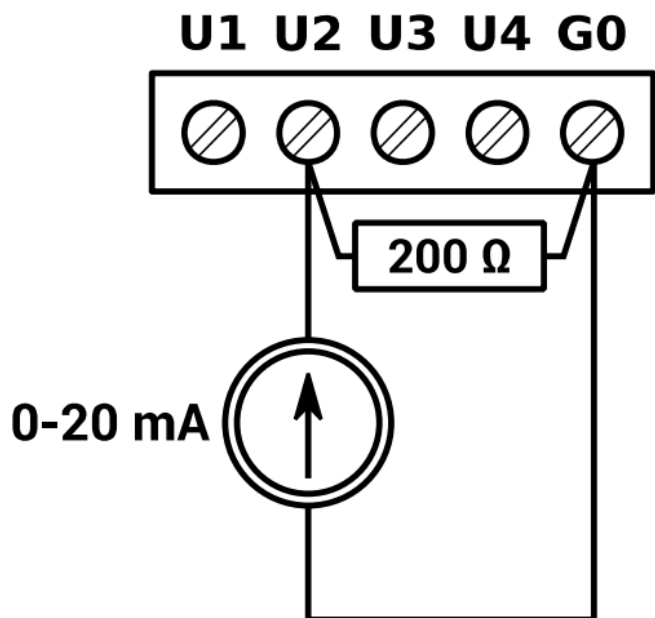

- Temperature measurement

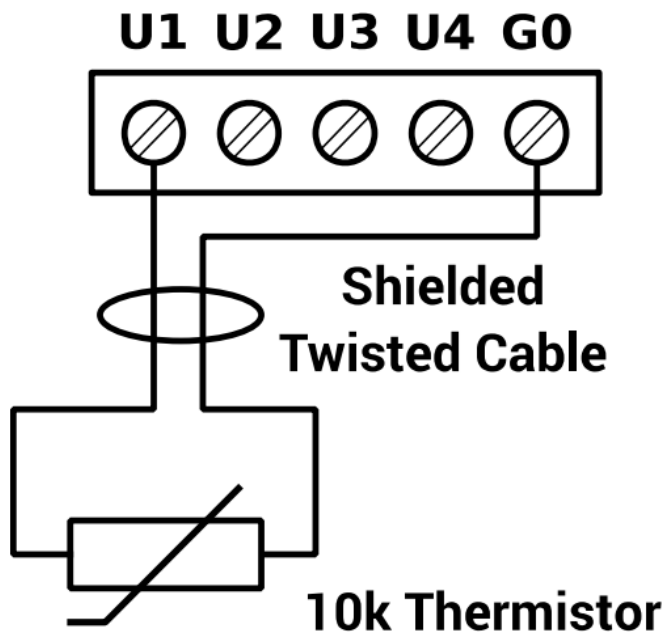


- Dry contact input

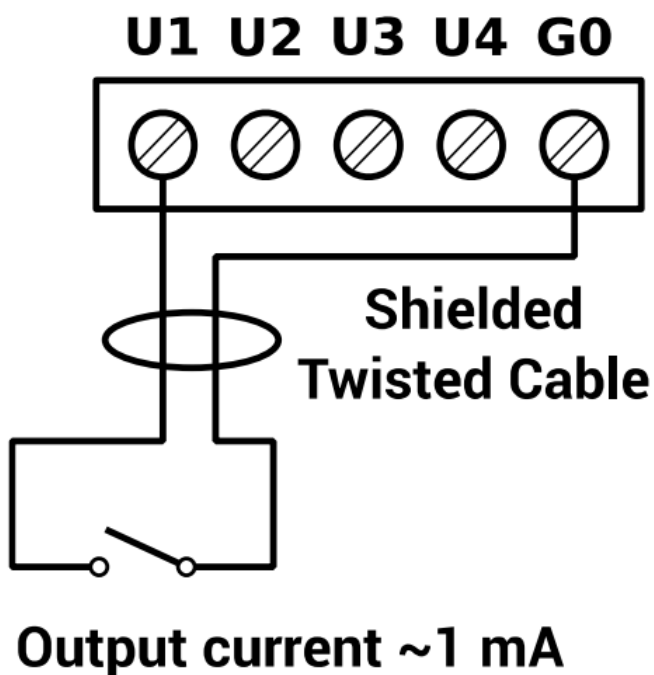


DIGITAL INPUTS

- Dry contact input

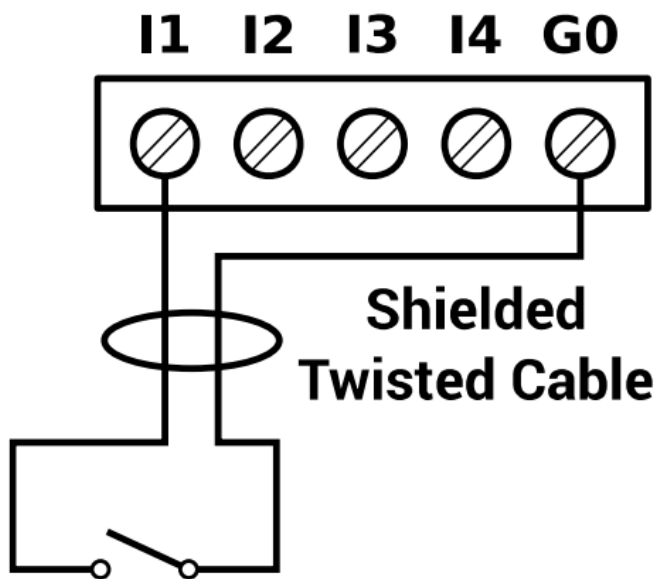


Output current ~1 mA


- Connection of electrovalve.

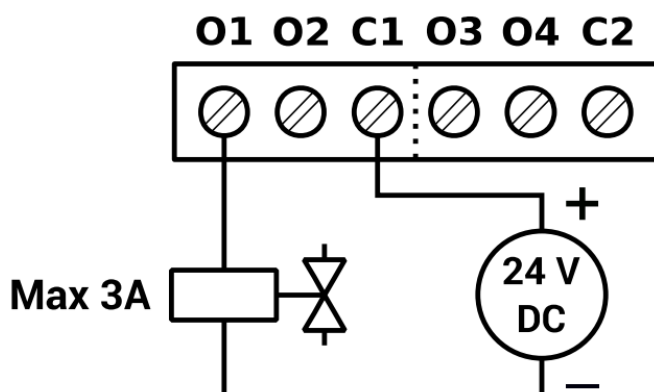


- Connection of resistive load

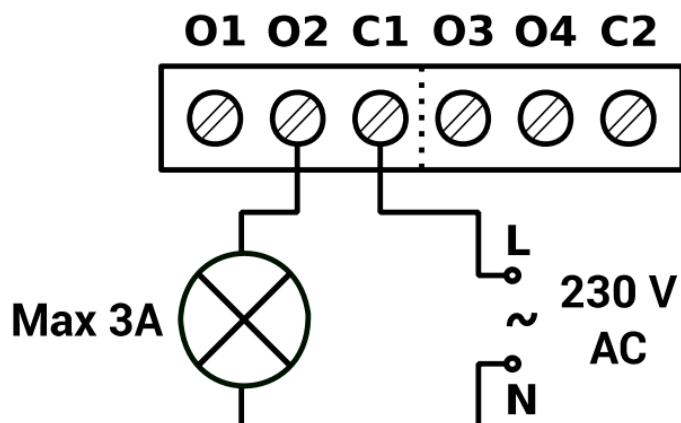


- Connection of inductive load

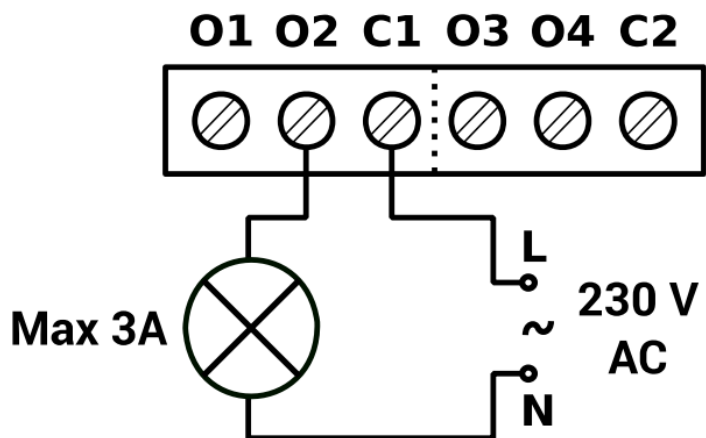


COMMUNICATION

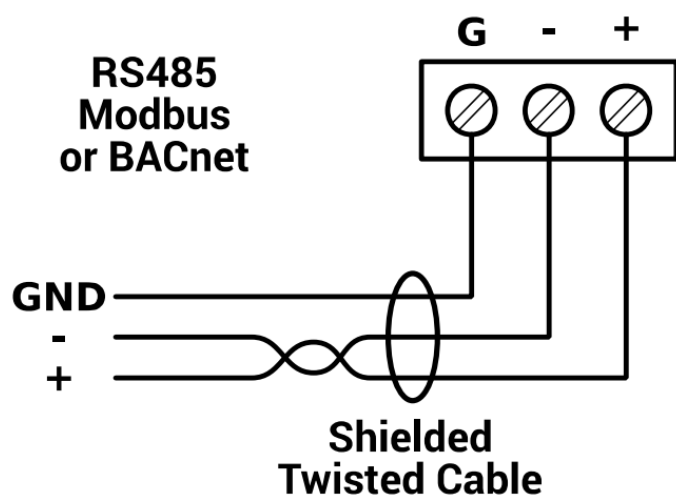

POWER SUPPLY

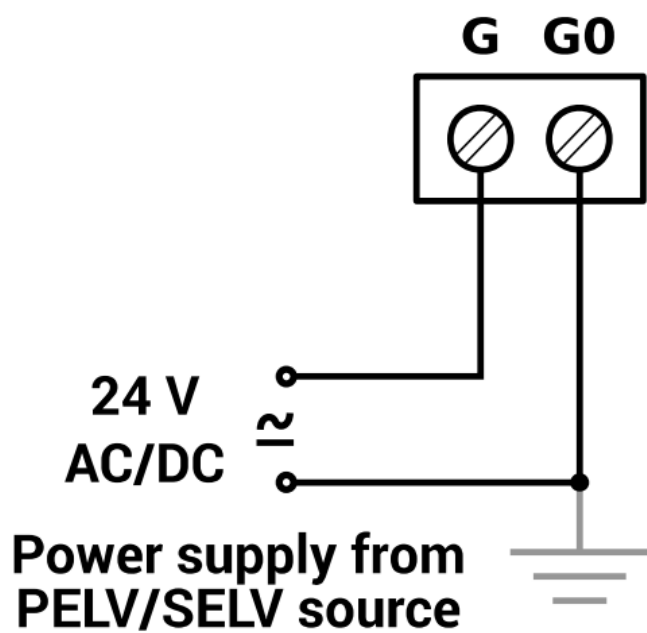


0-10 V output

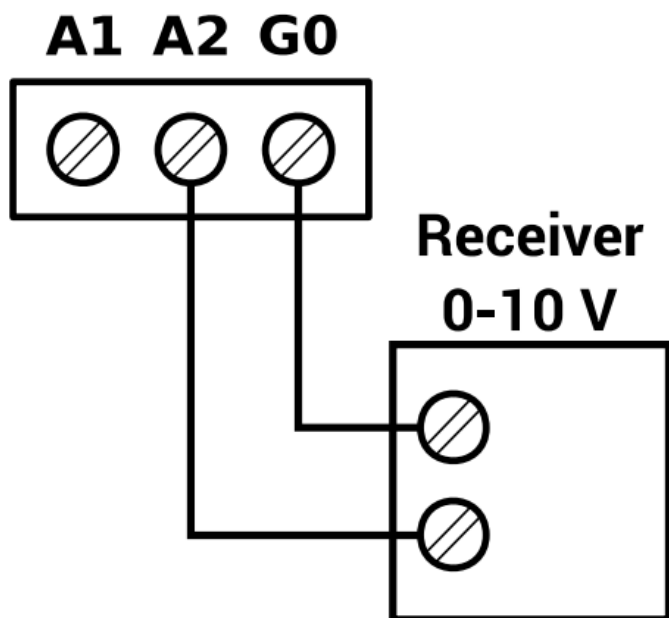



ANALOG OUTPUTS

- Connection of relay

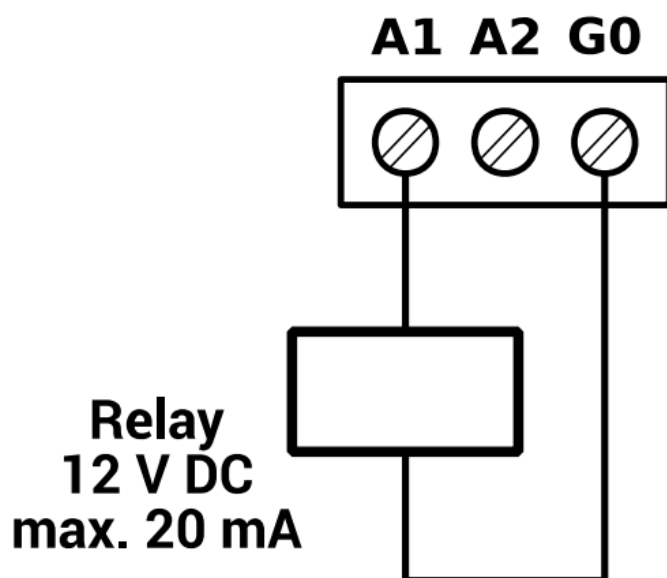


- Connection of actuator

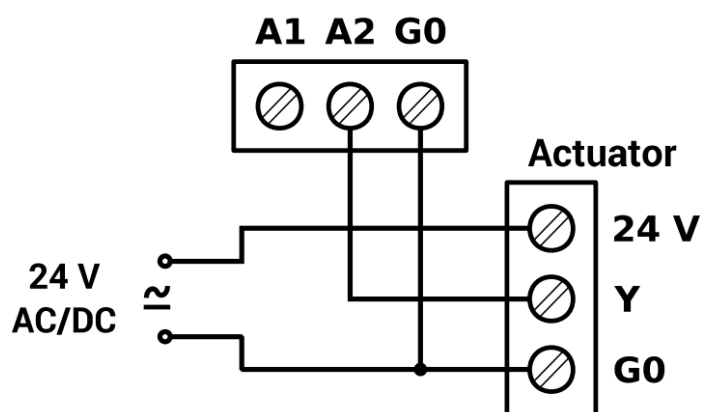

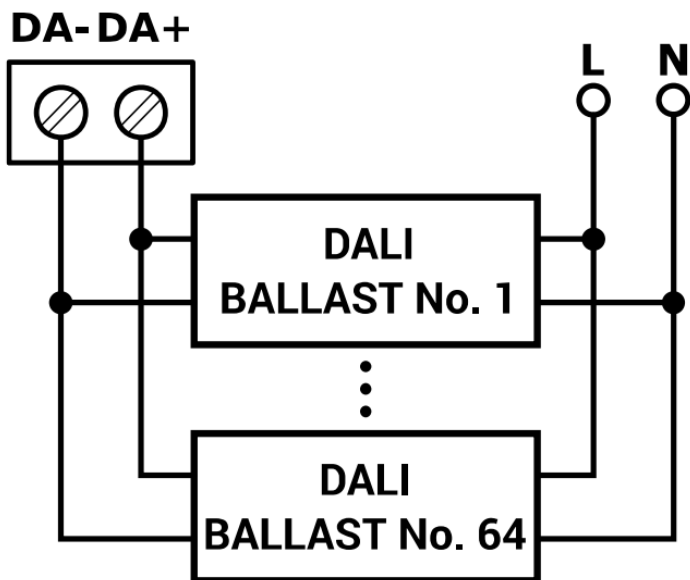


M-Bus

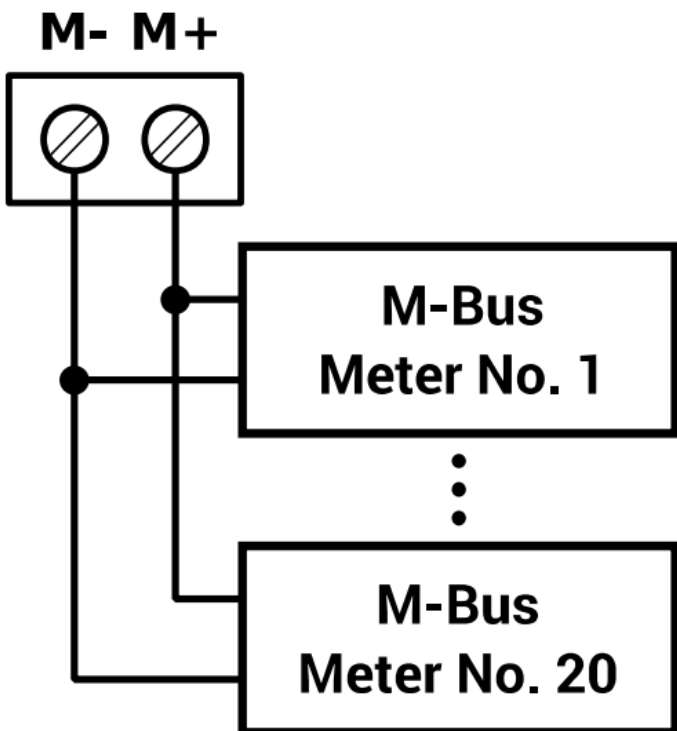


WARNING

- Note, an incorrect wiring of this product can damage it and lead to other hazards. Make sure the product has been correctly wired before turning the power ON.
- Before wiring, or removing/mounting the product, be sure to turn the power OFF. Failure to do so might cause electric shock.
- Do not touch electrically charged parts such as the power terminals. Doing so might cause electric shock.
- Do not disassemble the product. Doing so might cause electric shock or faulty operation.
- Use the product within the operating ranges recommended in the specification (temperature, humidity, voltage, shock, mounting direction, atmosphere, etc.). Failure to do so might cause fire or faulty operation.
- Firmly tighten the wires to the terminal. Insufficient tightening of the wires to the terminal might cause fire.

BLOCK DIAGRAM

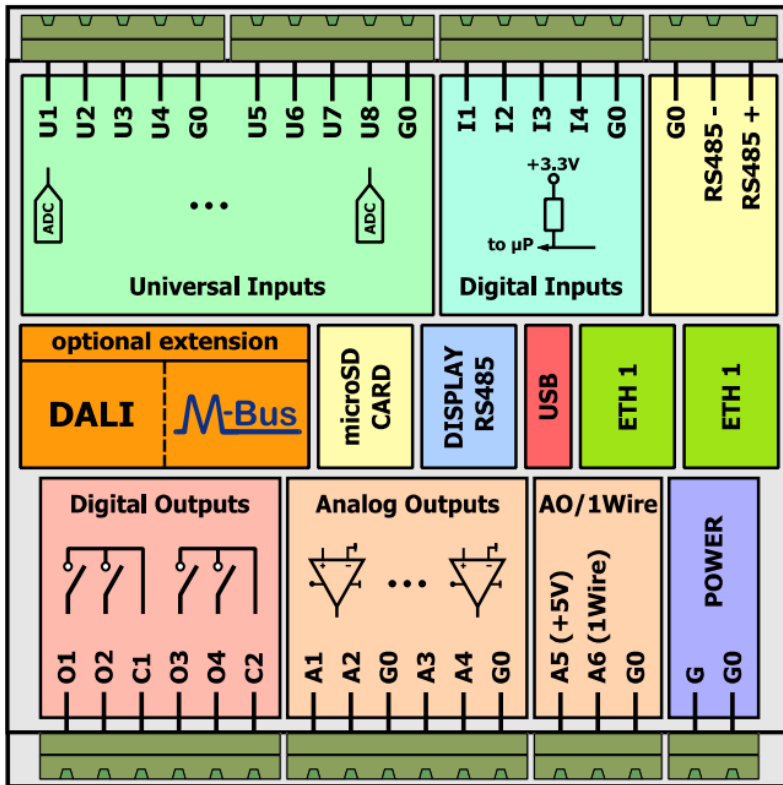


1-WIRE

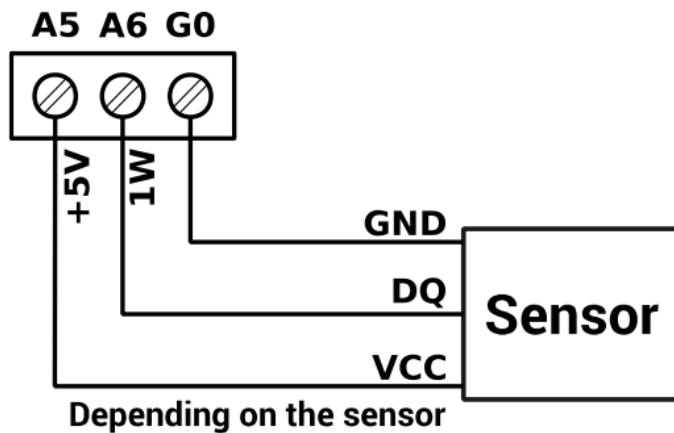

RS485 CONFIGURATION

In the iSMA-B-AAC20 device there is a built-in 3 position switch, which is dedicated to connect 120 Ω termination resistor and/or biasing resistors. It can be accessed by removing the bottom part of enclosure.

Switch Position	Biasing	Termination 120 Ω
1 (END)	ON	ON
2 (BIA) – default	ON	OFF
3 (NONE)	OFF	OFF

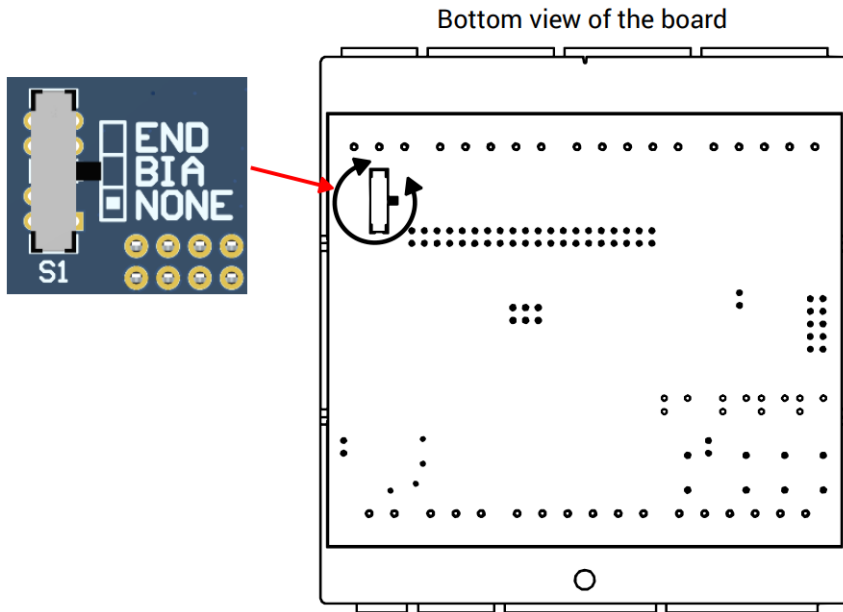

FCC COMPLIANCE NOTE

Note: This equipment has been tested and found to comply with the limits for a Class A digital device, pursuant to part 15 of the FCC Rules. These limits are designed to provide reasonable protection against harmful interference when the equipment is operated in a commercial environment. This equipment generates, uses, and can radiate radio frequency energy and, if not installed and used in accordance with the instruction manual, may cause harmful interference to radio communications. Operation of this equipment in a residential area is likely to cause harmful interference in which case the user will be required to correct the interference at his own expense.

WIRING

- Line power cables must be routed with spatial separation from signal and data transmission cables.
- Analog and digital signal cables should also be separated.
- It is recommended to use shielded cables for analog signals, cable shields should not be interrupted by intermediate terminals.
- The shielding should be earthed directly after the cable enters the cabinet.
- It is recommended to install interference suppressors when switching inductive loads (e.g., coils of contactors, relays, solenoid valves). RC snubbers or varistors are suitable for AC voltage and freewheeling diodes for DC voltage loads. The suppressing elements must be connected as close to the coil as possible.

INSTALLATION GUIDELINE

Please read the instruction before use or operating the device. In case of any questions after reading this document, please contact the iSMA CONTROLLI Support Team (support@ismacontrolli.com).



- Before wiring or removing/mounting the product, make sure to turn the power off. Failure to do so might cause an electric shock.

- Improper wiring of the product can damage it and lead to other hazards. Make sure that the product has been correctly wired before turning the power on.
- Do not touch electrically charged parts such as power terminals. Doing so might cause an electric shock.
- Do not disassemble the product. Doing so might cause an electric shock or faulty operation.



- Use the product only within the operating ranges recommended in the specification (temperature, humidity, voltage, shock, mounting direction, atmosphere, etc.). Failure to do so might cause a fire or faulty operation.

- Firmly tighten the wires to the terminal. Failure to do so might cause a fire.
- Avoid installing the product in close proximity to high-power electrical devices and cables, inductive loads, and switching devices. Proximity of such objects may cause an uncontrolled interference, resulting in an instable operation of the product.
- Proper arrangement of the power and signal cabling affects the operation of the entire control system. Avoid laying the power and signal wiring in parallel cable trays. It can cause interferences in monitored and control signals.
- It is recommended to power controllers/modules with AC/DC power suppliers. They provide better and more stable insulation for devices compared to AC/AC transformer systems, which transmit disturbances and transient phenomena like surges and bursts to devices. They also isolate products from inductive phenomena from other transformers and loads.
- Power supply systems for the product should be protected by external devices limiting overvoltage and effects of lightning discharges.
- Avoid powering the product and its controlled/monitored devices, especially high power and inductive loads, from a single power source. Powering devices from a single power source causes a risk of introducing disturbances from the loads to the control devices.
- If an AC/AC transformer is used to supply control devices, it is strongly recommended to use a maximum 100 VA Class 2 transformer to avoid unwanted inductive effects, which are dangerous for devices.
- Long monitoring and control lines may cause loops in connection with the shared power supply, causing disturbances in the operation of devices, including external communication. It is recommended to use galvanic separators.
- To protect signal and communication lines against external electromagnetic interferences, use properly grounded shielded cables and ferrite beads.
- Switching the digital output relays of large (exceeding specification) inductive loads can cause interference pulses to the electronics installed inside the product. Therefore, it is recommended to use external relays/contactors, etc. to switch such loads. The use of controllers with triac outputs also limits similar overvoltage phenomena.
- Many cases of disturbances and overvoltage in control systems are generated by switched, inductive loads

supplied by alternating mains voltage (AC 120/230 V). If they do not have appropriate built-in noise reduction circuits, it is recommended to use external circuits such as snubbers, varistors, or protection diodes to limit these effects.




Electrical installation of this product must be done in accordance with national wiring codes and conform to local regulations.

Contact Us

iSMA CONTROLLI S.p.A
Via Carlo Levi 52, 16010 Sant'Olcese (GE)
Italy
support@ismacontrolli.com
www.ismacontrolli.com
Installation Guideline 1st
Issue rev. 1 05/2022

Documents / Resources



[iSMACONTROLLI iSMA-B-AAC20 Sedona Advanced Application Controller](#) [pdf] Instruction Manual
iSMA-B-AAC20, iSMA-B-AAC20-D, iSMA-B-AAC20-M, Sedona Advanced Application Controller, Application Controller, iSMA-B-AAC20, Controller

References

- © [iSMA CONTROLLI S.p.A.](#)