

[Skip to content](#)

Manuals+

User Manuals Simplified.



Kilsen PA25/3L Remote LED Indicator Installation Guide

[Home](#) » [Kilsen](#) » Kilsen PA25/3L Remote LED Indicator Installation Guide

Contents [hide](#)

[1 Kilsen PA25/3L Remote LED Indicator](#)

[2 Description](#)

[3 Installation](#)

[4 Maintenance](#)

[5 Specifications](#)

[6 Regulatory information](#)

[6.1 Contact information and product documentation](#)

[6.2 Product warnings and disclaimers](#)

[7 Documents / Resources](#)

[7.1 References](#)

[8 Related Posts](#)



Kilsen

Kilsen PA25/3L Remote LED Indicator



Description


The PA25/3L Remote LED Indicator provides an external alarm indication for a detector that is out of view or in an enclosed area.
The unit uses three LED diodes to provide reduced consumption illumination.

Installation

WARNING: This product is part of a fire detection and alarm system. Follow all local regulations with regard to installation.
Caution: If the product is not connected to a Carrier Fire & Security detector, or if the product is used for any purpose other than that indicated, ensure that all voltage and current specifications remain inside the specified limits. See “Specifications.”
Notes

- Install the unit in an area of high visibility to ensure rapid reaction by fire security personnel.
- See the fire detector manual for electrical connection guidelines.

The LED indicator includes a surface-mounting fixture with entry points on either side for 20 mm tubing. For recessed mounting, use a standard recessed mounting box.
The unit can be connected to analogue or conventional fire systems using the appropriate terminal.

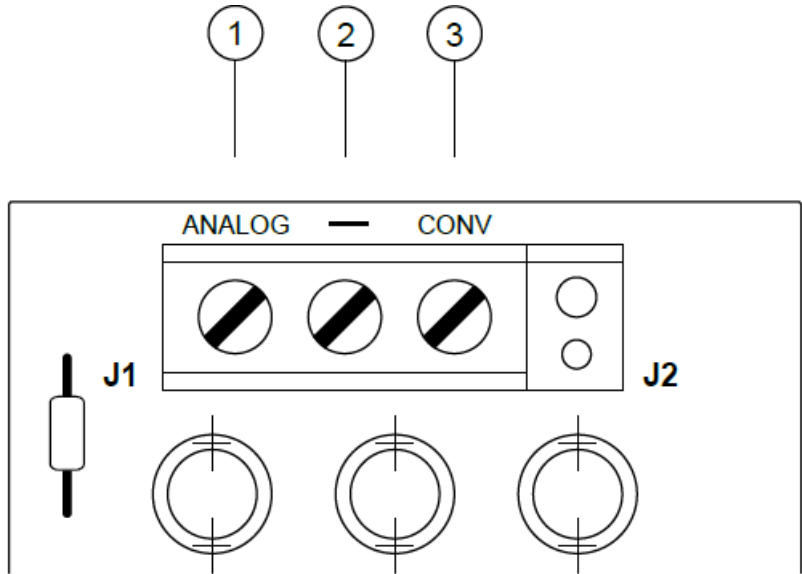

Item	Description
1.	Analogue
2.	Negative
3.	Conventional

In conventional systems, only a single LED illuminates. See “Specifications” for power supply details.



Maintenance

Maintenance depends on the environment. In clean areas, perform periodic functional tests by activating the detector to which the device is connected.
Note: Only qualified personnel may repair faults.

Specifications

Power supply	
Addressable	5 to 10 V
Conventional	2 to 5 V
Current consumption	50 mA max.
Distance between LED indicator and detector	100 m max.
LEDs	3
IP rating	IP40
Dimensions (W × H × D)	80 × 80 × 42 mm
Operating environment	
Temperature	–10 to +60°C
Relative humidity	10 to 95%, noncondensing
Storage temperature	–10 to +70°C

Regulatory information

Certification	
Manufacturer	<p>Carrier Safety System (Hebei) Co. Ltd., 80, Changjiang East Road, QETDZ, Qinhuangdao, Hebei Province, China 066004</p> <p>Authorized EU manufacturing representative: Carrier Fire & Security B.V., Kelvinstraat 7, 6003 DH Weert, Netherlands</p>
	<p>2012/19/EU (WEEE directive): Products marked with this symbol cannot be disposed of as unsorted municipal waste in the European Union. For proper recycling, return this product to your local supplier upon the purchase of equivalent new equipment, or dispose of it at designated collection points. For more information see: recyclethis.info.</p>

Contact information and product documentation

For contact information or to download the latest product documentation, visit firesecurityproducts.com.

Product warnings and disclaimers


THESE PRODUCTS ARE INTENDED FOR SALE TO AND INSTALLATION BY QUALIFIED PROFESSIONALS. CARRIER FIRE & SECURITY B.V. CANNOT PROVIDE ANY ASSURANCE THAT ANY PERSON OR ENTITY BUYING ITS PRODUCTS, INCLUDING ANY “AUTHORIZED DEALER” OR “AUTHORIZED RESELLER”, IS PROPERLY TRAINED OR EXPERIENCED TO CORRECTLY INSTALL FIRE AND SECURITY RELATED PRODUCTS.

For more information on warranty disclaimers and product safety information, please check



<https://firesecurityproducts.com/policy/product-warning/> or scan the QR code:

Documents / Resources



[Kilsen PA25/3L Remote LED Indicator](#) [pdf] Installation Guide
PA25 3L Remote LED Indicator, PA25 3L, Remote LED Indicator, LED Indicator

References

- [Home - Fire Security Products](#)
- [HOME](#)

[Manuals+](#),

- [home](#)
- [privacy](#)