

## Trove1PH1

- Trove1 enclosure with Altronix/Openpath backplane (TC1)

## TC1

- Altronix/Openpath backplane only

## Trove2PH2

- Trove2 enclosure with Altronix/Openpath backplane (TCV2)

## TCV2

- Altronix/Openpath backplane only

## Installation Guide



**More than just power.™**

All registered trademarks are property of their respective owners.

Rev. TPH012921

Installing Company: \_\_\_\_\_ Service Rep. Name: \_\_\_\_\_

Address: \_\_\_\_\_ Phone #: \_\_\_\_\_

## Overview:

Altronix Trove1PH1 and Trove2PH2 accommodate various combinations of Openpath boards with or without Altronix power supplies and sub-assemblies for access systems.

## Specifications:

- 16 Gauge backplane and enclosure with ample knockouts for convenient access.

### Trove1PH1

#### Trove1 enclosure with TC1 Altronix/Openpath backplane

- Includes: tamper switch, cam lock, lock nuts, and mounting hardware.
- Enclosure Dimensions (H x W x D): 18" x 14.5" x 4.625" (457mm x 368mm x 118mm).

### TC1

#### Altronix/Openpath backplane only

- Includes mounting hardware.
- Dimensions (H x W x D): 16.625" x 12.5" x 0.3125" (422.3mm x 317.5mm x 7.9mm).

#### TC1 accommodates a combination of the following:

- **Altronix Modules:**
  - One (1) AL400ULXB2, AL600ULXB, AL1012ULXB, AL1024ULXB2, eFlow4NB, eFlow6NB, eFlow102NB, eFlow104NB.
  - One (1) ACM8(CB), ACMS(CB), LINQ8ACM(CB).
  - Up to two (2) ACM4(CB), LINQ8PD(CB), MOM5, PD4UL(CB), PD8UL(CB), PDS8(CB), VR6.
- **Openpath Modules:**
  - One (1) OP-ACC, one (1) OP-16EM and either one (1) OP-EX-4E or one (1) OP-EX-8E.

### Trove2PH2

#### Trove2 enclosure with TCV2 Altronix/Openpath backplane

- Includes: tamper switch, cam lock, lock nuts, and mounting hardware.
- Enclosure Dimensions (H x W x D): 27.25" x 21.75" x 6.5" (692.2mm x 552.5mm x 165.1mm).

### TCV2

#### Altronix/Openpath backplane only

- Includes mounting hardware.
- Dimensions (H x W x D): 25.375" x 19.375" x 0.325" (644.5mm x 482.6mm x 8.3mm).

#### TCV2 accommodates a combination of the following:

- **Altronix Modules:**
  - Two (2) AL400ULXB2, AL600ULXB, AL1012ULXB, AL1024ULXB2, eFlow4NB, eFlow6NB, eFlow102NB, eFlow104NB.
  - Up to two (2) ACM8(CB), ACMS8(CB), LINQ8ACM(CB).
  - Up to two (2) ACM4(CB), LINQ8PD(CB), MOM5, PD4UL(CB), PD8UL(CB), PDS8(CB), VR6.
- **Openpath Modules:**
  - Two (2) OP-ACC, two (2) OP-16EM and either two (2) OP-EX-4E or two (2) OP-EX-8E.

## Agency Listings:

- UL 294 - 6th edition: Line Security I, Destructive Attack I, Endurance IV, Stand-by Power II\*.  
\*Stand-by Power Level I if no battery is supplied.
- This Class B digital apparatus complies with Canadian ICES-003.  
Cet appareil numérique de la classe B est conforme à la norme NMB-003 du Canada.
- CE European Conformity.


## Installation Instructions for Trove1 and Trove2:

1. Remove backplane from enclosure prior to mounting (do not discard hardware).
2. **Trove1PH1 (Pg. 7):**

Mark and predrill holes on the wall to line up with the top two keyholes in the enclosure. Install two upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the two upper screws; level and secure. Mark the position of the lower two holes. Remove the enclosure. Drill the lower holes and install the two fasteners. Place the enclosure's upper keyholes over the two upper screws. Install the two lower screws and make sure to tighten all screws.

**Trove2PH2 (Pg. 8):**

Mark and predrill holes on the wall to line up with the top three keyholes in the enclosure. Install three upper fasteners and screws in the wall with the screw heads protruding. Place the enclosure's upper keyholes over the three upper screws; level and secure. Mark the position of the lower three holes. Remove the enclosure. Drill the lower holes and install the three fasteners. Place the enclosure's upper keyholes over the three upper screws. Install the three lower screws and make sure to tighten all screws.
3. Mount included UL Listed tamper switch (Altronix Model TS112 or equivalent) in desired location, opposite hinge. Slide the tamper switch bracket onto the edge of the enclosure approximately 2" from the right side (*Fig. 1, pg. 2*). Connect tamper switch wiring to the Access Control Panel input or the appropriate UL Listed reporting device. To activate alarm signal open the door of the enclosure.
4. Mount Altronix/Openpath modules to TC1 or TCV2 backplane, refer to *pages 3, 4*.

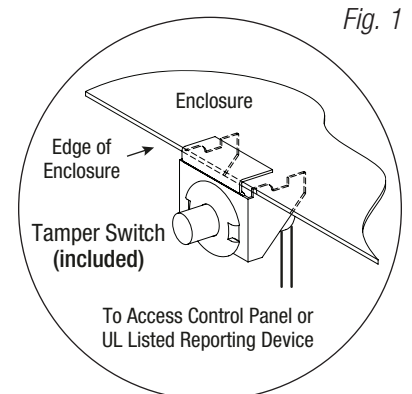

## TC1: Configuration of Altronix Power Supply, Sub-Assemblies and Openpath Modules

1. Push 5/16" pan head screws (provided) through the wholes in the backplane that match the pattern for Altronix Power Supply/Charger and/or sub-assemblies from the backside of backplane. Screw spacers onto screws.  
Fasten metal spacers in the correct locations to provide proper grounding, see below (*Fig. 2, pg. 3*).
2. Mount boards to spacers utilizing 5/16" pan head screws (provided) (*Fig. 2a, pg. 3*).
3. Mount appropriate Openpath boards into the correct positions by positioning pre-mounted spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (*Fig. 2, pg. 3*).
4. Fasten TC1 backplane to Trove1 enclosure utilizing pan head screws (provided).

### Access Controller Position Chart for the Following Openpath Modules:

| Openpath | Mounting Position |
|----------|-------------------|
| OP-ACC   | (A)               |
| OP-EX-4E | (B)               |
| OP-EX-8E | (C)               |
| OP-16EM  | (D)               |

Fig. 2 - Trove1PH1/TC1 Configurations

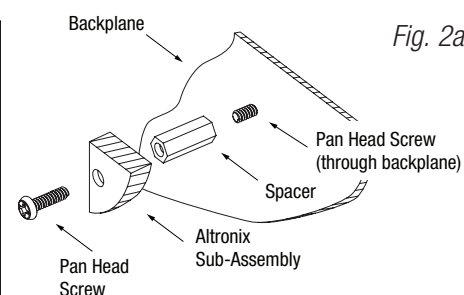
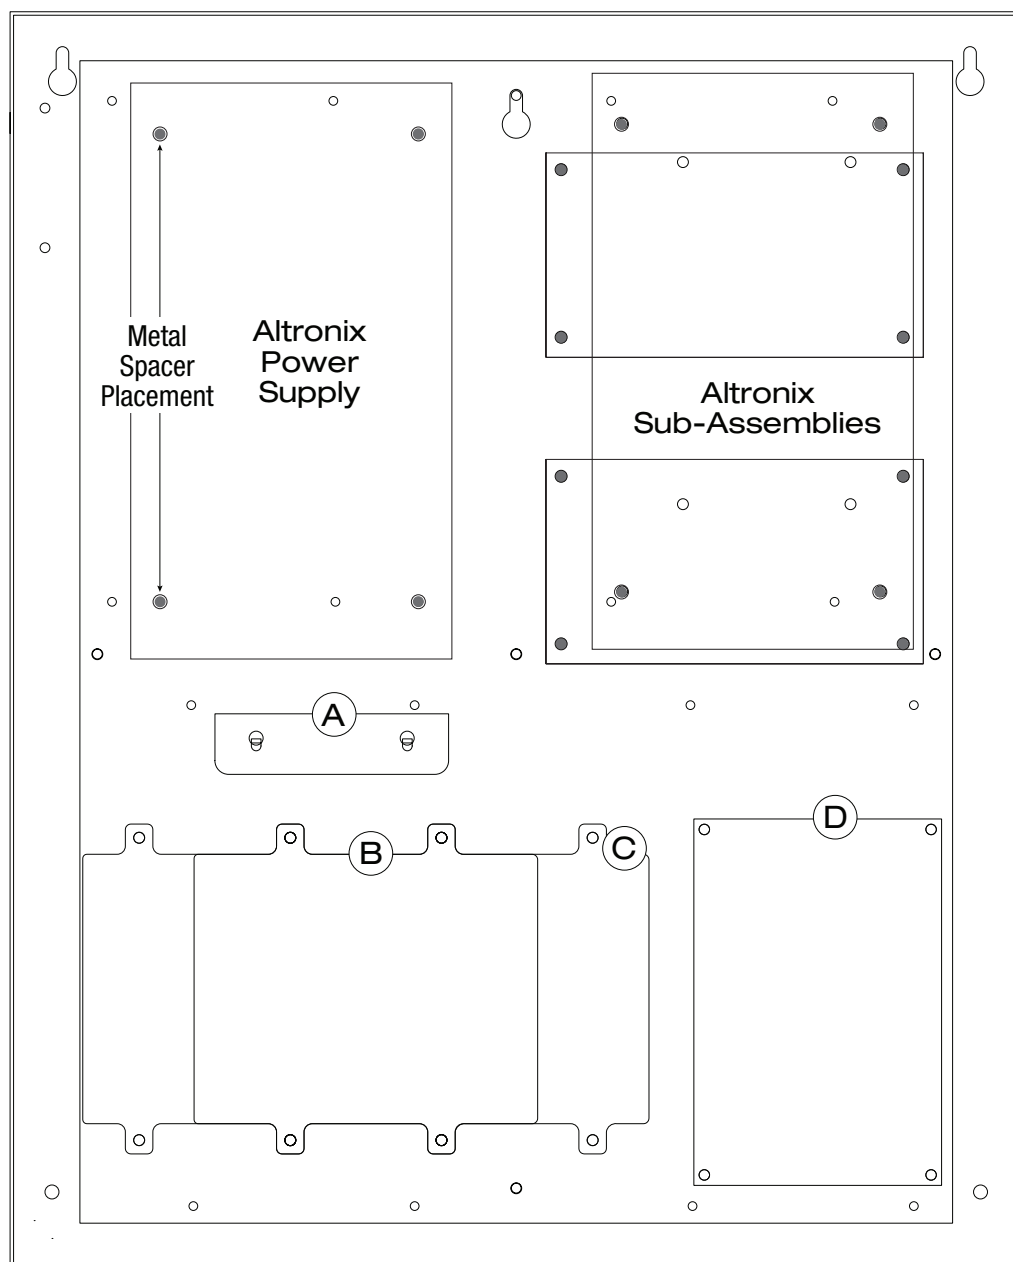


Fig. 2a

## TCV2: Configuration of Altronix Power Supply, Sub-Assemblies and Openpath Modules

1. Push 5/16" pan head screws (provided) through the wholes in the backplane that match the pattern for Altronix Power Supply/Charger(s) and/or sub-assemblies from the backside of backplane. Screw spacers onto screws.  
Fasten metal spacers in the correct locations to provide proper grounding, see below (*Fig. 3, pg. 4*).
2. Mount boards to spacers utilizing 5/16" pan head screws (provided) (*Fig. 3a, pg. 4*).
3. Mount appropriate Openpath boards into the correct positions by positioning pre-mounted spacers over appropriate holes on the backplane and depressing down on board to secure spacer to the backplane (*Fig. 3, pg. 4*).
4. Fasten TCV2 backplane to Trove2 enclosure utilizing pan head screws (provided).

### Access Controller Position Chart for the Following Openpath Modules:

| Openpath | Mounting Position |
|----------|-------------------|
| OP-ACC   | A                 |
| OP-EX-4E | B                 |
| OP-EX-8E | C                 |
| OP-16EM  | D                 |

Fig. 3 - Trove2PH2/TCV2 Configurations



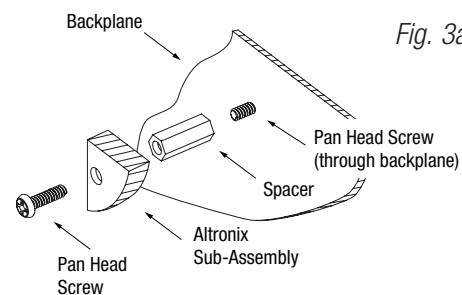


Fig. 3a


## TC1 Dimensions

16.625" x 12.5" x 0.3125" (422.3mm x 317.5mm x 7.9mm)

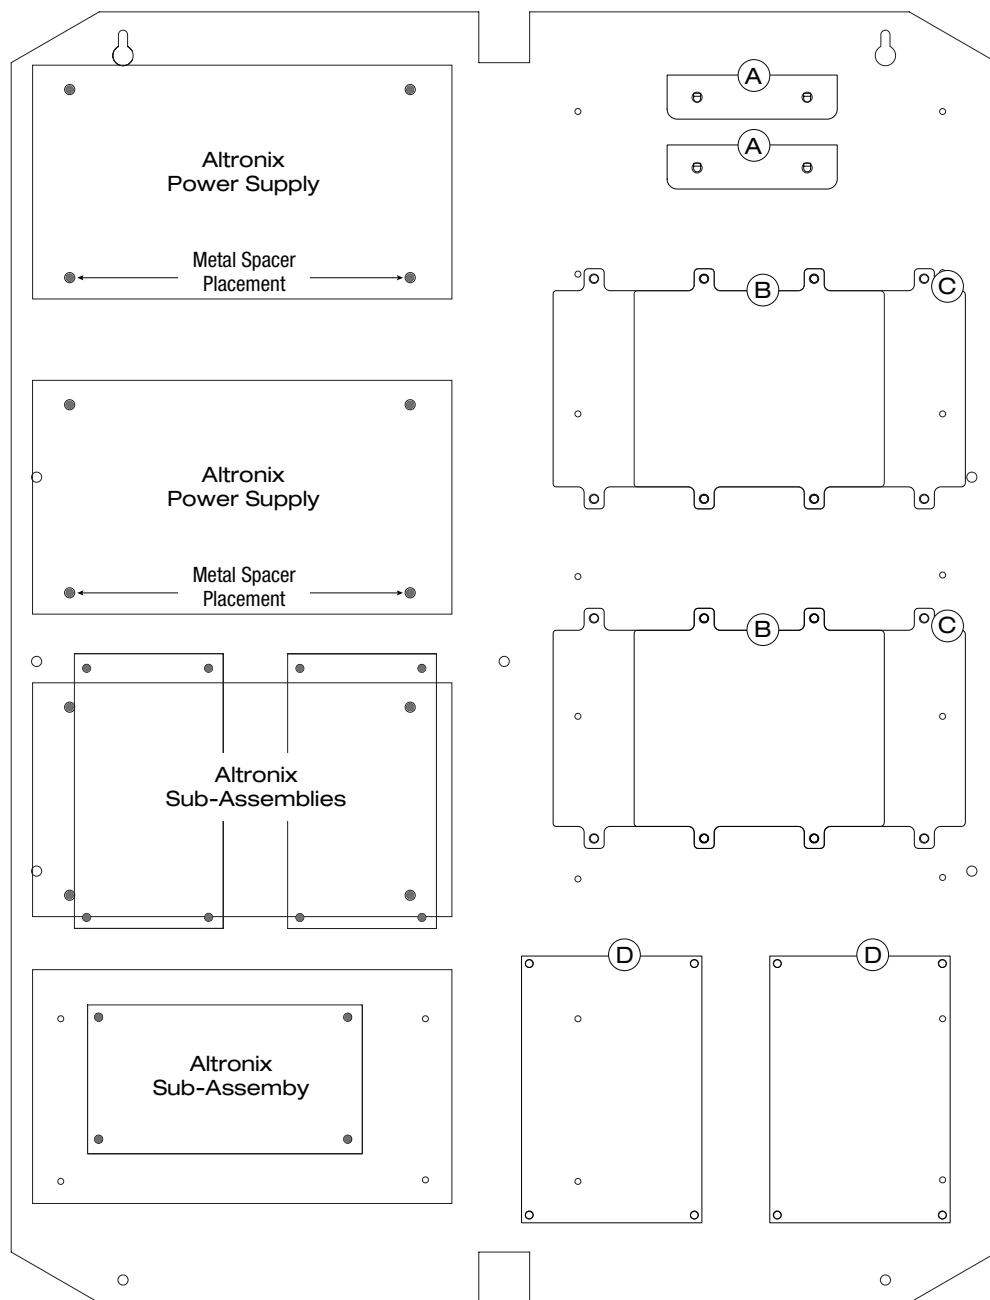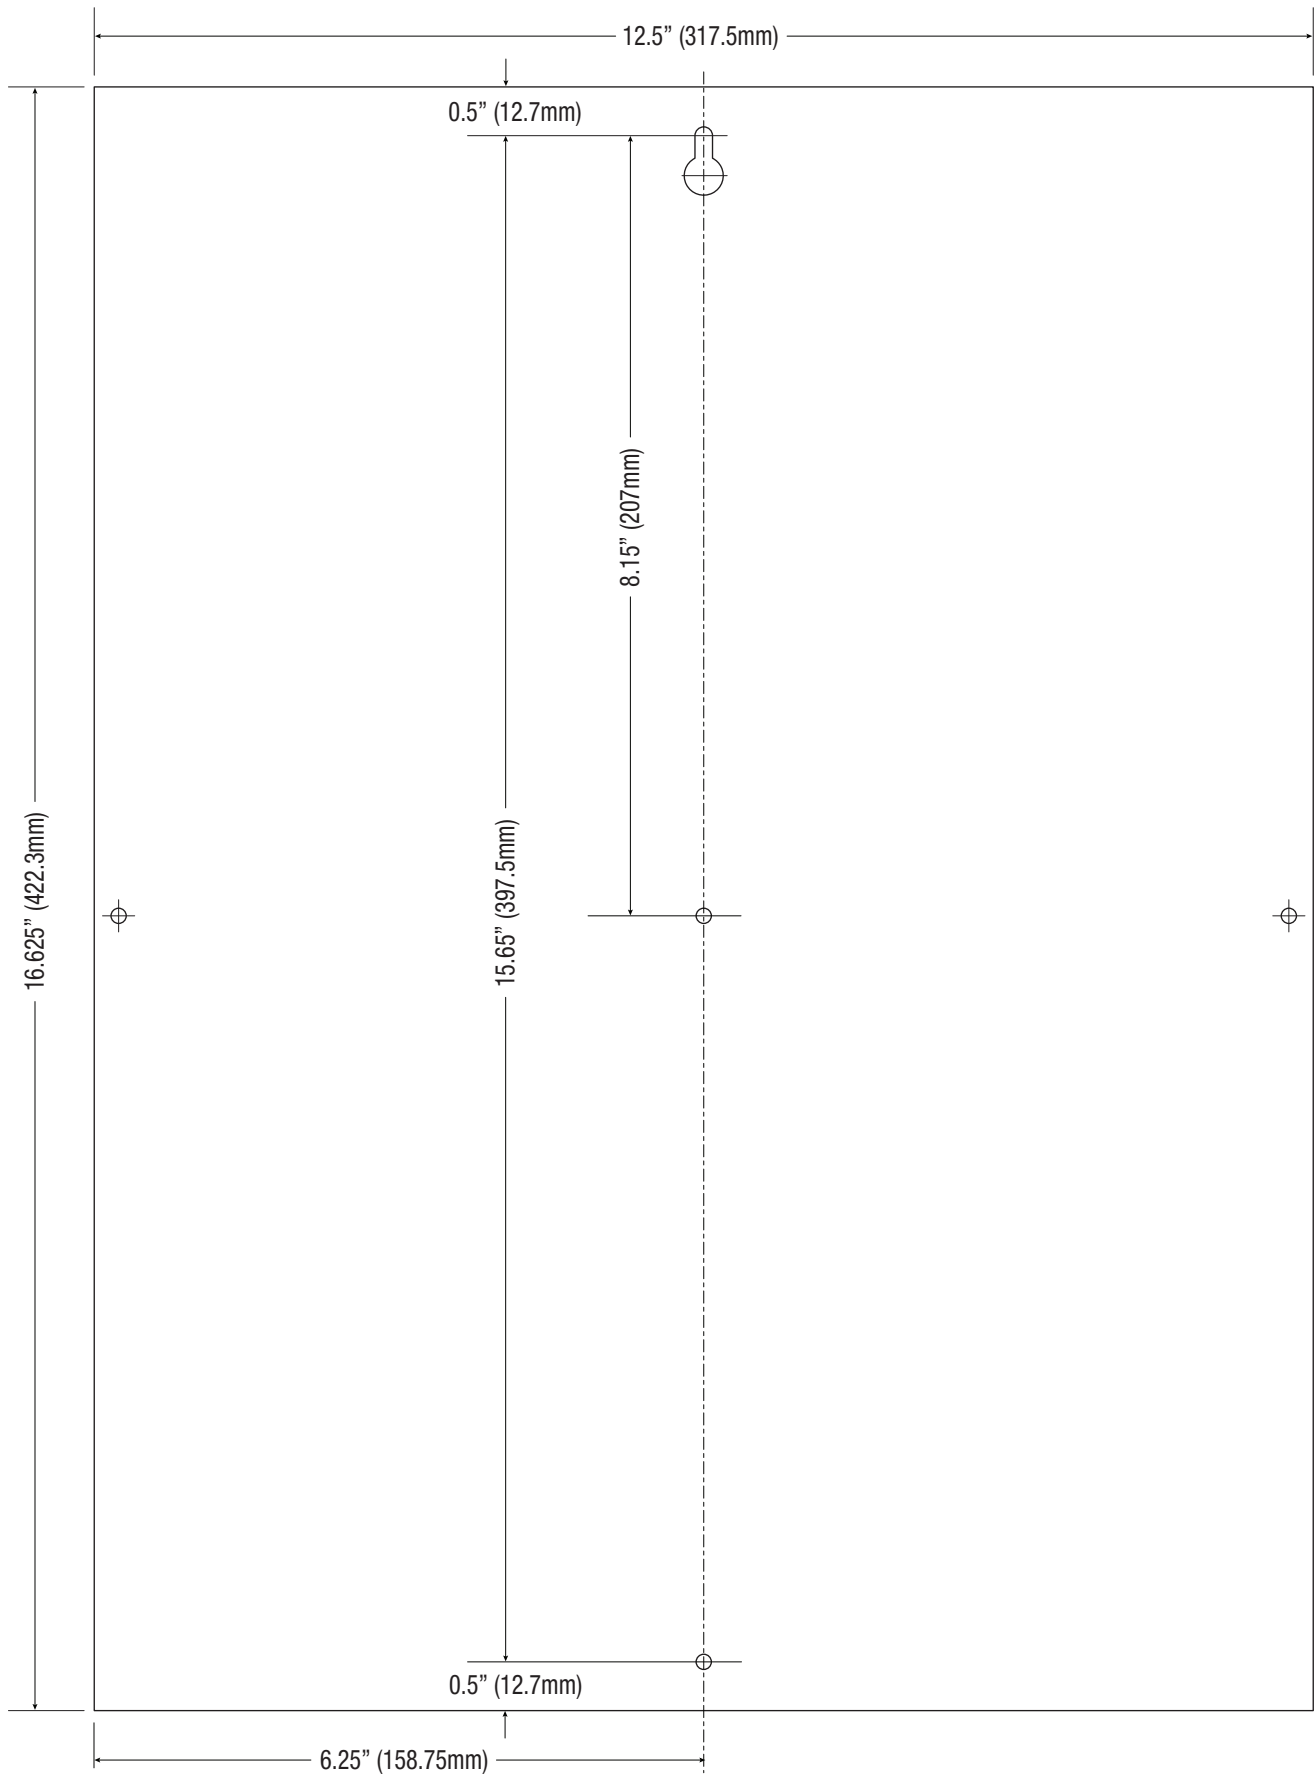


## Trove1PH1 Enclosure Dimensions (H x W x D):

18" x 14.5" x 4.625" (457mm x 368mm x 118mm)

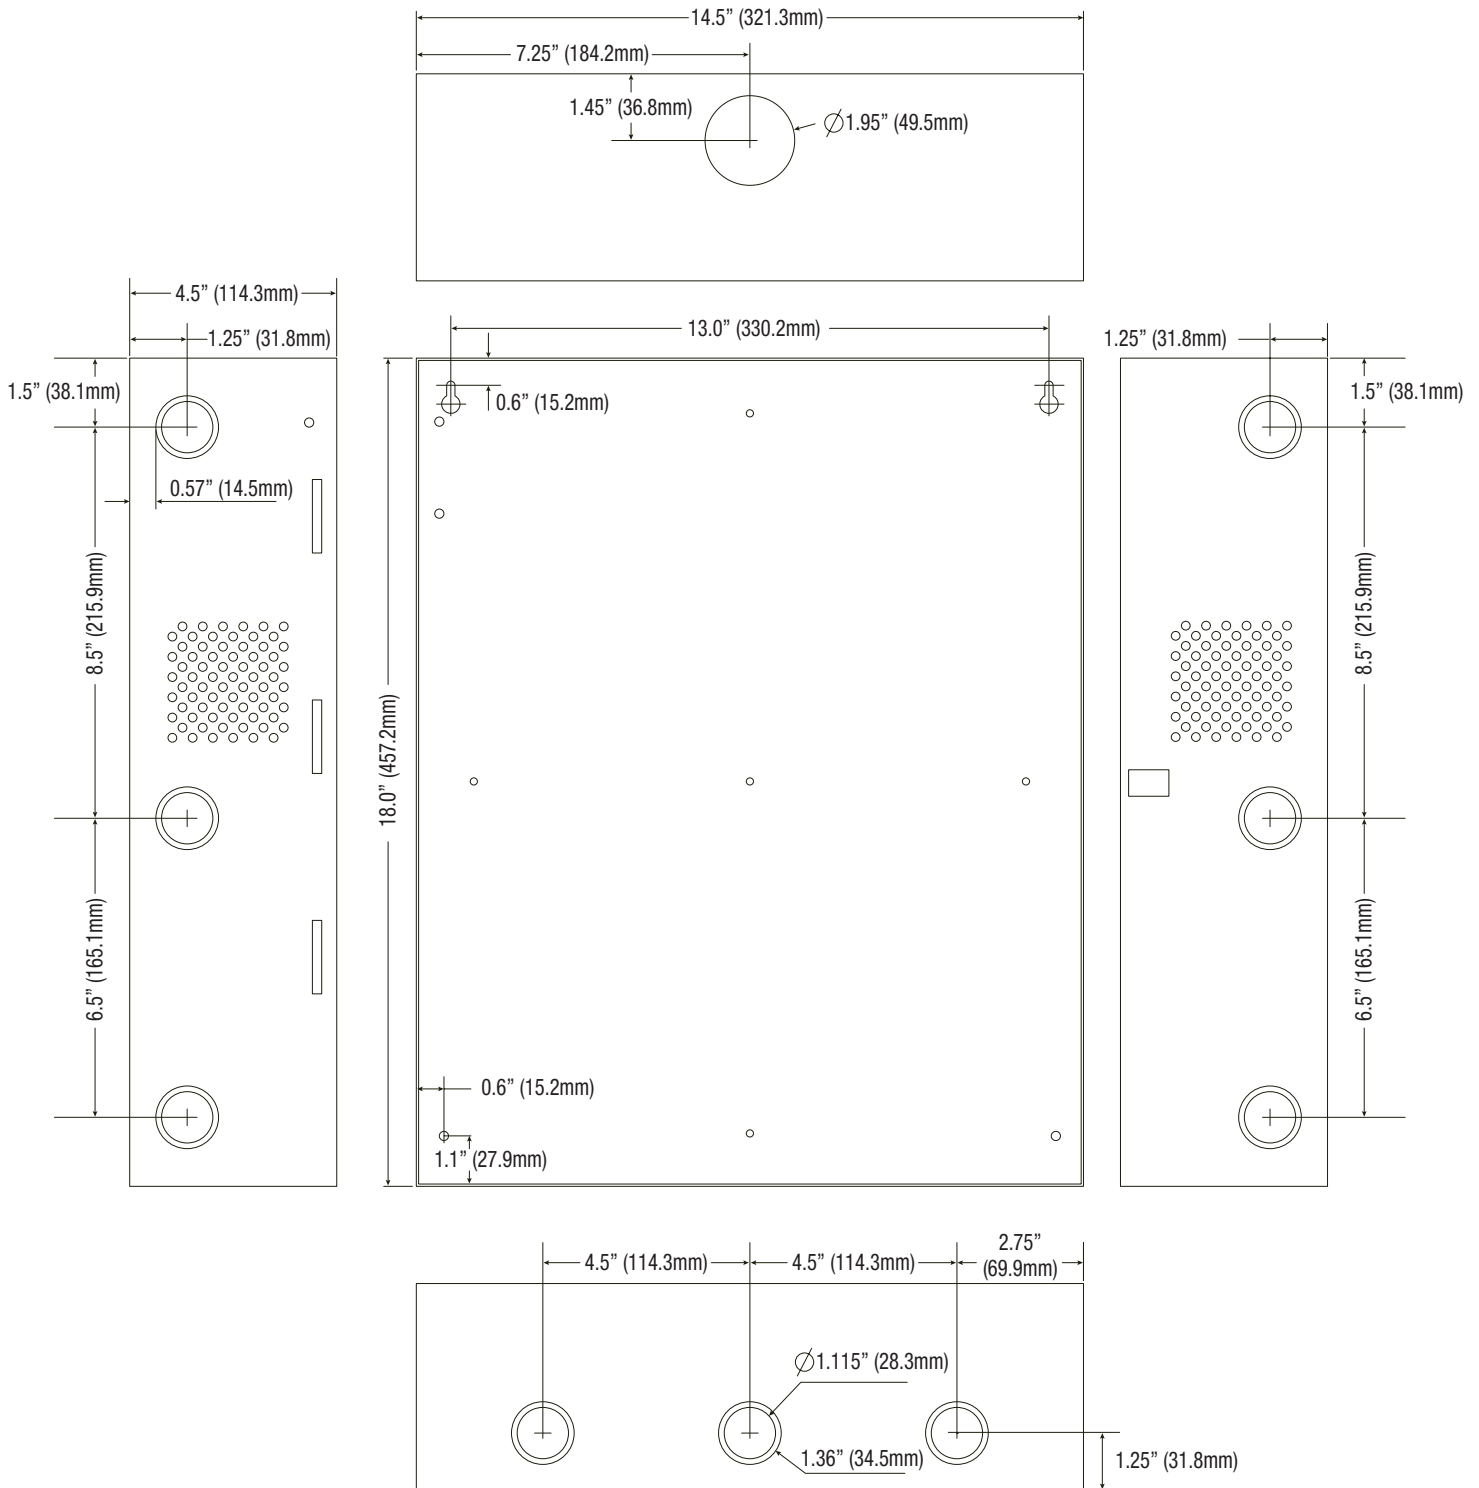


25.375" x 19.375" x 0.325" (644.5mm x 482.6mm x 8.3mm)

25.375" x 19.375" x 0.325" (644.5mm x 482.6mm x 8.3mm)

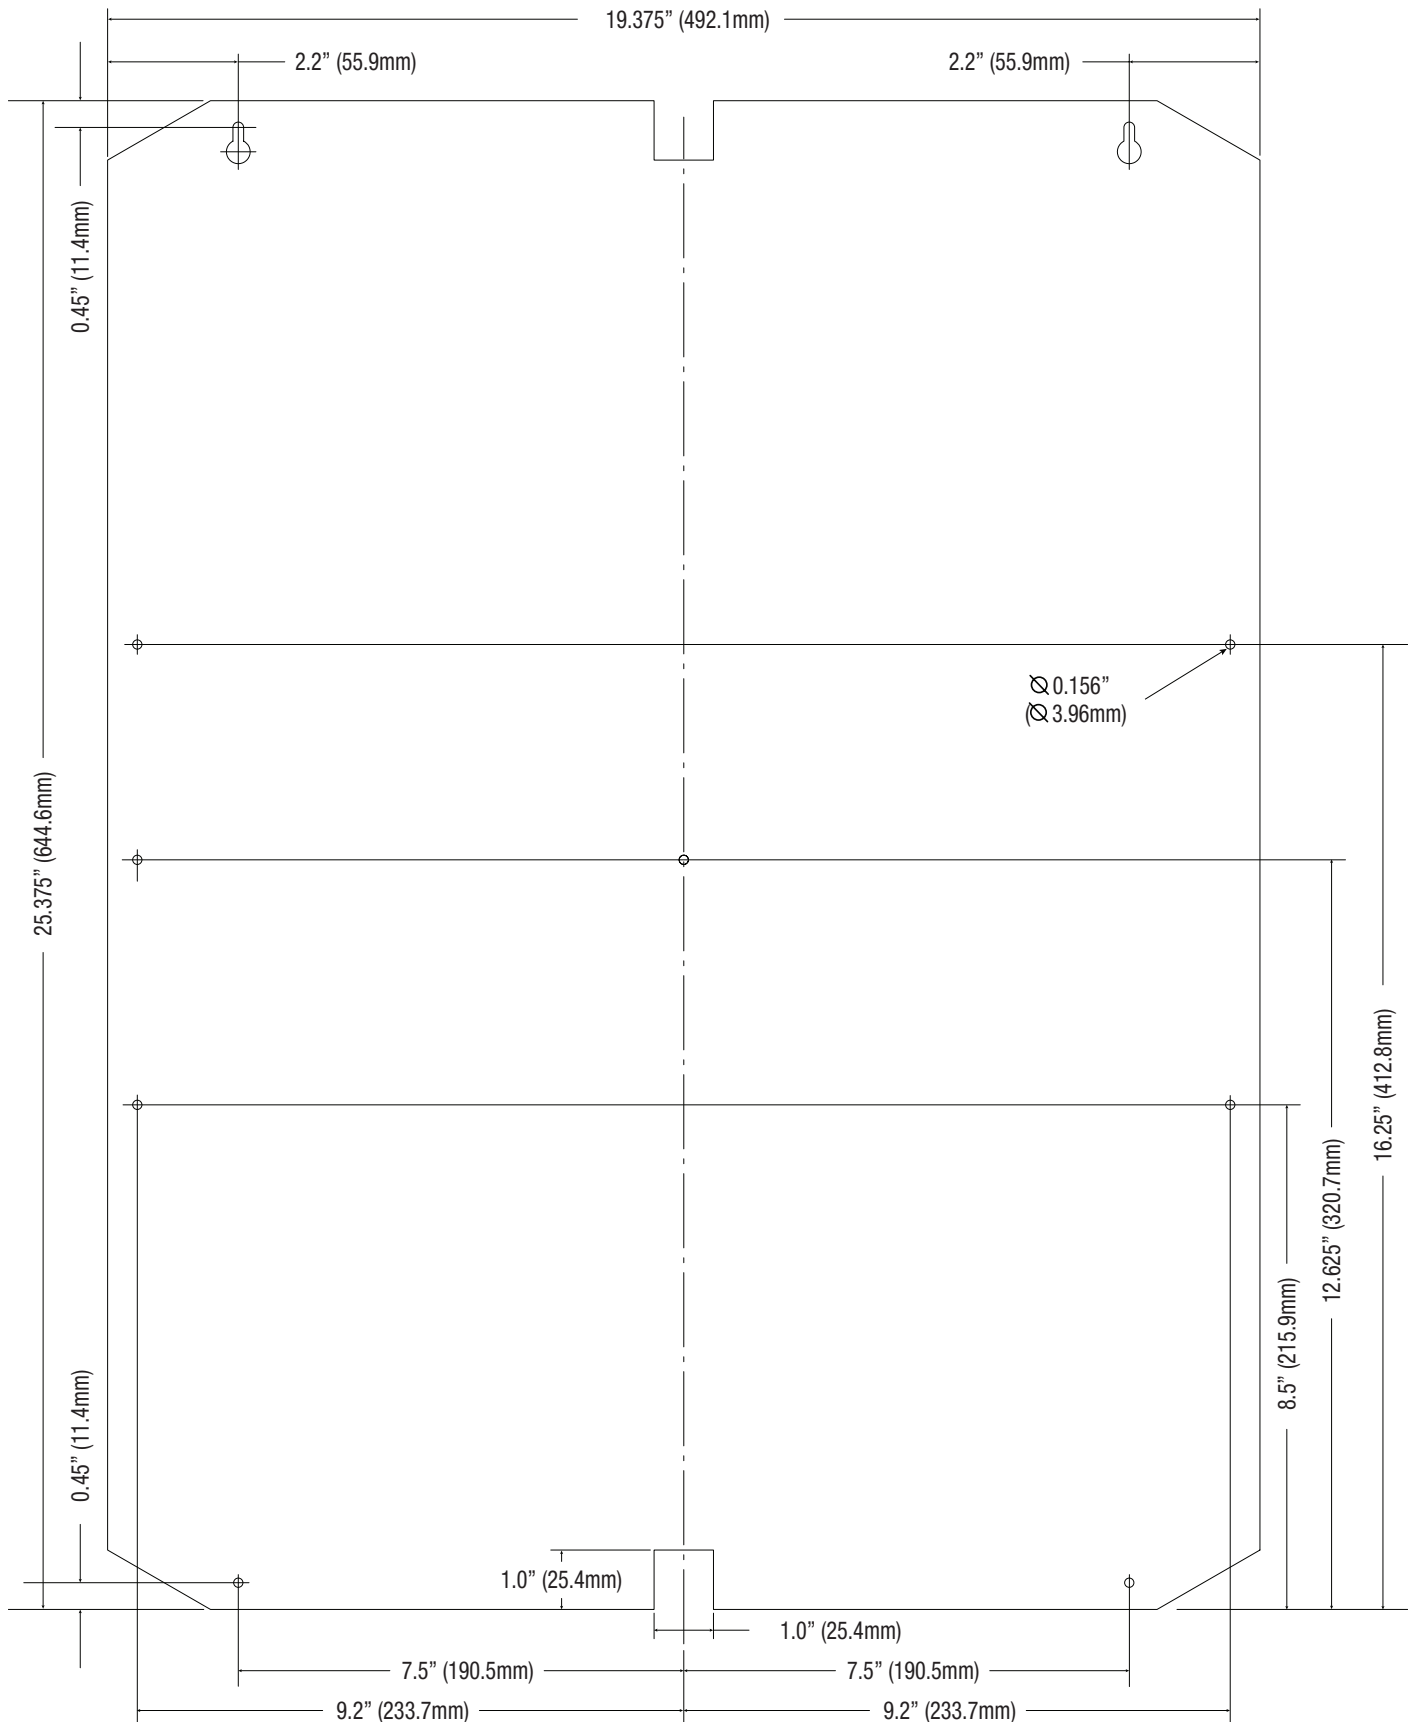

## Trove2PH2 Enclosure Dimensions (H x W x D):

27.25" x 21.75" x 6.5" (692.2mm x 552.5mm x 165.1mm)

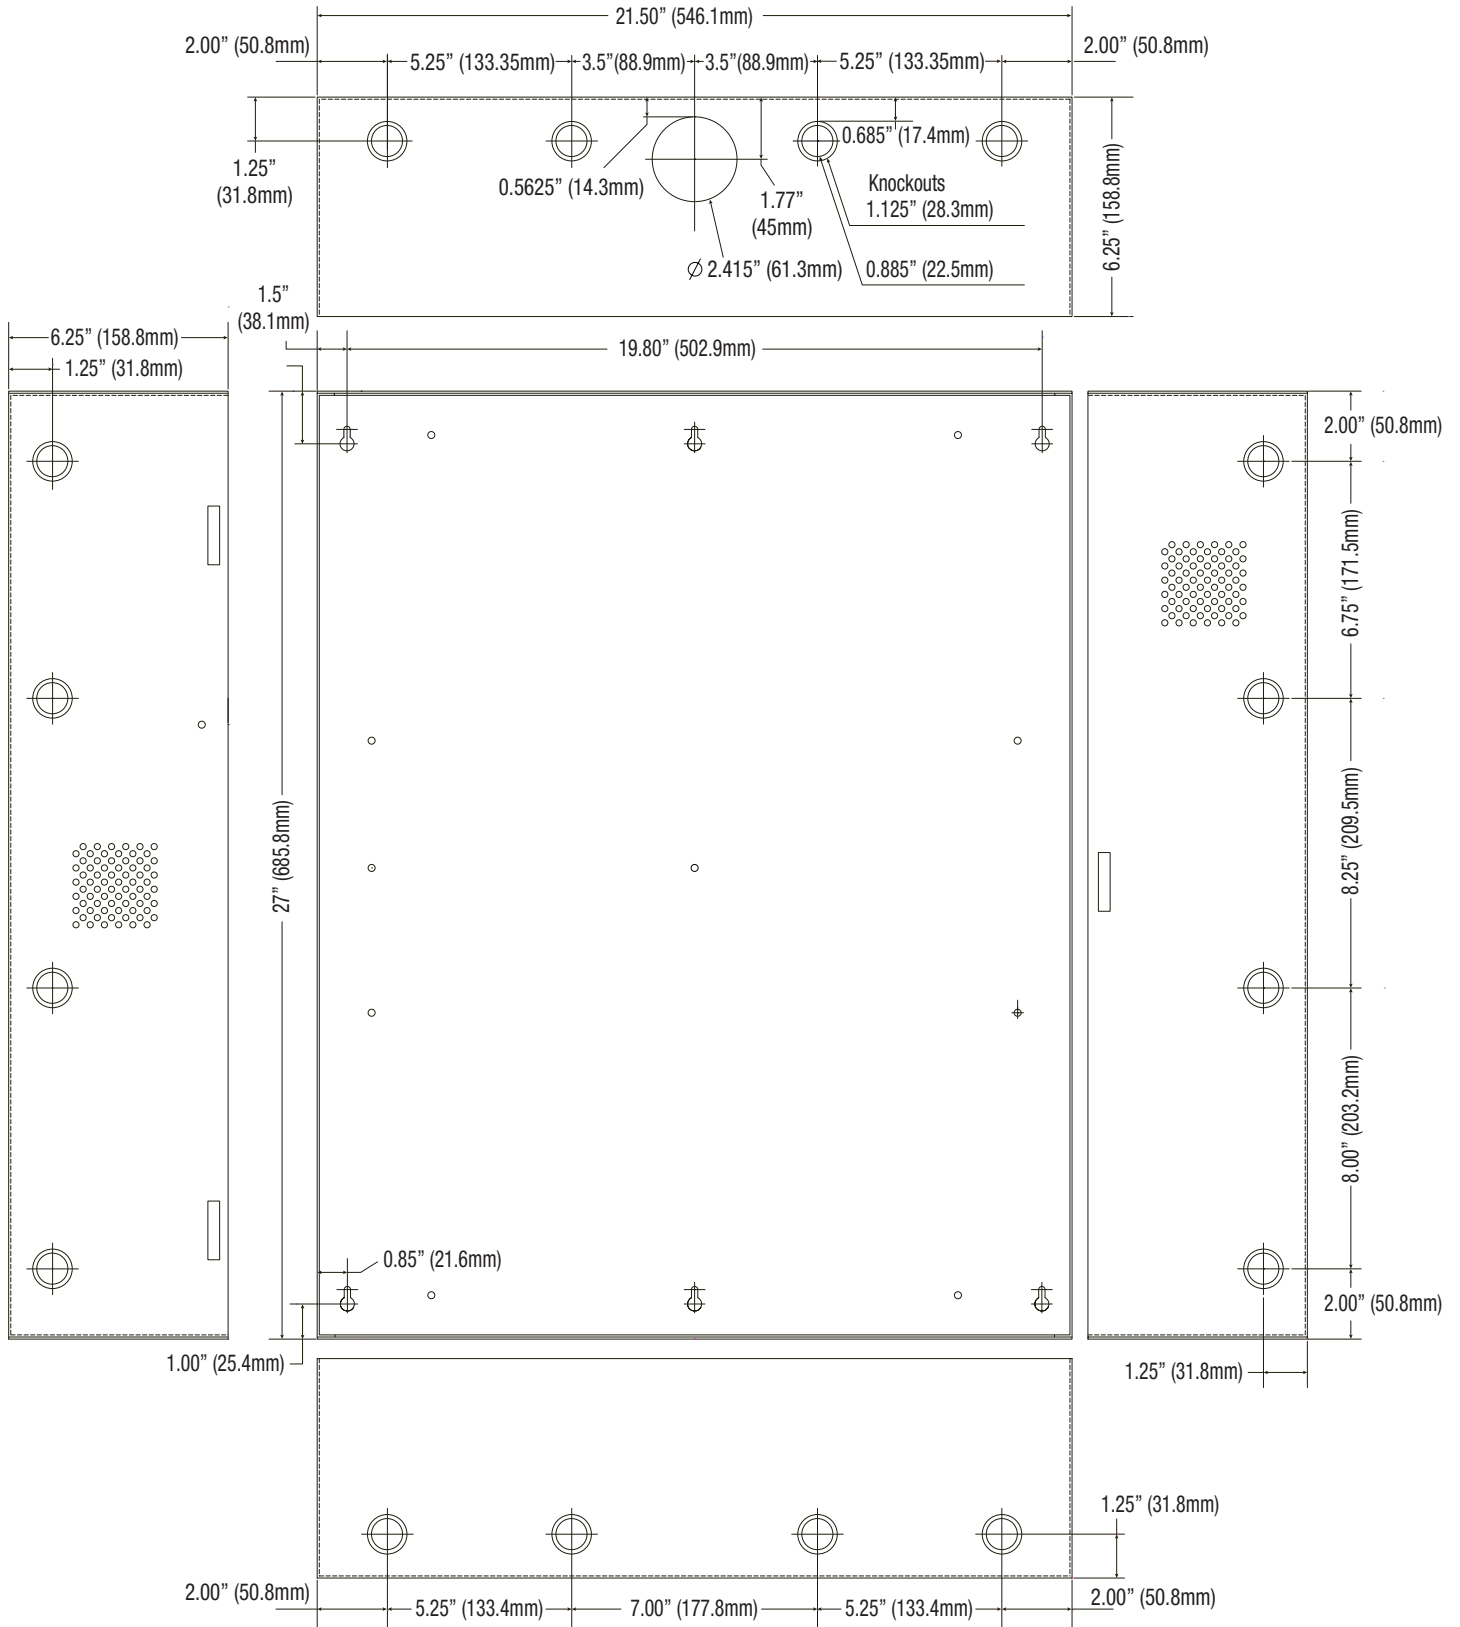

Altronix is not responsible for any typographical errors.

140 58th Street, Brooklyn, New York 11220 USA | phone: 718-567-8181 | fax: 718-567-9056

web site: [www.altronix.com](http://www.altronix.com) | e-mail: [info@altronix.com](mailto:info@altronix.com)

ITrove1PH1 / TC1 / Trove2PH2 / TCV2

JO5U

