

legrand®
LMRC-101 DLM Dual
Relay Room Controller



legrand LMRC-101 DLM Dual Relay Room Controller Instruction Manual

[Home](#) » [Legrand](#) » legrand LMRC-101 DLM Dual Relay Room Controller Instruction Manual 

Contents

- 1 legrand LMRC-101 DLM Dual Relay Room Controller
- 2 SPECIFICATIONS
- 3 PLACEMENT EXAMPLE
- 4 MOUNTING THE CONTROLLER
- 5 ATTACHING CABLES
- 6 CONNECTIVITY
- 7 PLUG N' GO OPERATION (PNG)
- 8 TROUBLESHOOTING
- 9 WARRANTY INFORMATION
- 10 Documents / Resources
 - 10.1 References
- 11 Related Posts



legrand LMRC-101 DLM Dual Relay Room Controller



Wattstopper®

Digital Lighting Management Single Relay Room Controller

Catalog Number

- **Country of Origin:** Made in China

This unit is preset for Plug n' Go™ operation, adjustment is optional.

For full operational details, adjustment and more features of the product, see the DLM System Installation Guide provided with Wattstopper room controllers, and also available at www.legrand.us/wattstopper.

Installation shall be in accordance with all applicable regulations, local and NEC codes.

Wire connections shall be rated suitable for the wire size (lead and building wiring) employed. For Class 2 DLM devices and device wiring: To be connected to a Class 2 power source only. Output Suitable for Parallel Interconnection Up to 10 Units Maximum – See Wiring Diagram. Do not reclassify and install as Class 1, or Power and Lighting Wiring.

WARNING: Do not install to cover a junction box having Class 1, 3 or Power and Lighting Circuits.

SPECIFICATIONS

- Input Voltage..... Single Phase 120/230/240/277VAC, 50/60Hz

Load Requirements

- Incandescent.....20A @ 120VAC
- Ballast.....20A @ 120/277VAC
- Motor..... 1Hp @ 120/240VAC
- Output..... 150mA @ 24VDC


DLM Local Network Characteristics:

- Provides low voltage power over Cat 5e cable (LMRJ). Supports up to 24 communicating devices, including 4 LMRC-10x or LMPL-101 max per each DLM Local Network. Free topology up to 1,000ft of low voltage cable.

Environment

- Operating Temperature.....32° to 104°F (0° to 40°C)
- Storage Temperature.....23° to 176°F (-5° to 80°C)
- Relative Humidity.....5 to 95% (non condensing) Patent Pending

PLACEMENT EXAMPLE

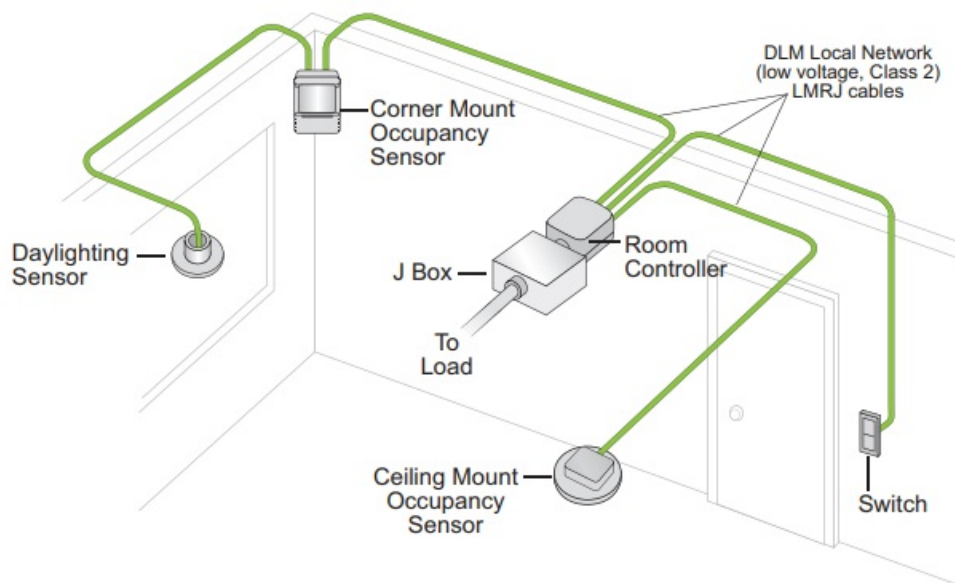


WARNING: TURN THE POWER OFF AT THE CIRCUIT BREAKER BEFORE WIRING.


CAUTION: TO CONNECT A COMPUTER TO THE DLM LOCAL NETWORK USE THE LMCI-100. NEVER CONNECT THE DLM LOCAL NETWORK TO AN ETHERNET PORT – IT MAY DAMAGE COMPUTERS AND OTHER CONNECTED EQUIPMENT.

MOUNTING THE CONTROLLER

The LMRC-101 room controller can be mounted external to either a 4"x 4" or 4-11/16 x 4-11/16 junction box, placing it in the plenum space or mounted directly inside a 4-11/16 x 4-11/16 junction box.

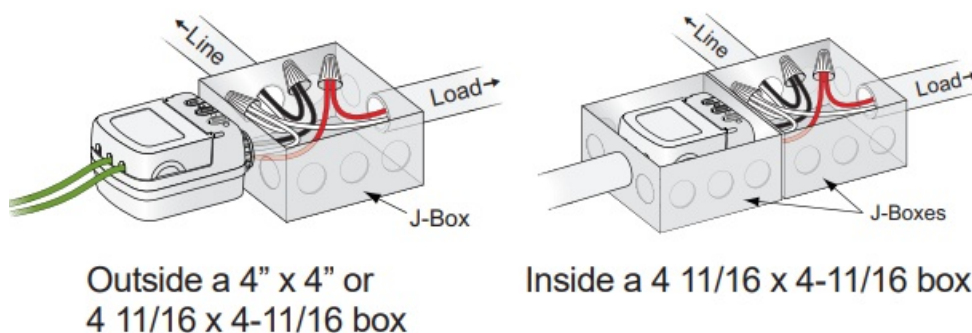


ATTACHING CABLES

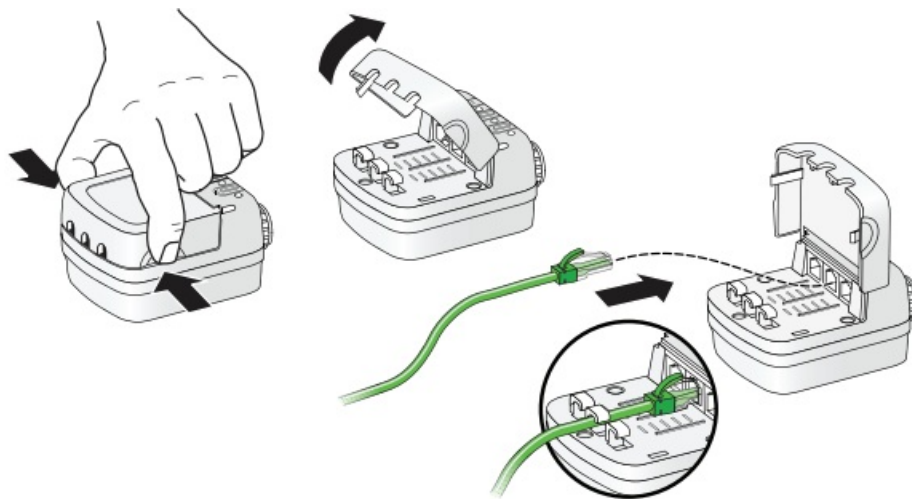

- Remove rubber jack covers if using all 3 RJ45 receptacles. Leave covers in place for all unused receptacles.

CONNECTIVITY

The LMRC-101 communicates to all other DLM devices connected to the DLM Local Network. Connection drawings are for example only. The low-voltage LMRJ cables can connect to any DLM device with an open RJ45 receptacle. All line voltage wiring is #12 AWG.

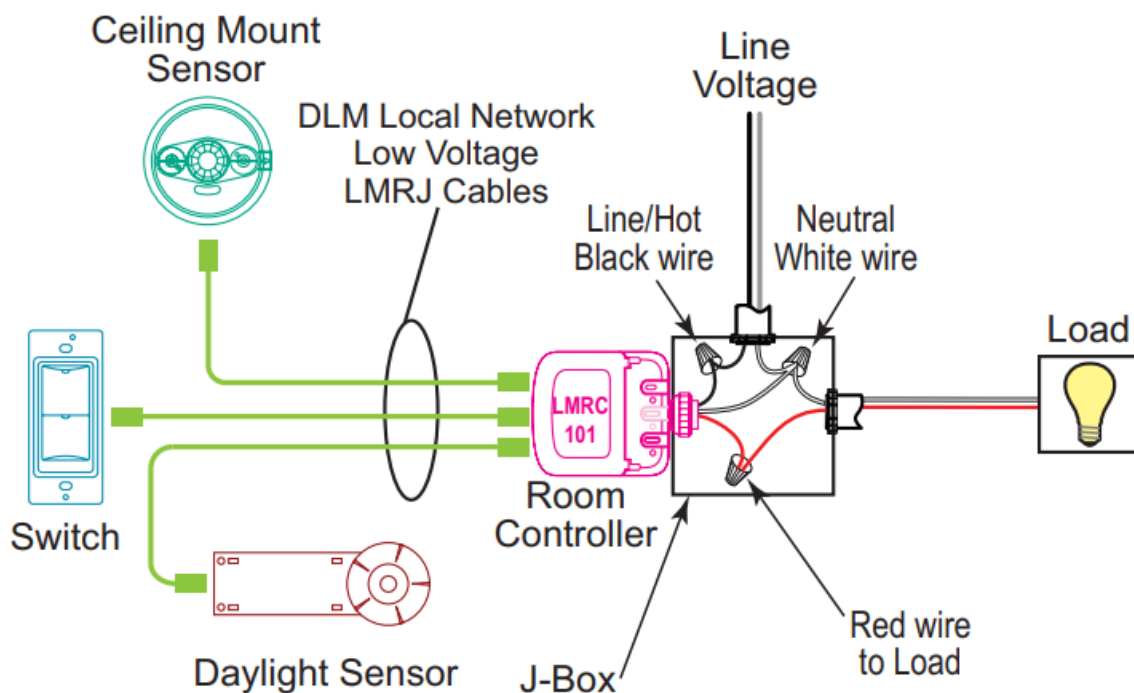

PLUG N' GO OPERATION (PNG)

Plug n' Go supports the most energy efficient control strategy. For example, if one load, one switch and one occupancy sensor are connected to the DLM local network, the system operates the load as Manual-On, Automatic-Off. See DLM device Quick Start Guides to determine how each device affects the PNG operation of the LMRC-101.



Load Control Arbitration

To take full advantage of automatic PnG configuration, review these simple rules about load control arbitration.

After the room controllers are connected to the DLM Local Network and powered up they automatically negotiate to determine which controller becomes the Master, as well as the load numbers for each relay on the DLM Local Network. The Master is the controller with the most load relays. If more than one controller has the most relays, the one with the highest serial number becomes the Master. The LMRC-101 has only one load . In a DLM local network with only LMRC-101 room controllers, the LMRC-101 with the highest serial number is the Master, carrying Load 1 and Load 2. The next highest serial number would have Load 3 and Load 4, and so forth.

Load ON/OFF button

Blue LED ON when load is ON

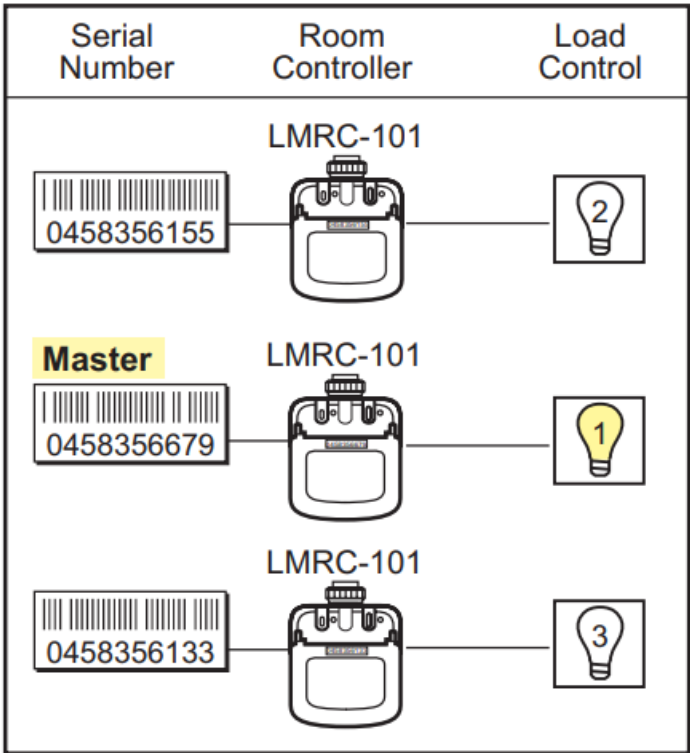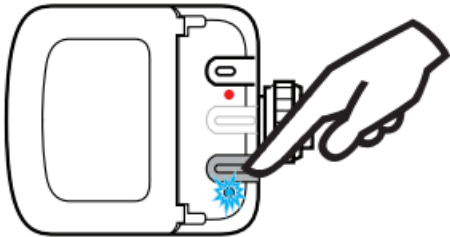

OPTIONAL UNIT ADJUSTMENT – PUSH N’ LEARN (PNL)


Load Selection Procedure

A configuration button (Config) allows access to our patented Push n’ Learn™ technology to change binding relationships between sensors, switches and loads.

Step 1 Enter Push n’ Learn

Press and hold the Config button (on any DLM device) for 3 seconds. The red LED on the LMRC-101 begins to blink as does the red LED on ALL other communicating devices connected to the DLM Local Network. The red LEDs continue to blink until you exit PnL mode. All loads in the room turn OFF immediately after entering PnL, and then one load will turn ON. This is Load #1, which is bound to switch button #1 and occupancy sensors as part of the Plug n’ Go factory default setting.

All switch buttons and sensors that are bound to this load have their blue LED solid ON.

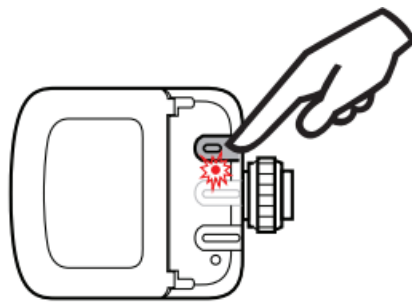

Config button & red LED

Step 2 Load selection

Press and release the Config button to step through the loads connected to the DLM Local Network. As each load turns ON note the devices (switch buttons and sensors) that are showing a bright solid blue LED. These devices are currently bound to the load that is ON. The blue LED on the room controller or plug load controller connected to the load is also lit.

- To unbind a switch button from a load, press the switch button while its blue LED is ON bright. The blue LED goes dim to indicate the button no longer controls the load that is currently ON.
- To unbind an occupancy sensor, press the **up or down** adjustment button while its blue LED is ON. The blue LED turns OFF to indicate the sensor no longer controls the load that is currently ON.

Pressing the switch or **up or down** button again while the load is ON rebinds the load to the button or sensor and the blue LED illuminates brightly.

Step 3 Exit Push n' Learn

Press and hold the Config button until the red LED turns OFF approximately 3 seconds.

TROUBLESHOOTING

Loads do not operate as expected

LEDs on a switch or sensor don't light	<ol style="list-style-type: none"> 1. Check to see that the device is connected to the DLM Local Network. 2. Check for 24VDC input to the device: Plug in a different DLM device at the device location. If the device does not power up, 24VDC is not present. <ul style="list-style-type: none"> • Check the high voltage connections to the room controller and/or plug load controller(s). • If high voltage connections are good and high voltage is present, recheck DLM Local Network connections between the device and the room controller and/or plug load controller(s).
The wrong lights and plug loads are controlled	<ol style="list-style-type: none"> 1. Configure the switch buttons and sensors to control the desired loads using the Push n' Learn adjustment procedure.
LEDs turn ON and OFF but the load does n't switch	<ol style="list-style-type: none"> 1. Make sure the DLM local network is not in PnL. 2. Check load connections to room controllers and/or plug load controllers.


WARRANTY INFORMATION

Wattstopper warrants its products to be free of defects in materials and workmanship for a period of five (5) years. There are no obligations or liabilities on the part of Wattstopper for consequential damages arising out of, or in connection with, the use or performance of this product or other indirect damages with respect to loss of property, revenue or profit, or cost of removal, installation or reinstallation.

No. 22893 – 2/24 rev. 3

- Copyright 2024 Legrand All Rights Reserved.
- 800.879.8585
- www.legrand.us/wattstopper

Documents / Resources

	<p>legrand LMRC-101 DLM Dual Relay Room Controller [pdf] Instruction Manual LMRC-101, BCS-WS-IS-LMRC-101-22893-R03-0224, LMRC-101 DLM Dual Relay Room Controller, LMRC-101, DLM Dual Relay Room Controller, Relay Room Controller, Room Controller, Controller</p>
---	--

References

-  [Wattstopper Lighting Control Systems](#)
- [User Manual](#)

[Manuals+](#), [Privacy Policy](#)

This website is an independent publication and is neither affiliated with nor endorsed by any of the trademark owners. The "Bluetooth®" word mark and logos are registered trademarks owned by Bluetooth SIG, Inc. The "Wi-Fi®" word mark and logos are registered trademarks owned by the Wi-Fi Alliance. Any use of these marks on this website does not imply any affiliation with or endorsement.