



LIGHTRONICS DB Series Distributed Dimming Bars Owner's Manual

[Home](#) » [LIGHTRONICS](#) » LIGHTRONICS DB Series Distributed Dimming Bars Owner's Manual 

Contents

- 1 LIGHTRONICS DB Series Distributed Dimming Bars
- 2 Product Information
- 3 Product Usage Instructions
- 4 DESCRIPTION OF UNIT
- 5 LOCATION AND ORIENTATION
- 6 MOUNTING
- 7 TO INSTALL THE MOUNTING ADAPTERS
- 8 MOUNTING ADAPTER INSTALLATION
- 9 POWER REQUIREMENTS
- 10 INSTALLATION
- 11 OPERATION
- 12 MAINTENANCE AND REPAIR
- TROUBLESHOOTING
- 13 Documents / Resources
 - 13.1 References



LIGHTRONICS DB Series Distributed Dimming Bars



Product Information

- **Product:** DB624 6 x 2400W DISTRIBUTED DIMMING BAR
- **Manufacturer:** Lightronics Inc
- **Version:** 1.1
- **Date:** 01/06/2022
- **Capacity:** 6 channels with a capacity of 2,400 watts per channel, giving a total of 14,400 watts
- **Control Protocol:** DMX512 lighting control protocol

Product Usage Instructions

1. Location and Orientation:

- The unit should be operated horizontally with the operator panel facing forward or backward (not up or down).
- Ensure that the ventilation holes on the face of the unit are not obstructed.
- Maintain a six-inch clearance between the unit and other surfaces for proper cooling.
- Do not expose the DB624 to moisture or excessive heat. It is intended for indoor use only.

2. Mounting:

- The DB624 is designed to be mounted on truss equipment using standard lighting pipe clamps.
- Attach the bolt of the pipe clamp to the inverted T slot located along the bottom of the dimmer.
- Ensure a six-inch clearance between the unit and other surfaces.
- Use safety chains or cables for any overhead dimmer installation.

3. Mounting Adapter Installation:

- The DB624 is supplied with three mounting adapters and associated hardware.
- Install a pipe clamp on the end of the adapter that overlaps itself.
- Install a 1/2 bolt and flat washer through the other end of the adapter.
- Slide the adapter onto the DB624 T slot and tighten the nut until snug.
- Repeat the process for the remaining adapters.
- Hang the entire assembly on a truss bar using pipe clamps and tighten all connections.

4. Power Requirements:

- Each DB624 requires both lines of a Single Phase 120/240 Volt AC service at 60 Amps per line
- Alternatively, it can be powered by Three Phase 120/208 Volt AC service.

DESCRIPTION OF UNIT

The DB624 is a 6 channel dimmer with a capacity of 2,400 watts per channel giving a total of 14,400 watts. The DB624 is controlled by the DMX512 lighting control protocol. Individual channels may be set to operate in "relay" mode where channels are switched only on or off depending on controller fader position.

LOCATION AND ORIENTATION

THE UNIT SHOULD BE OPERATED HORIZONTALLY WITH THE OPERATOR PANEL FACING FORWARD OR BACKWARD (NOT UP OR DOWN). Make certain the ventilation holes on the face of the unit are not obstructed. A six inch clearance should be maintained between the unit and other surfaces to ensure proper cooling. Do not place the DB624 where it will be exposed to moisture or excessive heat. The DB624 is intended for indoor use only.

MOUNTING

The DB624 is designed to be mounted on truss equipment using standard lighting pipe clamps. The attaching bolt for these clamps will fit into an inverted “T” slot located along the bottom of the dimmer. The slot will also accommodate a 1/2” bolt (3/4” across bolt head flats). Use a pipe clamp to mount the DB624 above a truss bar.

MOUNTING ADAPTERS


The DB624 is supplied with three mounting adapters and their associated hardware. The primary purpose of the adapters is to provide a way to install the unit below a truss bar without turning it upside down. The adapters can also be used for other user defined mounting arrangements.

TO INSTALL THE MOUNTING ADAPTERS

1. Install a pipe clamp on the end of the adapter which overlaps itself. Make the clamp snug but not tight against the adapter so you can make final adjustments when installing the unit on a bar.
2. Install 1/2” bolt and flat washer through the other end of the adapter so the bolt head and washer are inside the adapter.
3. Slide the adapter (with the 1/2” bolt and flat washer installed) on either end of the DB624 so the bolt head slides into the DB624 “T” slot. The flat washer must be between the DB624 and the adapter.
4. Install a lock washer and nut on the 1/2” bolt. Leave it loose enough to slide the adapter along the “T” slot in the DB624.
5. Slide the adapter along the DB624 “T” slot to the desired position and tighten the nut until it is snug. You may not want to completely tighten the nuts so you can make final adjustments when you hang the unit.
6. Repeat the above process for the remaining adapters.
7. Hang the entire assembly on a truss bar by the pipe clamps. Tighten down any connections left loose during the previous assembly process.

NOTE: Use of safety chains or cables is recommended for any overhead dimmer installation

MOUNTING ADAPTER INSTALLATION

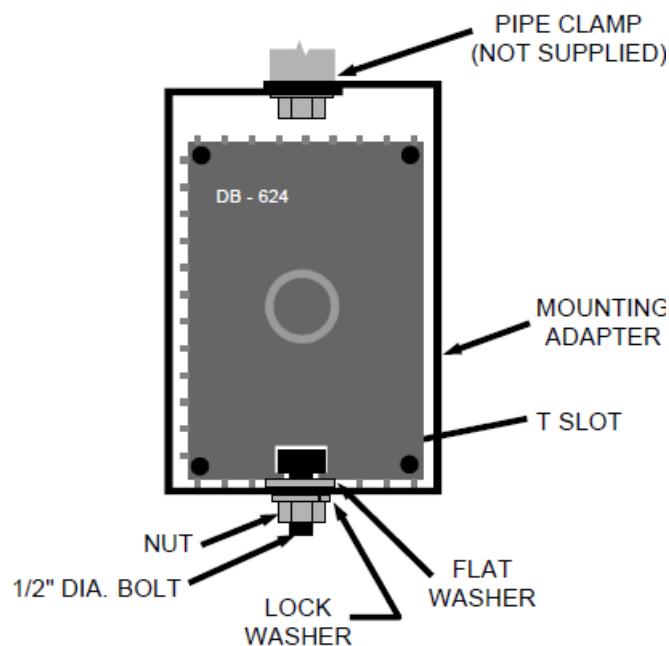

POWER REQUIREMENTS

Each DB624 requires both lines of a SINGLE PHASE 120/240 VOLT AC service at 60 Amps per line or THREE

PHASE 120/208 VOLT AC service at 40 Amps per line. Neutral and ground conductors are needed. The unit requires a line frequency of 60HZ but can be set up for 50HZ as a special order or update by contacting Lightronics. Power enters the DB624 through the knockout sized holes in the left end of the unit. A terminal block for connecting the incoming power is located inside the left end of the unit. There is also an earth ground lug. The DB624 will not operate correctly using only 2 phases of a 3 phase power service. This holds true regardless of whether the unit is set up for single or three phase power.

INSTALLATION

MAKE SURE THE INPUT POWER IS DISCONNECTED BEFORE INSTALLING THE DB624. The DB624 is supplied to operate on THREE PHASE 120/208 VAC power. It can be "field converted" to operate on SINGLE PHASE 120/240 VAC. See the section "SINGLE PHASE POWER CONNECTIONS" for information about converting to Single phase power. The power input terminals are rated for one AWG#8 wire or one AWG#6 wire. Terminal torque is 16 lb.-in max.

KNOCKOUTS

Power access to the DB624 is through the left end cover plate which has dual knockouts. The right end cover plate also has dual knockouts which "punch out" in the opposite direction. These end cover plates may be exchanged to accommodate your particular installation.

CONVERTING TO RIGHT HAND END POWER ACCESS

The DB624 may be field converted to provide power connection access at the right hand end of the unit while retaining correct orientation of the center control panel. This is done by removing the center control panel and reinstalling it upside down. When this is done, the power input will be at the right end, the control panel will still read "right side up" and the channel outputs will correctly correspond to the labeling.

The procedure is as follows:

1. Remove the eight screws which attach the center panel to the main chassis and carefully pull the panel out. Note the orientation of the two 6-pin, inline connectors which connect to the rear center of the control circuit card.
2. Disconnect the two 6-pin inline connectors (depress the latching tabs to release them). On the circuit card these are labeled as J1 (upper) and J2 (lower). Also disconnect the 2-pin inline connector.
3. Rotate the center control panel so it reads upside down and reinstall the 6-pin connectors. Do not rotate or move the female connectors which have wires in them. The connector which was attached to J1 should now connect to J2 and vice versa.
4. Reconnect the 2-pin inline connector and reinstall the control panel.

THREE PHASE POWER CONNECTIONS

True three phase power must be supplied to operate the DB624 in the three phase configuration. This means that each of the three input power hot legs (L1, L2 and L3) must have a 120 degree electrical phase offset from each other. The feed circuit must be able to supply 40 Amps for each hot leg. The DB624 is factory shipped to accommodate THREE PHASE, 120/208 VAC, Wye power service. Consult the applicable electrical codes for your location for exact wire specifications. The unit must be powered from a circuit providing a minimum of 40 Amps per line (3 pole 40 Amp circuit breaker). The minimum wire size is AWG#8. Wire may be either stranded or solid. The terminals are intended for copper wire only. **MAKE CERTAIN THE INPUT POWER SOURCE IS DE-ENERGIZED BEFORE MAKING CONNECTIONS.**


CONNECT POWER WIRES AS FOLLOWS

1. Remove the access cover at the end of the unit.
2. Connect the three "HOT" power input wires to the L1, L2, L3 terminals.
3. Connect the neutral wire to the terminal marked N.

4. Connect a ground wire to the CHASSIS GROUND terminal marked G.

When operating on three phase power, the DB624 expects a particular phase sequence for these three input power connections. It does not matter which phase is connected to the L1 terminal but L2 and L3 must be in the correct order. The unit will not be damaged if these two connections are reversed but dimming will not occur correctly and some channels will appear to be in an on/off mode. If this occurs – see the “Phase Sensing Jumper” section in this manual and set the jumper block for three phase reverse operation.

THREE PHASE POWER INPUT CONNECTIONS

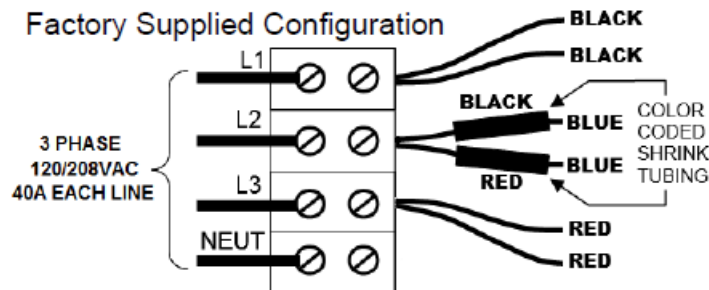


SINGLE PHASE POWER CONNECTIONS

The DB624 may be field converted to accommodate a SINGLE PHASE 120/240 VAC power service. Consult the applicable electrical codes for your location for exact wire specifications. The unit must be powered from a circuit providing a minimum of 60 Amps per line (2 pole 60 Amp circuit breaker). The minimum wire size is AWG#6. Wire may be either stranded or solid. The terminals are intended for copper wire only.

MAKE CERTAIN THE INPUT POWER SOURCE IS DE-ENERGIZED BEFORE MAKING CONNECTIONS.

1. Remove the access cover at the end of the unit.
2. Connect the two “HOT” power input wires to the L1 and L3 terminals.
 - **Note:** The terminal marked L2 is not used for single phase operation.
3. Connect the neutral wire to the terminal marked N.
4. Connect a ground wire to the CHASSIS GROUND terminal marked G. There are two blue wires in the L2 terminal on the opposite side of the power input terminal strip. These wires have color coded shrink tubing markers on them. One of them is marked with BLACK. The other is marked with RED.
5. Move the BLUE wire with the BLACK marker from the L2 terminal to the L1 terminal.
6. Move the BLUE wire with the RED marker from the L2 terminal to the L3 terminal. A diagram of single phase power connections is shown below:

SINGLE PHASE POWER INPUT CONNECTIONS

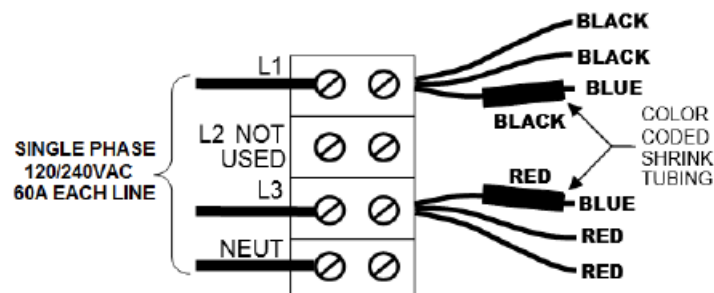


PHASE SENSING JUMPER

There is a small black jumper block located on the back of the control circuit board which must be set to correspond to either single phase or three phase AC input power. Install the jumper according to the power at your

facility using the diagram below. The positions are shown below and are marked on the circuit board. The control circuit board is mounted in the inside of the main control panel which is the front center panel on the unit. The Three Phase Reverse setting is provided only to correct “out of sequence” power input connections. Also see the section “Three Phase Power Connections” for more information concerning the Three Phase Reverse setting. The DB624 is usually shipped from the factory set for 3 Phase Normal operation.

Disconnect or turn off power to the unit before changing jumper settings

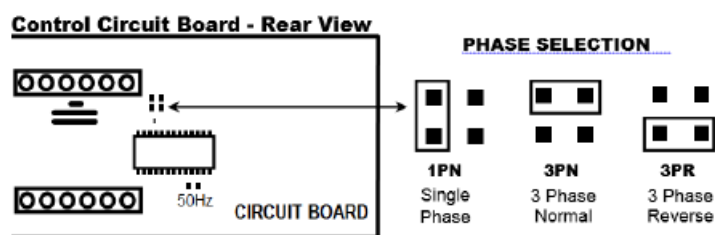

CHANNEL OUTPUT CONNECTIONS (LAMP LOAD CONNECTIONS)

Dimmer channel output connectors are on the face of the unit. Two connections are available for each channel (the optional twist-lock panels have one connection per channel). The numbering for the channels is shown on the unit center faceplate. The maximum load for each channel is 2400 Watts or 20 Amps.

CONTROL SIGNAL

Connect a Lightronics or other DMX512 compatible controller to the DB624 using the MALE 5-pin XLR connector located on the center faceplate of the unit. This connector is marked DMX IN. The FEMALE 5-pin XLR connector is provided so you can connect multiple dimmers as a system. This connector is marked DMX OUT and will pass the DMX signal through to additional dimmers on a DMX chain. Connector wiring information is given below.

PIN NUMBER	SIGNAL NAME
1	DMX Common
2	DMX Data –
3	DMX Data +
4	Not Used
5	Not Used

DMX TERMINATION

A DMX device chain should be electrically terminated at the last device (and only the last device) on the control chain. A DMX terminator consists of a 120 Ohm resistor connected across the DMX DATA + and DMX DATA – lines. The DB624 contains a built in terminator which may be switched in or out. The left end DIP switch on the unit center panel will apply the terminator if moved to the UP position.

OPERATION

• CIRCUIT BREAKERS

A small plate near one end of the unit contains a 20 Amp magnetic circuit breaker for each dimmer channel. To operate a channel the associated circuit breaker must be closed. Channel numbers for the circuit breakers are located on the circuit breaker panel. If the circuit breaker will not remain closed then there is an overload at the lamps for that channel which MUST be corrected before operation can continue.

• INDICATORS

There is a neon lamp for each channel on the center faceplate. This lamp indicates when INPUT power is available for the channel (Input power on and channel circuit breaker closed). There is also a row of six red LEDs on the center faceplate which give an approximate indication of the channel output intensity.

• SETTING THE UNIT STARTING ADDRESS


The DB624 may be addressed to any block of six DMX addresses between 1 and 507. Set the rotary decade switches on the unit center panel to the number corresponding to the DMX address which will be used for the first channel of the DB624. The remaining five channels will be assigned to consecutive higher DMX addresses. Multiple DB624s may be set to the same address block.

• CHANNEL TESTING

DB624 channel operation may be tested at the unit. The six small pushbuttons at the lower right of the center faceplate will activate the associated dimmer channel to full ON and OFF when pushed. In addition to channel testing, this function is useful when adjusting or focusing lamps. A channel which has been turned on by the test buttons can be turned back off at the DMX console by setting the associated channel fader to full ON and then back OFF. The red LED indicators located directly above the buttons indicate when the channel is on.

• RELAY MODE OPERATION

Individual channels of the DB624 may be switched into the relay mode. In this mode the dimmer channel will either be fully on or fully off depending on the channel intensity setting at the control console. The channel will remain off until a console fader position threshold point is crossed. When this occurs – the corresponding dimmer channel will switch to a full on condition. This mode is useful to control lamps and other lighting devices which cannot be dimmed. There is a block of seven DIP switches on the center panel of the unit. The right hand six of these switches are used to switch the corresponding channel into the relay mode. To switch a channel to the relay mode – push its DIP switch UP.

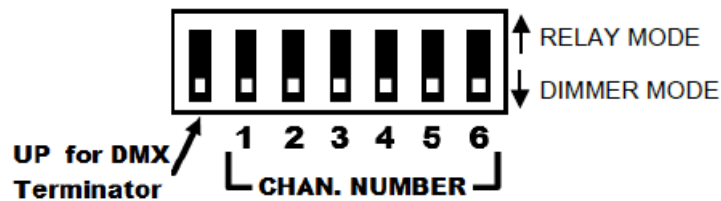

MAINTENANCE AND REPAIR TROUBLESHOOTING

VERIFY ALL POWER IS REMOVED BEFORE HANDLING THE UNIT.

1. Verify the unit channel addresses are correctly set.
2. Check that the DMX controller is powered and that DMX channels are correctly patched or set.
3. Check the control cable between the dimmer and its DMX controller.
4. Verify the loads and their connections.

OWNER MAINTENANCE

There is one fuse in the unit which provides protection for the unit's printed circuit board. It may be replaced only with a 1/2 Amp, 250VAC, Fast acting replacement fuse. There are no other user serviceable parts inside the unit. The best way to prolong the life of your unit is to keep it cool, clean, and dry. It is important that the cooling intake and exit vent holes are clean and unobstructed. Service by other than Lightronics authorized agents may void your warranty.


OPERATING AND MAINTENANCE ASSISTANCE

If service is required, contact the dealer from whom you purchased the equipment or return it to the Lightronics Service Department, 509 Central Drive, Virginia Beach, VA 23454. TEL 757 486 3588. Please contact Lightronics for a Repair Information Sheet to be filled out and included with items being returned for service. Lightronics recommends that you record the serial number of your DB624 for future reference

SERIAL NUMBER _____

WARRANTY INFORMATION AND REGISTRATION – CLICK LINK BELOW:
www.lightronics.com/warranty.html. www.lightronics.com. 509 Central Drive, Virginia Beach, VA 23454 Tel
757 486 3588

Documents / Resources

	LIGHTRONICS DB Series Distributed Dimming Bars [pdf] Owner's Manual DB624, DB Series Distributed Dimming Bars, Distributed Dimming Bars, Dimming Bars, Bars
---	--

References

- [Lightronics - Complete Lighting and Control Systems](#)
- [Lightronics Lighting Control Product Warranty Information](#)