

# **Model 500XLFC**

# **Water Pressure Reducing Valve** with Flanged Connections

## **Application**

Zurn Wilkins model 500XLFC is designed for installation on potable water lines to reduce high inlet pressure to a lower outlet pressure. The high flow capacity makes this device most suitable for industrial water lines and commercial water systems. The balanced piston design enables the regulator to react in a smooth and responsive manner to changes in system flow demand, while at the same time, providing protection from inlet pressure changes





#### **Approvals**

· Meets the requirements of NSF/ANSI/CAN 61

#### **Materials**

Low Lead Cast Bronze, ASTM B 806 Body & cover

Cast Bronze, ASTM B 584 Bell housing

Stem & plunger Low Lead Cast Bronze, ASTM B 806

Internals Stainless steel, 300 Series Elastomers EPDM (FDA approved)

Buna Nitrile (FDA approved)

Delrin™ Polymers

**Springs** Oil tempered wire, ASTM A229,

**Epoxy Coated** 

Natural Vulcanized Fibre Cap gasket Stainless steel, 300 Series Seat

#### **Features**

Sizes: 2", 21/2", 3"

Maximum working water pressure 300 psi Maximum working water temperature 140° F

25 psi to 75 psi Reduced pressure range (standard) End connections (flanged) ANSI Class 125 **Options** 

(Suffixes can be combined)

☐ 510XLFC - 400 psi inlet rating, 75 psi to 125 psi spring

range, field set

☐ FSC with cast iron "Y" type flanged strainer, fusion

epoxy coated, inside and out (2-1/2" & 3" only)

sealed cage for use in pit or vault □ SC

 $\square$  SW made for salt water service spring range is 75-125 psi, field set  $\square$  HR

☐ HLR spring range is 10-125 psi, field set

☐ HTSTSChigh temperature application, up to 180° F ☐ LPV high temperature application, up to 180° F,

spring range is 10-35 psi, factory set at 20 psi

□ BP tapped and plugged for 3/4" bypass connection


 $\square$  P tapped and plugged for gauge  $\square$  G tapped and plugged with gauge

valve stem features integral thermal by-pass ☐ TBP

check valve (applies to 3" size only)"

#### **Accessories**

☐ Repair kit (rubber only)



# Dimensions & Weights (do not include pkg.)

SIZE		CONNECTIONS	DIMENSIONS (approximate)								WEIGHT	
			A		В		С		D		WEIGHT	
in.	mm		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg.
2	50	FLANGED	10 3/8	263	15	381	3	76	6 1/2	165	30	13.5
2 1/2	65	FLANGED	10 3/8	263	15	381	3 1/2	89	8	203	36	16.5
3	80	FLANGED	11	279	17 3/4	451	3 3/4	95	8	203	50	22.5

Zurn Industries, LLC | Wilkins

1747 Commerce Way, Paso Robles, CA U.S.A. 93446 Ph. 855-663-9876, Fax 805-238-5766


In Canada | Zurn Industries Limited

7900 Goreway Drive, Unit 10, Brampton, Ontario L6T 5W6, 877-892-5216

www.zurn.com


Date: 11/19 Document No. REG-500XLFC Product No. Model 500XLFC

### MODEL 500XLFC 2" THRU 3" (STANDARD & METRIC)

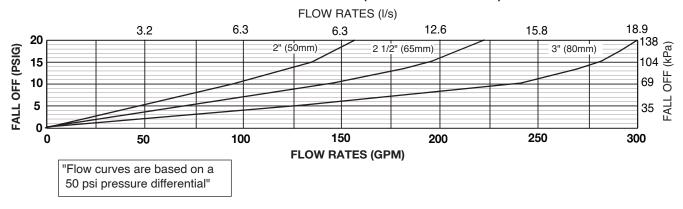

#### **Typical Installation**

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. The assembly shall be installed with sufficient side clearance for testing and maintenance. The Model 500XLFC may be installed in any position. If installed in a pit or vault, or indoor application, specify the "SC" sealed cage option. Multiple installations are recommended for wide demand variations or where the desired pressure reduction is more than 4 to 1 (i.e.: 200 psi inlet reduced to 50 psi outlet). **CAUTION:** Anytime a reducing valve is adjusted, a pressure gauge must be used downstream to verify correct pressure setting. Do not bottom adjustment bolt on bell housing.

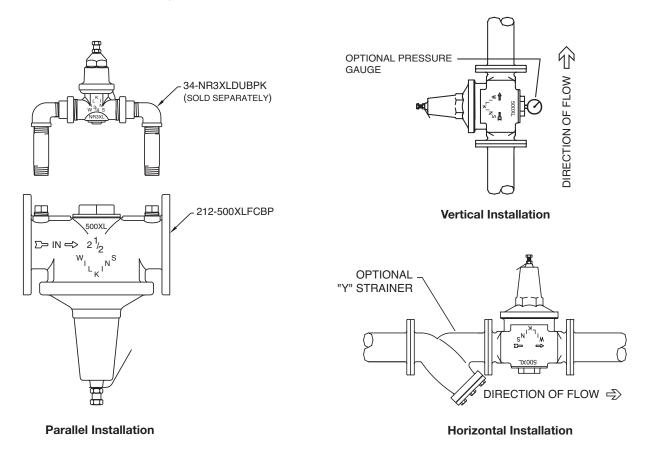

# **Specifications**

The Pressure Reducing Valve shall be certified to NSF/ANSI/CAN 61, consist of a bronze body and bell housing with flanged connections, shall have a separate access cover for the plunger and shall have a bolt to adjust the downstream pressure. The assembly shall be of the balanced piston design and shall reduce pressure in both flow and no-flow conditions. The bronze bell housing and access cap shall be threaded to the body and shall not require the use of ferrous screws. The Pressure Reducing Valve shall be a ZURN WILKINS Model 500XLFC.