

WLS70 Industrial LED Strip Light (AC)



Quick Start Guide

This guide is designed to help you set up and install the WLS70 Industrial LED Strip Light (AC). For complete information on programming, performance, troubleshooting, dimensions, and accessories, please refer to the Instruction Manual at www.bannerengineering.com. Search for p/n 220753 to view the Instruction Manual. Use of this document assumes familiarity with pertinent industry standards and practices.



Important: Read the following instructions before operating the light. Please download the complete WLS70 Industrial LED Strip Light (AC) technical documentation, available in multiple languages, from www.bannerengineering.com for details on the proper use, applications, Warnings, and installation instructions of this device.




Important: Lea el siguiente instructivo antes de operar el luminario. Por favor descargue desde www.bannerengineering.com toda la documentación técnica de los WLS70 Industrial LED Strip Light (AC), disponibles en múltiples idiomas, para detalles del uso adecuado, aplicaciones, advertencias, y las instrucciones de instalación de estos dispositivos.



Important: Lisez les instructions suivantes avant d'utiliser le luminaire. Veuillez télécharger la documentation technique complète des WLS70 Industrial LED Strip Light (AC) sur notre site www.bannerengineering.com pour les détails sur leur utilisation correcte, les applications, les notes de sécurité et les instructions de montage.

Models

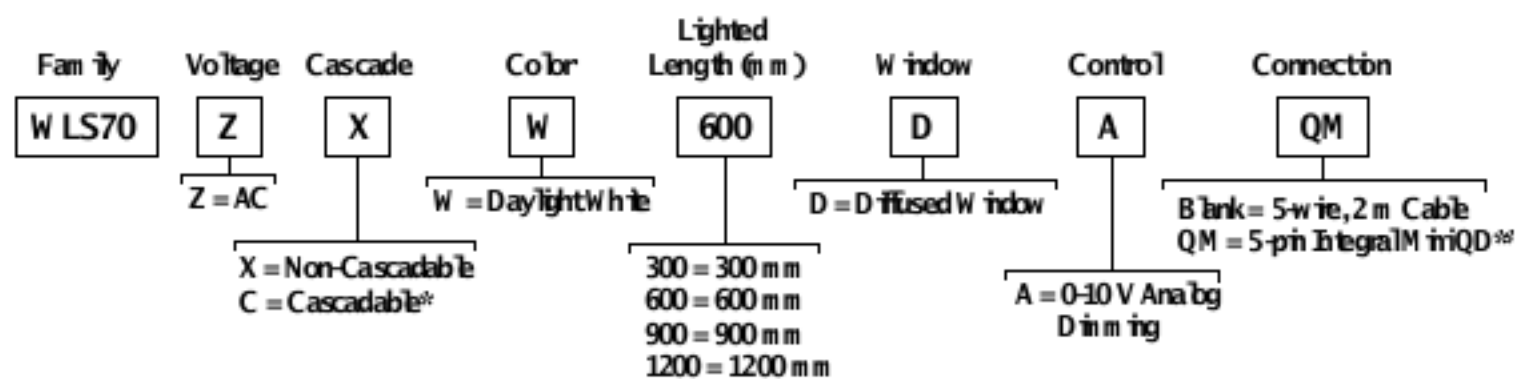

*Cascadable models only available with QM connection.

**Models with a quick disconnect require a mating cordset. See [Cordsets](#) on p. 3.

Installing the WLS70 Industrial LED Strip Light

Figure 1. Attaching the Clamp Brackets (Step 3)


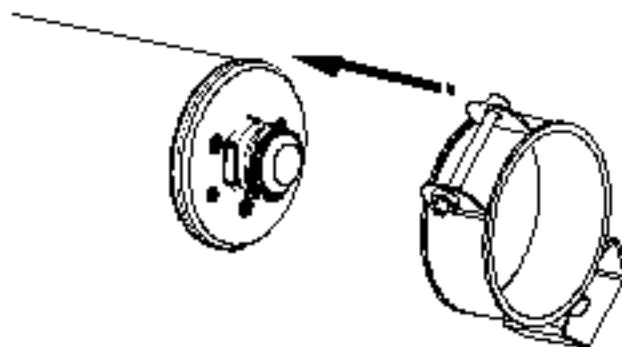


Figure 2. Verifying the Cascade Cover is Attached (Step 10)



1. Turn off power at fuse or circuit breaker box.
2. Remove the light from the packaging and inspect it for damage before installing it.
3. Attach the included LMBWLS70T clamp brackets to the light. Slide on gasket if desired.
Refer to the instruction manual for a complete list of compatible brackets.
4. Select a suitable horizontal or vertical mounting location.
5. Place the light in the mounting location and mark the positions of the bracket mounting holes.
The optional LMBWLS70HK bracket can be used to hang the light in conjunction with the LMBWLS70T (see [Brackets](#) on p. 3).
6. Drill the holes and use appropriate screws to secure the bracket to the mounting location.

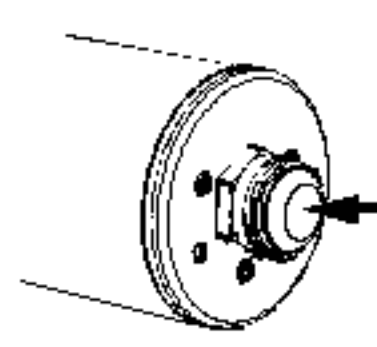

7. Clamp the light onto the brackets.
8. When daisy chaining multiple lights, follow steps 1 through 5 to mount additional lights. See the application note in [specctons](#) on p. 2 for the maximum allowed lights daisy chained together and maximum allowed cable run when choosing mounting locations.
9. Connect the daisy chained units together using cascade cordsets (see [Cordsets](#) on p. 3).
10. Verify the supplied cascade cover is on the output connector of the last light in the chain.
11. Attach cables (cabled model) or cordsets (quick-disconnect model) per the wiring diagram. Terminate wire as appropriate per application.

Installation is complete. Turn on electricity at fuse or circuit breaker box.



WARNING:

- Risk of electric shock
- Failure to follow these instructions could result in serious injury or death.
- Disconnect or turn off power before installing, removing, or servicing the device.
- Install and connect the device in accordance with the National Electrical Code (NEC) and any applicable local code requirements and supply the device with an appropriate fuse box or circuit breaker (see [specctons](#)).

Wiring Diagram

Diagram	Wire	Connection	Pinout (Male)	Pinout (Female)
	L - Black	Line/Hot	 1 = Purple 2 = White 3 = Yellow/Green 4 = Black 5 = Gray	 1 = Purple 2 = White 3 = Yellow/Green 4 = Black 5 = Gray
	N - White	Neutral		
	- Green/Yellow	Earth ground		
	Dim (+) - Purple	0-10 V DC analog dimming		
	Dim (-) - Gray	Return analog dimming		

ptions

Supply Voltage

Nominal voltage: 120 V AC to 277 V AC, 60 Hz in North America
 Nominal voltage: 100 V AC to 277 V AC, 50/60 Hz outside North America
 Power factor: > 0.95 at 120 V AC and > 0.90 at 277 V AC
 Total harmonic distortion (THD): < 20%
 See electrical characteristics on product label

Supply Current

Lighted Length (mm)	Max. Current Draw (A) at 100 V AC	Typical Current Draw (A)		
		120 V AC	230 V AC	277 V AC
300	0.120	0.080	0.040	0.040
600	0.220	0.165	0.080	0.070
900	0.320	0.240	0.130	0.110
1200	0.420	0.315	0.160	0.140

Application Notes

When connecting continuous run/cascadable lights in series, it is important not to exceed maximum current limitations of 8A. For example: the typical current draw of a 1200 mm [xtrngs](#) at 120 V is 0.315A. 8A/0.315A yields a maximum of 25 [xtrngs](#) cascaded together. Two or more lights installed in parallel must maintain a 150 mm (6 inch) spacing to maintain a 50 °C operating temperature.

[specctons](#) and Approvals



UL/cULus E47D122

Light Characteristics

Daylight White [ccy](#) up to 143 lumens/watt typical at 120 V AC at 25 °C (77 °F)
 CRI: 82, typical

Model	Color	Color Temperature (CCT)	Lumens (Typical at 25 °C)	Watts at 120 V AC	Luminous ccy (lm/w)
300	Daylight White	5000 K (±300 K)	1350	9.6	141
600	Daylight White	5000 K (±300 K)	2700	19.8	136
900	Daylight White	5000 K (±300 K)	4050	28.8	141
1200	Daylight White	5000 K (±300 K)	5400	37.8	143

Dimming

Compatible with 0-10 V analog LED dimming, dimmable to 5% intensity
 Dimming current: <1.0 mA

Supply Protection Circuitry

Protected against transient voltages

Construction

Clear anodized aluminum housing; polycarbonate outer housing

Mounting

Several optional mounting brackets are available (see [Accessories](#))

Connections

Integral 5-pin 7/8"Mini-style quick disconnect (8A / 300V / 2.5kV / 2), (5-pin connecting cordset required); or 2 m (6.5 ft) integral [STOOW](#) UL/HAR PVC cable
 See [Cordsets](#) on p. 3

Environmental Rating

IEC IP65

LED Lifetime

When operating within [specctons](#) output will decrease less than 30% after 50,000 hours.

Operating Temperature

Surface Mount Installation: -40 °C to +50 °C (-40 °F to +122 °F)
 85% at +50 °C maximum relative humidity (non-condensing)

Storage Temperature


-40 °C to +70 °C (-40 °F to +158 °F)

Vibration and Mechanical Shock

Vibration: 10 Hz to 55 Hz, 0.5 mm peak-to-peak amplitude per IEC 60068-2-6 (5 minute sweep, 30 minute dwell)
 Shock: 15G 11 ms duration, half sine wave per IEC 60068-2-27
 Impact: IK10 (IEC 60068-2-75)

Dimensions

All measurements are listed in millimeters [inches], unless noted otherwise.

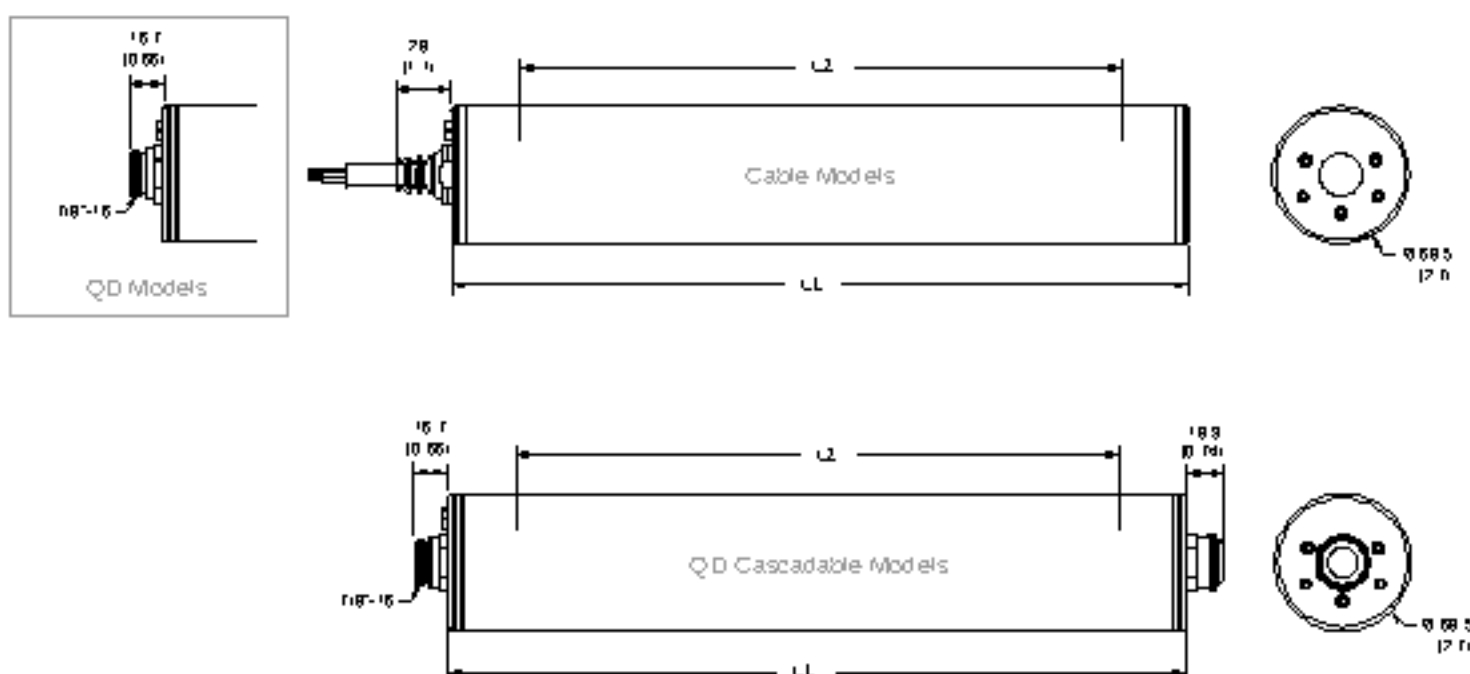

Model	Housing Length (L1)	Lighted Length (L2)
WLS70..300..	369.8	302
WLS70..600..	667.6	600
WLS70..900..	965.3	898
WLS70..1200..	1263	1196

Accessories

Brackets

All measurements are listed in millimeters, unless noted otherwise. Refer to the instruction manual for a complete list of compatible brackets.

LMBWLS70T

- Stainless steel
- Includes two clamp brackets for hanging or surface mount, two anti-rotation gaskets, and stainless steel hardware for securing the bracket to the light
- For use with M8 or 5/16" mounting hardware



Note: The LMBWLS70T is supplied with the light.


LMBWLS70HK

- Hanging bracket kit allows for suspended installation
- Includes two hanging bracket assemblies
- For use with bracket LMBWLS70T



Cordsets

5-Pin Threaded 7/8-in Cordsets--Single Ended				
Model	Length	Style	Dimensions	Pinout (Female)
MBCQL-506	2 m (6.56 ft)	Straight		1 = Purple 2 = White 3 = Yellow/Green 4 = Black 5 = Gray
MBCQL-515	5 m (16.4 ft)			
MBCQL-530	9 m (29.5 ft)			

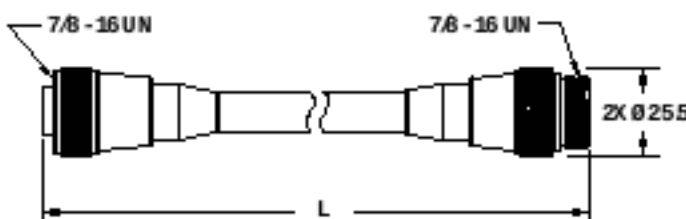5-Pin Threaded 7/8-in Cordsets--Double Ended				
Model	Length	Style	Pinout (Male)	Pinout (Female)
MBCQL-503SS	1 m (3.28 ft)	Female Straight/Male Straight		
MBCQL-506SS	2 m (6.56 ft)			
MBCQL-512SS	4 m (13.1 ft)			
MBCQL-520SS	6 m (19.7 ft)			
			1 = Purple 2 = White 3 = Yellow/Green 4 = Black 5 = Gray	1 = Purple 2 = White 3 = Yellow/Green 4 = Black 5 = Gray

Banner Engineering Corp. Limited Warranty

Banner Engineering Corp. warrants its products to be free from defects in material and workmanship for one year following the date of shipment. Banner Engineering Corp. will repair or replace, free of charge, any product of its manufacture which, at the time it is returned to the factory, is found to have been defective during the warranty period. This warranty does not cover damage or liability for misuse, abuse, or the improper application or installation of the Banner product.

THIS LIMITED WARRANTY IS EXCLUSIVE AND IN LIEU OF ALL OTHER WARRANTIES WHETHER EXPRESS OR IMPLIED (INCLUDING, WITHOUT LIMITATION, ANY WARRANTY OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE), AND WHETHER ARISING UNDER COURSE OF PERFORMANCE, COURSE OF DEALING OR TRADE USAGE.

This Warranty is exclusive and limited to repair or, at the discretion of Banner Engineering Corp., replacement. IN NO EVENT SHALL BANNER ENGINEERING CORP. BE LIABLE TO BUYER OR ANY OTHER PERSON OR ENTITY FOR ANY EXTRA COSTS, EXPENSES, LOSSES, LOSS OF PROFITS, OR ANY INCIDENTAL, CONSEQUENTIAL OR SPECIAL DAMAGES RESULTING FROM ANY PRODUCT DEFECT OR FROM THE USE OR INABILITY TO USE THE PRODUCT, WHETHER ARISING IN CONTRACT OR WARRANTY, STATUTE, TORT, STRICT LIABILITY, NEGLIGENCE, OR OTHERWISE.

Banner Engineering Corp. reserves the right to change, modify or improve the design of the product without assuming any obligations or liabilities relating to any product previously manufactured by Banner Engineering Corp. Any misuse, abuse, or improper application or installation of this product or use of the product for personal protection applications when the product is ~~designed~~ as not intended for such purposes will void the product warranty. Any ~~modifications~~ to this product without prior express approval by Banner Engineering Corp will void the product warranties. All ~~specifications~~ published in this document are subject to change; Banner reserves the right to modify product ~~specifications~~ or update documentation at any time. ~~specifications~~ and product information in English supersede that which is provided in any other language. For the most recent version of any documentation, refer to: www.bannerengineering.com.

For patent information, see www.bannerengineering.com/patents.

FCC Part 15 and CAN ICES-3 (B)/NMB-3(B)

This device complies with part 15 of the FCC Rules and CAN ICES-3 (B)/NMB-3(B). Operation is subject to the following two conditions:

1. This device may not cause harmful interference, and
2. This device must accept any interference received, including interference that may cause undesired operation.

This equipment has been tested and found to comply with the limits for a Class B digital device, pursuant to part 15 of the FCC Rules and CAN ICES-3 (B)/NMB-3(B). These limits are designed to provide reasonable protection against harmful interference in a residential installation. This equipment generates, uses and can radiate radio frequency energy and, if not installed and used in accordance with the instructions, may cause harmful interference to radio communications. However, there is no guarantee that interference will not occur in a particular installation. If this equipment does cause harmful interference to radio or television reception, which can be determined by turning the equipment off and on, the user is encouraged to try to correct the interference by one or more of the following measures:

- Reorient or relocate the receiving antenna.
- Increase the separation between the equipment and receiver.
- Connect the equipment into an outlet on a circuit different from that to which the receiver is connected.
- Consult the manufacturer.

Mexican Importer

Banner Engineering de México, S. de R.L. de C.V.
David Alfaro Siqueiros 103 Piso 2 Valle Oriente
San Pedro Garza García Nuevo León, C. P. 66269

81 8863.2714