

High–Wall Duct–Free Split systems

PA13A / PW3CA Cooling Sizes 009–012

PA13N / PW3CN Cooling Sizes 018–024

PH13A / PW3HA HP Sizes 009–012

PH13N / PW3HN HP Sizes 018–024

Product Data



The ideal compliment to your ducted system when it is impractical or prohibitively expensive to use ductwork.

INDUSTRY LEADING FEATURES / BENEFITS

AN INEXPENSIVE AND CREATIVE SOLUTION TO DESIGN PROBLEMS.

The PA(H)13 / PW3 series duct-free split systems are a matched combination of an outdoor condensing unit and an indoor fan coil unit connected only by refrigerant tubing and wires.

The fan coil is mounted on the wall, near the ceiling. This selection of fan coils permits inexpensive and creative solutions to design problems such as:

- Add-ons to current space (an office or family room addition)
- Special space requirements
- When changes in the load cannot be handled by the existing system.
- When adding air conditioning to spaces that are heated by hydronic or electric heat and have no ductwork.
- Historical renovations or any application where preserving the look of the original structure is essential.

These compact indoor fan coil units take up very little space in the room and do not obstruct windows. The fan coils are attractively styled to blend with most room decors. Advanced system components incorporate innovative technology to provide reliable cooling performance at low sound levels.

LOW SOUND LEVELS

When noise is a concern, the duct-free split systems are the answer. The indoor units are whisper quiet. There are no compressors indoors, either in the conditioned space or directly over it, and there is none of the noise usually generated by air being forced through ductwork.

When sound ordinances and proximity to neighbors demand quiet operation, the PA(H)13 unit is the right choice: The advanced, horizontal airflow design distributes air more evenly over the coil.

SECURE OPERATION

If security is an issue, outdoor and indoor units are connected only by refrigerant piping and wiring to prevent intruders from crawling through ductwork. In addition, since PA(H)13 units can be installed close to an outside wall, coils are protected from vandals and severe weather.

FAST INSTALLATION

This compact duct-free split system is simple to install. A mounting bracket is standard with the indoor units and only wire and piping need to be run between indoor and outdoor units. These units are fast and easy to install ensuring minimal disruption to customers in the home or workplace. This makes the PA13NA(N)/PW3CA(N), PH13A(N)/PW3HA(N) duct-free split systems the equipment of choice, especially in retrofit situations.

SIMPLE SERVICING AND MAINTENANCE

Removing the top panel on outdoor units provides immediate access to the control compartment, providing a service technician access to check unit operation. In addition, the draw-thru design of the outdoor section means that dirt accumulates on the outside surface of the coil. Coils can be cleaned quickly from the inside using a pressure hose and detergent.

On all indoor units, service and maintenance expense is reduced due to easy-to-use cleanable filters. In addition, these high wall systems have extensive self-diagnostics to assist in troubleshooting.

BUILT-IN RELIABILITY

Duct-free split system indoor and outdoor units are designed to provide years of trouble-free operation.

The high wall indoor units include protection against freeze-up and high evaporator temperatures on heat pumps.

The condensing units and heat pumps are also protected. There is a three minute time delay before the compressor will start. The compressor is also protected by the over-current protection. On size 18k and 24k heat pumps, there is high temperature protection.

INDIVIDUAL ROOM COMFORT

Maximum comfort is provided because each space can be controlled individually based on usage pattern. The air sweep feature provided permits optimal room air mixing to eliminate hot and cold spots for occupant comfort. In addition, year-round comfort can be provided with heat pumps.

ECONOMICAL OPERATION

The duct-free split system design allows individual room heating or cooling when required. There is no need to run large supply-air fans or chilled water pumps to handle a few spaces with unique load patterns. In addition, because air is moved only in the space required, no energy is wasted moving air through ducts.

EASY-TO-USE CONTROLS

The high-wall units have microprocessor-based controls to provided the ultimate in comfort and efficiency. The user friendly wireless remote control provides the interface between user and the unit.

ACCESSORIES



Customizing these duct-free split systems to your application is easily accomplished.

Adding a condensate pump accessory to the high wall fan coil provides installation flexibility.

AGENCY LISTINGS

All systems are listed with ARI (Air Conditioning & Refrigeration Institute), and ETL.

MODEL NUMBER NOMENCLATURE

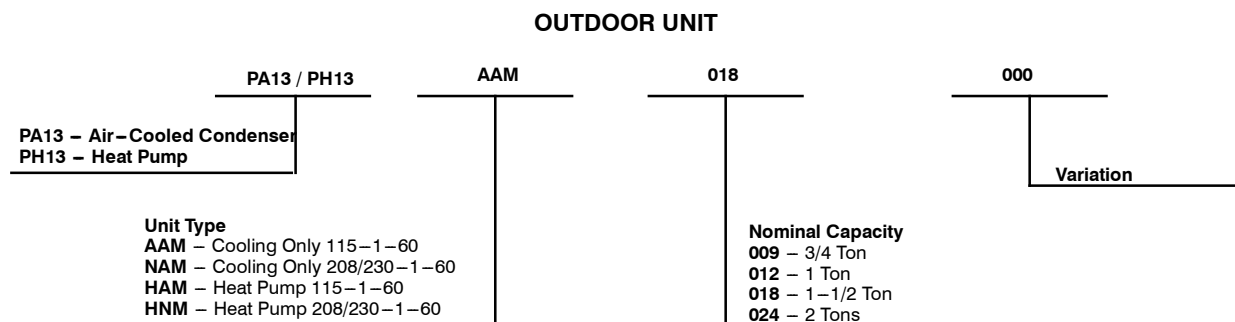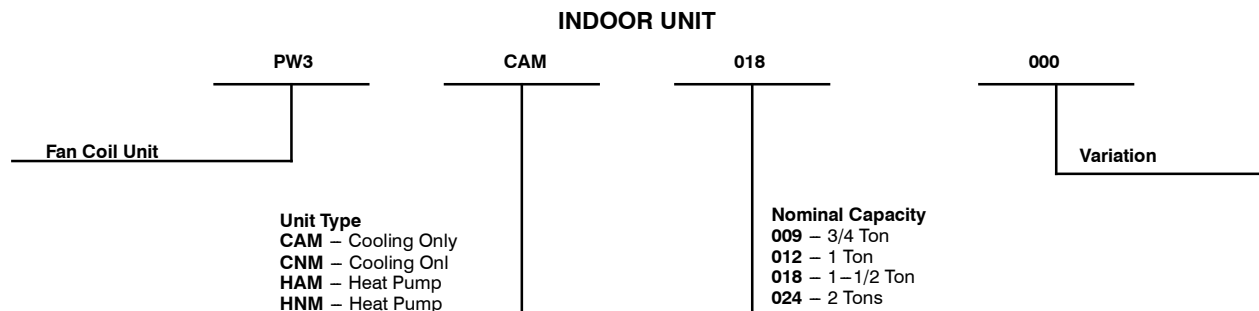

PA(H)13A(N)AM / PW3C(H)A(N)M



STANDARD FEATURES AND ACCESSORIES

Ease Of Installation	
Mounting Brackets	S
Low Voltage Controls	S
Comfort Features	
Microprocessor Controls	S
Wireless Remote Control	S
Automatic Air Sweep	S
Air Direction Control	S
Auto Restart Function	S
Cold Blow Protection On Heat Pumps	S
Auto Changeover On Heat Pumps	S
Energy Saving Features	
Sleep Mode	S
Stop/Start Timer	S
Safety And Reliability	
3 Minute Time Delay For Compressor	S
Over Current Protection For Compressor	S
Indoor Coil Freeze Protection	S
Indoor Coil High Temperature Protection On Heat Pumps	S
Condenser High Temperature Protection On heat Pumps†	S
Accumulator On Heat Pumps	S
Ease Of Service And Maintenance	
Cleanable Filters	S
Diagnostics	S
Liquid Line Pressure Taps	S
Suction And Discharge Pressure Taps (Sizes 18 and 24K)	S
Application Flexibility	
Condensate Pumps	A
Crankcase Heater	A
Wind Baffles	F
Warranty	
6 – Year Compressor Warranty	S
2 – Parts Warranty	S
Compressor Extended Warranty Years 6 Thru 10	O
All Parts And Labor Years 2 Thru 5	O
All Parts And Labor Years 2 Thru 5, Compressor Years 6 Thru 10	O

† Sizes 18k & 24k

Legend


S Standard

A Accessory

O Optional

F Field Fabricated

INDOOR UNITS

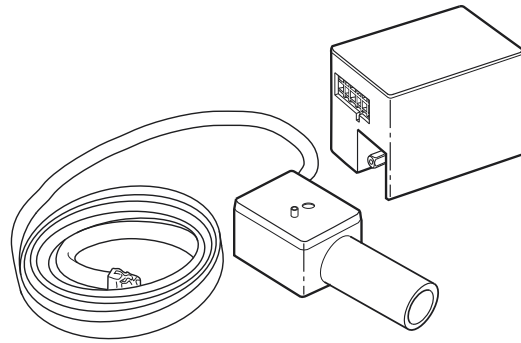

A07892

Fig. 1 – Condensate Pump Accessory

On high wall fan coils, the condensate pump has a lift capability of 12 ft (3.6 m) on the discharge side with the pump mounted in the fan coil or 6 ft (1.8 m) on the suction side if the pump is remote mounted. The pump is recommended when adequate drain line pitch cannot be provided, or when the condensate must move up to exit.

NOTE: An external 115v power source will be required to run the pump on unit sizes 9k and 12k.

OUTDOOR UNITS

CRANKCASE HEATER

Available for units with rotary compressors. Heater clamps around compressor oil sump. Recommended for long line applications.

AHRI* CAPACITY RATINGS

OUTDOOR SECTION	INDOOR SECTION	STANDARD CFM		COOLING BTUH	SEER	HIGH HEAT	
		Outdoor	Indoor			BTUH	HSPF
PA13AAM09000	PW3CAM09000	1000	325	9,200	13	N/A	N/A
PA13AAM12000	PW3CAM12000	1000	425	11,400	13	N/A	N/A
PA13NAM18000	PW3CNM18000	1600	630	17,500	13	N/A	N/A
PA13NAM24000	PW3CNM24000	1600	750	22,000	13	N/A	N/A
PH13AAM09000	PW3HAM09000	1000	325	9,600	13	9,400	7.7
PH13AAM12000	PW3HAM09000	1000	425	11,500	13	11,500	7.7
PH13NAM18000	PW3HNM18000	1600	560	17,500	13	17,000	7.7
PH13NAM24000	PW3HNM24000	1600	750	22,500	13	21,500	7.7

*Air Conditioning, Heating & Refrigeration Institute

Legend


HSPF – Heating Seasonal Performance Factor

SEER – Seasonal Energy Efficiency Ratio

NOTES:

- Ratings are net values reflecting the effects of circulating fan heat. Ratings are based on: Cooling Standard: 80°F (26.67°C) db, 67°F (19.44°C) wb air entering indoor unit and 95°F (35°C) db air entering outdoor unit. High Temperature Heating Standard: 70°F (21.11°C) db air entering indoor unit and 47°F (8.33°C) db, 43°F (6.11°C) wb air entering outdoor unit.
- Ratings are based on 25 ft. (7.62 m) of interconnecting refrigerant lines.
- All system ratings are based on fan coil units operating at high fan speed. Consult Physical Data tables for airflows at all available fan speeds.


DIMENSIONS - INDOOR

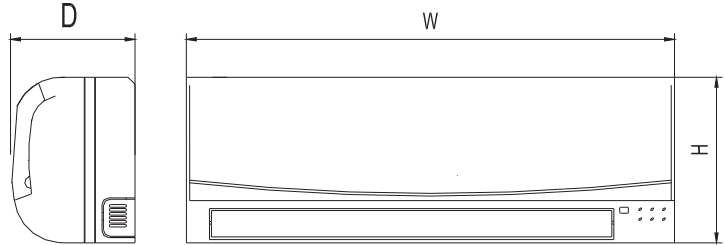

A07336

Model Size	W in. (mm)	H in. (mm)	D in. (mm)	Operating Weight lb (kg)
9K	32.09 (815)	11.02 (280)	7.68 (195)	17.6 (8)
12K	35.67 (906)	11.26 (286)	9.25 (235)	25.3 (11.5)
18K	49.21 (1250)	12.80 (325)	9.06 (230)	39.6 (18)
24K	49.21 (1250)	12.80 (325)	9.06 (230)	39.6 (18)


DIMENSIONS - OUTDOOR

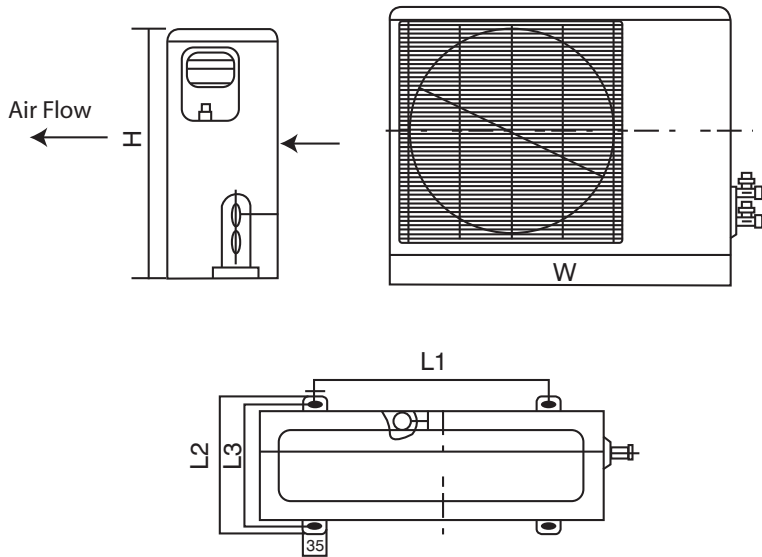

A07337

Model Size	W in. (mm)	H in. (mm)	L1 in. (mm)	L2 in. (mm)	L3 in. (mm)	Operating Weight lb (kg) Cooling Only	Operating Weight lb (kg) Heat Pumps
9K	30.71 (780)	21.26 (540)	21.61 (549)	11.81 (300)	10.87 (276)	70.4 (32)	72.6 (33)
12K	29.92 (760)	23.23 (590)	20.87 (530)	12.40 (315)	11.42 (290)	79.2 (36)	83.6 (38)
18K	33.07 (840)	27.36 (695)	22.05 (560)	14.17 (360)	13.19 (335)	116.6 (53)	117.7 (53.5)
24K	35.00 (889)	33.50 (851)	23.11 (588)	13.98 (355)	13.11 (333)	149.6 (68)	151 (68.5)

SERVICE VALVE LOCATIONS

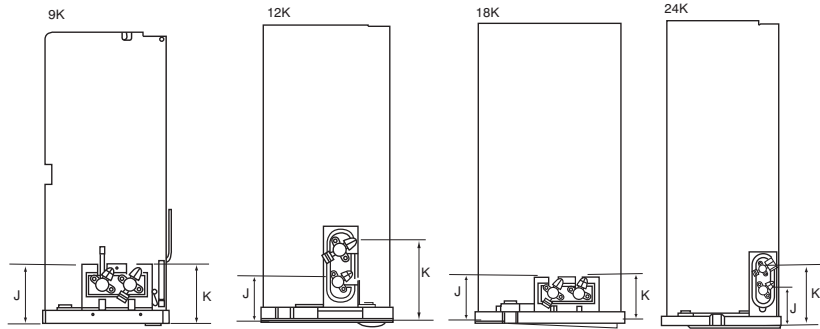

A07376a

Service Valve Locations	9K in. (mm)	12K in. (mm)	18K in. (mm)	24K in. (mm)
J	3.46 (88)	3.19 (81)	3.46 (88)	4.02 (102)
K	3.46 (88)	5.63 (143)	3.62 (92)	6.57 (167)

PA(H)13A(N)AM / PW3C(H)A(N)M

CLEARANCES - INDOOR


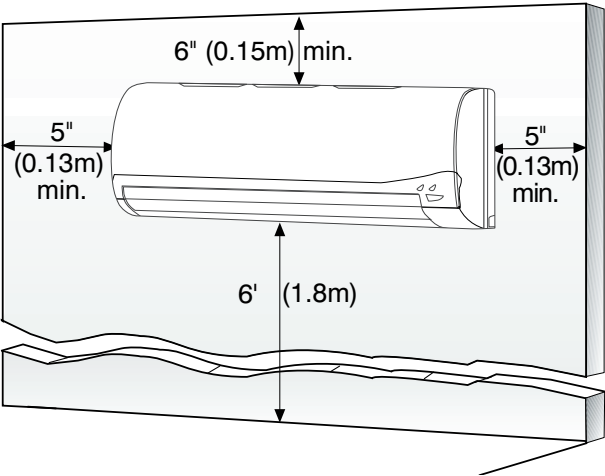


Fig. 2 – Indoor unit clearance

A07891

CLEARANCES - OUTDOOR

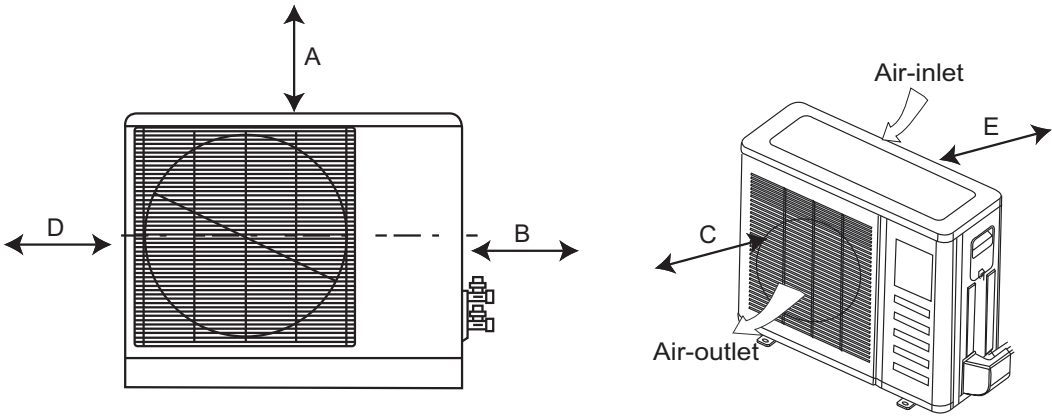

A07894

UNIT	9k and 12k in. (mm)	18k and 24k in. (mm)
A	24 (610)	24 (610)
B	24 (610)	36 (914)
C	24 (610)	24 (610)
D	6 (152)	6 (152)
E	12 (305)	12 (305)

Fig. 3 – Outdoor Unit Clearance

PHYSICAL DATA

Outdoor Unit PA13A(N)AM	009	012	018	024
System Voltage	115 V	115 V	208/230	208/230
Nominal Capacity (Btuh)	9000	12000	18000	24000
Operating Weight lb (kg)	70.4 (32)	79.2 (36)	116.6 (53)	149.6 (68)
Refrigerant Type	R-410A			
Metering Device	Capillary Tube at Outdoor			
Charge lb (kg)	2.3 (1.0)	2.9 (1.3)	4.4 (2.0)	5.3 (2.4)
Compressor	Rotary			
Type	Rotary			
Model	EA82X1C-1FZDU1	EA108X1C-1FZDU1	PA150X2CS-3KUU	PA200X2CS-3MUU
Oil Charge (POE -oz)	11.8	11.8	25.4	25.4
Outdoor Fan				
Rpm	900	900	840	740
Diameter (in) .. No. of Blades	15.8 ... 3	15.8 ... 3	18.1 ... 3	18.1 ... 3
Motor (watts / hp)	23 / 0.102	23 / 0.102	53 / 0.224	100 / 0.218
Outdoor Coil				
Face Area (sq. ft)	4.05	3.94	5.51	6.67
No. Rows	2	2	4	3
Fins per inch	17	17	18	18
Circuits	4	4	4	6
Refrigerant Lines	Flare			
Connection Type	Flare			
Liquid (Mix Phase) (in) OD	1/4"	1/4"	1/4"	3/8"
Vapor Line (in) OD	3/8"	1/2"	1/2"	5/8"
Maximum Length* ft (m)	65 (20.0)	65 (20.0)	100 (30.4)	100 (30.4)
Max Lift (Fan Coil Above) ft (m)	35 (10.7)	35 (10.7)	50 (12.2)	60 (18.3)
Max Drop (Fan Coil Below)ft (m)	35 (10.7)	35 (10.7)	50 (12.2)	60 (18.3)
Controls				
Control Voltage	13 VDC	13 VDC	Pulse DC	Pulse DC
External Finish	White	White	White	White

Outdoor Unit PH13A(N)AM	009	012	018	024
System Voltage	115 V	115 V	208/230	208/230
Nominal Capacity (Btuh)	9000	12000	18000	24000
Operating Weight lb(kg)	72.6 (33)	83.6 (38)	117.7 (53.5)	151.0 (68.5)
Refrigerant Type	R-410A			
Metering Device	Capillary Tube at Outdoor			
Charge lb (kg)	2.4 (1.1)	3.0 (1.4)	4.5 (2.0)	5.3 (2.4)
Compressor	Rotary			
Type	Rotary			
Model	EA82X1C-1FZDU1	EA108X1C-1FZDU1	PA150X2CS-3KUU	PA200X2CS-3MUU
Oil Charge (POE -oz)	11.8	11.8	25.4	25.4
Outdoor Fan				
Rpm	900	900	840	740
Diameter (in) .. No. of Blades	15.8 ... 3	15.8 ... 3	18.1 ... 3	18.1 ... 3
Motor (watts / hp)	23 / 0.102	23 / 0.102	53 / 0.224	100 / 0.218
Outdoor Coil				
Face Area (sq. ft)	4.05	3.94	5.51	6.67
No. Rows	2	2	2	3
Fins per inch	17	18	18	18
Circuits	4	4	4	6
Refrigerant Lines	Flare			
Connection Type	Flare			
Liquid Line (in) OD	1/4"	1/4"	1/4"	3/8"
Vapor Line (in) OD	3/8"	1/2"	1/2"	5/8"
Maximum Length* ft (m)	65 (20.0)	65 (20.0)	100 (30.4)	100 (30.4)
Max Lift (Fan Coil Above) ft (m)	35 (10.7)	35 (10.7)	50 (12.2)	60 (18.3)
Max Drop (Fan Coil Below)ft (m)	35 (10.7)	35 (10.7)	50 (12.2)	60 (18.3)
Controls				
Control Voltage	13 VDC	13 VDC	Pulse DC	Pulse DC
Finish	White	White	White	White

* Refer to Long Line Application section on page 21

PA(H)13A(N)AM / PW3C(H)A(N)M

PHYSICAL DATA (CONT.)

Indoor Unit PW3CA(N)M	009	012	018	024
System Voltage	115	115	208/230	208/230
Nominal Capacity (Btuh)	9000	12000	18000	24,000
Operating Weight lb(kg)	17.6(8)	25.3(11.5)	39.6(18)	39.6(18)
Refrigerant Type	R-410A			
Metering Device	Capillary Tube at Outdoor			
Charge (lb)	2.3(1.0)	2.9(1.3)	4.4(2.0)	5.3(2.4)
Indoor Fan				
Rpm/Cfm (High)	1250/325	1270/425	1070/630	1070/750
Rpm/Cfm (Medium)	1000/260	1100/365	1000/570	1000/660
Rpm/Cfm (Low)	800/190	1000/340	960/500	960/585
Motor (Watts / hp)	20 / .034	25 / .044	31 / .075	50 / .112
Blower Diameter ... Length (in)	3.84 ... 25.87	4.17 ... 25.2	4.21 ... 37.6	4.21 ... 37.6
Indoor Coil				
Face Area (sq. ft)	2.15	2.54	4.36	4.36
No. Rows	2	2	2	2
Fins per inch	19.5	19.5	19.5	19.5
Circuits	2	3	6	6
Controls	Integrated Microprocessor			
Remote Controller	Wireless			
Fan Mode	High/Medium/Low/Auto			
Dehumidification Mode	Yes			
Sleep Mode	Yes			
Diagnostics	Yes			
Timer Mode	Yes			
Freeze Protection	Yes			
Test Mode	Yes			
Auto Restart	Yes			
Auto Sweep	Yes			
Control Voltage	13 VDC	13 VDC	Pulse DC	Pulse DC
Refrigerant Lines				
Connection Type	Flare			
Liquid Line (in) OD	1/4"	1/4"	1/4"	3/8"
Vapor Line (in) OD	3/8"	1/2"	1/2"	5/8"
Maximum Length* ft (m)	65 (19.8)	65 (19.8)	100 (30.5)	100 (30.5)
Max Lift (Fan Coil Above) ft (m)	35 (10.7)	35 (10.7)	50 (15.2)	60 (18.3)
Max Drop (Fan Coil Below) ft (m)	35 (10.7)	35 (10.7)	50 (15.2)	60 (18.3)
Condensate Drain				
Size (in)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)
External Finish	White	White	White	White

* Refer to Long Line Application section on page 21

PHYSICAL DATA (CONT.)

Indoor Unit PW3HA(N)M	009	012	018	024
System Voltage	115	115	208/230	208/230
Nominal Capacity (Btuh)	9000	12000	18000	24000
Operating Weight lb (kg)	17.6 (8)	25.3 (11.5)	39.6 (18)	39.6 (18)
Refrigerant Type	R-410A			
Metering Device	Capillary Tube at Outdoor			
Charge lb (kg)	2.35 (1.1)	3.0 (1.4)	4.5 (2.0)	5.3 (2.4)
Indoor Fan				
Rpm/Cfm (High)	1250/325	1270/425	1070/630	1070/750
Rpm/Cfm (Medium)	1000/260	1100/365	1000/570	1000/660
Rpm/Cfm (Low)	800/190	1000/340	960/500	960/585
Motor (Watts / hp)	20 / .034	25 / .044	31 / .075	50 / .112
Blower Diameter ... Length (in)	3.84 ... 25.87	4.17 ... 25.2	4.21 ... 37.6	4.21 ... 37.6
Indoor Coil				
Face Area (sq. ft)	2.15	2.54	4.36	4.36
No. Rows	2	2	2	2
Fins per inch	19.5	19.5	19.5	19.5
Circuits	2	3	6	6
Controls	Integrated Microprocessor			
Remote Controller	Wireless			
Fan Mode	High/Medium/Low/Auto			
Auto Changeover	Yes			
Dehumidification Mode	Yes			
Demand Defrost	Yes			
Sleep Mode	Yes			
Diagnostics	Yes			
Timer Mode	Yes			
Freeze Protection	Yes			
Test Mode	Yes			
Auto Restart	Yes			
Auto Sweep	Yes			
Control Voltage	13 VDC	13 VDC	Pulse DC	Pulse DC
Refrigerant Lines				
Connection Type	Flare			
Liquid Line (in) OD	1/4"	1/4"	1/4"	3/8"
Vapor Line (in) OD	3/8"	1/2"	1/2"	5/8"
Maximum Length* ft (m)	65 (19.8)	65 (19.8)	100 (30.5)	100 (30.5)
Max Lift (Fan Coil Above) ft (m)	35 (10.7)	35 (10.7)	50 (15.2)	60 (18.3)
Max Drop (Fan Coil Below) ft (m)	35 (10.7)	35 (10.7)	50 (15.2)	60 (18.3)
Condensate Drain				
Size (in)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)	.65 (OD) .53 (ID)
External Finish	White	White	White	White

* Refer to Long Line Application section on page 21

PERFORMANCE DATA

COOLING CAPACITIES PA(H)13AAM09000 / PW3C(H)AM09000

Temp °F (°C) Air Entering Condenser (Edb)		Air Entering Evaporator – Cfm/BF											
		190/0.04				259/0.04				327/0.05			
		Air Entering Evaporator – Ewb °F (°C)											
		57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)
55 (12.78)	TCG	7.70	8.60	9.37	10.14	9.08	9.34	10.07	10.66	9.75	9.74	10.44	10.93
	SHG	7.44	6.61	5.80	4.95	9.08	7.59	6.45	5.29	9.75	8.30	6.95	5.50
	TC	7.69	8.58	9.36	10.12	9.07	9.32	10.06	10.65	9.74	9.72	10.42	10.92
	kW	0.48	0.48	0.48	0.47	0.48	0.48	0.47	0.47	0.48	0.48	0.47	0.47
	CMP	0.39	0.39	0.39	0.38	0.39	0.39	0.38	0.38	0.39	0.39	0.38	0.38
	LDB	45.0	48.9	52.8	56.9	48.4	53.5	57.6	61.7	52.9	56.9	60.7	64.8
65 (18.33)	LWB	40.9	45.6	50.8	56.2	43.3	49.2	54.5	60.2	45.4	51.6	56.9	62.6
	TCG	7.40	8.31	9.14	9.95	8.88	9.08	9.87	10.51	9.53	9.50	10.27	10.81
	SHG	7.40	6.57	5.71	4.88	8.88	7.55	6.41	5.25	9.53	8.34	6.98	5.51
	TC	7.38	8.29	9.13	9.93	8.86	9.07	9.85	10.50	9.52	9.48	10.26	10.80
	kW	0.54	0.55	0.55	0.54	0.55	0.55	0.54	0.54	0.55	0.55	0.54	0.54
	CMP	0.45	0.45	0.46	0.45	0.46	0.46	0.45	0.45	0.45	0.45	0.45	0.45
75 (23.89)	LDB	45.1	49.1	53.2	57.2	49.1	53.6	57.7	61.9	53.5	56.7	60.6	64.8
	LWB	41.6	46.2	51.2	56.5	43.6	49.6	54.8	60.3	45.7	51.9	57.1	62.7
	TCG	7.50	7.94	8.88	9.73	8.56	8.72	9.57	10.33	9.28	9.12	10.00	10.61
	SHG	7.50	6.52	5.62	4.80	8.56	7.49	6.33	5.21	9.28	8.24	6.93	5.50
	TC	7.49	7.93	8.87	9.71	8.54	8.70	9.55	10.31	9.26	9.10	9.98	10.60
	kW	0.61	0.61	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62
85 (29.44)	CMP	0.52	0.52	0.53	0.52	0.52	0.53	0.53	0.52	0.53	0.53	0.52	0.52
	LDB	44.7	49.2	53.6	57.6	50.1	53.8	57.9	62.0	54.2	57.0	60.7	64.8
	LWB	41.4	47.0	51.7	56.9	44.1	50.1	55.2	60.6	46.0	52.3	57.4	62.8
	TCG	7.20	7.55	8.50	9.42	8.20	8.09	9.25	10.04	8.99	8.72	9.62	10.34
	SHG	7.20	6.49	5.52	4.67	8.20	7.34	6.28	5.12	8.99	8.23	6.86	5.44
	TC	7.18	7.53	8.48	9.41	8.19	8.07	9.23	10.03	8.97	8.71	9.61	10.33
95 (35)	kW	0.68	0.69	0.69	0.70	0.69	0.69	0.70	0.70	0.70	0.70	0.70	0.70
	CMP	0.59	0.59	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60
	LDB	46.0	49.3	54.0	58.2	51.3	54.3	58.1	62.3	54.9	57.0	60.9	65.0
	LWB	42.1	47.8	52.5	57.5	44.7	51.1	55.6	60.9	46.4	52.7	57.8	63.1
	TCG	6.86	7.02	8.06	9.06	7.82	7.63	8.86	9.66	8.57	8.22	9.22	9.98
	SHG	6.86	6.37	5.42	4.53	7.82	7.28	6.20	5.00	8.57	8.22	6.83	5.35
105 (40.56)	TC	6.85	7.00	8.05	9.05	7.80	7.61	8.85	9.64	8.55	8.20	9.21	9.97
	kW	0.76	0.76	0.77	0.78	0.77	0.77	0.78	0.78	0.78	0.78	0.78	0.78
	CMP	0.66	0.67	0.68	0.69	0.67	0.67	0.68	0.69	0.68	0.68	0.69	0.69
	LDB	47.5	49.8	54.4	58.8	52.6	54.4	58.3	62.7	56.0	57.0	60.9	65.2
	LWB	42.8	48.9	53.3	58.1	45.3	51.7	56.2	61.4	46.9	53.3	58.2	63.4
	TCG	6.40	6.54	7.59	8.70	7.39	7.09	8.26	9.20	8.10	8.10	8.73	9.56
115 (46.11)	SHG	6.40	6.19	5.28	4.40	7.39	7.09	6.11	4.86	8.10	8.10	6.74	5.26
	TC	6.39	6.53	7.58	8.69	7.38	7.07	8.25	9.19	8.08	8.09	8.72	9.54
	kW	0.84	0.85	0.86	0.87	0.86	0.85	0.87	0.87	0.86	0.86	0.87	0.87
	CMP	0.75	0.75	0.76	0.77	0.76	0.76	0.77	0.77	0.77	0.77	0.77	0.78
	LDB	49.6	50.6	55.0	59.4	54.0	55.0	58.6	63.1	57.3	57.3	61.2	65.4
	LWB	43.9	49.9	54.2	58.7	46.0	52.5	57.0	61.9	47.5	53.4	58.7	63.8
125 (51.67)	TCG	5.87	5.81	7.03	8.09	6.91	6.91	7.64	8.67	7.59	7.59	8.01	8.99
	SHG	5.87	5.79	5.08	4.18	6.91	6.91	5.97	4.70	7.59	7.59	6.61	5.10
	TC	5.85	5.80	7.01	8.08	6.89	6.90	7.63	8.65	7.57	7.57	7.99	8.97
	kW	0.93	0.93	0.95	0.96	0.95	0.95	0.96	0.97	0.96	0.96	0.96	0.97
	CMP	0.83	0.83	0.85	0.86	0.85	0.85	0.86	0.87	0.86	0.86	0.86	0.87
	LDB	52.0	52.4	55.9	60.3	55.6	55.6	59.0	63.6	58.7	58.7	61.5	65.8
125 (51.67)	LWB	45.0	51.3	55.2	59.7	46.7	52.8	57.8	62.5	48.1	54.0	59.4	64.3
	TCG	5.33	5.33	6.22	7.44	6.37	6.37	6.80	8.09	7.03	7.03	7.00	8.35
	SHG	5.33	5.33	4.75	3.96	6.37	6.37	5.71	4.54	7.03	7.03	6.31	4.96
	TC	5.31	5.31	6.21	7.42	6.35	6.35	6.78	8.07	7.02	7.02	6.99	8.33
	kW	1.03	1.03	1.04	1.06	1.04	1.04	1.05	1.07	1.05	1.05	1.05	1.07
	CMP	0.93	0.93	0.94	0.96	0.94	0.94	0.95	0.97	0.95	0.95	0.95	0.97
125 (51.67)	LDB	54.4	54.5	57.3	61.3	57.5	57.5	59.8	64.1	60.2	60.2	62.2	66.2
	LWB	46.2	52.3	56.7	60.8	47.6	53.5	58.8	63.2	48.8	54.6	60.4	64.9

LEGEND

BF – Bypass Factor
 CMP – Compressor
 Edb – Entering Dry Bulb
 Ewb – Entering Wet Bulb
 kW – Total Power
 LDB – Leaving Dry Bulb
 LWB – Leaving Wet Bulb
 SHG – Gross Sensible Capacity (1000 Btu/hour)
 TC – Total Net Cooling Capacity (1000 Btu/hour)
 TCG – Gross Cooling Capacity (1000 Btu/hour)

NOTES:

- Direct interpolation is permissible. Do not extrapolate.
- The SHG is based on 80°F (26.67°C) edb temperature of air entering indoor coil.
Below 80°F (26.67°C) edb, subtract (corr factor x cfm) from SHG.
Above 80°F (26.67°C) edb, add (corr factor x cfm) to SHG.
Correction Factor = $1.10 \times (1 - BF) \times (edb - 80)$.

PERFORMANCE DATA (CONT.)

COOLING CAPACITIES PA(H)13AAM12000 / PW3C(H)AM12000

Temp °F (°C) Air Entering Condenser (Edb)		Air Entering Evaporator – Cfm/BF											
		339/0.04				367/0.04				427/0.05			
		Air Entering Evaporator – Ewb °F (°C)											
		57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)
55 (12.78)	TCG	11.97	12.10	12.93	13.50	12.26	12.28	13.10	13.60	12.71	12.61	13.33	13.76
	SHG	11.97	9.93	8.34	6.68	12.26	10.27	8.58	6.77	12.71	10.96	8.95	6.97
	TC	11.94	12.07	12.90	13.47	12.23	12.25	13.07	13.57	12.68	12.58	13.30	13.74
	kW	0.63	0.63	0.62	0.62	0.63	0.63	0.62	0.62	0.62	0.62	0.62	0.62
	CMP	0.53	0.53	0.53	0.53	0.53	0.53	0.53	0.53	0.53	0.53	0.53	0.53
	LDB	48.2	53.5	57.8	62.4	49.8	54.6	58.9	63.5	53.0	56.6	61.0	65.3
65 (18.33)	LWB	43.2	49.4	54.8	60.6	44.0	50.2	55.7	61.4	45.5	51.7	57.2	62.9
	TCG	11.64	11.71	12.64	13.30	11.94	11.91	12.79	13.37	12.44	12.25	13.07	13.52
	SHG	11.64	9.78	8.27	6.66	11.94	10.15	8.49	6.73	12.44	10.95	9.02	6.90
	TC	11.61	11.68	12.61	13.27	11.91	11.88	12.76	13.34	12.41	12.22	13.04	13.49
	kW	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72	0.72
	CMP	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62	0.62
75 (23.89)	LDB	49.0	53.9	58.0	62.4	50.6	54.9	59.1	63.5	53.5	56.6	60.8	65.4
	LWB	43.6	49.8	55.1	60.8	44.3	50.6	55.9	61.6	45.7	52.1	57.4	63.1
	TCG	11.28	11.27	12.27	13.00	11.56	11.45	12.43	13.12	12.07	11.48	12.70	13.25
	SHG	11.28	9.63	8.15	6.61	11.56	9.92	8.47	6.75	12.07	10.16	8.94	6.89
	TC	11.25	11.24	12.24	12.97	11.53	11.43	12.40	13.09	12.04	11.46	12.67	13.23
	kW	0.81	0.81	0.82	0.82	0.81	0.81	0.82	0.82	0.82	0.82	0.82	0.82
85 (29.44)	CMP	0.71	0.71	0.71	0.72	0.71	0.71	0.71	0.72	0.71	0.71	0.71	0.72
	LDB	49.9	54.3	58.3	62.5	51.5	55.5	59.1	63.5	54.3	58.3	60.9	65.4
	LWB	44.0	50.3	55.5	61.1	44.8	51.2	56.3	61.9	46.1	52.7	57.7	63.3
	TCG	10.79	10.76	11.78	12.63	11.12	10.68	11.96	12.76	11.63	11.29	12.24	12.93
	SHG	10.79	9.24	7.98	6.49	11.12	9.50	8.25	6.64	11.63	10.62	8.81	6.89
	TC	10.76	10.73	11.76	12.60	11.09	10.65	11.93	12.73	11.60	11.27	12.21	12.91
95 (35)	kW	0.91	0.91	0.92	0.92	0.92	0.91	0.92	0.93	0.92	0.92	0.92	0.93
	CMP	0.81	0.81	0.82	0.82	0.81	0.81	0.82	0.82	0.82	0.82	0.82	0.82
	LDB	51.2	55.3	58.7	62.8	52.5	56.4	59.6	63.7	55.2	57.3	61.2	65.4
	LWB	44.6	51.5	56.0	61.4	45.3	52.0	56.7	62.2	46.5	52.8	58.0	63.5
	TCG	10.17	9.76	11.21	12.15	10.55	10.05	11.37	12.27	11.12	11.12	11.66	12.49
	SHG	10.17	9.14	7.81	6.32	10.55	9.50	8.08	6.47	11.12	11.12	8.64	6.79
105 (40.56)	TC	10.14	9.73	11.18	12.12	10.53	10.02	11.34	12.24	11.09	11.09	11.63	12.46
	kW	1.02	1.01	1.03	1.04	1.02	1.02	1.03	1.04	1.03	1.03	1.03	1.04
	CMP	0.91	0.91	0.92	0.93	0.92	0.91	0.92	0.93	0.92	0.92	0.93	0.93
	LDB	52.7	55.4	59.1	63.2	53.8	56.4	60.0	64.1	56.2	56.2	61.5	65.6
	LWB	45.4	52.0	56.6	61.8	45.9	52.5	57.3	62.6	47.0	53.0	58.5	63.8
	TCG	9.51	8.95	10.54	11.55	9.87	9.86	10.70	11.68	10.54	10.55	10.96	11.88
115 (46.11)	SHG	9.51	8.73	7.59	6.12	9.87	9.86	7.88	6.28	10.54	10.55	8.44	6.60
	TC	9.48	8.92	10.51	11.52	9.84	9.84	10.68	11.65	10.52	10.52	10.93	11.85
	kW	1.13	1.12	1.14	1.15	1.13	1.13	1.14	1.15	1.14	1.14	1.15	1.16
	CMP	1.02	1.01	1.04	1.05	1.03	1.03	1.04	1.05	1.04	1.04	1.04	1.05
	LDB	54.4	56.5	59.7	63.7	55.5	55.5	60.4	64.6	57.4	57.4	61.9	66.0
	LWB	46.2	52.9	57.2	62.4	46.7	52.7	57.9	63.1	47.5	53.5	59.0	64.2
125 (51.67)	TCG	8.82	8.82	9.56	10.82	9.16	9.16	9.82	10.96	9.81	9.81	10.17	11.16
	SHG	8.82	8.82	7.29	5.87	9.16	9.16	7.61	6.04	9.81	9.81	8.21	6.37
	TC	8.79	8.79	9.53	10.79	9.13	9.13	9.80	10.93	9.78	9.78	10.14	11.13
	kW	1.25	1.25	1.26	1.28	1.25	1.25	1.26	1.28	1.26	1.26	1.27	1.28
	CMP	1.14	1.14	1.15	1.17	1.14	1.14	1.15	1.17	1.15	1.15	1.16	1.17
	LDB	56.2	56.2	60.4	64.4	57.2	57.1	61.0	65.1	58.9	58.9	62.4	66.4
125 (51.67)	LWB	47.0	53.0	58.2	63.0	47.4	53.4	58.7	63.6	48.2	54.1	59.6	64.7
	TCG	8.11	8.14	8.49	9.97	8.42	8.41	8.65	10.10	9.01	9.01	8.81	10.30
	SHG	8.11	8.14	6.97	5.59	8.42	8.41	7.18	5.77	9.01	9.01	7.63	6.11
	TC	8.08	8.11	8.46	9.94	8.39	8.38	8.63	10.07	8.99	8.98	8.78	10.27
	kW	1.37	1.37	1.37	1.40	1.37	1.37	1.38	1.40	1.39	1.39	1.38	1.41
	CMP	1.26	1.26	1.26	1.29	1.26	1.26	1.27	1.29	1.27	1.27	1.27	1.29
125 (51.67)	LDB	58.1	58.0	61.2	65.1	58.9	58.9	62.1	65.7	60.5	60.6	63.5	66.9
	LWB	47.9	53.7	59.2	63.8	48.2	54.1	59.7	64.3	49.0	54.8	60.7	65.3

LEGEND

BF – Bypass Factor
 CMP – Compressor
 Edb – Entering Dry Bulb
 Ewb – Entering Wet Bulb
 kW – Total Power
 LDB – Leaving Dry Bulb
 LWB – Leaving Wet Bulb
 SHG – Gross Sensible Capacity (1000 Btu/hour)
 TC – Total Net Cooling Capacity (1000 Btu/hour)
 TCG – Gross Cooling Capacity (1000 Btu/hour)

NOTES:

- Direct interpolation is permissible. Do not extrapolate.
- The SHG is based on 80°F (26.67°C) edb temperature of air entering indoor coil.
 Below 80°F (26.67°C) edb, subtract (corr factor x cfm) from SHG.
 Above 80°F (26.67°C) edb, add (corr factor x cfm) to SHG.
 Correction Factor = $1.10 \times (1 - BF) \times (edb - 80)$.

PA(H)13A(N)AM / PW3C(H)A(N)M

PERFORMANCE DATA (CONT.)

COOLING CAPACITIES PA(H)13NAM18000 / PW3C(H)NM18000

Temp °F (°C) Air Entering Condenser (Edb)		Air Entering Evaporator – Cfm/BF											
		502/0.04				568/0.04				631/0.05			
		Air Entering Evaporator – Ewb (°F)											
		57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)	57 (13.89)	62 (16.67)	67 (19.44)	72 (22.22)
55 (12.78)	TCG	17.50	18.57	19.75	20.70	18.16	19.02	20.07	21.03	18.68	19.33	20.33	21.34
	SHG	17.50	15.22	12.67	10.45	18.16	16.04	13.10	10.71	18.68	16.68	13.46	10.89
	TC	17.33	18.40	19.58	20.53	17.98	18.85	19.90	20.85	18.50	19.15	20.15	21.17
	kW	0.90	0.90	0.89	0.89	0.90	0.89	0.89	0.89	0.90	0.89	0.89	0.89
	CMP	0.75	0.75	0.74	0.74	0.75	0.75	0.74	0.74	0.75	0.74	0.74	0.74
	LDB	48.6	52.6	57.2	61.3	51.0	54.4	59.1	63.0	53.1	55.9	60.6	64.4
65 (18.33)	LWB	43.5	49.0	54.5	60.2	44.7	50.3	55.9	61.5	45.6	51.4	56.9	62.5
	TCG	17.18	18.13	19.38	20.38	17.81	18.54	19.70	20.67	18.33	18.84	19.99	20.93
	SHG	17.18	15.30	12.64	10.32	17.81	16.19	13.11	10.59	18.33	16.99	13.78	10.80
	TC	17.01	17.95	19.21	20.21	17.63	18.37	19.53	20.50	18.16	18.66	19.82	20.75
	kW	1.03	1.03	1.02	1.02	1.03	1.03	1.02	1.02	1.03	1.02	1.02	1.02
	CMP	0.88	0.88	0.87	0.87	0.88	0.88	0.87	0.87	0.88	0.87	0.87	0.87
75 (23.89)	LDB	49.1	52.5	57.3	61.6	51.6	54.1	59.1	63.2	53.5	55.5	60.1	64.5
	LWB	43.8	49.3	54.7	60.4	44.9	50.6	56.1	61.7	45.9	51.7	57.1	62.7
	TCG	16.66	17.56	18.85	19.97	17.39	17.91	19.22	20.23	17.89	18.25	19.48	20.46
	SHG	16.66	15.36	12.54	10.15	17.39	16.30	13.20	10.45	17.89	17.20	13.59	10.68
	TC	16.48	17.39	18.68	19.79	17.21	17.74	19.04	20.06	17.71	18.08	19.31	20.28
	kW	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16
85 (29.44)	CMP	1.01	1.01	1.01	1.01	1.02	1.01	1.01	1.01	1.01	1.01	1.01	1.01
	LDB	50.0	52.3	57.4	61.9	52.2	53.9	58.9	63.4	54.1	55.1	60.4	64.7
	LWB	44.2	49.8	55.1	60.7	45.2	51.1	56.4	62.0	46.1	52.0	57.4	62.9
	TCG	16.06	16.69	18.22	19.41	16.78	17.24	18.54	19.69	17.37	17.56	18.82	19.90
	SHG	16.06	15.39	12.45	10.01	16.78	16.41	13.04	10.34	17.37	16.93	13.61	10.59
	TC	15.89	16.52	18.05	19.24	16.60	17.06	18.37	19.51	17.19	17.39	18.64	19.72
95 (35)	kW	1.30	1.30	1.31	1.31	1.30	1.31	1.31	1.31	1.31	1.31	1.31	1.32
	CMP	1.15	1.15	1.16	1.16	1.16	1.16	1.16	1.17	1.16	1.16	1.16	1.17
	LDB	51.0	52.2	57.6	62.1	53.1	53.7	59.1	63.6	54.9	55.5	60.3	64.8
	LWB	44.7	50.4	55.6	61.0	45.7	51.5	56.8	62.3	46.5	52.4	57.7	63.2
	TCG	15.33	15.64	17.37	18.64	15.99	16.15	17.74	18.97	16.60	16.51	18.00	19.18
	SHG	15.33	15.05	12.28	9.75	15.99	15.76	12.96	10.13	16.60	16.51	13.54	10.43
105 (40.56)	TC	15.16	15.47	17.20	18.46	15.81	15.98	17.57	18.80	16.43	16.34	17.83	19.00
	kW	1.45	1.45	1.47	1.47	1.45	1.46	1.47	1.47	1.46	1.46	1.47	1.47
	CMP	1.30	1.30	1.32	1.32	1.31	1.31	1.32	1.32	1.31	1.31	1.32	1.33
	LDB	52.2	52.8	57.8	62.5	54.3	54.7	59.2	63.9	55.9	56.1	60.4	65.0
	LWB	45.3	51.2	56.1	61.5	46.2	52.2	57.3	62.7	47.0	53.0	58.2	63.5
	TCG	14.49	14.46	16.37	17.74	15.13	15.14	16.71	18.04	15.67	15.69	16.97	18.28
115 (46.11)	SHG	14.49	14.46	12.11	9.47	15.13	15.14	12.81	9.86	15.67	15.69	13.44	10.21
	TC	14.32	14.29	16.19	17.57	14.96	14.96	16.54	17.87	15.49	15.52	16.80	18.10
	kW	1.61	1.61	1.63	1.64	1.61	1.61	1.63	1.64	1.62	1.62	1.63	1.64
	CMP	1.46	1.46	1.48	1.49	1.46	1.46	1.48	1.49	1.47	1.47	1.48	1.49
	LDB	53.7	53.8	58.1	63.0	55.6	55.6	59.4	64.3	57.2	57.2	60.5	65.3
	LWB	46.0	52.1	56.8	62.1	46.9	52.9	57.9	63.1	47.6	53.5	58.7	64.0
125 (51.67)	TCG	13.45	13.45	14.96	16.66	14.13	14.13	15.41	16.94	14.65	14.66	15.73	17.15
	SHG	13.45	13.45	11.82	9.20	14.13	14.13	12.59	9.61	14.65	14.66	13.25	9.98
	TC	13.27	13.27	14.79	16.48	13.95	13.96	15.24	16.77	14.48	14.48	15.56	16.97
	kW	1.77	1.77	1.79	1.81	1.78	1.78	1.80	1.81	1.79	1.79	1.80	1.82
	CMP	1.62	1.62	1.64	1.66	1.63	1.63	1.65	1.67	1.64	1.64	1.65	1.67
	LDB	55.5	55.5	58.5	63.4	57.2	57.2	59.7	64.6	58.6	58.6	60.7	65.6
125 (51.67)	LWB	46.8	52.8	57.8	62.7	47.6	53.5	58.6	63.7	48.2	54.1	59.3	64.5
	TCG	12.22	12.22	13.26	15.35	12.92	12.93	13.66	15.60	13.46	13.48	14.02	15.79
	SHG	12.22	12.22	11.26	8.82	12.92	12.93	12.20	9.26	13.46	13.48	12.95	9.66
	TC	12.05	12.05	13.09	15.17	12.74	12.76	13.48	15.43	13.29	13.30	13.84	15.62
	kW	1.95	1.95	1.96	1.99	1.96	1.96	1.97	1.99	1.97	1.96	1.97	1.99
	CMP	1.80	1.80	1.81	1.84	1.81	1.81	1.82	1.84	1.82	1.82	1.82	1.85
125 (51.67)	LDB	57.6	57.7	59.5	64.1	59.1	59.0	60.3	65.1	60.3	60.3	61.1	66.0
	LWB	47.8	53.7	58.9	63.5	48.4	54.3	59.6	64.4	49.0	54.8	60.2	65.1

LEGEND

BF – Bypass Factor
 CMP – Compressor
 Edb – Entering Dry Bulb
 Ewb – Entering Wet Bulb
 kW – Total Power
 LDB – Leaving Dry Bulb
 LWB – Leaving Wet Bulb
 SHG – Gross Sensible Capacity (1000 Btu/hour)
 TC – Total Net Cooling Capacity (1000 Btu/hour)
 TCG – Gross Cooling Capacity (1000 Btu/hour)

NOTES:

- Direct interpolation is permissible. Do not extrapolate.
- The SHG is based on 80°F (26.67°C) edb temperature of air entering indoor coil.
Below 80°F (26.67°C) edb, subtract (corr factor x cfm) from SHG.
Above 80°F (26.67°C) edb, add (corr factor x cfm) to SHG.
Correction Factor = $1.10 \times (1 - BF) \times (edb - 80)$.

PERFORMANCE DATA (CONT.)

COOLING CAPACITIES PA(H)13NAM24000 / PW3C(H)NM24000

Temp °F (°C) Air Entering Condenser (Edb)		Air Entering Evaporator – Cfm/BF											
		584/0.04				657/0.04				759/0.05			
		Air Entering Evaporator – Ewb (°F)											
		57	62	67	72	57	62	67	72	57	62	67	72
55 (12.78)	TCG	21.41	23.09	24.52	25.73	22.21	23.60	24.95	26.13	23.21	24.19	25.43	26.63
	SHG	21.41	18.42	15.56	12.83	22.21	19.37	16.10	13.17	23.21	20.61	16.74	13.53
	TC	21.10	22.78	24.21	25.42	21.91	23.29	24.64	25.82	22.91	23.88	25.12	26.32
	kW	1.23	1.23	1.22	1.22	1.23	1.23	1.22	1.22	1.23	1.22	1.22	1.22
	CMP	1.00	1.00	1.00	1.00	1.00	1.00	1.00	0.99	1.00	1.00	0.99	0.99
	LDB	46.7	51.3	55.8	60.1	49.1	53.0	57.6	61.8	51.9	55.0	59.8	63.8
65 (18.33)	LWB	42.7	48.0	53.6	59.4	43.9	49.4	55.0	60.7	45.2	50.9	56.5	62.1
	TCG	20.89	22.42	23.92	25.12	21.77	22.95	24.38	25.61	22.68	23.50	24.86	26.02
	SHG	20.89	18.27	15.39	12.56	21.77	19.25	15.99	12.97	22.68	20.50	16.84	13.39
	TC	20.58	22.11	23.61	24.81	21.46	22.64	24.07	25.30	22.37	23.19	24.55	25.71
	kW	1.38	1.39	1.39	1.39	1.39	1.39	1.39	1.39	1.39	1.39	1.39	1.39
	CMP	1.15	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16	1.16
75 (23.89)	LDB	47.4	51.5	56.0	60.5	49.7	53.2	57.8	62.1	52.5	55.1	59.6	63.9
	LWB	43.1	48.4	53.9	59.7	44.2	49.8	55.3	60.9	45.5	51.2	56.7	62.4
	TCG	20.21	21.66	23.21	24.61	21.15	22.15	23.67	24.95	22.04	22.71	24.13	25.32
	SHG	20.21	18.13	15.13	12.37	21.15	19.10	15.83	12.75	22.04	20.44	16.61	13.19
	TC	19.90	21.35	22.90	24.30	20.84	21.85	23.36	24.64	21.74	22.40	23.82	25.01
	kW	1.55	1.56	1.56	1.57	1.56	1.56	1.57	1.57	1.56	1.56	1.57	1.57
85 (29.44)	CMP	1.32	1.33	1.34	1.34	1.33	1.33	1.34	1.34	1.33	1.33	1.34	1.34
	LDB	48.4	51.7	56.4	60.8	50.5	53.3	58.0	62.4	53.2	55.2	59.9	64.1
	LWB	43.6	49.0	54.4	60.0	44.6	50.2	55.6	61.3	45.9	51.6	57.1	62.7
	TCG	19.48	20.73	22.38	23.82	20.35	21.24	22.82	24.16	21.31	21.75	23.29	24.50
	SHG	19.48	17.94	14.91	12.08	20.35	18.95	15.60	12.47	21.31	20.59	16.45	12.90
	TC	19.17	20.42	22.07	23.51	20.04	20.94	22.51	23.85	21.00	21.44	22.98	24.20
95 (35)	kW	1.72	1.74	1.75	1.76	1.73	1.74	1.75	1.76	1.74	1.74	1.75	1.76
	CMP	1.49	1.51	1.52	1.53	1.50	1.51	1.52	1.53	1.51	1.52	1.53	1.53
	LDB	49.5	51.9	56.7	61.2	51.6	53.5	58.2	62.7	54.1	55.0	60.0	64.5
	LWB	44.1	49.6	54.9	60.4	45.1	50.8	56.1	61.6	46.3	52.1	57.4	63.0
	TCG	18.65	19.49	21.39	22.87	19.47	20.11	21.81	23.21	20.47	20.70	22.25	23.56
	SHG	18.65	17.94	14.65	11.76	19.47	19.09	15.32	12.14	20.47	19.99	16.23	12.61
105 (40.56)	TC	18.35	19.18	21.08	22.56	19.16	19.81	21.50	22.91	20.16	20.39	21.94	23.25
	kW	1.91	1.92	1.94	1.95	1.92	1.93	1.94	1.96	1.93	1.94	1.95	1.96
	CMP	1.68	1.69	1.71	1.73	1.69	1.70	1.72	1.73	1.70	1.71	1.72	1.73
	LDB	50.7	51.9	57.1	61.7	52.7	53.3	58.6	63.1	55.1	55.7	60.3	64.8
	LWB	44.7	50.4	55.5	60.9	45.6	51.4	56.6	62.1	46.7	52.6	57.9	63.4
	TCG	17.81	18.14	20.24	21.73	18.51	18.71	20.65	22.09	19.45	19.31	21.06	22.41
115 (46.11)	SHG	17.81	17.46	14.30	11.33	18.51	18.23	15.04	11.77	19.45	19.31	15.98	12.26
	TC	17.50	17.83	19.94	21.42	18.20	18.40	20.34	21.78	19.14	19.01	20.76	22.10
	kW	2.11	2.11	2.14	2.16	2.12	2.12	2.15	2.16	2.13	2.13	2.15	2.17
	CMP	1.88	1.88	1.91	1.93	1.89	1.89	1.92	1.94	1.91	1.90	1.92	1.94
	LDB	52.0	52.5	57.5	62.3	54.0	54.4	58.9	63.6	56.3	56.4	60.5	65.2
	LWB	45.3	51.3	56.1	61.5	46.2	52.2	57.2	62.6	47.3	53.3	58.4	63.8
125 (51.67)	TCG	16.73	16.67	18.93	20.40	17.42	17.43	19.28	20.74	18.31	18.33	19.67	21.05
	SHG	16.73	16.67	13.90	10.86	17.42	17.43	14.66	11.30	18.31	18.33	15.64	11.81
	TC	16.42	16.37	18.62	20.09	17.11	17.12	18.98	20.44	18.00	18.02	19.36	20.74
	kW	2.32	2.32	2.35	2.37	2.33	2.33	2.36	2.38	2.34	2.34	2.36	2.38
	CMP	2.09	2.09	2.12	2.14	2.10	2.10	2.13	2.15	2.11	2.11	2.13	2.15
	LDB	53.6	53.7	58.1	63.0	55.5	55.5	59.4	64.2	57.6	57.6	60.9	65.7
125 (51.67)	LWB	46.1	52.2	56.9	62.2	46.9	52.9	57.9	63.2	47.9	53.8	59.0	64.4
	TCG	15.61	15.61	17.39	18.89	16.27	16.27	17.73	19.19	17.06	17.09	18.07	19.47
	SHG	15.61	15.61	13.42	10.33	16.27	16.27	14.19	10.77	17.06	17.09	15.18	11.29
	TC	15.30	15.30	17.08	18.58	15.96	15.96	17.43	18.88	16.75	16.78	17.77	19.16
	kW	2.53	2.53	2.56	2.59	2.54	2.54	2.57	2.59	2.56	2.56	2.57	2.60
	CMP	2.30	2.30	2.33	2.36	2.32	2.32	2.34	2.37	2.33	2.33	2.35	2.37
125 (51.67)	LDB	55.3	55.3	58.8	63.8	57.0	57.0	60.0	64.9	59.1	59.0	61.4	66.3
	LWB	46.9	52.9	57.8	63.0	47.6	53.6	58.7	63.9	48.5	54.4	59.7	65.0

LEGEND

BF – Bypass Factor
 CMP – Compressor
 Edb – Entering Dry Bulb
 Ewb – Entering Wet Bulb
 kW – Total Power
 LDB – Leaving Dry Bulb
 LWB – Leaving Wet Bulb
 SHG – Gross Sensible Capacity (1000 Btu/hour)
 TC – Total Net Cooling Capacity (1000 Btu/hour)
 TCG – Gross Cooling Capacity (1000 Btu/hour)

NOTES:

- Direct interpolation is permissible. Do not extrapolate.
- The SHG is based on 80°F (26.67°C) edb temperature of air entering indoor coil.
 Below 80°F (26.67°C) edb, subtract (corr factor x cfm) from SHG.
 Above 80°F (26.67°C) edb, add (corr factor x cfm) to SHG.
 Correction Factor = 1.10 x (1 – BF) x (edb – 80).

PA(H)13A(N)AM / PW3C(H)A(N)M

PERFORMANCE DATA (CONT.)

INSTANTANEOUS AND INTEGRATED HEATING RATINGS
PHI3AAM09000 / PW3HAM09000

Air Temperature Entering Indoor Unit °F (°C)	Indoor Airflow (CFM) L-M-H	Item	Air Temperature Entering Outdoor Coil – DB/WB °F (°C)											
			57/53 (13.89/11.67)			47/43 (8.33/6.11)			37/33 (2.78/0.56)			27/23 (-2.78/-5)		
			Instant. Rating	Integrated Rating	Cap	Instant. Rating	Integrated Rating	Cap	Instant. Rating	Integrated Rating	Cap	Instant. Rating	Integrated Rating	Cap
55 (12.78)	214	Cap kW	10.99	10.99	0.83	9.55	9.55	0.77	8.13	7.40	6.80	6.80	6.04	5.06
	284	Cap kW	11.39	11.39	0.74	9.97	9.97	0.71	8.47	7.70	7.08	6.29	5.78	5.27
60 (15.56)	346	Cap kW	11.57	11.57	0.69	10.12	10.12	0.66	8.65	7.87	7.24	6.43	5.91	5.39
	214	Cap kW	10.75	10.75	0.87	9.31	9.31	0.80	7.93	7.21	6.60	5.86	5.36	4.88
65 (18.33)	284	Cap kW	11.18	11.18	0.78	9.78	9.78	0.74	8.27	7.53	6.89	6.12	5.58	5.09
	346	Cap kW	11.36	11.36	0.73	9.93	9.93	0.70	8.46	7.70	7.05	6.26	5.71	5.21
70 (21.11)	214	Cap kW	10.51	10.51	0.90	9.11	9.11	0.84	7.72	7.02	6.39	5.67	5.15	4.69
	284	Cap kW	10.96	10.96	0.82	9.52	9.52	0.77	8.07	7.34	6.68	5.93	5.38	4.91
75 (23.89)	346	Cap kW	11.14	11.14	0.77	9.74	9.74	0.73	8.26	7.52	6.85	6.08	5.51	5.02
	214	Cap kW	10.28	10.28	0.94	8.88	8.88	0.87	7.50	6.83	6.18	5.48	4.93	4.50
80 (26.67)	284	Cap kW	10.74	10.74	0.86	9.31	9.31	0.81	7.86	7.15	6.47	5.75	5.16	4.71
	346	Cap kW	10.93	10.93	0.81	9.56	9.56	0.77	8.06	7.33	6.63	5.89	5.30	4.83
85 (29.44)	214	Cap kW	10.04	10.04	0.97	8.64	8.64	0.90	7.28	6.66	5.96	5.29	4.71	4.29
	284	Cap kW	10.51	10.51	0.89	9.09	9.09	0.84	7.64	6.99	6.25	5.55	4.94	4.51
90 (32.22)	346	Cap kW	10.71	10.71	0.84	9.32	9.32	0.80	7.84	7.14	6.42	5.70	5.08	4.63
	214	Cap kW	9.80	9.80	1.01	8.40	8.40	0.93	7.06	6.42	5.74	5.09	4.47	4.08
95 (35.00)	284	Cap kW	10.27	10.27	0.93	8.85	8.85	0.87	7.42	6.75	6.03	5.35	4.71	4.30
	346	Cap kW	10.49	10.49	0.88	9.11	9.11	0.84	7.62	6.94	6.19	5.50	4.84	0.97

Indicates Rating Condition (Integrated Capacity)

Indicates Integrated Rating

Cap – Heating Capacity (100 Btuh), Includes indoor fan motor heat

kW – Total Power Input, includes compressor motor power input, outdoor fan motor power input, and indoor fan motor power input

Note: Integrated Capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat to defrost it.

PERFORMANCE DATA (CONT.)

INSTANTANEOUS AND INTEGRATED HEATING RATINGS PHI3AAM12000 / PW3HAM12000

Air Temperature Entering Indoor Unit °F (°C)	Indoor Airflow (CFM) L-M-H	Item	Air Temperature Entering Outdoor Coil – DB/WB °F (°C)											
			57/53 (13.89/11.67)			47/43 (8.33/6.11)			37/33 (2.78/0.56)			27/23 (-2.78/-5)		
			Instant. Rating	Integrated Rating	Cap kW	Instant. Rating	Integrated Rating	Cap kW	Instant. Rating	Integrated Rating	Cap kW	Instant. Rating	Integrated Rating	Cap kW
55 (12.78)	304	Cap kW	14.78	14.78	1.04	12.92	12.92	0.96	11.39	10.36	0.90	9.62	8.55	0.84
		Cap kW	14.85	14.85	0.99	12.97	12.97	0.92	11.44	10.41	0.87	9.74	8.65	0.81
		Cap kW	14.85	14.85	0.92	13.03	13.03	0.86	11.45	10.42	0.82	9.89	8.79	0.78
		Cap kW	14.63	14.63	1.10	12.81	12.81	1.01	11.21	10.20	0.95	9.32	8.28	0.87
60 (15.56)	304	Cap kW	14.71	14.71	1.04	12.85	12.85	0.97	11.35	10.32	0.92	9.55	8.48	0.85
		Cap kW	14.75	14.75	0.97	12.91	12.91	0.91	11.36	10.34	0.87	9.71	8.62	0.82
		Cap kW	14.46	14.46	1.15	12.67	12.67	1.07	11.02	10.03	0.99	9.07	8.05	0.91
		Cap kW	14.56	14.56	1.10	12.73	12.73	1.02	11.17	10.16	0.96	9.22	8.18	0.89
65 (18.33)	304	Cap kW	14.63	14.63	1.03	12.52	12.52	0.96	10.82	9.84	0.91	8.82	7.83	0.86
		Cap kW	14.29	14.29	1.21	12.60	12.60	1.12	10.97	9.98	1.04	8.96	7.96	0.95
		Cap kW	14.40	14.40	1.16	12.60	12.60	1.07	10.97	9.98	1.01	8.96	7.96	0.92
		Cap kW	14.49	14.49	1.09	12.67	12.67	1.02	11.16	10.16	0.97	9.16	8.14	0.89
70 (21.11)	304	Cap kW	14.11	8.66	1.27	12.37	12.37	1.18	10.52	8.66	1.07	8.60	7.63	0.99
		Cap kW	14.24	8.89	1.21	12.46	12.46	1.13	10.75	8.89	1.05	8.72	7.74	0.96
		Cap kW	14.34	14.34	1.14	12.55	12.55	1.07	10.96	9.98	1.01	8.90	7.90	0.93
		Cap kW	13.93	13.93	1.32	12.22	12.22	1.23	10.24	9.31	1.11	8.36	7.42	1.03
75 (23.89)	304	Cap kW	14.06	14.06	1.27	12.31	12.31	1.19	10.42	9.48	1.09	8.49	7.54	1.01
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
80 (26.67)	304	Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97
		Cap kW	14.18	14.18	1.20	12.41	12.41	1.12	10.74	9.77	1.06	8.66	7.69	0.97

Indicates Rating Condition (Integrated Capacity)

Indicates Integrated Rating

Cap – Heating Capacity (100 Btuh), Includes indoor fan motor heat

Note: Integrated Capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat to defrost it.

PA(H)13A(N)AM / PW3C(H)A(N)M

PERFORMANCE DATA (CONT.)

INSTANTANEOUS AND INTEGRATED HEATING RATINGS

PHI3NAM18000 / PW3HNMI8000

Air Temperature Entering Indoor Unit °F (°C)	Indoor Airflow (CFM) L-M-H	Item	Air Temperature Entering Outdoor Coil – DB/WB °F (°C)									
			57/53 (13.89/11.67)		47/43 (8.33/6.11)		37/33 (2.78/0.56)		27/23 (-2.78/-5)		17/13 (-8.33/-10.56)	
			Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating
55 (12.78)	426	Cap	18.57	18.57	16.44	16.44	0.00	0.00	11.47	10.19	9.32	8.50
		kW	1.48	1.38	1.38	1.38	0.00	0.00	1.17	1.17	1.20	1.20
	449	Cap	18.69	18.69	16.53	16.53	14.04	12.77	11.57	10.27	9.39	8.56
		kW	1.46	1.46	1.36	1.36	1.25	1.25	1.16	1.16	1.19	1.19
60 (15.56)	539	Cap	18.99	18.99	16.76	16.76	14.59	13.28	11.90	10.57	9.62	8.77
		kW	1.37	1.29	1.29	1.29	1.22	1.22	1.12	1.12	1.16	1.16
	426	Cap	18.23	18.23	16.12	16.12	13.48	12.27	11.10	9.86	8.97	8.18
		kW	1.55	1.44	1.44	1.44	1.31	1.31	1.22	1.22	1.24	1.24
65 (18.33)	449	Cap	18.34	18.34	16.23	16.23	13.61	12.39	11.19	9.94	9.04	8.25
		kW	1.52	1.42	1.42	1.42	1.30	1.30	1.21	1.21	1.23	1.23
	539	Cap	18.66	18.66	16.49	16.49	14.03	12.77	11.49	10.20	9.26	8.45
		kW	1.44	1.35	1.35	1.35	1.26	1.26	1.17	1.17	1.20	1.20
70 (21.11)	426	Cap	17.87	17.87	15.60	15.60	13.05	11.87	10.71	9.51	8.61	7.85
		kW	1.62	1.49	1.49	1.49	1.36	1.36	1.26	1.26	1.29	1.29
	449	Cap	18.00	18.00	15.88	15.88	13.18	11.99	10.81	9.60	8.68	7.92
		kW	1.59	1.48	1.48	1.48	1.35	1.35	1.25	1.25	1.28	1.28
75 (23.89)	539	Cap	18.32	18.32	16.19	16.19	13.59	12.37	11.10	9.86	8.90	8.11
		kW	1.50	1.41	1.41	1.41	1.30	1.30	1.22	1.22	1.25	1.25
	426	Cap	17.53	17.53	15.09	15.09	12.60	11.46	10.32	9.16	8.26	7.53
		kW	1.68	1.54	1.54	1.54	1.41	1.41	1.31	1.31	1.33	1.33
80 (26.67)	449	Cap	17.65	17.65	15.26	15.26	12.73	11.59	10.41	9.25	8.32	7.58
		kW	1.66	1.52	1.52	1.52	1.40	1.40	1.30	1.30	1.32	1.32
	539	Cap	17.98	17.98	15.88	15.88	13.16	11.98	10.71	9.51	8.52	7.77
		kW	1.57	1.47	1.47	1.47	1.35	1.35	1.27	1.27	1.30	1.30
75 (23.89)	426	Cap	17.17	8.66	14.66	14.66	12.15	8.66	9.92	8.81	7.86	7.17
		kW	1.75	1.59	1.59	1.59	1.46	1.46	1.36	1.36	1.50	1.50
	449	Cap	17.29	8.89	14.79	14.79	12.27	8.89	10.01	8.89	7.93	7.24
		kW	1.72	1.57	1.57	1.57	1.45	1.45	1.35	1.35	1.37	1.37
80 (26.67)	539	Cap	17.64	17.64	15.30	15.30	12.69	11.54	10.30	9.14	8.16	7.44
		kW	1.64	1.52	1.52	1.52	1.40	1.40	1.31	1.31	1.35	1.35
	426	Cap	16.75	16.75	14.19	14.19	11.72	10.67	9.51	8.45	7.46	6.80
		kW	1.81	1.65	1.65	1.65	1.51	1.51	1.41	1.41	1.43	1.43
80 (26.67)	449	Cap	16.92	16.92	14.35	14.35	11.84	10.77	9.60	8.53	7.53	6.86
		kW	1.79	1.63	1.63	1.63	1.50	1.50	1.40	1.40	1.42	1.42
	539	Cap	17.28	17.28	14.82	14.82	12.22	11.12	9.88	8.78	7.73	1.54
		kW	1.71	1.57	1.57	1.57	1.46	1.46	1.36	1.36	1.40	1.40

Indicates Rating Condition (Integrated Capacity)

Indicates Integrated Rating

Cap – Heating Capacity (100 Btuh), Includes indoor fan motor heat

Note: Integrated Capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat to defrost it.

kW – Total Power Input, includes compressor motor power input, outdoor fan motor power input, and indoor fan motor power input

PERFORMANCE DATA (CONT.)

INSTANTANEOUS AND INTEGRATED HEATING RATINGS

PHI3NAM24000 / PW3HNM24000

Air Temperature Entering Indoor Unit °F (°C)	Indoor Airflow (CFM) L-M-H	Item	Air Temperature Entering Outdoor Coil – DB/WB °F (°C)									
			57/53 (13.89/11.67)		47/43 (8.33/6.11)		37/33 (2.78/0.56)		27/23 (-2.78/-5)		17/13 (-8.33/-10.56)	
			Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating	Instant. Rating	Integrated Rating
55 (12.78)	625	Cap kW	25.79	25.79	22.58	22.58	19.52	17.77	16.24	14.42	13.28	12.11
			1.76	1.63		1.52		1.41			1.32	
		Cap kW	25.99	25.99	22.72	22.72	19.81	18.03	16.40	14.57	13.43	12.25
60 (15.56)	689	Cap kW	26.14	26.14	22.85	22.85	20.12	18.31	16.65	14.78	13.59	12.39
			1.63	1.53		1.45		1.36			1.29	
		Cap kW	25.42	25.42	22.28	22.28	18.96	17.26	15.78	14.02	12.90	11.76
65 (18.33)	625	Cap kW	25.61	25.61	22.42	22.42	19.26	17.53	15.98	14.19	13.00	11.85
			1.78	1.66		1.55		1.45			1.36	
		Cap kW	25.80	25.80	22.55	22.55	19.56	17.80	16.20	14.38	13.16	12.00
70 (21.11)	689	Cap kW	25.02	25.02	21.92	21.92	18.39	16.74	15.36	13.64	12.39	11.29
			1.92	1.78		1.64		1.53			1.43	
		Cap kW	25.23	25.23	22.08	22.08	18.73	17.05	15.49	13.75	12.54	11.44
75 (23.89)	625	Cap kW	25.44	25.44	22.26	22.26	19.03	17.32	15.71	13.95	12.70	11.58
			1.80	1.68		1.58		1.48			1.39	
		Cap kW	24.62	24.62	21.46	21.46	18.00	16.38	14.87	13.21	11.92	10.87
80 (26.67)	689	Cap kW	24.82	24.82	21.68	21.68	18.24	16.60	15.01	13.33	12.07	11.00
			1.95	1.81		1.68		1.57			1.47	
		Cap kW	25.04	25.04	21.90	21.90	18.50	16.83	15.23	13.52	12.26	11.18
75 (23.89)	625	Cap kW	24.18	8.66	20.85	20.85	17.46	8.66	14.38	12.77	11.43	10.43
			2.09	1.92		1.78		1.65			1.55	
		Cap kW	24.41	8.89	21.23	21.23	17.65	8.89	14.52	12.89	11.59	10.56
75 (23.89)	689	Cap kW	24.64	24.64	21.49	21.49	17.96	16.34	14.74	13.09	11.75	10.71
			1.98	1.84		1.71		1.60			1.51	
		Cap kW	23.70	23.70	20.22	20.22	16.93	15.41	13.82	12.28	10.94	9.97
80 (26.67)	625	Cap kW	23.94	23.94	20.59	20.59	17.17	15.62	14.01	12.44	11.08	10.11
			2.11	1.95		1.81		1.69			1.59	
		Cap kW	24.22	24.22	20.98	20.98	17.44	15.87	14.22	12.63	11.25	2.25
75 (23.89)	689	Cap kW	24.22	24.22	20.98	20.98	17.44	15.87	14.22	12.63	11.25	2.25
			2.06	1.91		1.78		1.67			1.57	
		Cap kW	24.22	24.22	20.98	20.98	17.44	15.87	14.22	12.63	11.25	2.25

Indicates Rating Condition (Integrated Capacity)

Indicates Integrated Rating

Cap – Heating Capacity (100 Btu/h), Includes indoor fan motor heat

kW – Total Power Input, includes compressor motor power input, outdoor fan motor power input, and indoor fan motor power input
Note: Integrated Capacity is maximum (instantaneous) capacity less the effect of frost on the outdoor coil and the heat to defrost it.

PA(H)13A(N)AM / PW3C(H)A(N)M

APPLICATION DATA

UNIT SELECTION

Select equipment to either match or be slightly less than anticipated peak load. This provides better humidity control, fewer unit cycles, and less part-load operation.

For units used in spaces with high sensible loads, base equipment selection on unit sensible load, not on total anticipated load. Adjust for anticipated room wet bulb temperature to avoid undersizing equipment.

UNIT MOUNTING (INDOOR)

Unit leveling – For reliable operation, units should be level in all planes.

Clearance – Provide adequate clearance for airflow as shown in Fig. 2.

Unit location – Select a location which will provide the best air circulation for the room.

These units should be positioned as high as possible on the wall for best air circulation. The unit return and discharge should not be obstructed by furniture, curtains, or anything which may cause unit short cycling or air recirculation. Place the unit in the middle of the selected wall (if possible). Use an outside wall, if available, to make piping easier, and place the unit so it faces the normal location of room occupants.

UNIT MOUNTING (OUTDOOR)

Unit leveling – For reliable operation, units should be level in all planes.

Clearance – Minimum clearance, as shown in Fig. 3, must be provided for airflow. The condensing units are designed for free-blow application. Air inlets and outlets should not be restricted.

Unit location – A location which is convenient to installation and not exposed to strong wind. If unit is exposed to strong winds it is recommended that a wind baffle be used. Contact your Payne representative for drawings.

A location which can bear the weight of outdoor unit and where the outdoor unit can be mounted in a level position.

Do not install the indoor or outdoor units in a location with special environmental conditions. For those applications, contact your Payne representative.

MOUNTING TEMPLATE

The fan coil units are furnished with mounting to mark the location of the wiring, and refrigeration line hole locations.

SUPPORT

Adequate support must be provided to support the weight of all fan coils. Refer to the Physical Data section for fan coil weights, and the base unit dimensional drawings for the location of mounting brackets.

SYSTEM OPERATING CONDITIONS

Cooling operating range:

	Maximum		Minimum	
	DB °F (°C)	WB °F (°C)	DB °F (°C)	WB °F (°C)
Outdoor Unit	125 (51.67)	–	55 (12.78)	–
Indoor Unit	85 (29.44)	72 (22.22)	64 (17.78)	52 (11.11)

Heating operating range:

	Maximum		Minimum	
	DB °F (°C)	WB °F (°C)	DB °F (°C)	WB °F (°C)
Outdoor Unit	75 (23.89)	67 (19.44)	5 (–15)	50% RH
Indoor Unit	80 (26.67)	–	55 (12.78)	–

METERING DEVICES

These units have capillary tube metering devices in the outdoor unit.

DRAIN CONNECTIONS

Install drains to meet local sanitation codes. If adequate gravity drainage cannot be provided, unit should be equipped with accessory condensate pump. High wall fan coil unit condensate pumps have a maximum lift of 10' (3.05 m) for 9k and 12k units and 25' (7.62 m) for 18k and 24k units.

See physical dimension tables for drain sizes.

NOTE: High wall fan coil units have internal condensate traps. A trap is not required.

Drain connections may be routed through alternate locations on most fan coils as shown in Fig. 4.

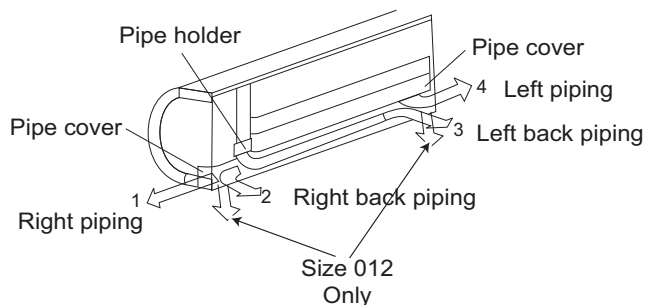


Fig. 4 – Piping Locations

A07344

REFRIGERANT LINES

General refrigerant line sizing:

1. The PA(H)13, PW3C(H) units are shipped with a full charge of R410A refrigerant. All charges, line sizing, and capacities are based on runs of 25 ft (7.6 m). For runs over 25 ft (7.6 m), consult long-line section on this page for proper charge adjustments.
2. Refrigerant lines should not be buried in the ground. If it is necessary to bury the lines, not more than 36-in (914 mm) should be buried. Provide a minimum 6-in (152 mm) vertical rise to the service valves to prevent refrigerant migration.
3. Both lines must be insulated. Use a minimum of 1/2-in. (12.7 mm) thick insulation. Closed-cell insulation is recommended in all long-line applications.
4. Special consideration should be given to isolating interconnecting tubing from the building structure. Isolate the tubing so that vibration or noise is not transmitted into the structure.

Long Line Applications, PA13A(N) Units:

1. A crankcase heater should be added for line lengths longer than 25 ft (7.62 m) to prevent the migration of refrigerant to the compressor during the "OFF" cycle.
2. A field fabricated wind baffle is recommended.
3. No change in line sizing is required.
4. Add refrigerant per table below.

ADDITIONAL CHARGE TABLE

Unit Size	Total Line Length, ft		Additional Charge, oz. ft (m)		
	Min.	Max.	10 – 25 (3.05 – 7.62)	>25 – 65 (7.62–19.81)	>65 – 100 (19.81–30.48)
9K cool only	10	65	none	0.1 oz per foot	
9K hp					
12K cool only					
12K hp					
18K cool only		100			0.3 oz. per foot
18K hp					
24K cool only					
24K hp					

5. Reduction in capacity due to long lines can be calculated from the chart below.

CAPACITY LOSS

Capacity, % Loss				
	Line Length, ft			
Cooling:	25	45	65	100
9 & 12 KBTU/H models	0%	2%	5%	
18 & 24 KBTU/H models	0%	2%	4%	7%
Heating:				
9 & 12 KBTU/H models	0%	7%	11%	
18 & 24 KBTU/H models	0%	7%	11%	15%

WIRING

The main power is supplied to the outdoor unit. the field supplied connecting cable from the outdoor unit to indoor unit consists of four wires and provides the power for the indoor unit as well as the communication signal between the outdoor unit and indoor unit. For 9K and 12K units, all four wires are low voltage DC.

For 18K and 24K, two wires are high voltage AC power, one is low voltage DC, and one is a ground wire.

CONTROL SYSTEM

The PW3C(H) units are equipped with a microprocessor control to operate the system and give optimum levels of comfort and operating efficiency.

The main microprocessor is located in the control box of the fan coil unit (there is one in the outdoor unit too) with thermistors located in the fan coil inlet and on the indoor coil. These thermistors monitor the system operation and control the operating mode. To change the settings or the modes of operation, use the factory supplied wireless remote control.

The PW3C(H) units have 5 operating modes:

- Fan Only
- Auto (heat pump models only)
- Heating (heat pump models only)
- Cooling
- Dehumidification (Dry)

FAN ONLY - In Fan Only mode, the system filters and circulates the room air without changing the room air temperature.

AUTO - In Auto mode, the system will automatically select one of the following operating modes: cooling, heating or fan only based on the difference between the room temperature and the set point temperature.

HEATING - In the Heating mode, the system heats and filters room air.

COOLING - In Cooling mode, the system cools, dries and filters room air.

DEHUMIDIFICATION (DRY) - in Dehumidification (Dry) mode, the system dries, filters and slightly cools room temperature. This mode does not take place of a dehumidifier.

In addition to the above modes that are selected by using the remote control, The unit can run in two other modes selected by the manual button:

- EMERGENCY RUN
- TEST MODE

EMERGENCY mode is used when the remote control is misplaced or the batteries in the remote control died. Pushing the manual button once will put the unit in Auto mode with a predetermined set point (76 °F/ 24.4 °C) .

TEST mode is used when a technician needs to diagnose the unit for a malfunction. Pushing the manual button twice will put the unit in test mode. The unit will run continuously for 30 min regardless of the set point.

For more details on the sequence of operation please refer to the service manual for those units.

WIRELESS REMOTE CONTROL

1. A wireless remote control is supplied for system operation of all high-wall units.
2. Each battery-operated wireless (infrared) remote control may be used to control more than one unit.
3. The wireless remote control has a range of 25 ft. (7.6 m).

AIR THROW DATA

UNIT CAPACITY	APPROXIMATE AIR THROW ft. (m)		
	Low	Medium	High
009 115v	14 (4.3 m)	18 (5.5)	28 (8.5)
012 115v	16 (4.9)	20 (6.1)	30 (9.1)
018 208/230v	22 (6.7)	37 (8.2)	35 (10.7)
024 208/230v	23 (7.0)	31 (9.4)	40 (12.2)

SOUND RATINGS

Outdoor Units

Model Number	Sound Power dBa	Sound Pressure dBa
PA13AAM09000	65	54
PA13AAM12000	65	54
PA13NAM18000	68	57
PA13NAM24000	67	56
PH13AAM09000	64/66 (Clg/Htg)	53/55 (Clg/Htg)
PH13AAM12000	63/64 (Clg/Htg)	52/53 (Clg/Htg)
PH13NAM18000	68/72 (Clg/Htg)	57/61 (Clg/Htg)
PH13NAM24000	65/67 (Clg/Htg)	54/56 (Clg/Htg)

Indoor Units

Model Number	High		Medium		Low	
	Sound Power dBa	Sound Pressure dBa	Sound Power dBa	Sound Pressure dBa	Sound Power dBa	Sound Pressure dBa
PW3CAM09000	53	42	47	36	39	28
PW3CAM12000	58	47	53	42	51	40
PW3CNM18000	59	48	56	45	54	43
PW3CNM24000	64	53	61	50	59	48
PW3HAM09000	52/54 (Clg/Htg)	41/43 (Clg/Htg)	47/47 (Clg/Htg)	36/36 (Clg/Htg)	42/44 (Clg/Htg)	31/33 (Clg/Htg)
PW3HAM12000	59/58 (Clg/Htg)	48/47 (Clg/Htg)	54/51 (Clg/Htg)	43/40 (Clg/Htg)	51/47 (Clg/Htg)	40/36 (Clg/Htg)
PW3HNM18000	58/57 (Clg/Htg)	47/46 (Clg/Htg)	56/56 (Clg/Htg)	45/45 (Clg/Htg)	54/54 (Clg/Htg)	43/43 (Clg/Htg)
PW3HNM24000	65/66 (Clg/Htg)	54/55 (Clg/Htg)	62/64 (Clg/Htg)	51/53 (Clg/Htg)	59/60 (Clg/Htg)	48/49 (Clg/Htg)

NOTES:

- Sound power ratings are per ARI 270 and ARI 350
- Sound pressure ratings are estimated sound pressure, 3 feet (.91 m) from the unit, based on sound power data.

ELECTRICAL DATA

UNIT SIZE	OPERATING VOLTAGE*	COMPRESSOR			OUTDOOR FAN			INDOOR FAN				MCA	MAX FUSE/CB AMP
	MAX/MIN	VOLTS-PH-HZ	RLA	LRA	FLA	HP	W	VOLTS	FLA	HP	W		
009	127/104	115-1-60	7.5	40	0.60	0.102	23	35 DC	1.1	0.034	20	12	20
012			9.9	47					1.18	0.044	25	15	25
018	253/187	208/230-1-60	7.3	32.6	0.78	0.224	53	208/230-1-6.	0.26	0.075	31	11	20
024			9.7	34.8	0.62	0.218	100		0.39	0.112	50	14	25

*Permissible limits of the voltage range at which the unit will operate satisfactorily

LEGEND

FLA — Full Load Amps

LRA — Locked Rotor Amps

MCA — Minimum Circuit Amps

RLA — Rated Load Amps

WIRING DIAGRAMS

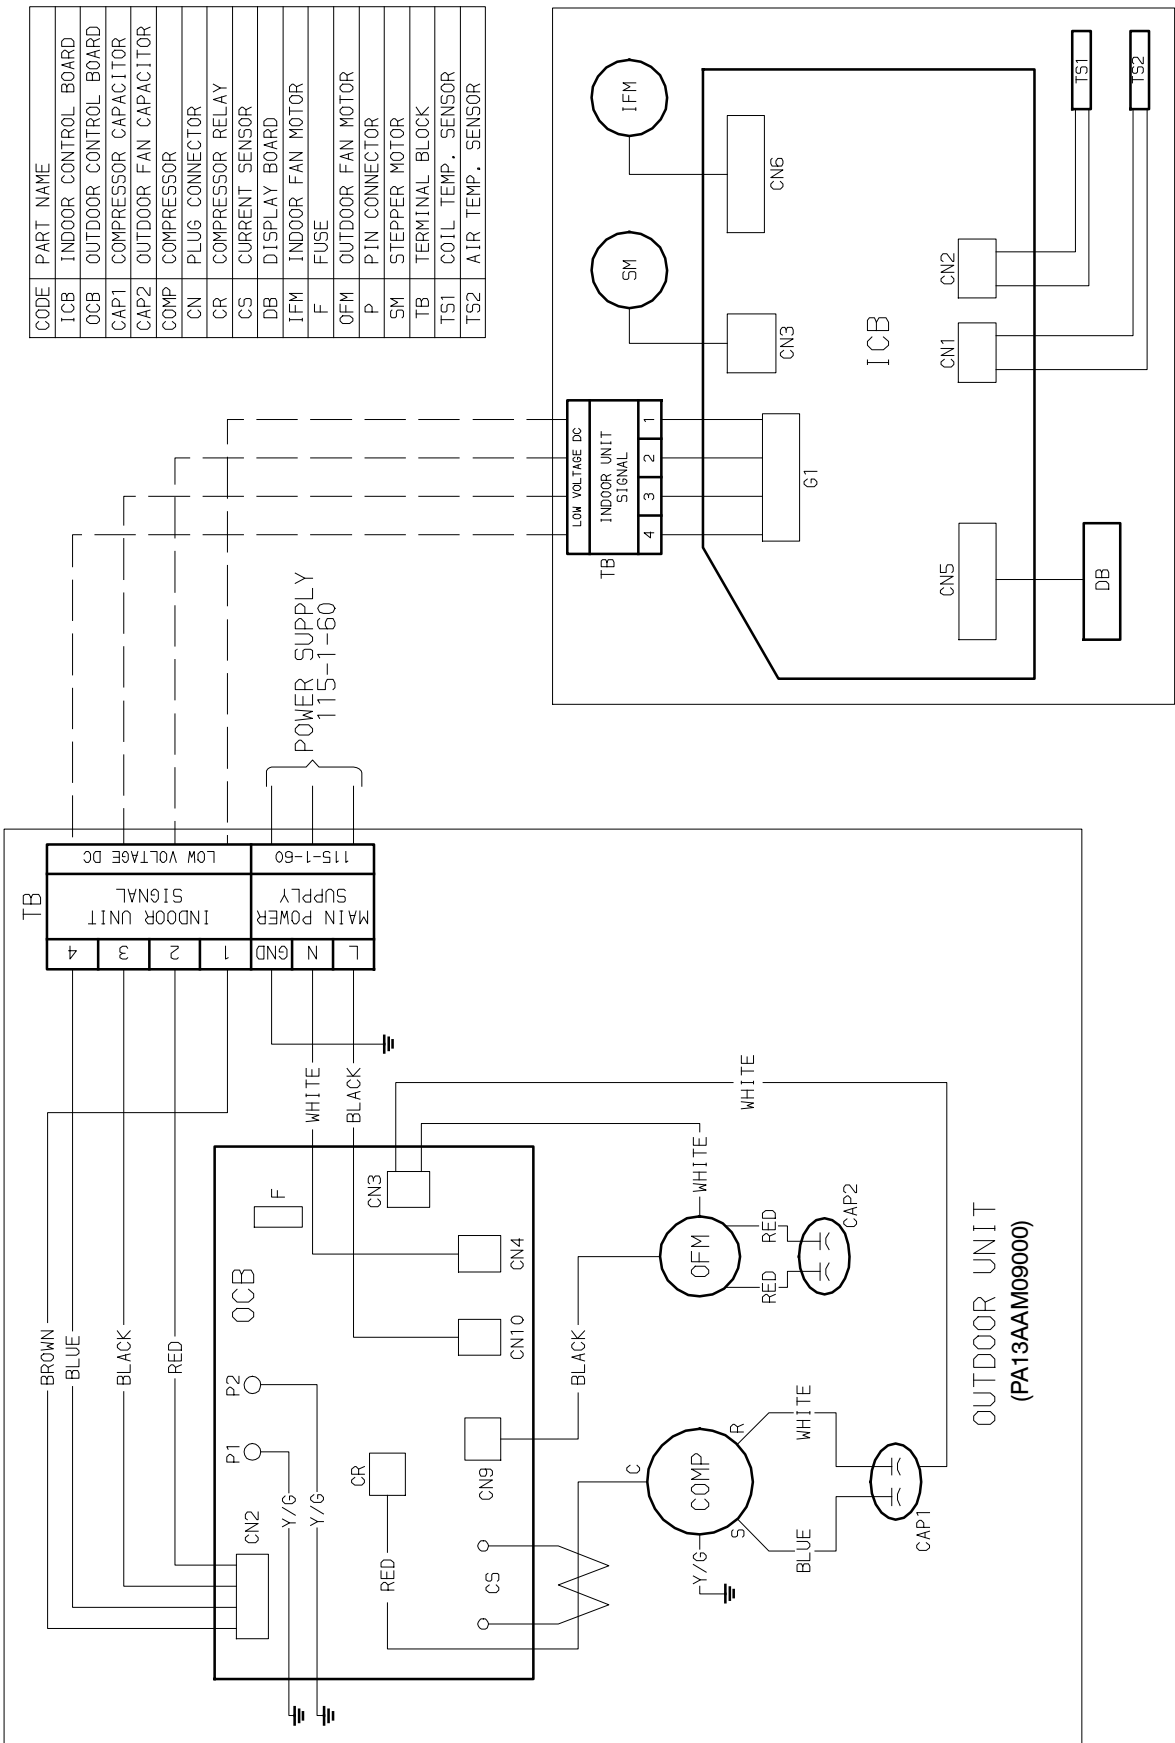


Fig. 5 – Wiring Diagram PA13AAM09000 W/ PW3CAM09000

WIRING DIAGRAMS (CONT.)

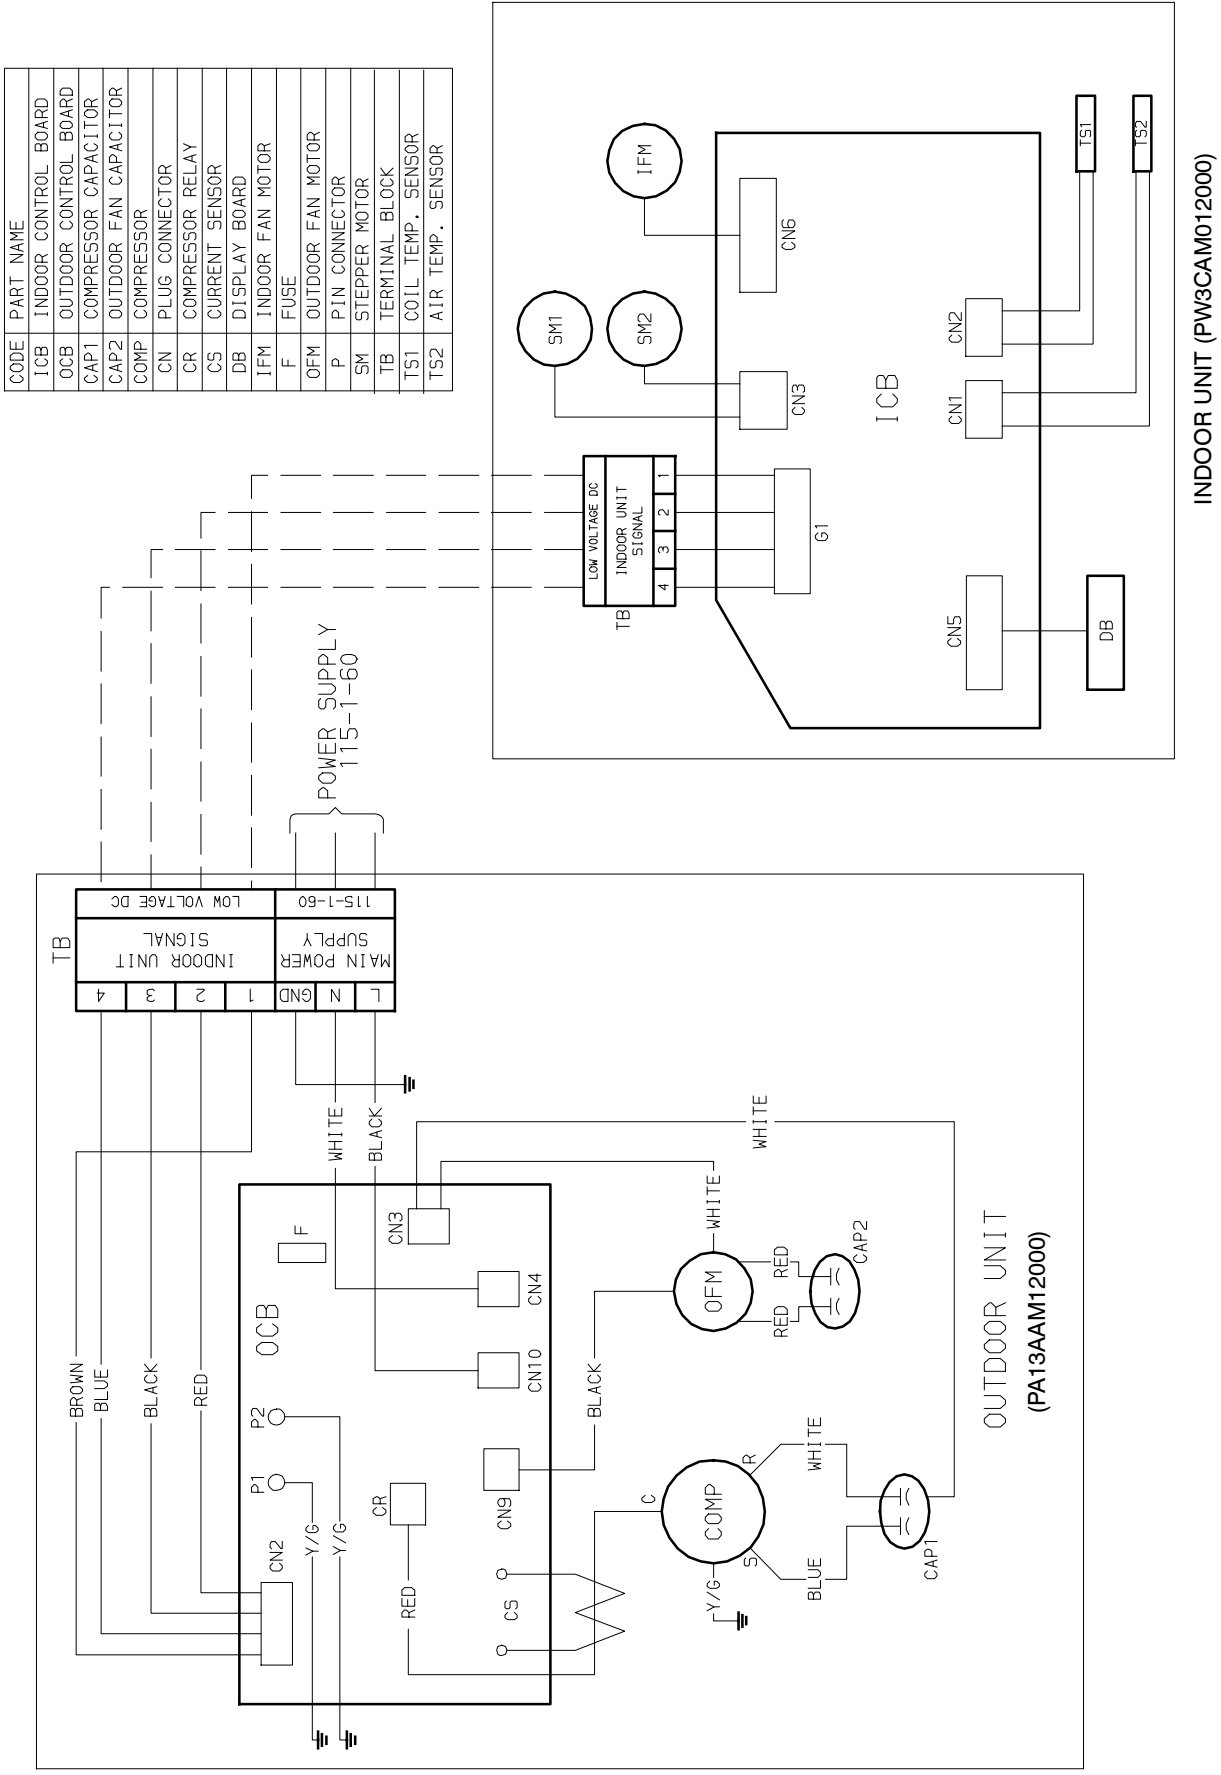


Fig. 6 – Wiring Diagram PA13AAM12000 W/ PW3CAM012000

WIRING DIAGRAMS (CONT.)

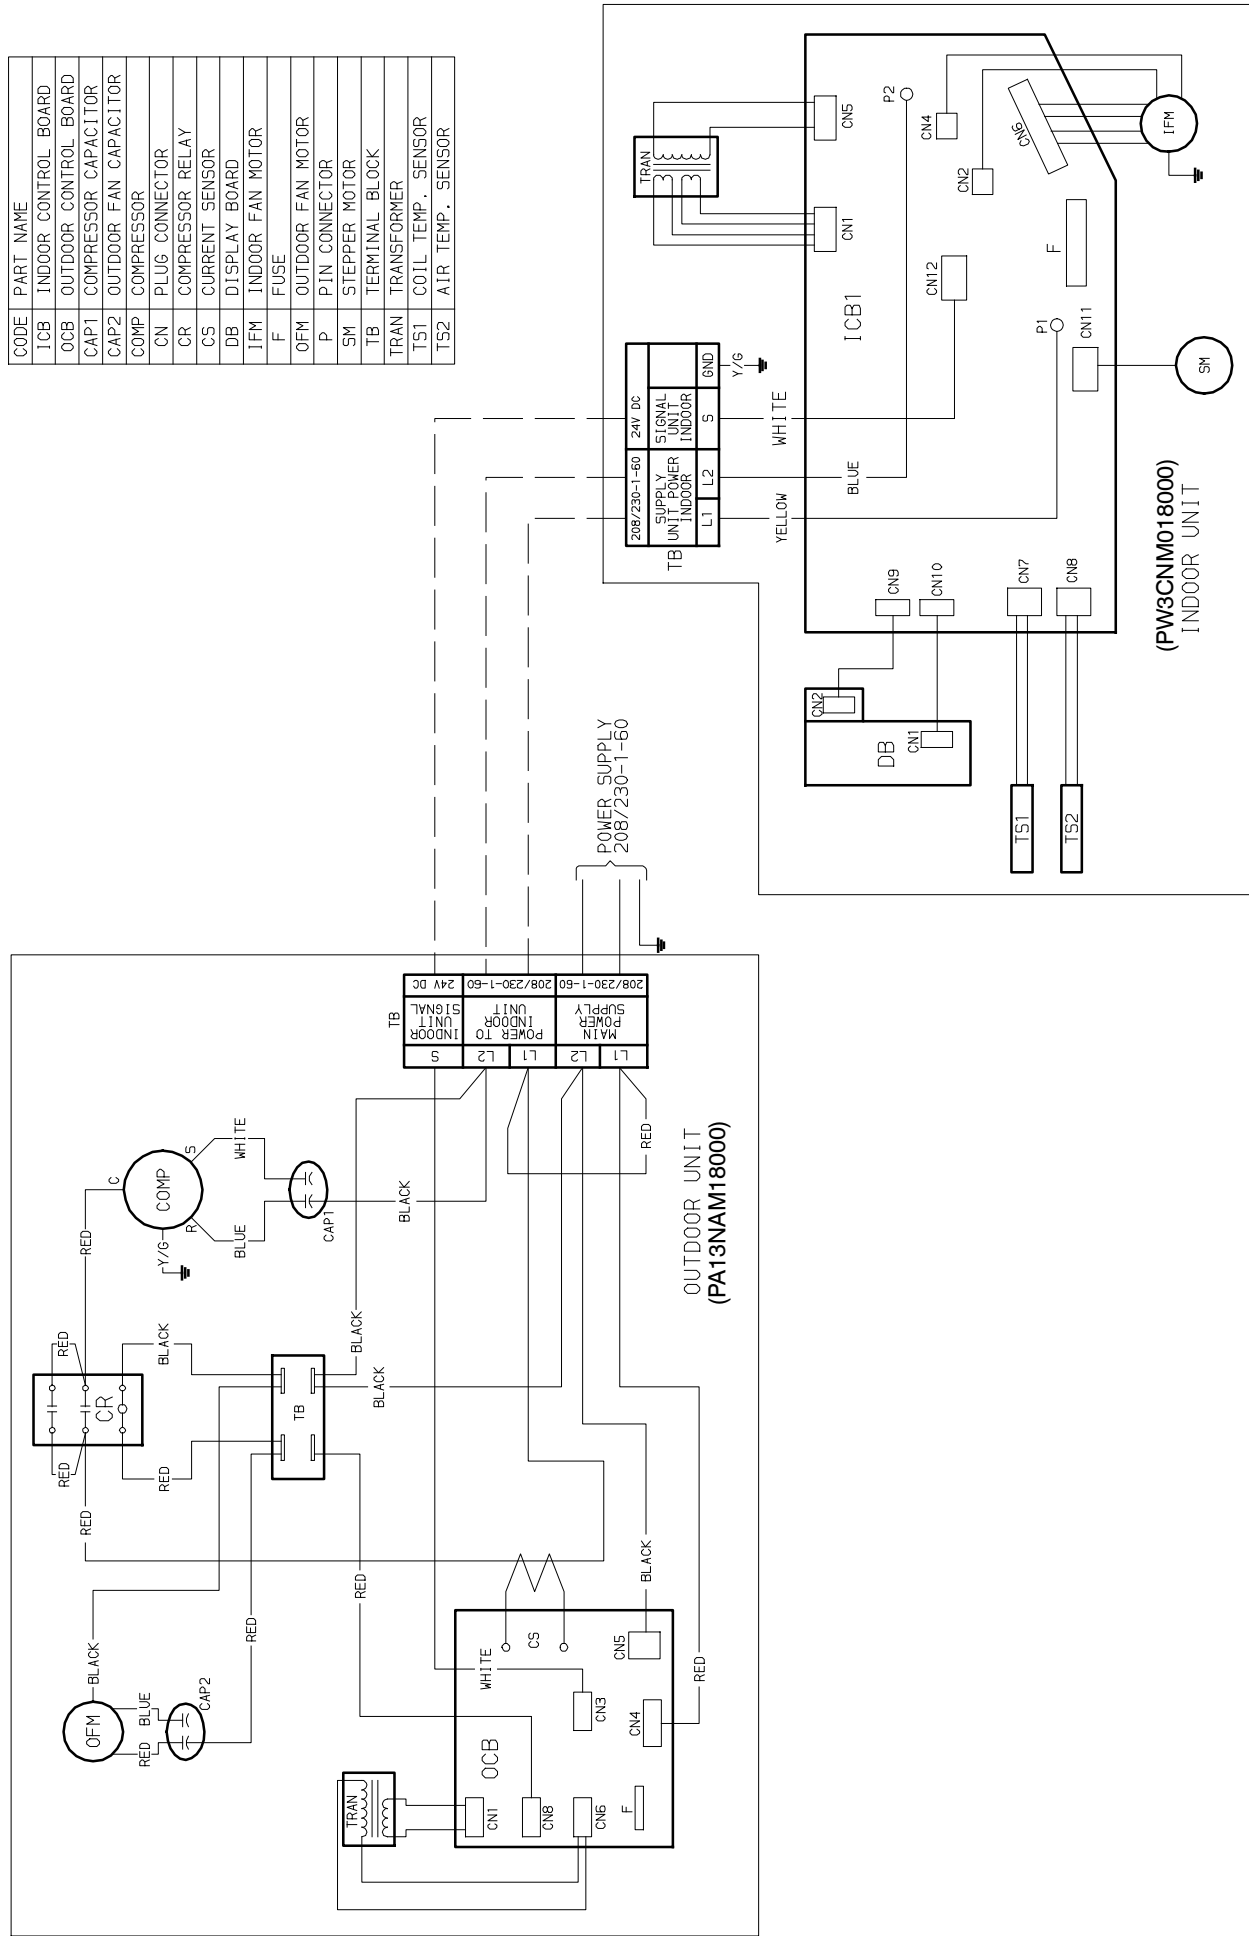


Fig. 7 – Wiring Diagram PA13NAM18000 W/ PW3CNNM018000

WIRING DIAGRAMS (CONT.)

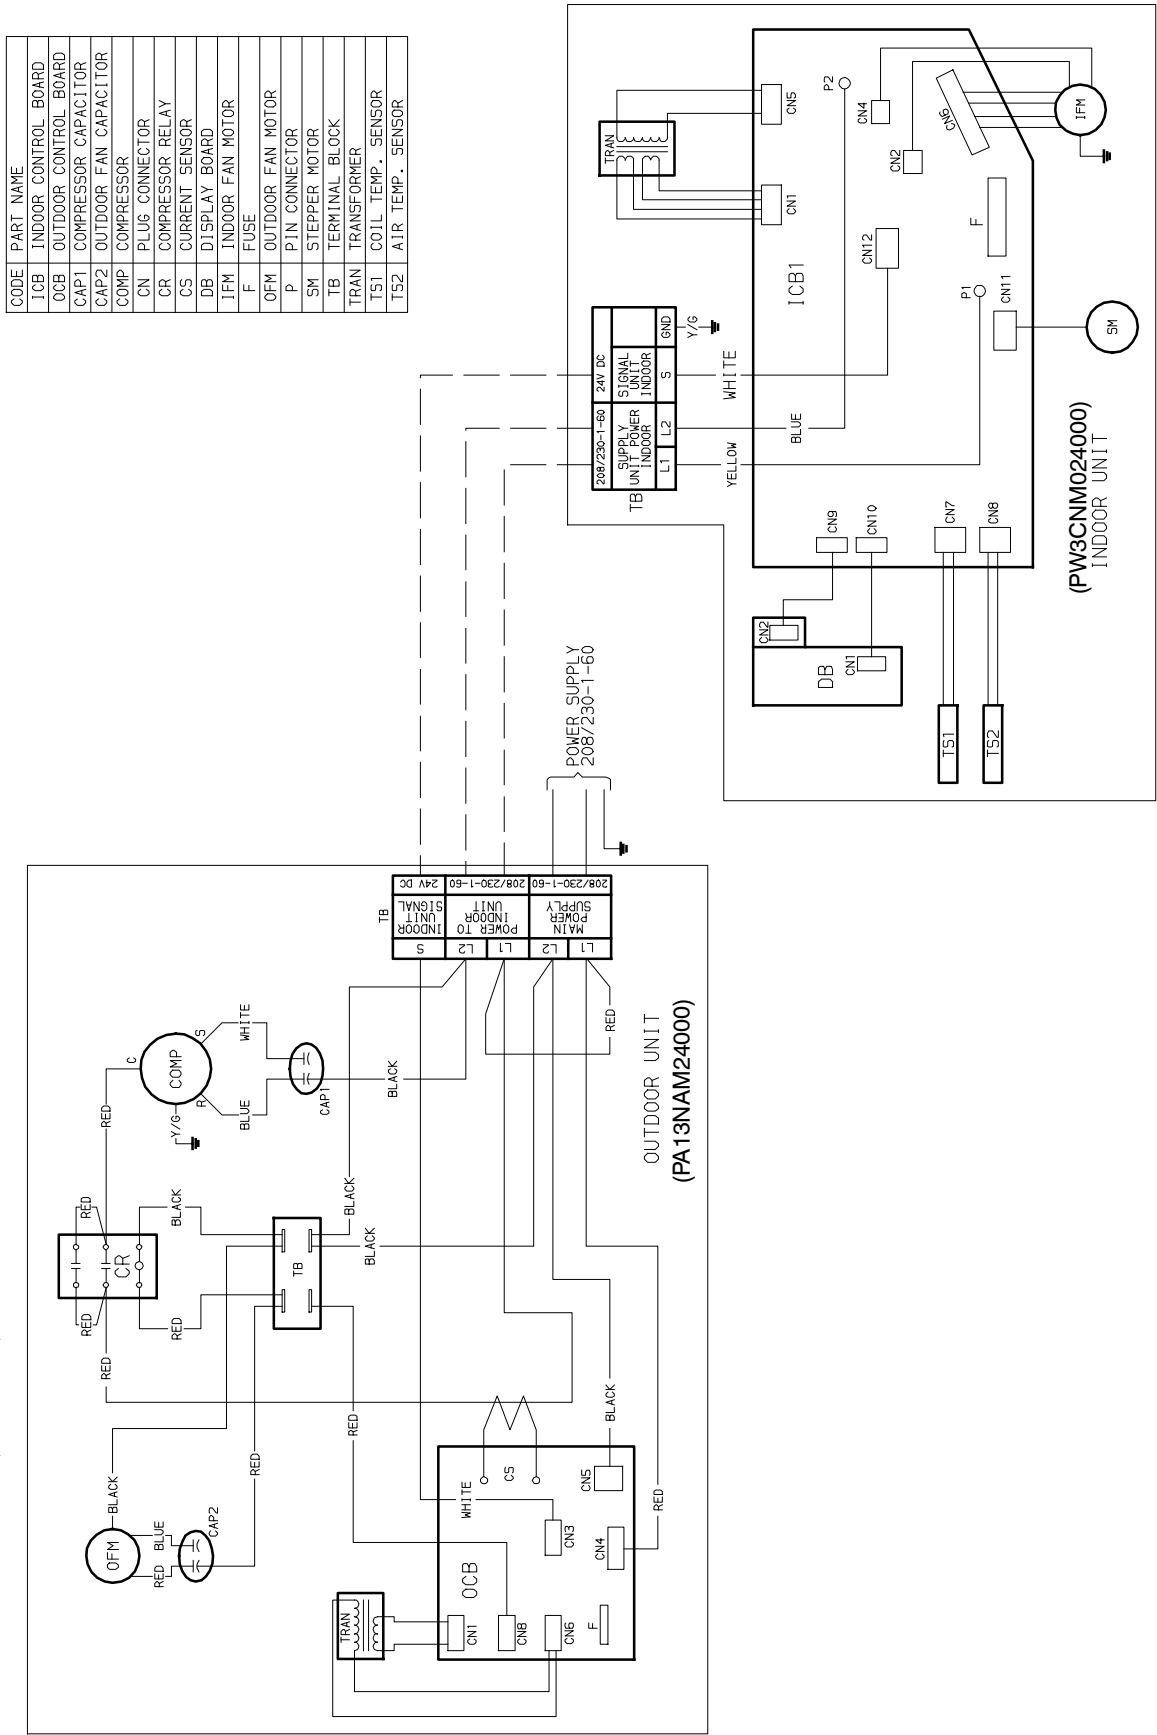


Fig. 8 – Wiring Diagram PA13NAM24000 W/ PW3CNNM024000

OUTDOOR UNIT (PH13AAM09000)

COMPONENTS:

- COMP: COMPRESSOR
- OFM: OUTDOOR FAN MOTOR
- RV: REVERSING VALVE
- TS1: COIL TEMP. SENSOR
- TS2: AIR TEMP. SENSOR

WIRING CONNECTIONS:

- COMPRESSOR (COMP):**
 - Y/G: Ground
 - S: Blue
 - R: White
 - C: Black
- FAN MOTOR (OFM):**
 - RED: Red
 - RED: Red
 - WHITE: White
- REVERSING VALVE (RV):**
 - BLACK (OR BLUE): Black (or Blue)
 - WHITE: White
- SENSORS:**
 - TS1: Blue
 - TS2: White

INDOOR UNIT (ICB) CONNECTIONS:

- MAIN POWER SUPPLY (115-1-60):**
 - L: Line
 - N: Neutral
 - GND: Ground
- INDOOR UNIT SIGNAL:**
 - 1: Signal 1
 - 2: Signal 2
 - 3: Signal 3
 - 4: Signal 4

LEGEND:

CODE	PART NAME
ICB	INDOOR CONTROL BOARD
OCB	OUTDOOR CONTROL BOARD
CAP1	COMPRESSOR CAPACITOR
CAP2	OUTDOOR FAN CAPACITOR
COMP	COMPRESSOR
CN	PLUG CONNECTOR
CR	COMPRESSOR RELAY
CS	CURRENT SENSOR
DB	DISPLAY BOARD
DTS	DEFROST TEMP. SENSOR
IFM	INDOOR FAN MOTOR
F	FUSE
OFM	OUTDOOR FAN MOTOR
P	PIN CONNECTOR
RV	REVERSING VALVE
SM	STEPPER MOTOR
TB	TERMINAL BLOCK
TS1	COIL TEMP. SENSOR
TS2	AIR TEMP. SENSOR

Fig. 9 – Wiring Diagram PH13AAM09000 W/ PW3HAM09000

25

WIRING DIAGRAMS (CONT.)

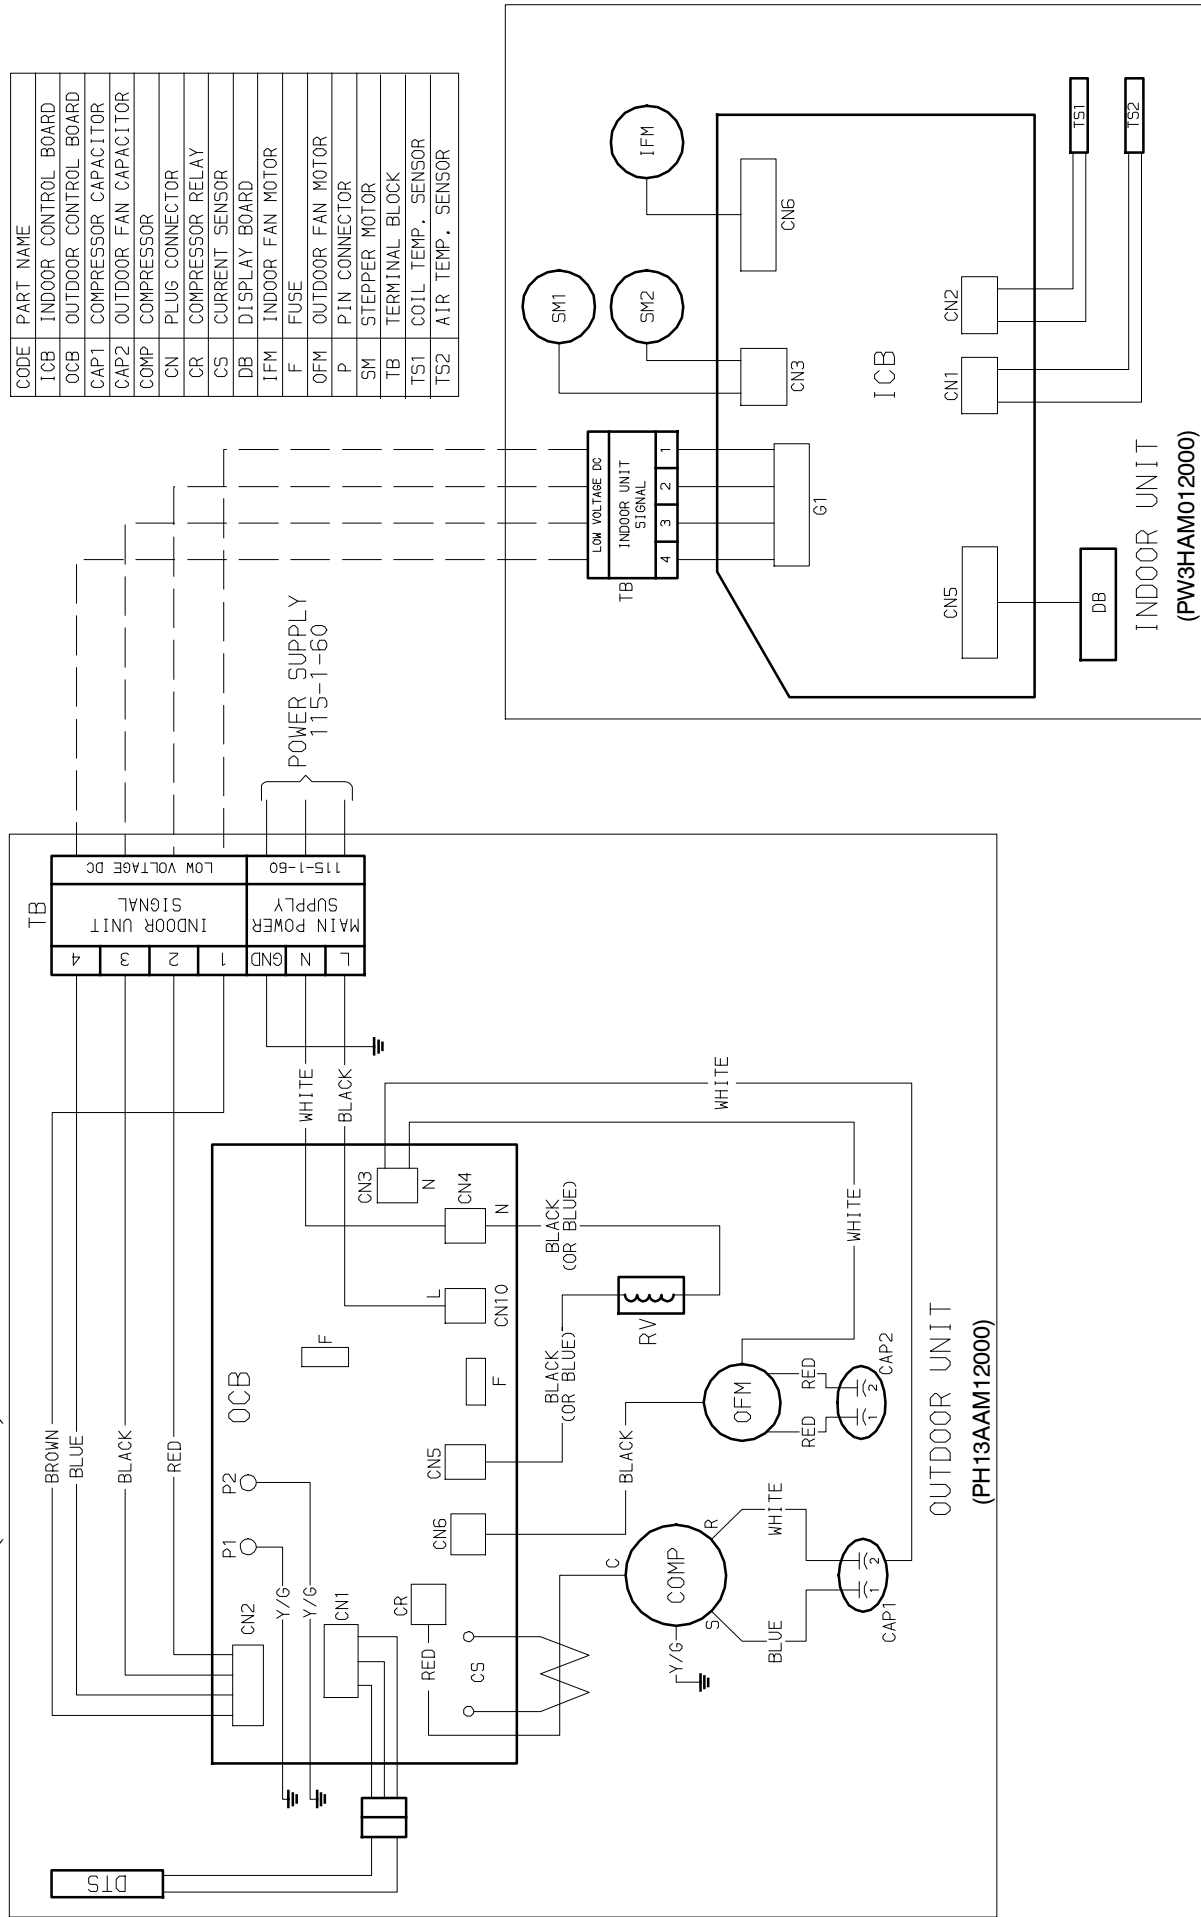


Fig. 10 – Wiring Diagram PH13AAM12000 W/ PW3HAM012000

WIRING DIAGRAMS (CONT.)

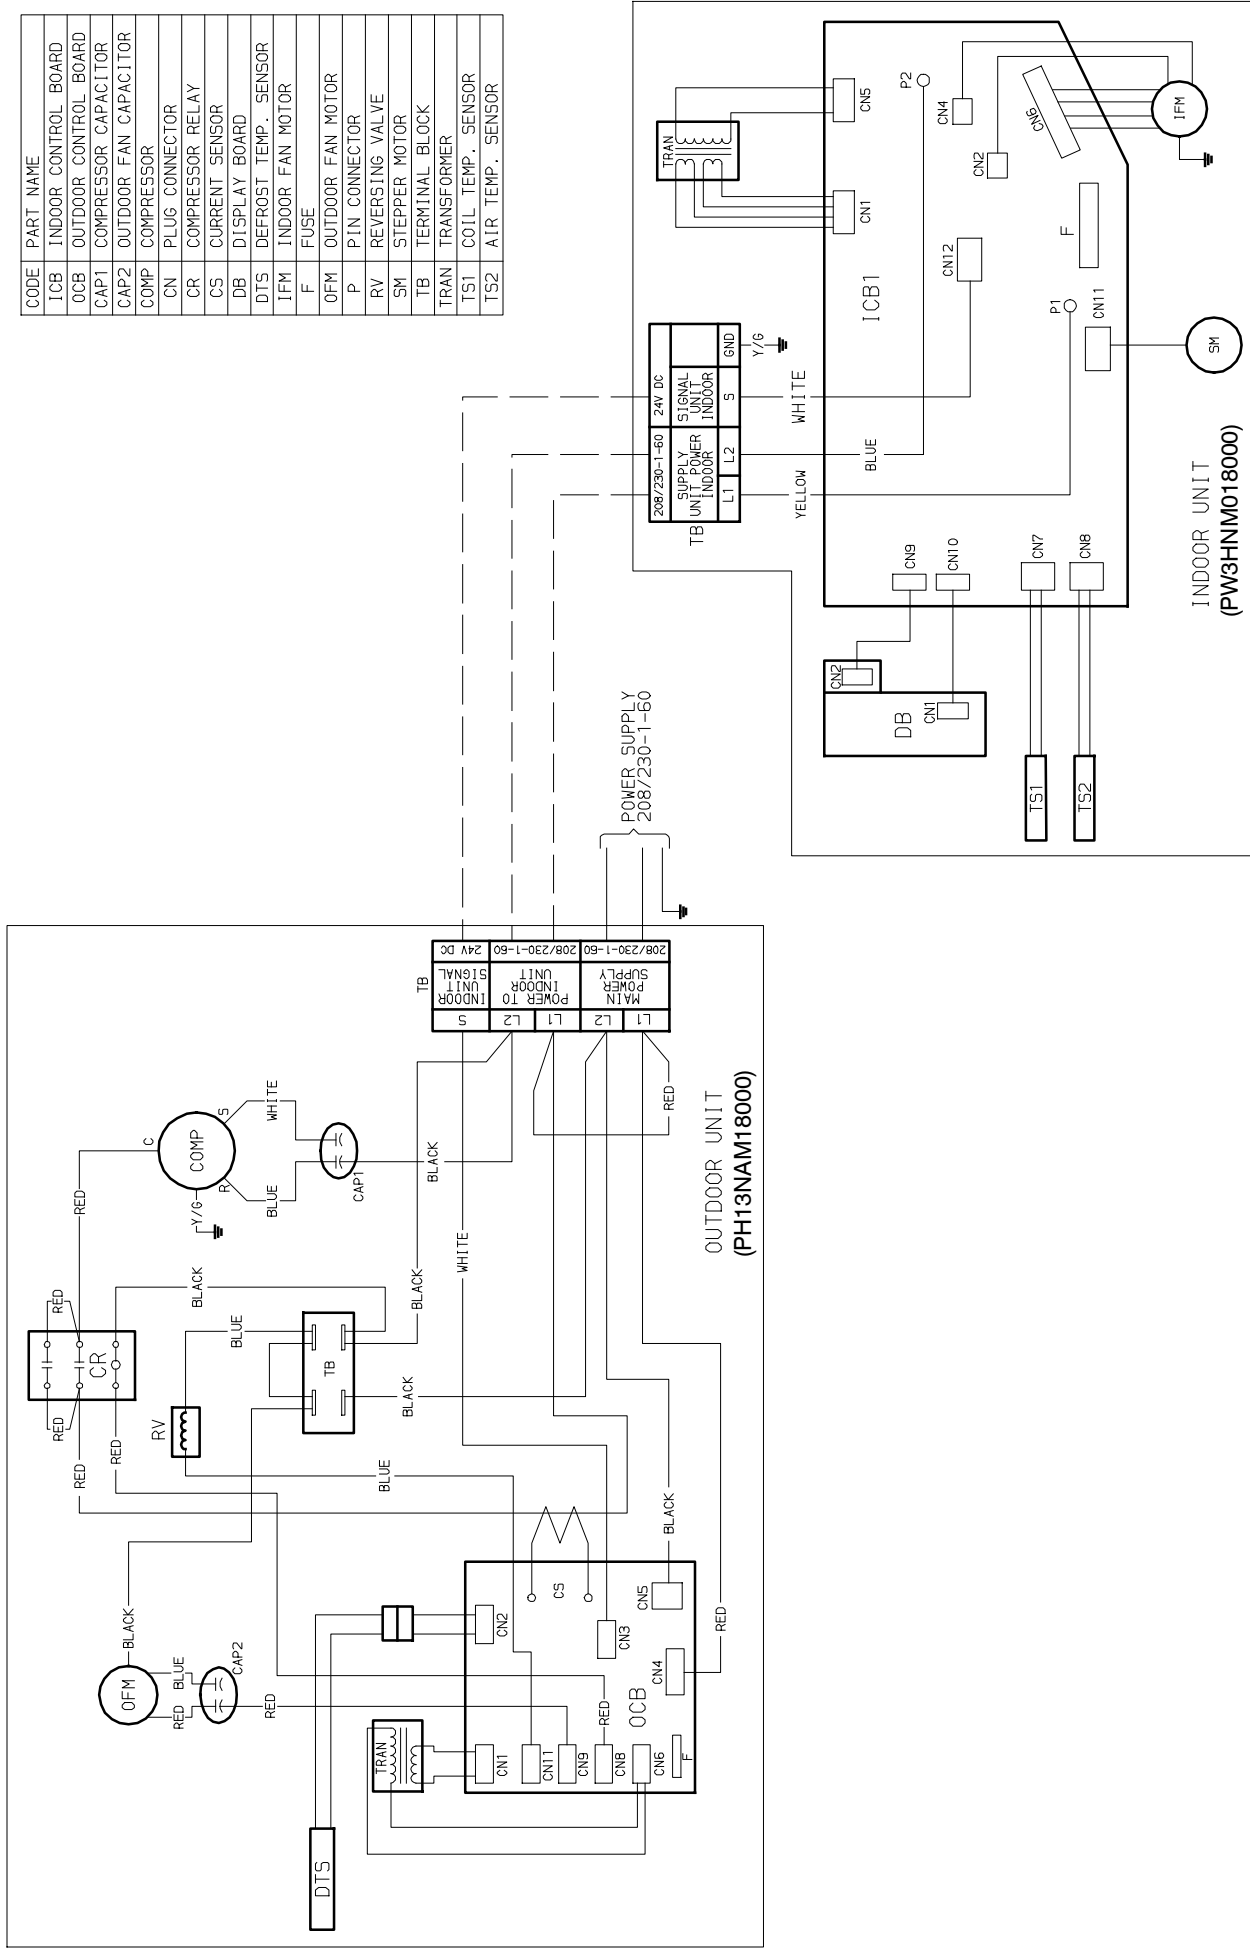


Fig. 11 – Wiring Diagram PH13NAM18000 W/ PW3HNM018000

WIRING DIAGRAMS (CONT.)

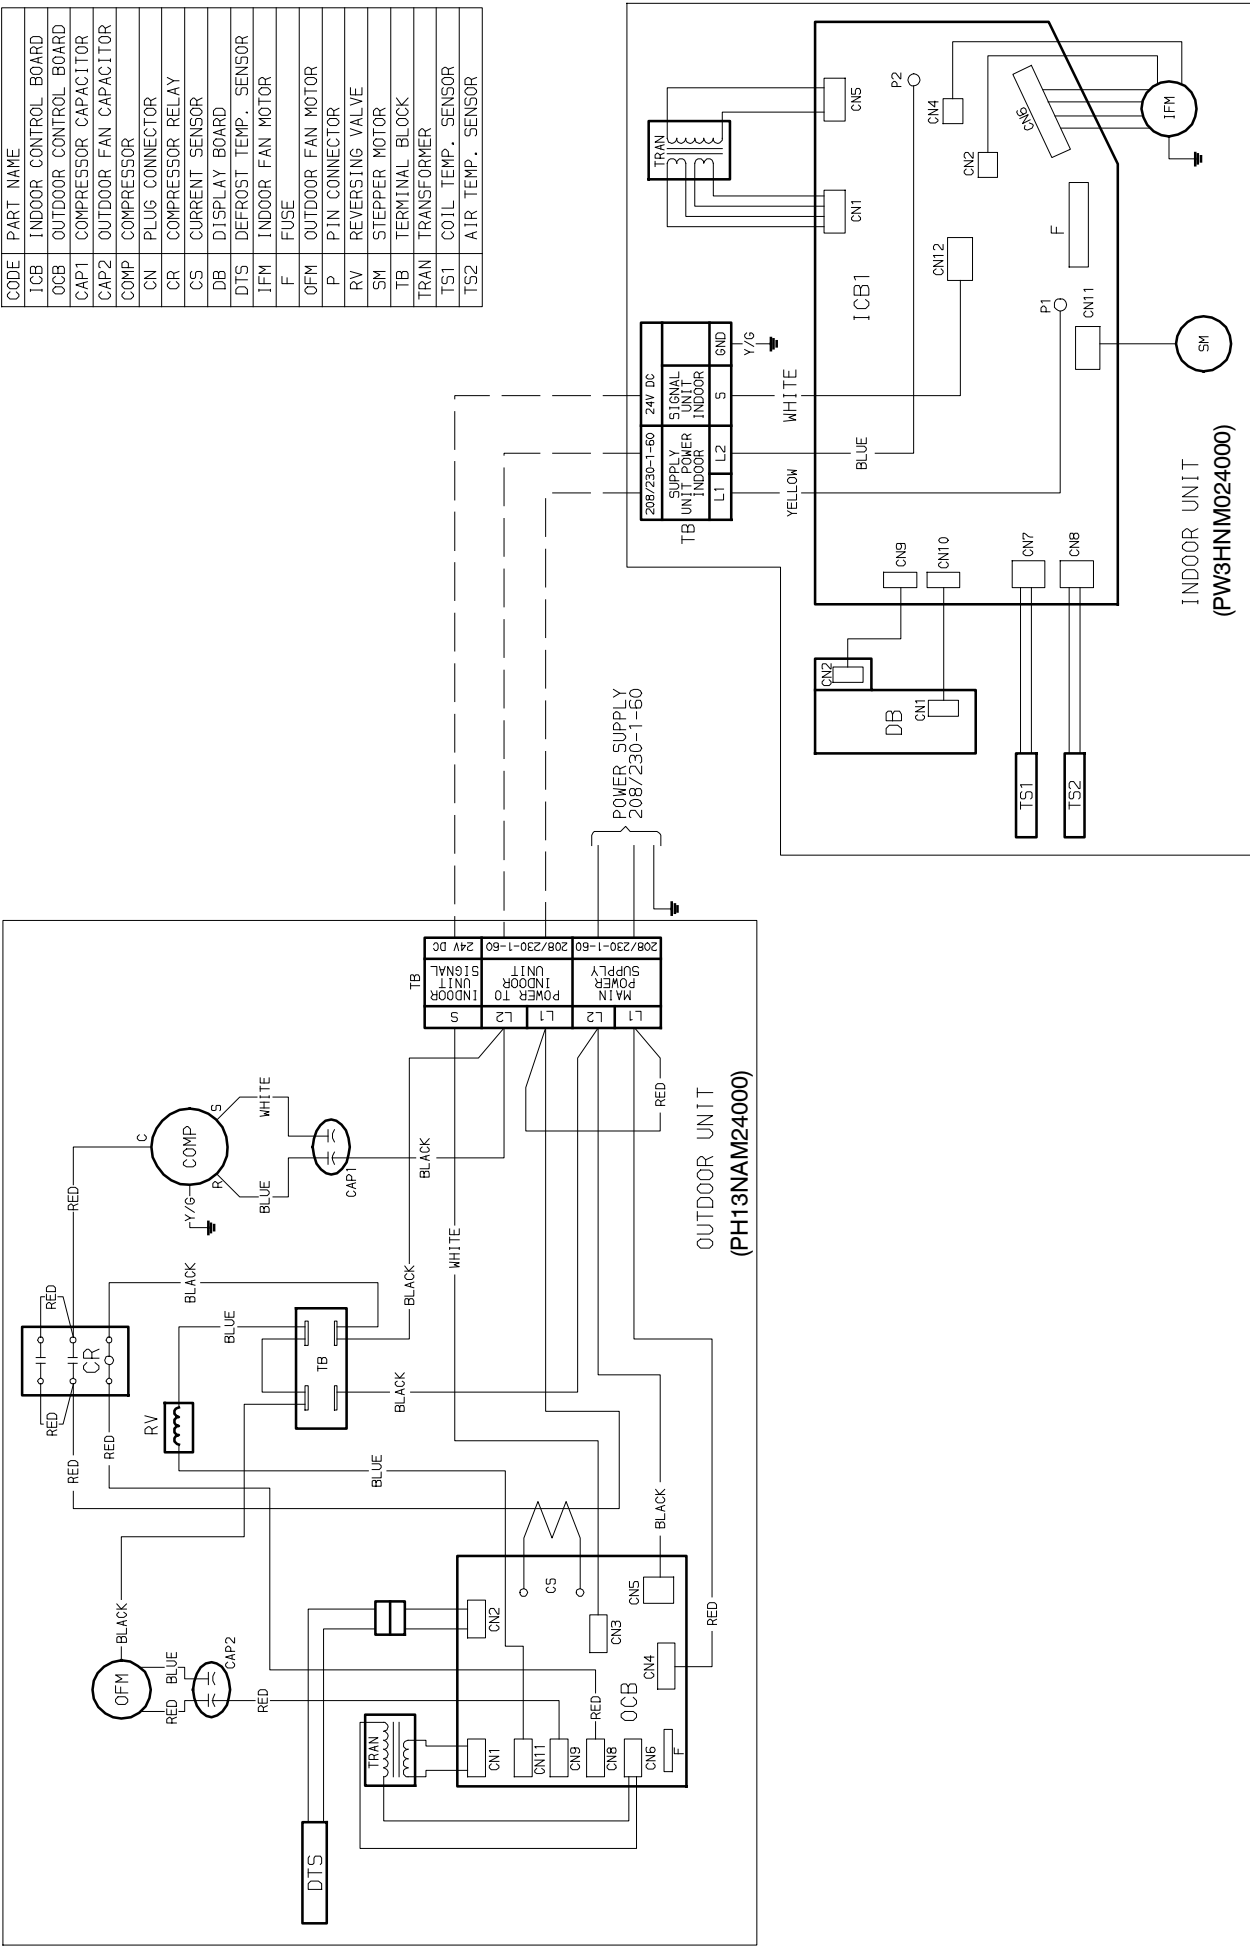


Fig. 12 – Wiring Diagram PH13NAM24000 W/ PW3HNM024000

GUIDE SPECIFICATIONS

INDOOR WALL-MOUNTED DUCT-FREE UNITS

Size Range: 3/4 to 2 Ton Nominal Cooling Capacity / 3/4 to 2 Ton Nominal Heating Capacity

Payne Model Number: PA13AAM, PA13NAM, PH13AAM, PH13NAM

PART 1 - GENERAL

1.01 System Description

Indoor, wall-mounted, direct-expansion fan coils are matched with cooling only or heat pump outdoor unit .

1.02 Agency Listings

Unit shall be rated per ARI Standards 210/240 and listed in the ARI directory as a matched system.

1.03 Delivery, Storage, And Handling

Units shall be stored and handled per unit manufacturer's recommendations.

1.04 Warranty (For Inclusion By Specifying Engineer)

PART 2 - PRODUCTS

2.01 Equipment

A. General:

Indoor, direct-expansion, wall-mounted fan coil. Unit shall be complete with cooling/heating coil, fan, fan motor, piping connectors, electrical controls, microprocessor control system, and integral temperature sensing. Unit shall be furnished with integral wall mounting bracket and mounting hardware.

B. Unit Cabinet:

Cabinet discharge and inlet grilles shall be attractively styled, high-impact polystyrene. Cabinet shall be fully insulated for improved thermal and acoustic performance.

C. Fans:

1. Fan shall be tangential direct-drive blower type with air intake at the top of the unit and discharge at the bottom front. Automatic, motor-driven vertical air sweep shall be provided standard.
2. Air sweep operation shall be user selectable. The vertical sweep may be adjusted (using the remote control) and the horizontal air direction may be set manually.

D. Coil:

Coil shall be copper tube with aluminum fins and galvanized steel tube sheets. Fins shall be bonded to the tubes by mechanical expansion. A drip pan under the coil shall have a drain connection for hose attachment to remove condensate. Condensate pan shall have internal trap.

E. Motors:

Motors shall be open drip-proof, permanently lubricated ball bearing with inherent overload protection. Fan motors shall be 3-speed.

F. Controls:

Controls shall consist of a microprocessor-based control system which shall control space temperature, determine optimum fan speed, and run self diagnostics. the temperature control range shall be from 62°F to 84°F (16.67°C to 28.89°C).

The unit shall have the following functions as a minimum:

1. An automatic restart after power failure at the same operating conditions as at failure.
2. A timer function to provide a minimum 24-hour timer cycle for system Auto Start/Stop.
3. Temperature-sensing controls shall sense return air temperature.
4. Indoor coil freeze protection.
5. Wireless infrared remote control to enter set points and operating conditions.
6. Automatic air sweep control to provide on or off activation of air sweep louvers.
7. Dehumidification mode shall provide increased latent removal capability by modulating system operation and set point temperature.
8. Fan-only operation to provide room air circulation when no cooling is required.
9. Diagnostics shall provide continuous checks of unit operation and warn of possible malfunctions. Error messages shall be displayed at the unit.
10. Fan speed control shall be user-selectable: high, medium, low, or microprocessor controlled automatic operation during all operating modes.
11. Automatic heating-to-cooling changeover in heat pump mode. Control shall include deadband to prevent rapid mode cycling between heating and cooling.
12. Indoor coil high temperature protection shall be provided to detect excessive indoor discharge temperature when unit is in heat pump mode.

G. Filters:

Unit shall have filter track with factory-supplied cleanable filters.

H. Electrical Requirements:

Indoor fan motor to operate on 35VDC on model sizes 009-012 and on 208-230v on model sizes 018-024, power is supplied from outdoor unit.

I. Operating Characteristics:

The PA(H)13 / PW3C(H) system shall have a minimum listed SEER (seasonal energy efficiency ratio) of 13 at ARI conditions, and a minimum HSPF of 7.7.

J. Refrigerant Lines:

All units should have refrigerant lines that can be oriented to connect from the left, right or back of unit. Both refrigerant lines need to be insulated.

K. Special Features (Field Installed):

1. Condensate Pump:
 - The condensate pump shall remove condensate from the drain pan when gravity drainage cannot be used. Pump shall be designed for quiet operation. Pump shall consist of two parts: an internal reservoir/sensor assembly, and a remote sound-shielded pump assembly. A liquid level sensor in the reservoir shall stop cooling operation if the liquid level in the reservoir is unacceptable.

PA(H)13A(N)AM / PW3C(H)A(N)M

GUIDE SPECIFICATIONS

HORIZONTAL DISCHARGE OUTDOOR UNITS

Size Range: 3/4 to 2 Ton Nominal Cooling Capacity / 3/4 to 2 Ton Nominal Heating Capacity

Payne Model Number: PW3CAM, PW3CNM, PW3HAM, PW3HNM

PART 1 - GENERAL

1.01 System Description

- A. Outdoor air-cooled split system compressor sections suitable for on-the-ground, rooftop, wall hung or balcony mounting. Units shall consist of a rotary compressor, an air-cooled coil, propeller-type draw-through outdoor fan, reversing valve (HP), accumulator (HP units), metering device(s), and control box. Units shall discharge air horizontally as shown on the contract drawings. Units shall function as the outdoor component of an air-to-air cooling only, or heat pump system.
- B. Units shall be used in a refrigeration circuit matched to duct-free cooling only or heat pump fan coil units.

1.02 Agency Listings

- A. Unit construction shall comply with ANSI/ASHRAE 15, latest revision, and with the NEC.
- B. Units shall be evaluated in accordance with UL standard 1995.
- C. Units shall be listed in the CEC directory.
- D. Unit cabinet shall be capable of withstanding 500-hour salt spray test per Federal Test Standard No. 141 (method 6061).
- E. Air-cooled condenser coils shall be leak tested at 573 psig.

1.03 Delivery, Storage, And Handling

Units shall be shipped in one piece and shall be stored and handled per unit manufacturer's recommendations.

1.04 Warranty (For Inclusion By Specifying Engineer)

PART 2 - PRODUCTS

2.01 Equipment

A. General:

Factory assembled, single piece, air-cooled outdoor unit. Contained within the unit enclosure shall be all factory wiring, piping, controls, and the compressor.

B. Unit Cabinet:

- 1. Unit cabinet shall be constructed of galvanized steel, bonderized and coated with a baked-enamel finish on inside and outside.
- 2. Unit access panels shall be removable with minimal screws and shall provide full access to the compressor, fan, and control components.
- 3. Outdoor compartment shall be isolated and have an acoustic lining to assure quiet operation.

C. Fans:

- 1. Outdoor fans shall be direct-drive propeller type, and shall discharge air horizontally. Fans shall draw air through the outdoor coil.
- 2. Outdoor fan motors shall be totally-enclosed, single phase motors with class B insulation and permanently-lubricated ball bearings. Motor shall be protected by internal thermal overload protection.
- 3. Shaft shall have inherent corrosion resistance.

- 4. Fan blades shall be non metallic and shall be statically and dynamically balanced.
- 5. Outdoor fan openings shall be equipped with PVC metal/mesh coated protection grille over fan.

D. Compressor:

- 1. Compressor shall be fully hermetic rotary type.
- 2. Compressor shall be equipped with oil system, operating oil charge, and motor. Internal overloads shall protect the compressor from over-temperature and over-current.
- 3. Motor shall be NEMA rated class F, suitable for operation in a refrigerant atmosphere.
- 4. Compressor assembly shall be installed on rubber vibration isolators.
- 5. Compressors shall be single phase.

E. Outdoor Coil:

Coil shall be constructed of aluminum fins mechanically bonded to seamless copper tubes, which are cleaned, dehydrated, and sealed.

F. Refrigeration Components:

Refrigerant circuit components shall include brass external liquid line service valve with service gage port connections, suction line service valve with service gage connection port, service gage port connections on compressor suction and discharge lines with Schrader type fittings with brass caps, accumulator, reversing valve.

G. Controls and Safeties:

Operating controls and safeties shall be factory selected, assembled, and tested. The minimum control functions shall include the following:

- 1. Controls:
 - a. A time delay control sequence is provided standard through the fan coil board.
 - b. Automatic outdoor-fan motor protection.
- 2. Safeties:
 - a. System diagnostics.
 - b. Compressor motor current and temperature overload protection.
 - c. Outdoor fan failure protection.

H. Electrical Requirements:

- 1. Unit shall operate on single-phase, 60 Hz power at 115 v for unit sizes 009-012 and 208/230v for unit sizes 018, and 024, as specified.
- 2. Unit electrical power shall be a single point connection.
- 3. Unit control voltage to the indoor-fan coil shall be 24 VDC.
- 4. All power and control wiring must be installed per NEC and all local electrical codes.
- 5. Unit shall have high- and low-voltage terminal block connections.

I. Special Features (Field Installed):

- 1. Crankcase Heater
- 2. Wind baffle (field fabricated)