

If the 'TIME ONLY' resistor is used in place of the Outdoor Temperature Sensor, the Controller's operation is determined by the adjustable timer settings only – the Controller does not limit the operation based on the temperature and humidity limits shown in Figure 3.

If a jumper wire is used in place of the Outdoor Temperature Sensor, the Controller will disregard the temperature setting and base the ventilation on the indoor relative humidity and the user-adjustable timer settings. In this application, the Controller will not ventilate when the indoor relative humidity rises above 55%.

IV. LIMITED WARRANTY

Your Research Products Corporation Aprilaire® Ventilation Controller is expressly warranted for two (2) year from date of installation to be free from defects.

Research Products Corporation's exclusive obligation under this warranty shall be to supply, without charge, a replacement for the Controller which is found to be defective within two (2) year period and which is returned not later than thirty (30) days after said two (2) year period by you to either your original supplier or to Research Products Corporation, Madison, Wisconsin 53701, together with the installation date of the Controller.

THIS WARRANTY SHALL NOT OBLIGATE RESEARCH PRODUCTS CORPORATION FOR ANY LABOR COSTS AND SHALL NOT APPLY TO DEFECTS IN WORKMANSHIP OR MATERIALS FURNISHED BY YOUR INSTALLER AS CONTRASTED TO DEFECTS IN THE CONTROLLER ITSELF. IMPLIED WARRANTIES OF MERCHANTABILITY OR FITNESS FOR A PARTICULAR PURPOSE SHALL BE LIMITED IN DURATION TO THE AFORESAID ONE YEAR PERIOD. RESEARCH PRODUCTS CORPORATION'S LIABILITY FOR INCIDENTAL OR CONSEQUENTIAL DAMAGES, OTHER THAN DAMAGES FOR PERSONAL INJURIES, RESULTING FROM ANY BREACH OF THE AFORESAID IMPLIED WARRANTIES OR THE ABOVE LIMITED WARRANTY IS EXPRESSLY EXCLUDED. THIS LIMITED WARRANTY IS VOID IF DEFECT(S) RESULT FROM FAILURE TO HAVE THIS UNIT INSTALLED BY A QUALIFIED HEATING AND AIR CONDITIONING CONTRACTOR. IF THE LIMITED WARRANTY IS VOID DUE TO FAILURE TO USE A QUALIFIED CONTRACTOR, ALL DISCLAIMERS OF IMPLIED WARRANTIES SHALL BE EFFECTIVE UPON INSTALLATION.

Some states do not allow limitations on how long an implied warranty lasts or the exclusion or limitation of incidental or consequential damages so the above exclusion or limitations may not apply to you.

This warranty gives you specific legal rights and you may also have other rights which vary from state to state.

WARRANTY REGISTRATION

Please... Take a few minutes to visit us on-line at
Aprilaire.com
to register your Aprilaire product.

If you do not have on-line access, please mail a postcard
with your name, address, phone number, product purchased
and date of purchase to:

Research Products Corporation
P.O. BOX 1828
Madison, WI 53701

Thank you!

Your Warranty Registration information will not be sold or shared outside of this company.

10005994
B2203172




RESEARCH PRODUCTS CORPORATION

1015 E. WASHINGTON AVE. • MADISON, WI 53703 • PHONE: 608/257-8801 • FAX: 608/257-4357 • www.aprilaire.com

Aprilaire®

Ventilation Controller

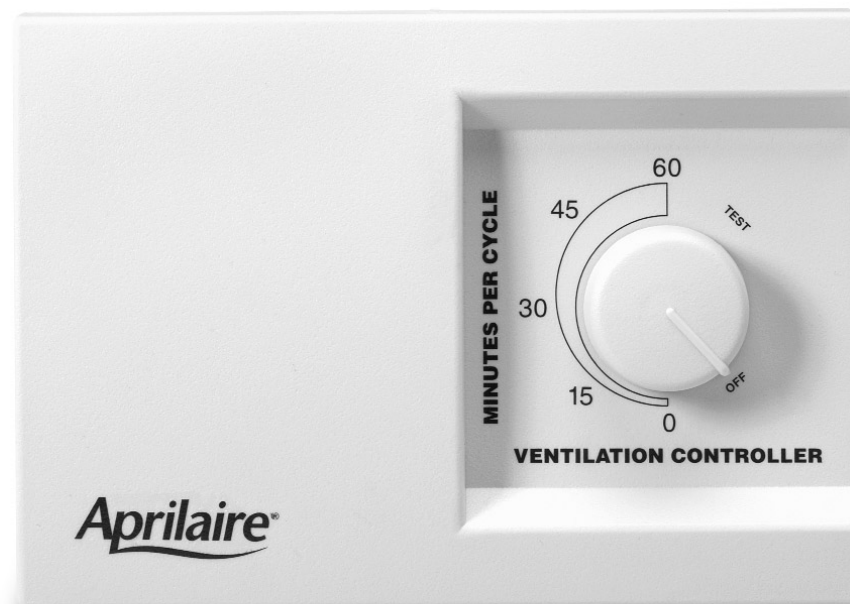

Model 8120 Ventilation Controller Owner's Manual

**Includes Safety & Operating Instructions
and Warranty Information**

WARNING

120 volts may cause injury from electrical shock. Disconnect power before servicing.

CAUTION

Sudden operation may cause personal injury or property damage. Turn Ventilation Controller to "OFF" before servicing.

READ AND SAVE THESE INSTRUCTIONS

