


INSTALLATION LED POWER SUPPLY - QZ-DMX



TOP VIEW

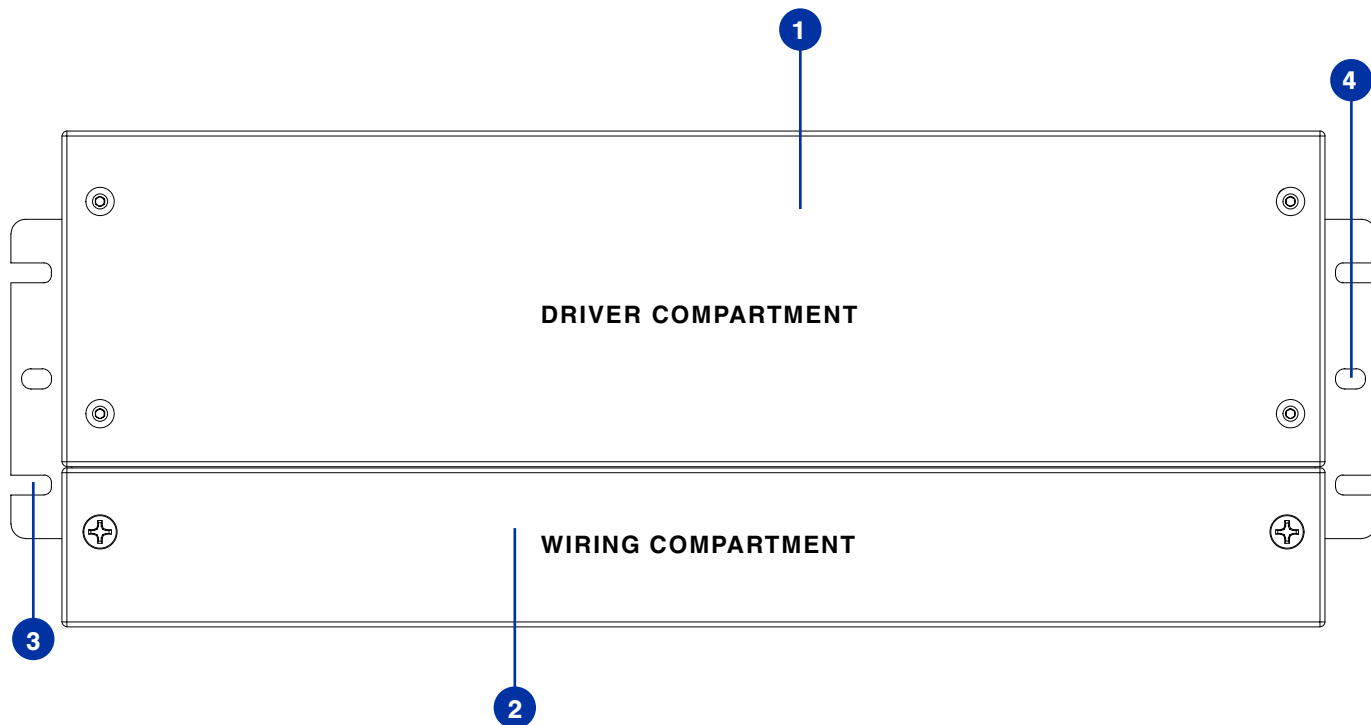

- Must be installed by licensed electrician.
- Installation must be in accordance with DMX512-A standard
- DMX Shield must be grounded to Earth Ground at a single point external to power supply

QZ Components

- | | | | |
|----------------------|----------------------|----------------------|----------------------|
| 1 Driver Compartment | 2 Wiring Compartment | 3 Mounting Tab Slots | 4 Mounting Tab Holes |
|----------------------|----------------------|----------------------|----------------------|


INSTALLATION LED POWER SUPPLY - QZ-DMX



Required Hardware




Mounting Foot:

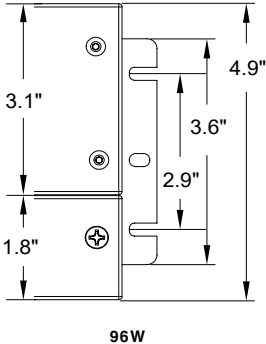


Mounting

- 1 The QZ-DMX can be mounted either vertically or horizontally, utilizing the supplied screws and the mounting tabs on the bottom of the enclosure

CENTER HOLE

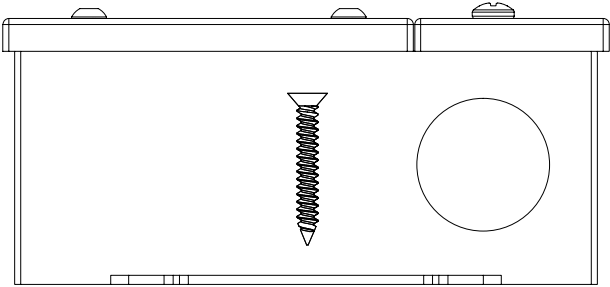


SIDE SLOTS

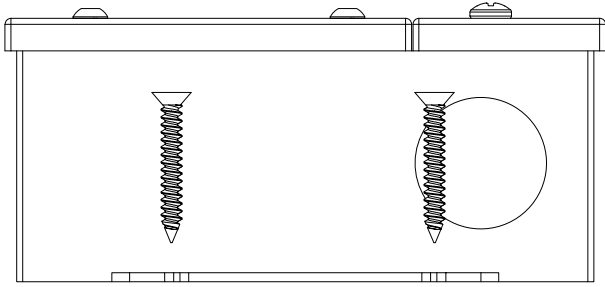


- 2 The QZ must be mounted into a stud for sufficient support, using either the center holes or the slots of each mounting tab

CENTER HOLE

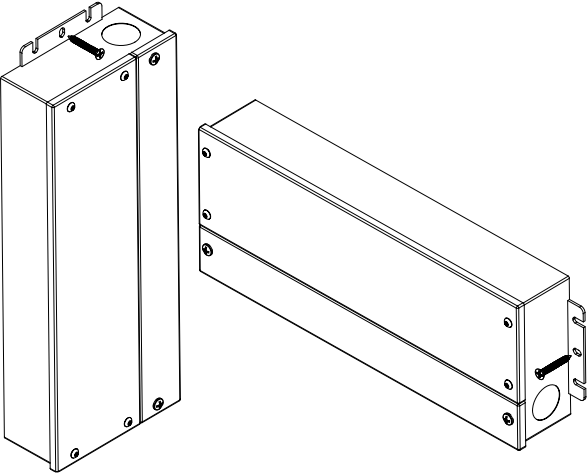


SIDE SLOTS

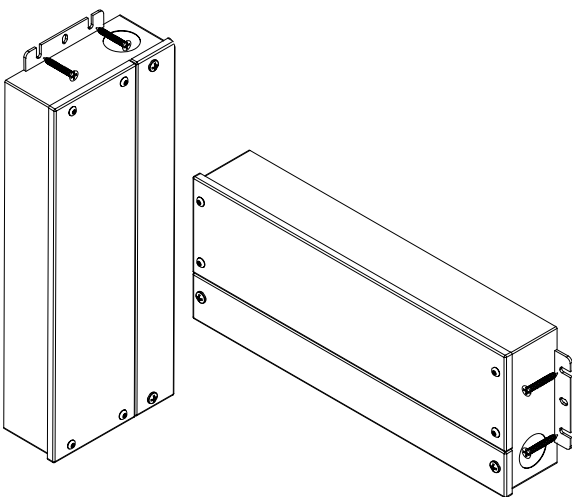


INSTALLATION LED POWER SUPPLY - QZ-DMX



- 3 When installing multiple QZ power supplies, separate the enclosures by 3" of space from edge to edge. This prevents the rise of ambient temperature between the power supplies.

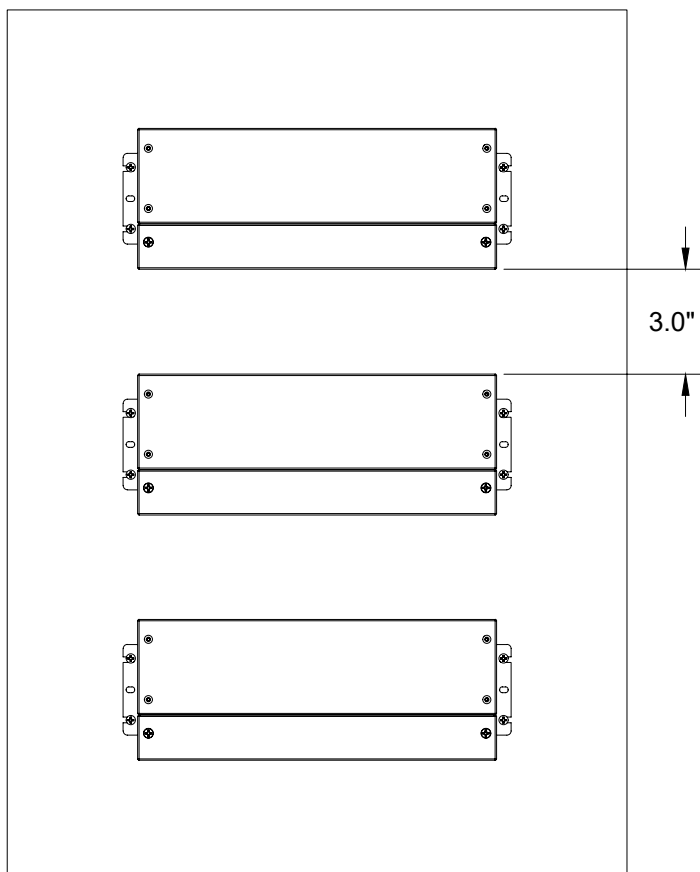

Horizontal mount illustrated above




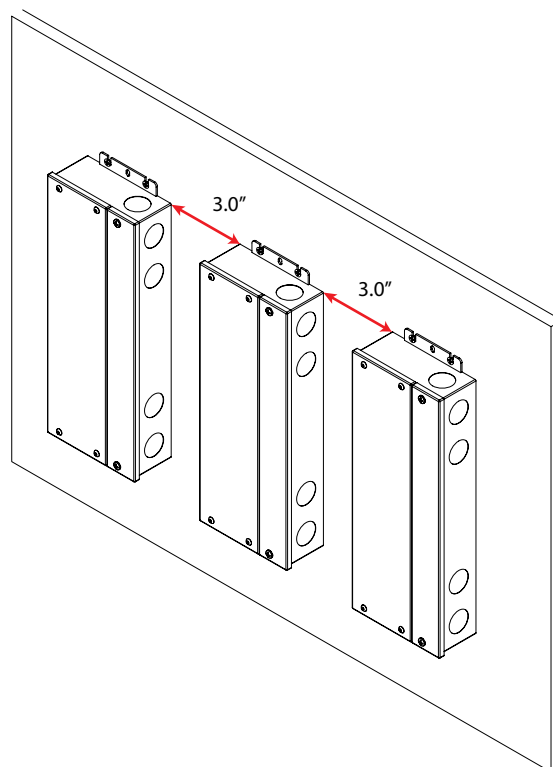


Vertical mount illustrated above

INSTALLATION LED POWER SUPPLY - QZ-DMX



4 Wiring diagram

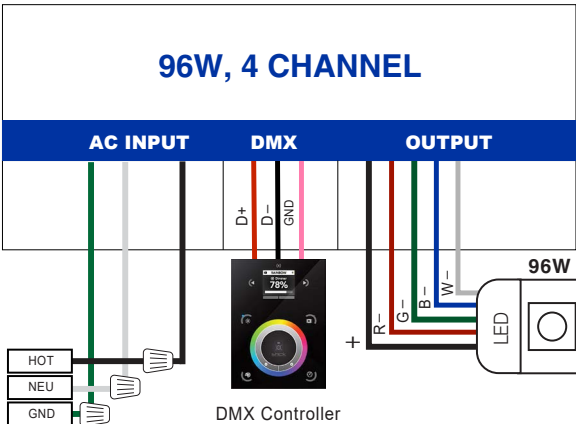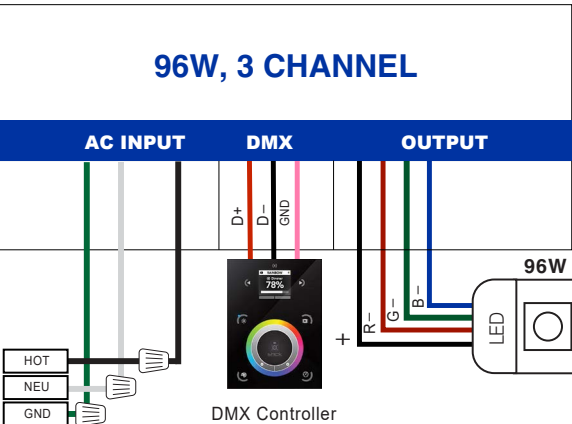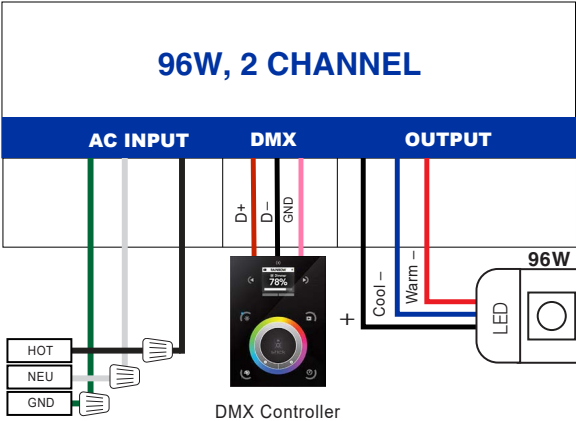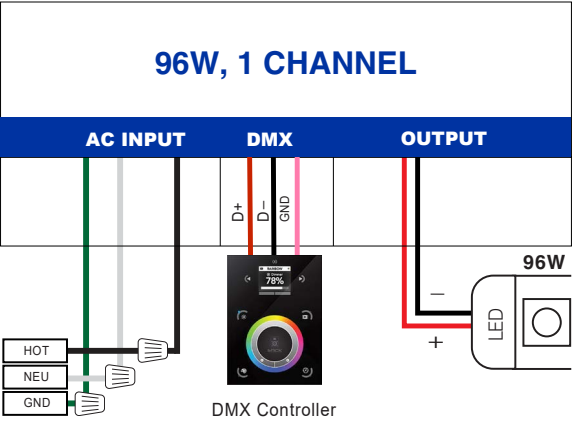


Wiring from power supply to light fixture must be single multiconductor cable

INSTALLATION LED POWER SUPPLY - QZ-DMX



QZ-DMX 96W

TOP VIEW

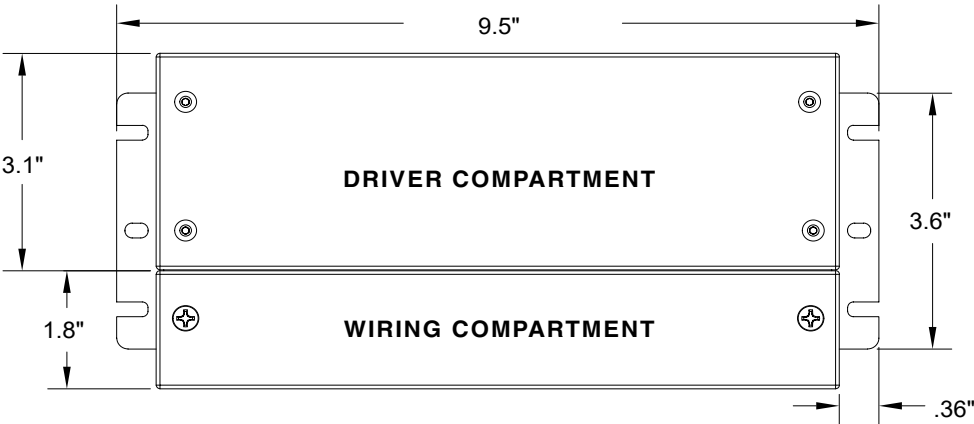

WIRING COMPARTMENT VIEW

