

1. DESCRIPTION

The BA584G is a field mounting general purpose, two input Rate Totaliser which will function with a wide variety of sensors. The instrument can display rate of flow and total flow of the two inputs and their sum or difference.


This abbreviated instruction sheet is intended to assist with installation, a comprehensive instruction manual describing system design and configuration may be downloaded from the BEKA website or may be requested from the BEKA sales office.

2. INSTALLATION


The BA584G Rate Totaliser has a robust IP66 glass reinforced polyester (GRP) carbon loaded enclosure incorporating an armoured glass window & stainless steel fittings. It is suitable for exterior surface mounting in most industrial environments, or pipe mounting using an accessory kit.

If the enclosure is not bolted to an earthed post or structure, the earth terminal on the cable entry bonding plate, which may be assembled on the inside or outside of the enclosure, should be connected to local earthed metalwork or to the plant's potential equalising conductor.


Terminals A1, A2, A3 and A4 are only fitted when the Rate Totaliser includes optional alarms. Similarly terminals C1, C2, C3 and C4 are only fitted when the instrument has an optional 4/20mA output. See full manual for details.




Step A
Unscrew the four captive 'A' screws and separate the indicator assembly and the back-box.



Step B
Secure the enclosure back-box to a flat surface with M6 screws through the four 'B' holes. Alternatively use a pipe mounting kit.



Step C
Remove the temporary hole plug and install an appropriate IP rated cable gland or conduit fitting. Feed the field wiring through the cable entry.



Step D
Terminate field wiring on the instrument assembly. Replace the assembly on the enclosure back-box and tighten the four 'A' screws.

Fig 1 BA584G installation procedure

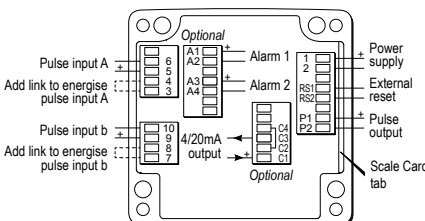

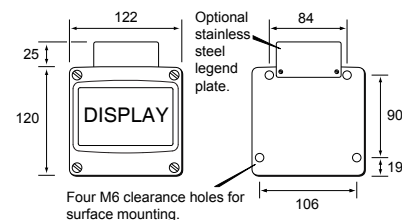


Fig 2 Dimensions and terminal connections

EMC

For specified immunity all wiring should be in screened twisted pairs with screens earthed at one point.

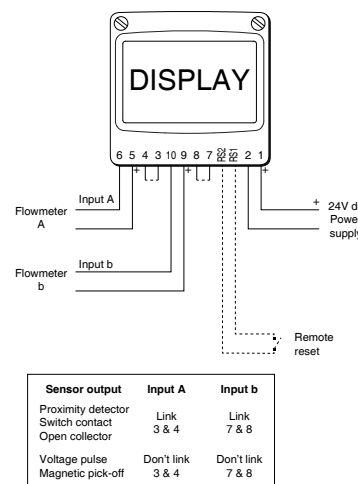


Fig 3 Typical measurement loop

Scale card

The instrument's units of measurement and tag information are shown above the display on a slide-in scale card. New instruments are fitted with a scale card showing the information specified when the instrument was ordered, if this was not provided a blank scale card will be fitted which can easily be marked on-site. Custom printed scale cards are available from BEKA associates.

To remove the scale card carefully pull the tab perpendicularly away from the instrument assembly. See Fig 2 for the location of the scale card tab.

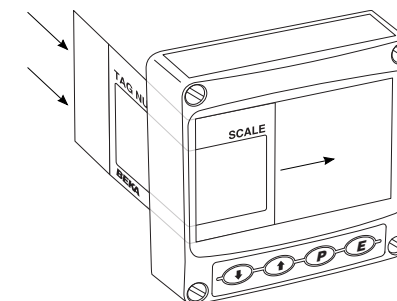


Fig 4 Inserting scale card into instrument assembly

To replace the scale card carefully insert it into the slot shown in Fig 2. Force should be applied evenly to both sides of the scale card to prevent it twisting. The card should be inserted until about 2mm of the transparent tab remains protruding.

3. OPERATION


The BA584G is controlled and configured via four front panel push buttons. In the display mode i.e. when the instrument is displaying flow the push button functions are:

- ▼ or ▲ Scrolls both displays between:
Input R
Input b
Input R + b or Input R - b which is configurable
- ⏏ + ▼ Grand total - shows L0 followed by the least significant 8 digits of a 16 grand total.
- ⏏ + ▲ Grand total - shows H, followed by the most significant 8 digits of a 16 digit grand total. If buttons are pressed for longer than 10 seconds the grand total will be reset to zero if the grand total reset function [Lr Rst] is enabled.
- To reset the grand total to zero from the operating mode press the ⏏ and ▲ buttons for ten seconds until [Lr Rst] is displayed. Using the ▼ or ▲ button change the display to [Lr Rst] and press ⏏ which will reset the grand total and restore the original display.
- ▼ + ▲ If the local total reset function [Lr Rst] is enabled in the configuration menu, simultaneously pressing the ▼ and ▲ buttons for more than three seconds allows total R, total b or both totals to be selected by operating the ▼ or ▲ button. Operating the ⏏ button will then reset the selected total to zero and clear any stored output pulses.
- ⏏ + ▼ Shows each for 2 seconds:
Firmware and version numbers
Function of instrument: [Lr Rst]
Options fitted
- R Alarm outputs
- P Pulse output (always fitted)
- C 4/20mA output
- ⏏ + ▼ Provides direct access to the alarm setpoints when the Rate Totaliser is fitted with optional alarms and the [Lr Rst] setpoints function has been enabled.
- ⏏ + ⏏ Access to configuration menu

The BA584G is CE marked to show compliance with the EMC Directive 2014/30/EU.

Issue 2
18th July 2017

BEKA associates Ltd. Old Charlton Rd, Hitchin, Hertfordshire, SG5 2DA, UK Tel: +44(0)1462 438301 Fax: +44(0)1462 453971 e-mail: sales@beka.co.uk web: www.beka.co.uk

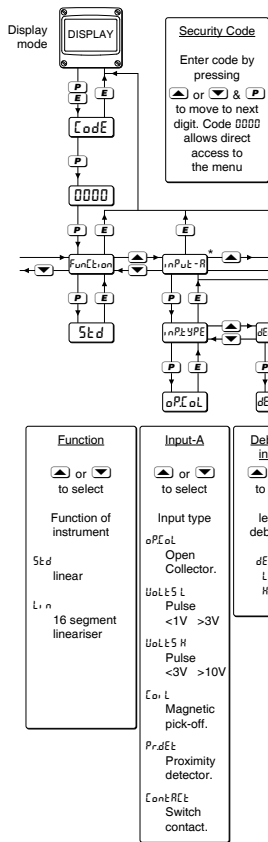

4. CONFIGURATION


Rate Totalisers are supplied configured as requested at time of ordering, if not specified default configuration will be supplied but can easily be changed on-site. Fig 5 shows the location of each function within the configuration menu with a brief summary of the function. Please refer to the full instruction manual for detailed configuration information and for description of optional outputs. Access to the configuration menu is obtained by pressing the P and E buttons simultaneously. If the Rate Totaliser's security code is set to default 0000 the first parameter Funct, on will be displayed. If the instrument is protected by a security code, CodE will be displayed. The four digit code must be entered to gain access to the menu.

* Followed by identical function for input b

When fitted with optional alarms functions appear here

When fitted with optional 4/20mA output functions appear here

Unless otherwise specified menu functions are shown on the upper display

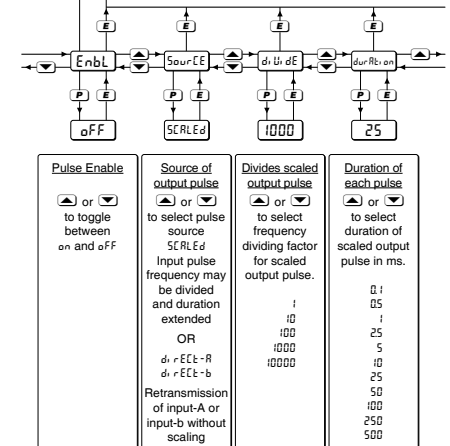

SCRLd is not available when R-b is selected in the Count function.

These functions only appear in sub-menu when pulse source is conditioned as SCRLd.



Manuals and datasheets can be downloaded from <http://www.beka.co.uk/ba584g>

Fig 5 Configuration menu