









Floor standing enclosures

Combinable one glazed door and swingframe

MOUNTING INSTRUCTIONS

7697-0318-02 REV. 0

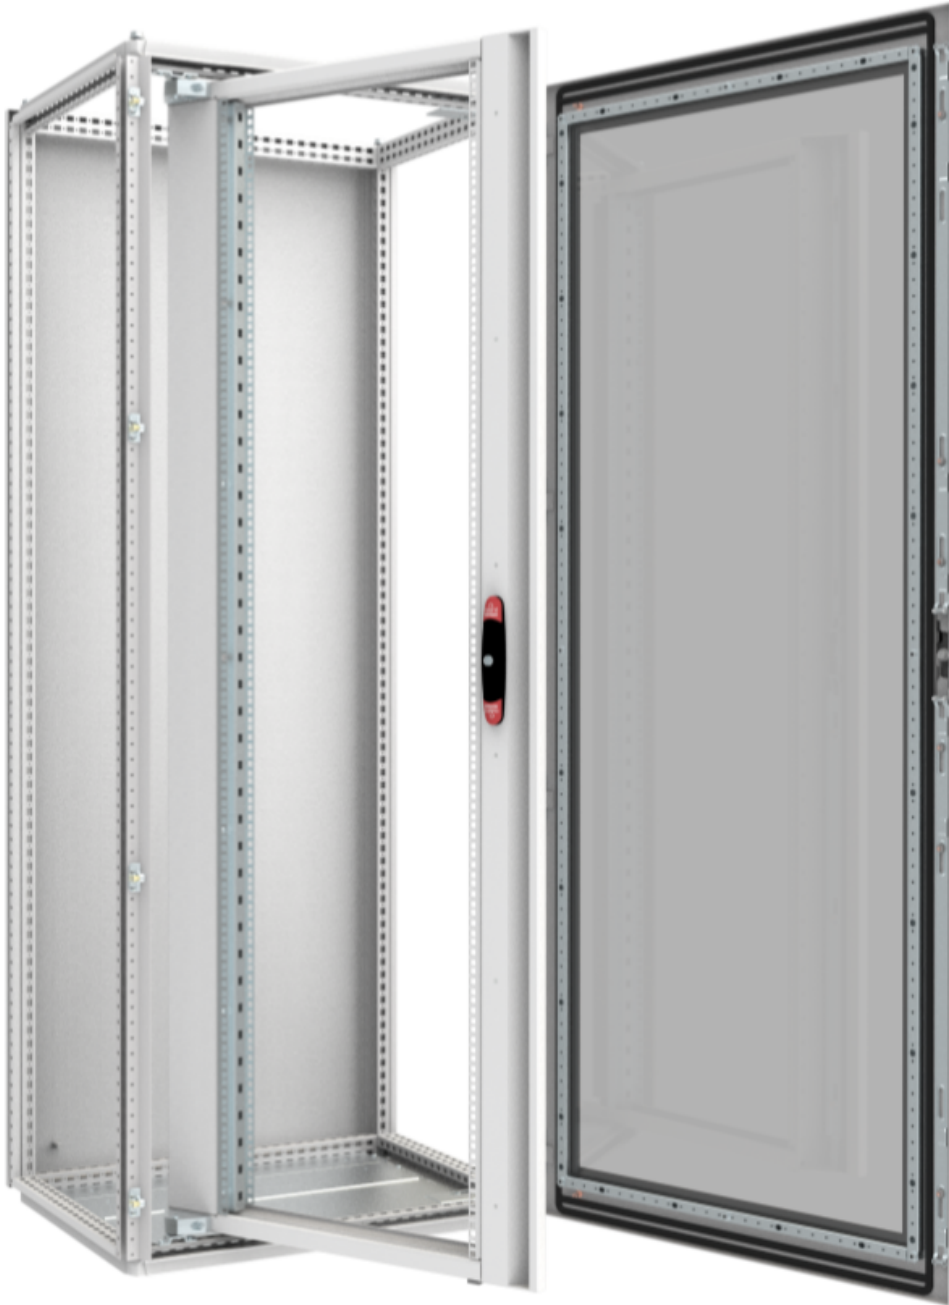


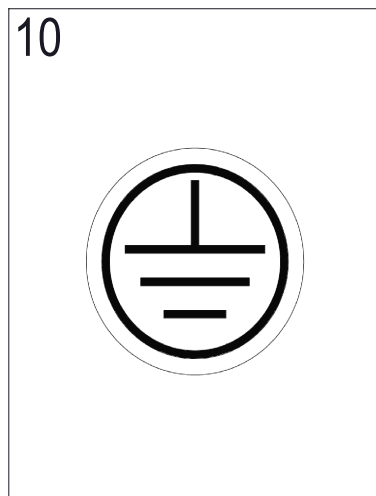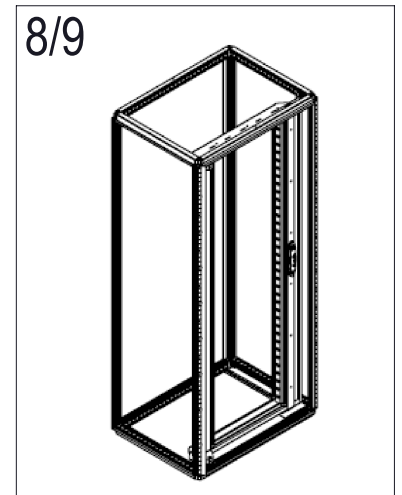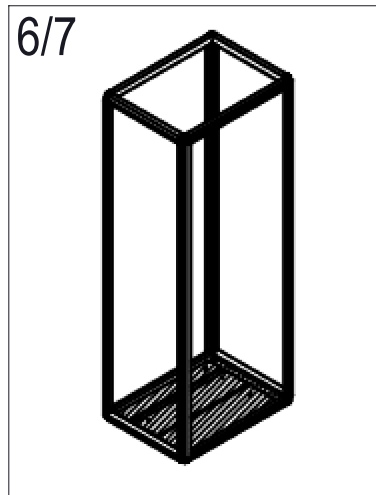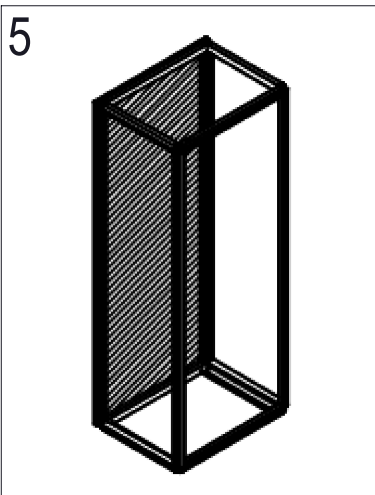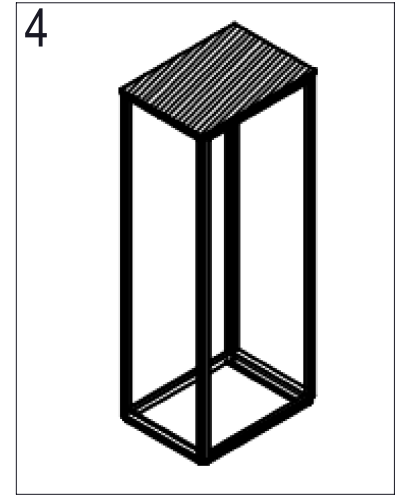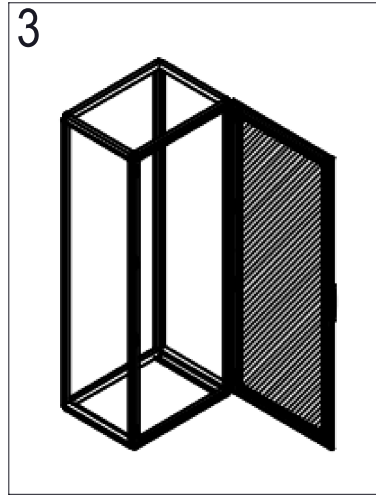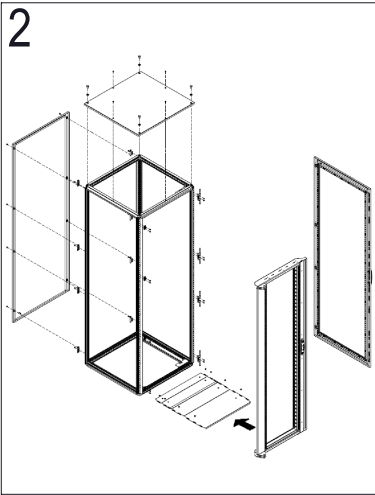

WARNING: When mounting on or over a combustible surface, a floor plate of at least 1.43 mm galvanized or 1.6 mm uncoated steel extended at least 150 mm beyond the equipment on all sides must be installed.

WARNING: In order to maintain the enviromental integrity of the enclosure, devices with the same enviromental ratings shall be used to close openings in customized enclosure.



MCS DGSFM

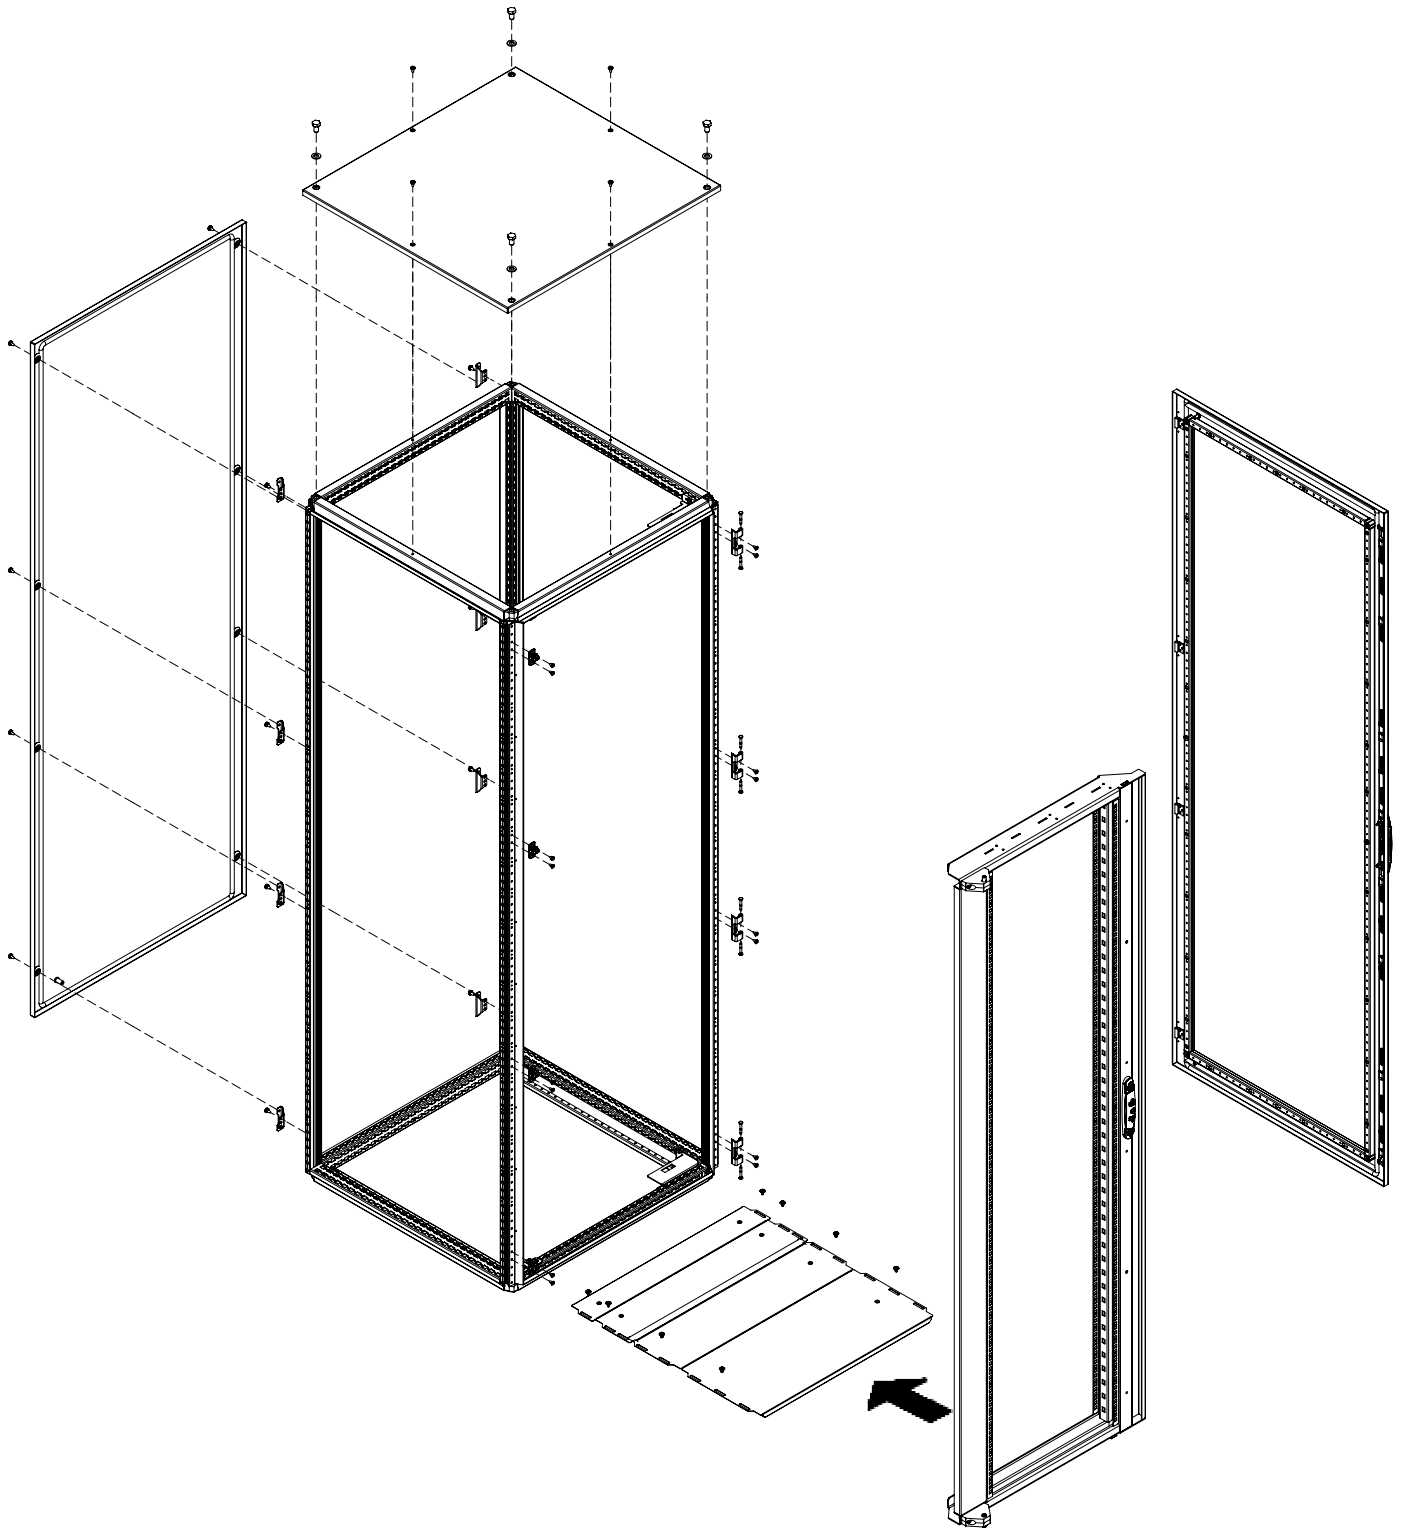




GLAZED DOOR


Ref.	Pic.	Qty.
A		4
B		4
C	M6x12	16

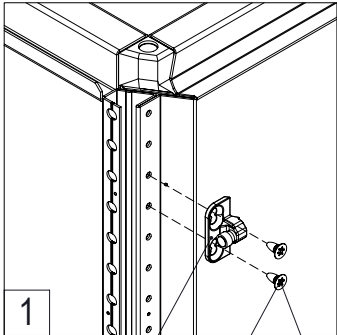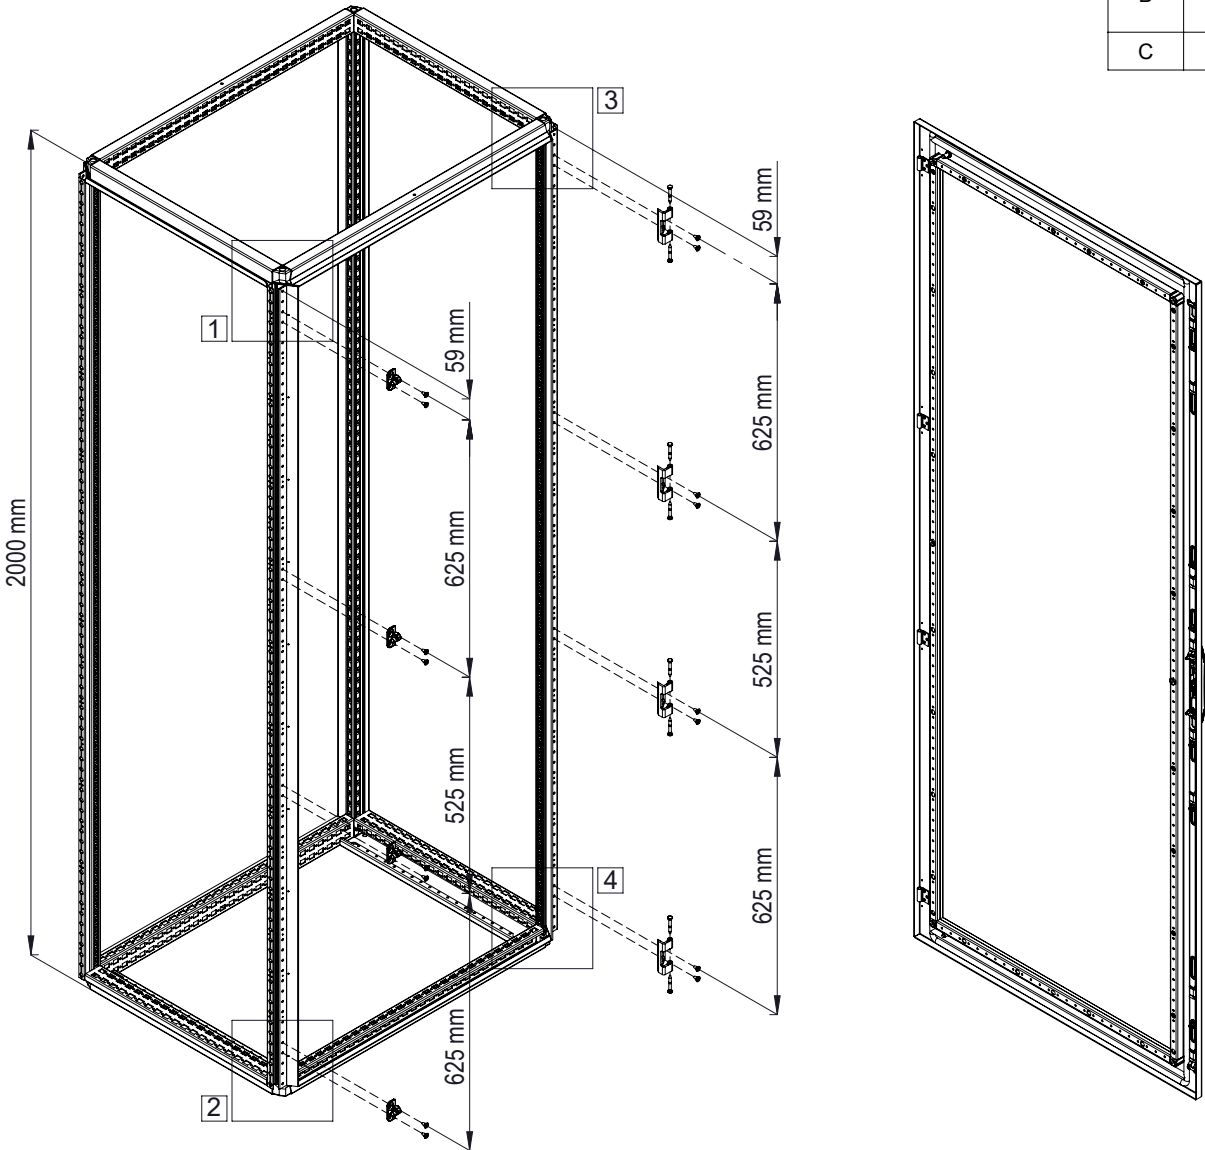


A C Torque 8-9 Nm

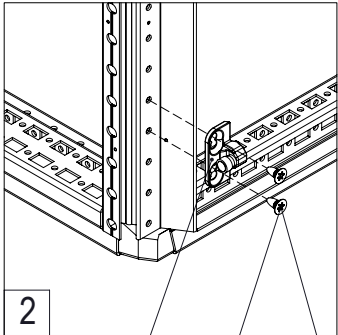

A C Torque 8-9 Nm

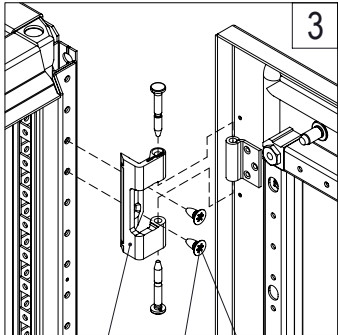

B C Torque 8-9 Nm

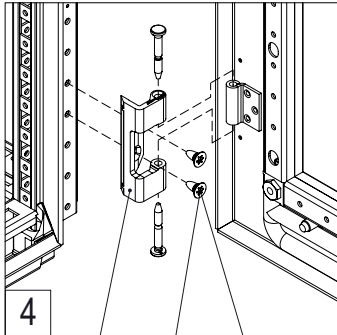


B C Torque 8-9 Nm



ROOF PLATE


Ref.	Pic.	Qty.	
		D=600	D=800
A	M12x20	4	4
B	M12	4	4
C	M6x12	2	4





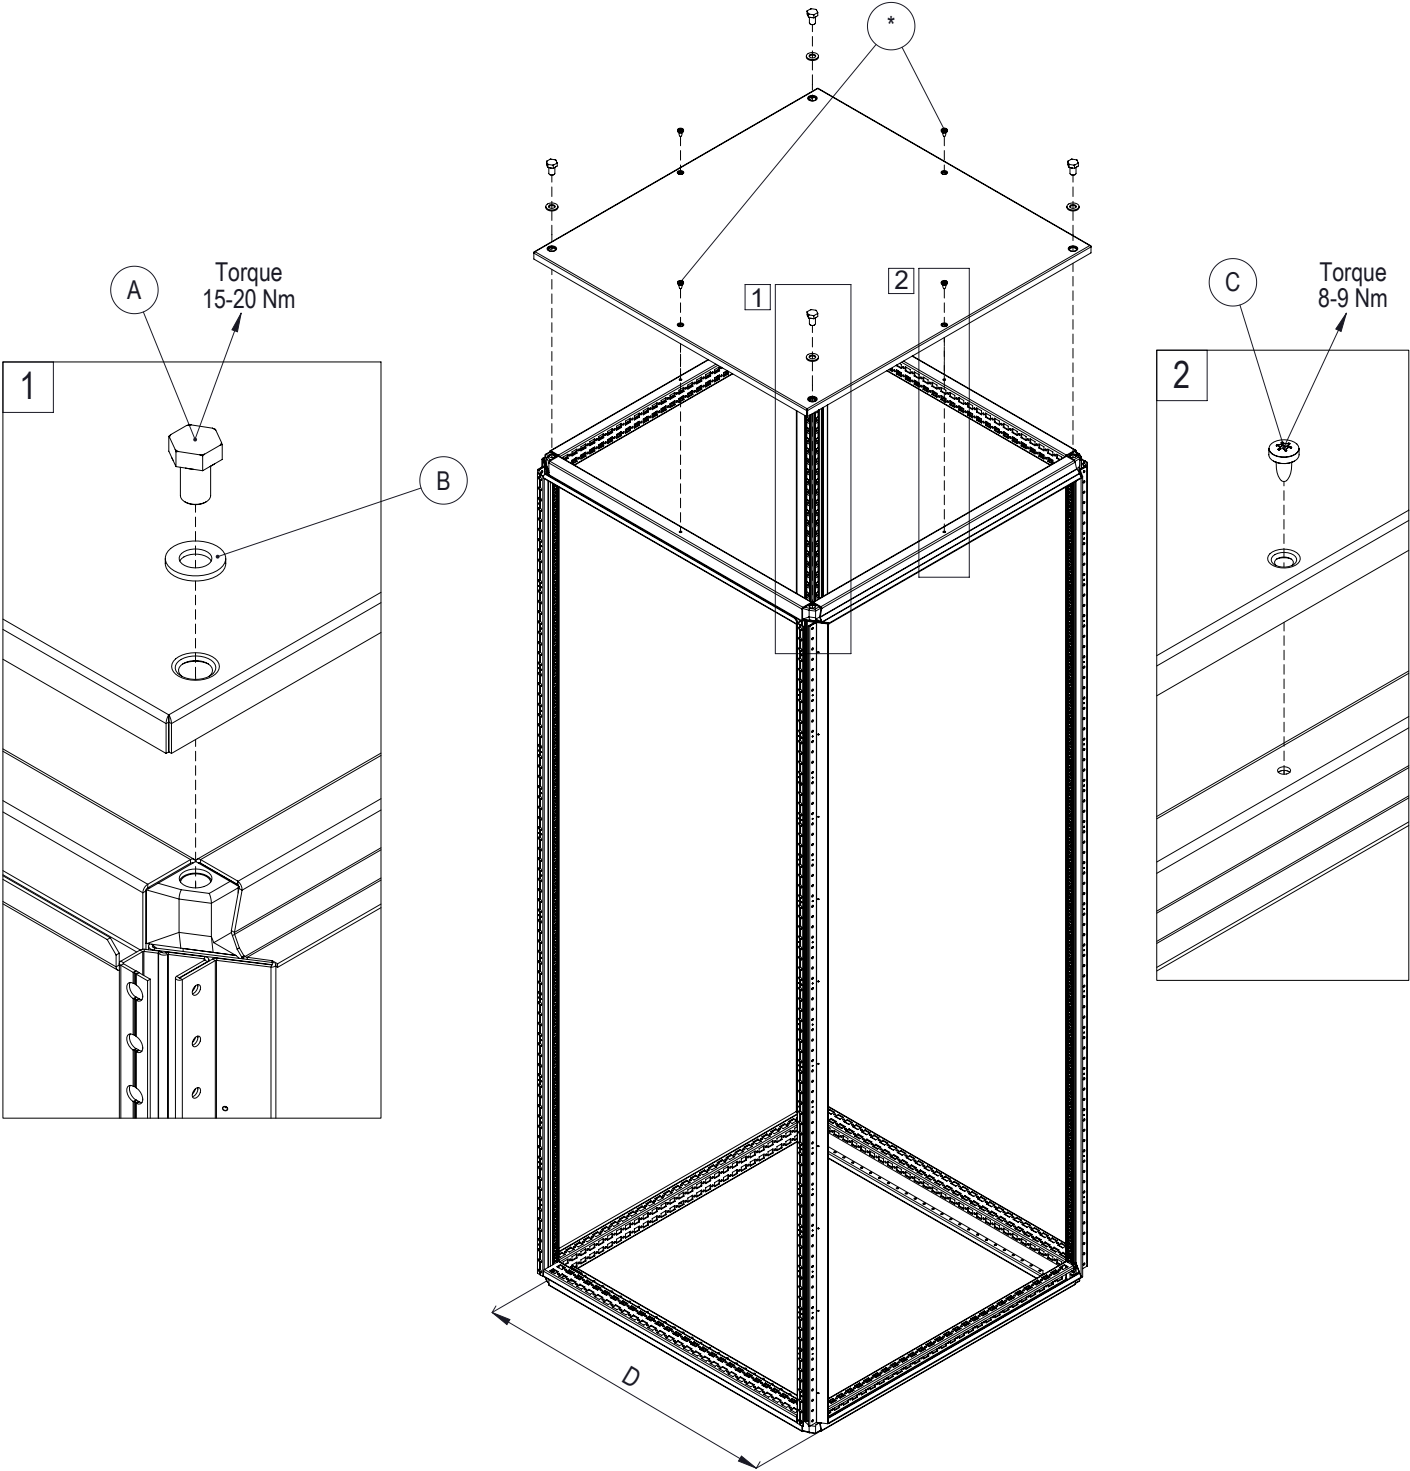


* - Used on enclosures 800 mm deep.
** - Torque value for first tightening. For following tightening, torque value recommended is 4-5 Nm.



BACK PANEL






Ref.	Pic.	Qty.
A		8
B	 M6x12	16

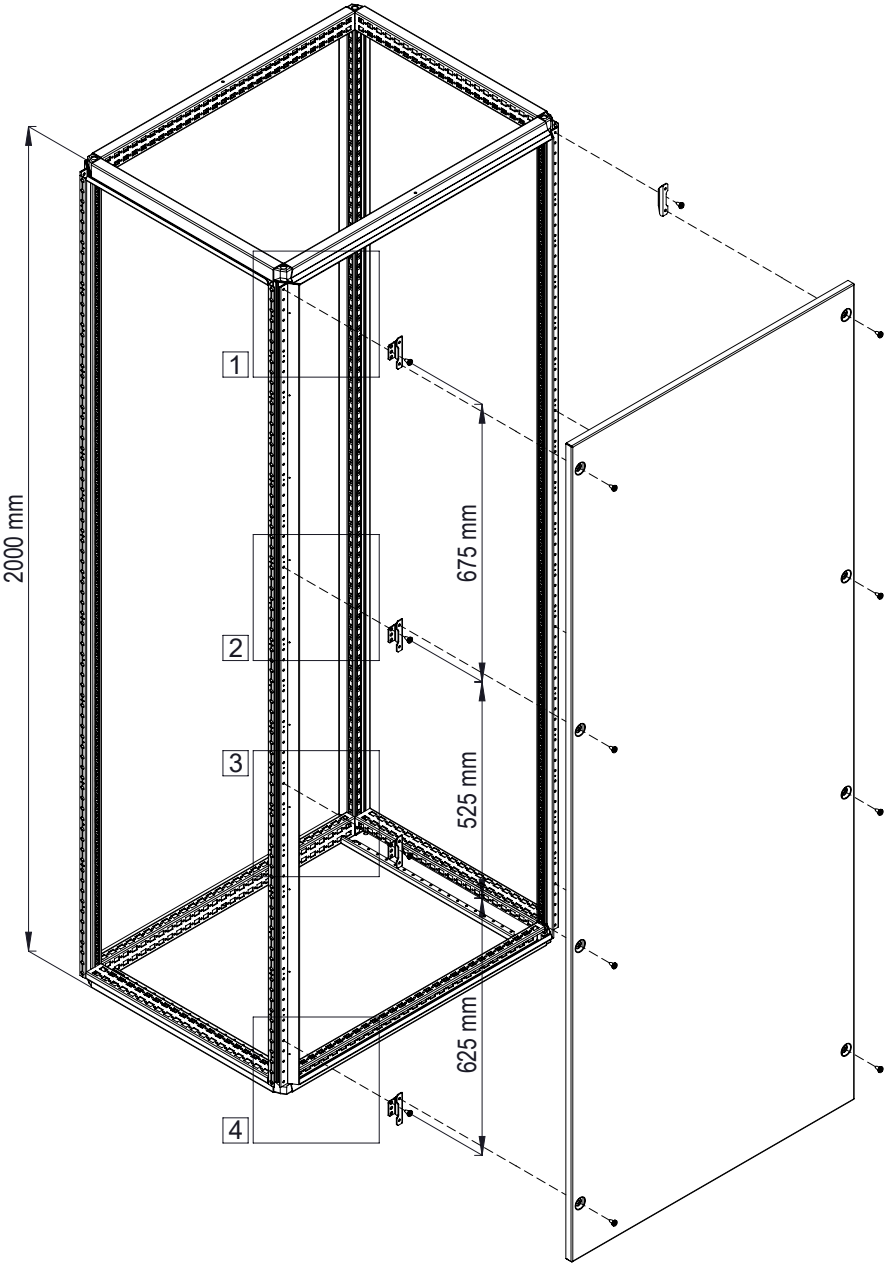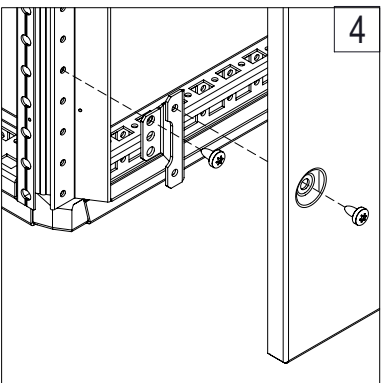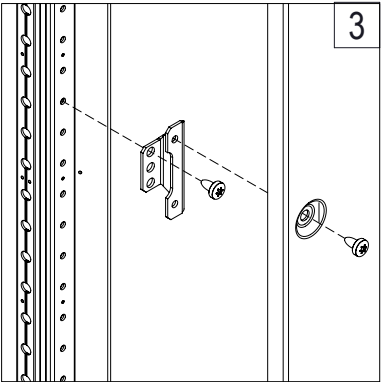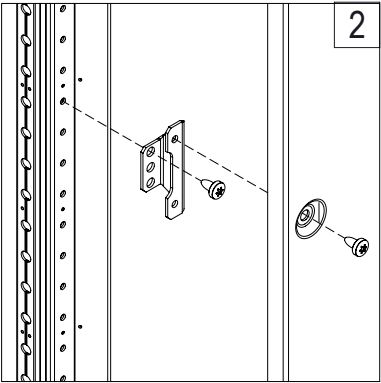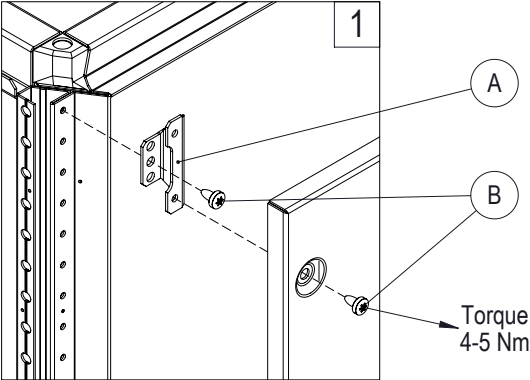



BOTTOM PLATES

Ref.	Pic.	Qty.	
		D=600	D=800
A	St. 5.5x10	6	8
B		5	6

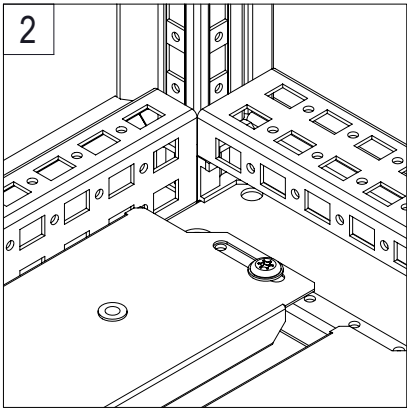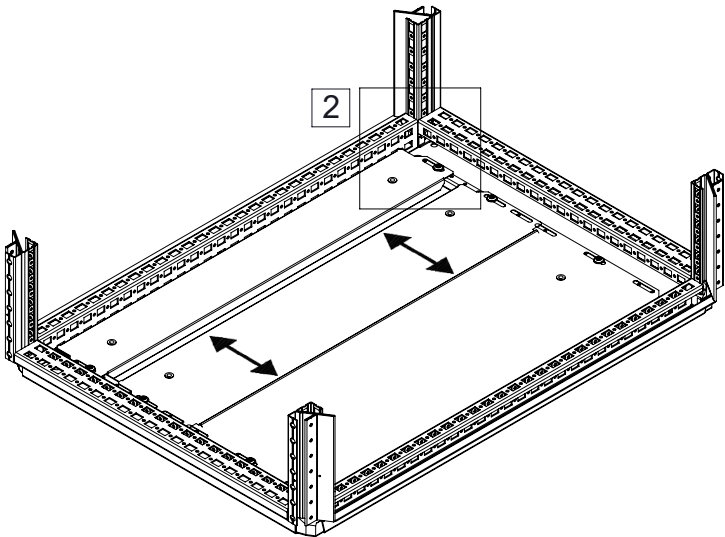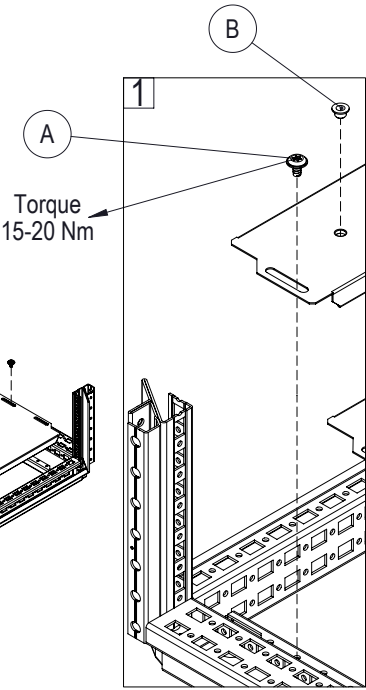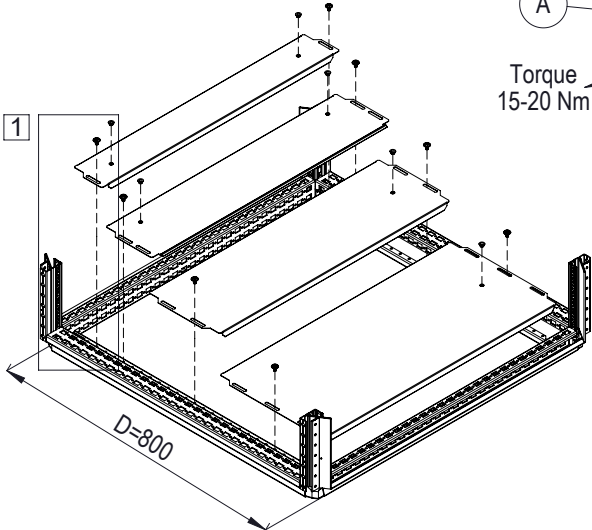
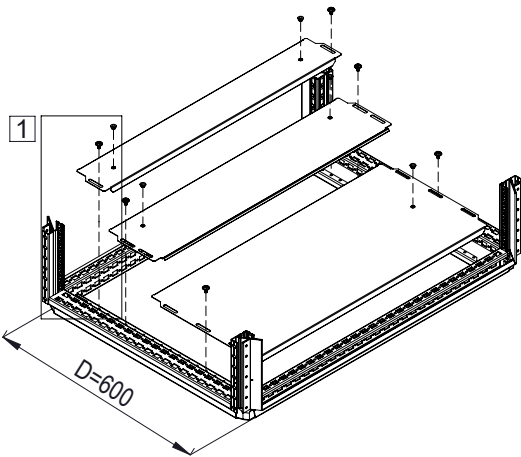




SEALING BOTTOM PLATES *Required for IP55*

Ref.	Pic.	Qty.
A	 4,5x8	6 m
B	 25x25	1.6 m
C		4







BG01 ordered separately

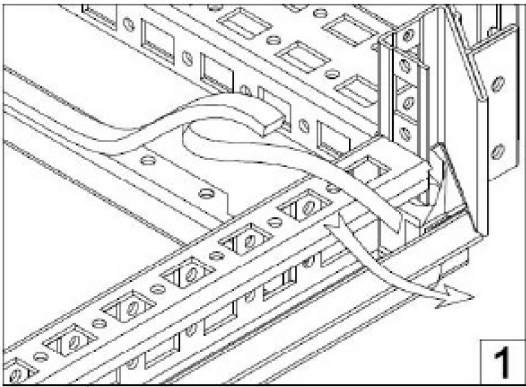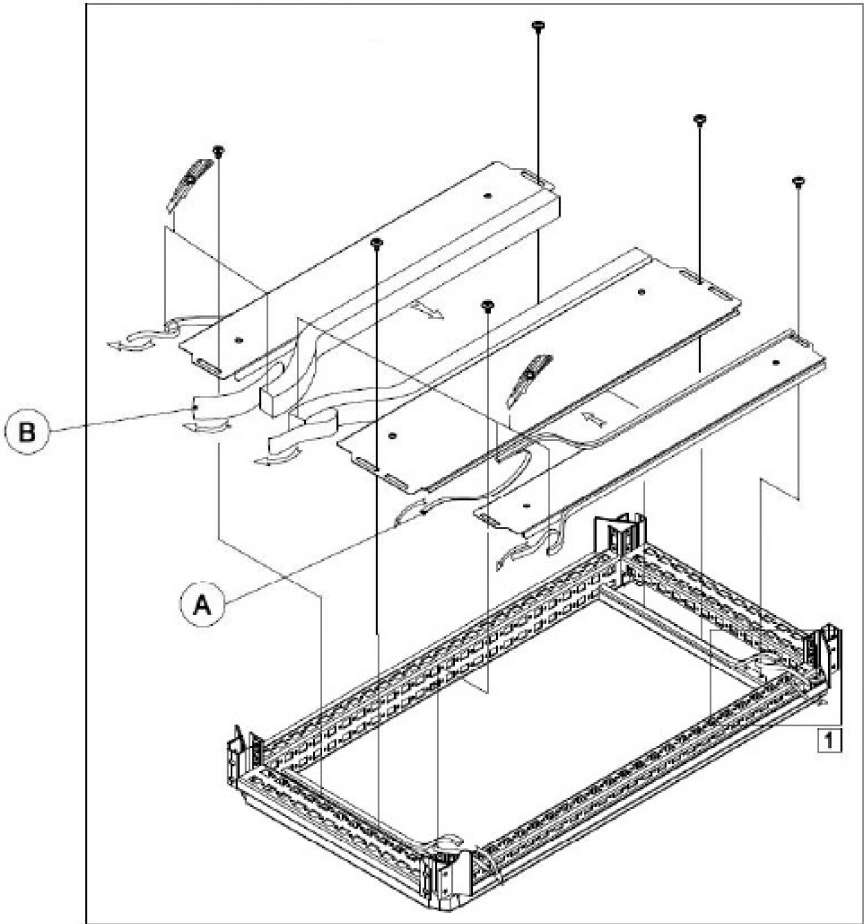



SWING FRAME



Ref.	Pic.	Qty.
A		1
B		1
C		1
D		1
E		1
F		2
G		2
H		10

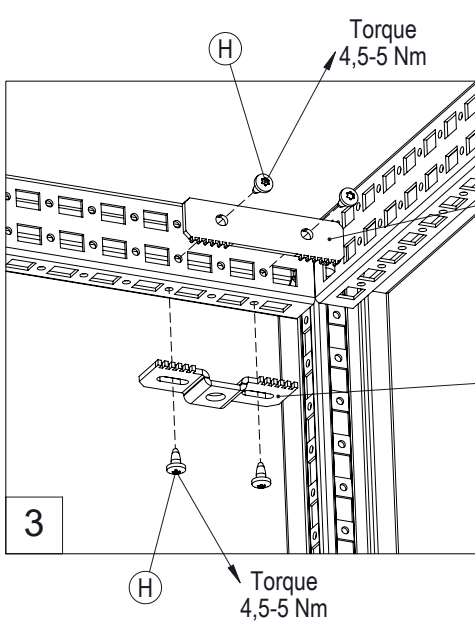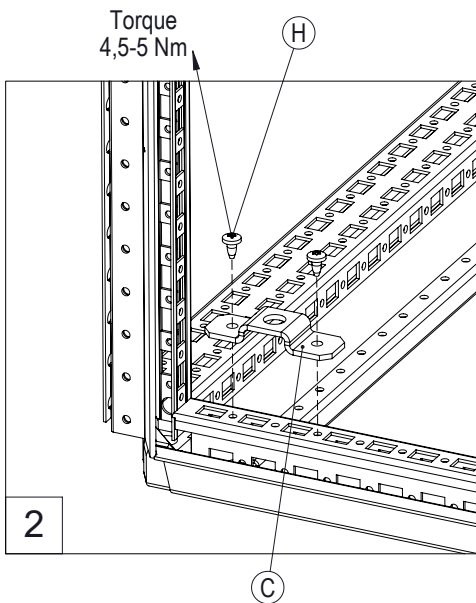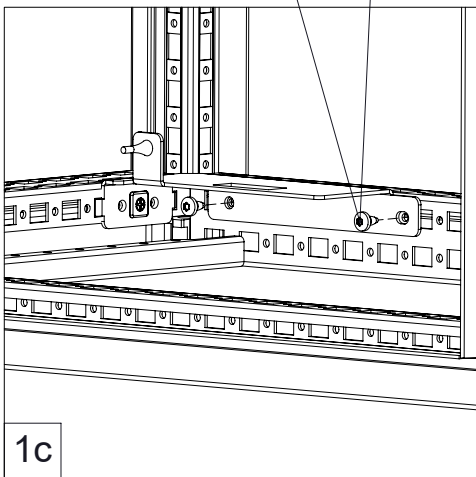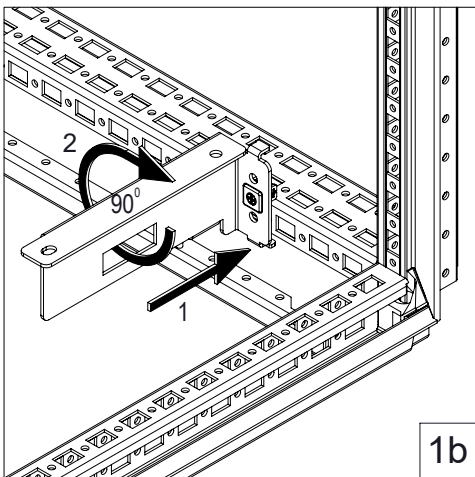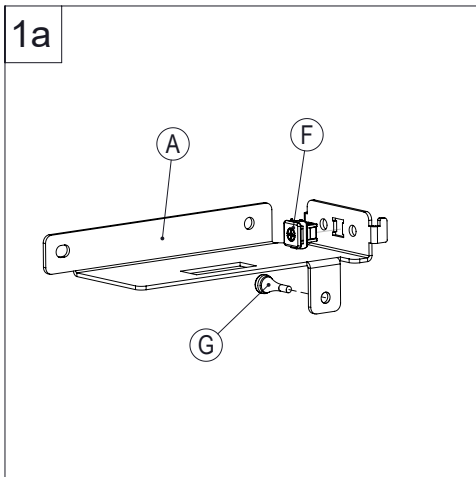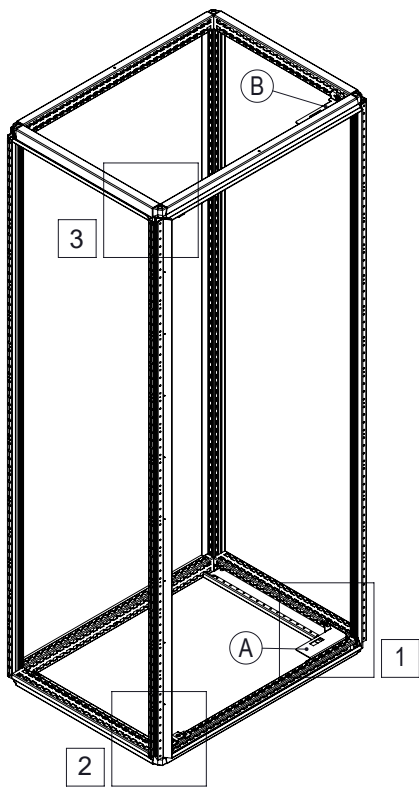



SWING FRAME

Ref.	Pic.	Qty.
A		2
B		1
C		1
D		1
E		2
F		1
G		4
H		4
I		2

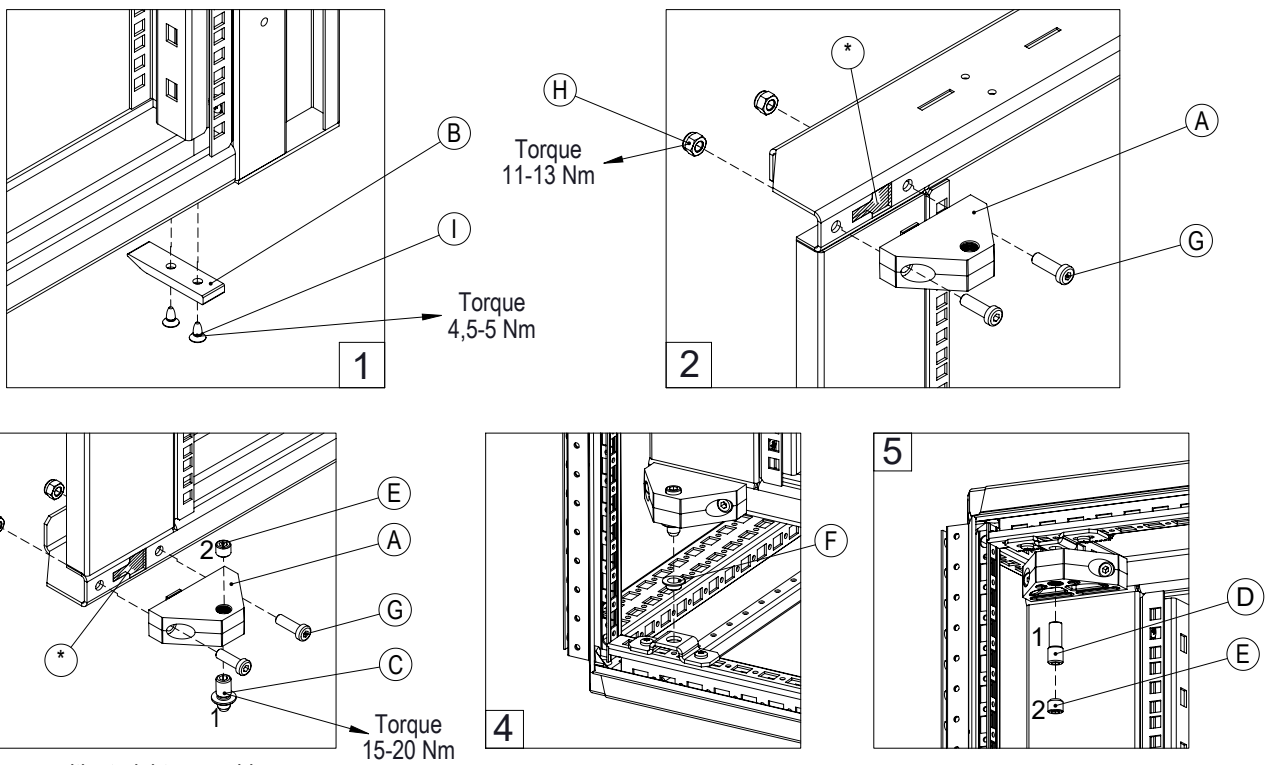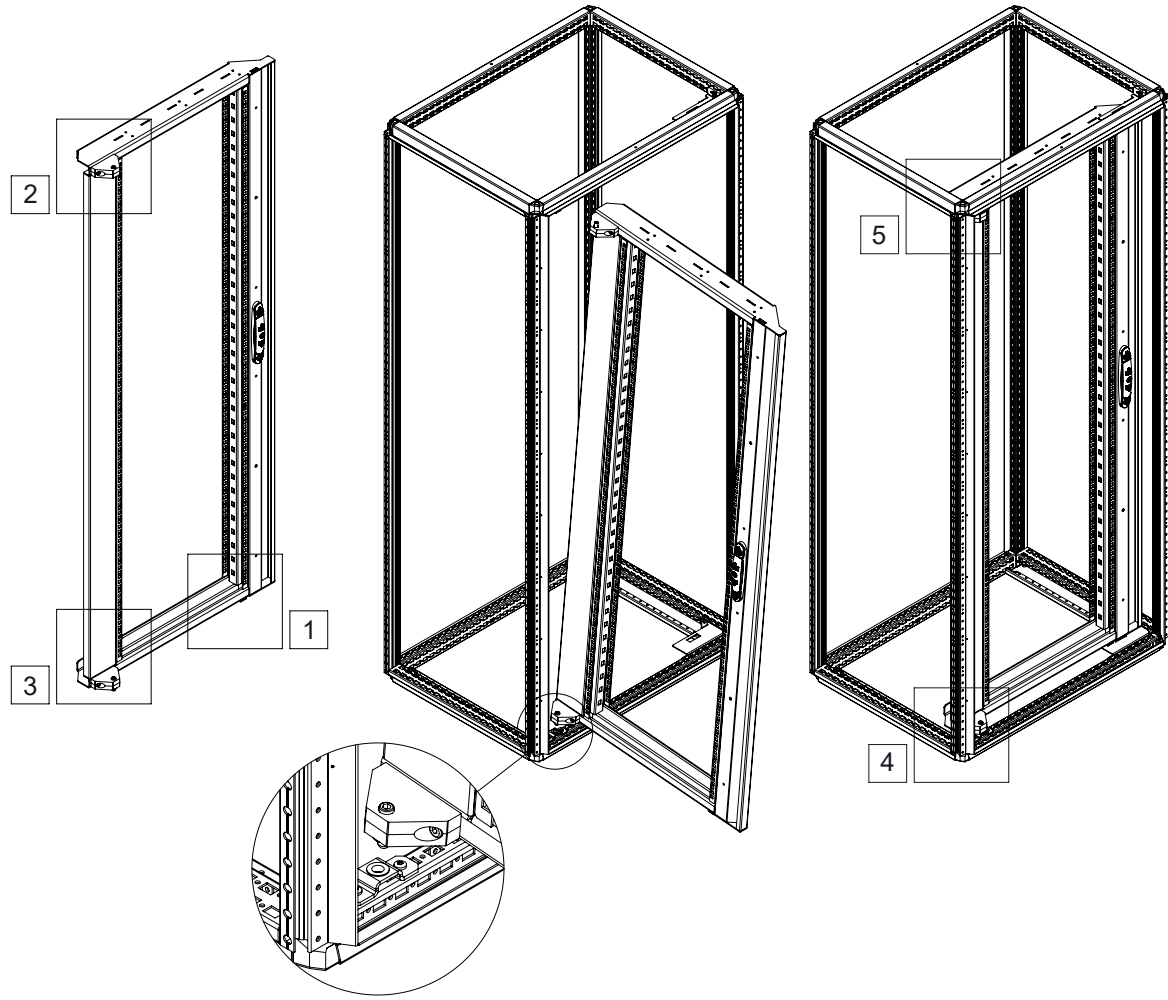

* - Remove with straight screwdriver



EARTHING

Ref.	Pic.	Qty.
A		1
B		1
C		1
D		4
E		2
F		2
G		3

