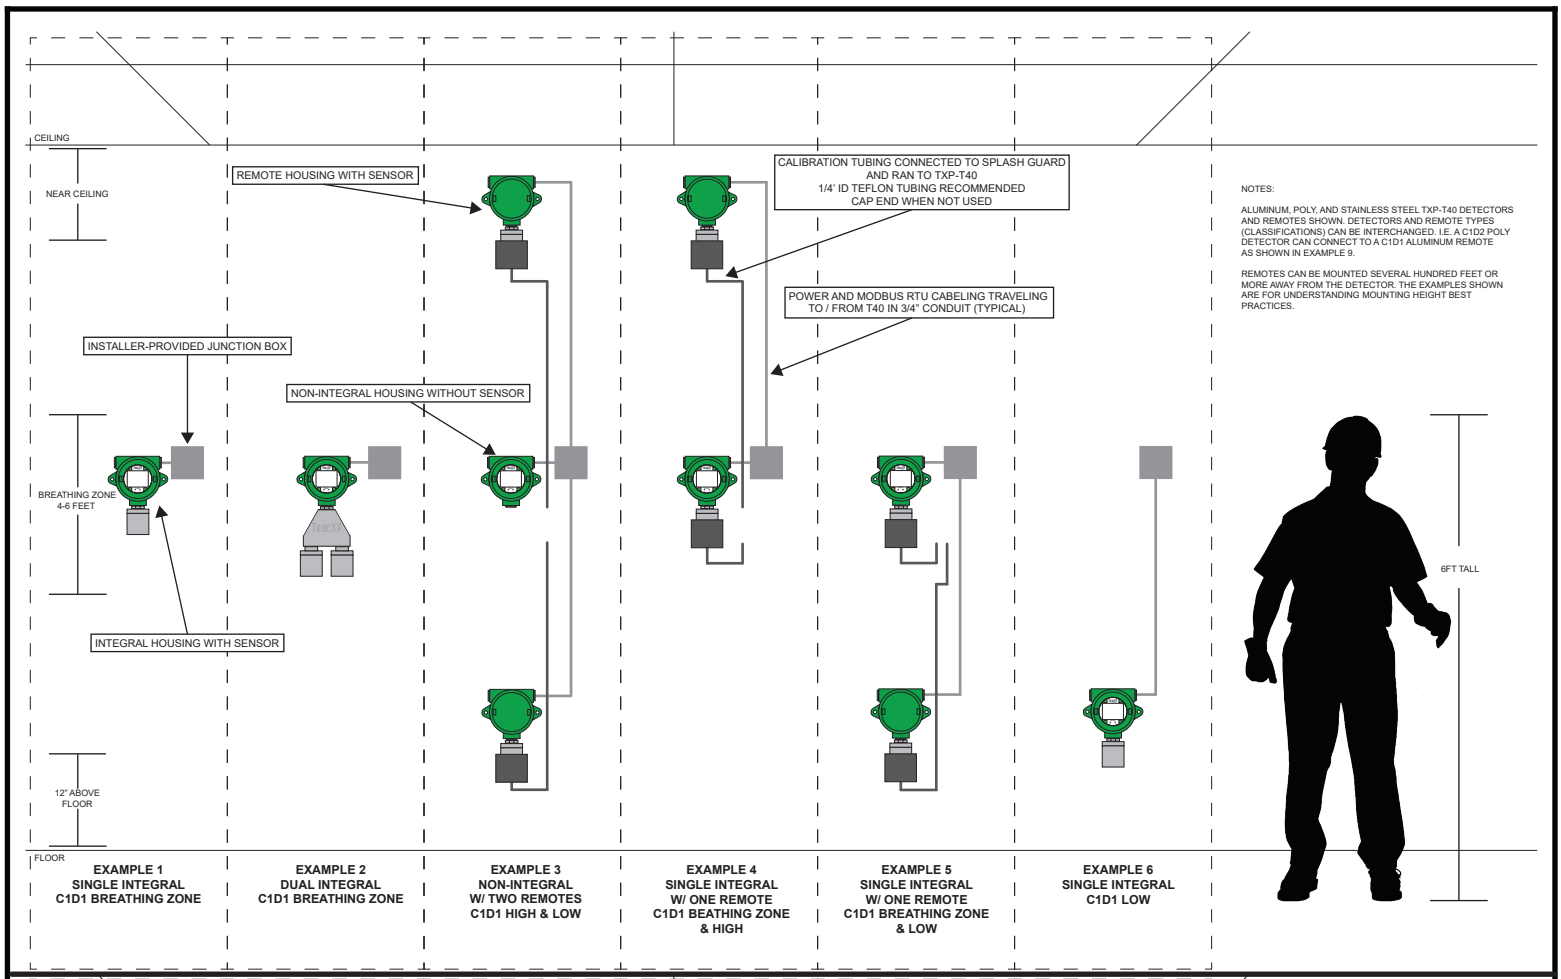

NOTES:

ALUMINUM, POLY, AND STAINLESS STEEL TXP-T40 DETECTORS AND REMOTES SHOWN. DETECTORS AND REMOTE TYPES (CLASSIFICATIONS) CAN BE INTERCHANGED. I.E. A C1D2 POLY DETECTOR CAN CONNECT TO A C1D1 ALUMINUM REMOTE AS SHOWN IN EXAMPLE 9.

REMOTES CAN BE MOUNTED SEVERAL HUNDRED FEET OR MORE AWAY FROM THE DETECTOR. THE EXAMPLES SHOWN ARE FOR UNDERSTANDING MOUNTING HEIGHT BEST PRACTICES.

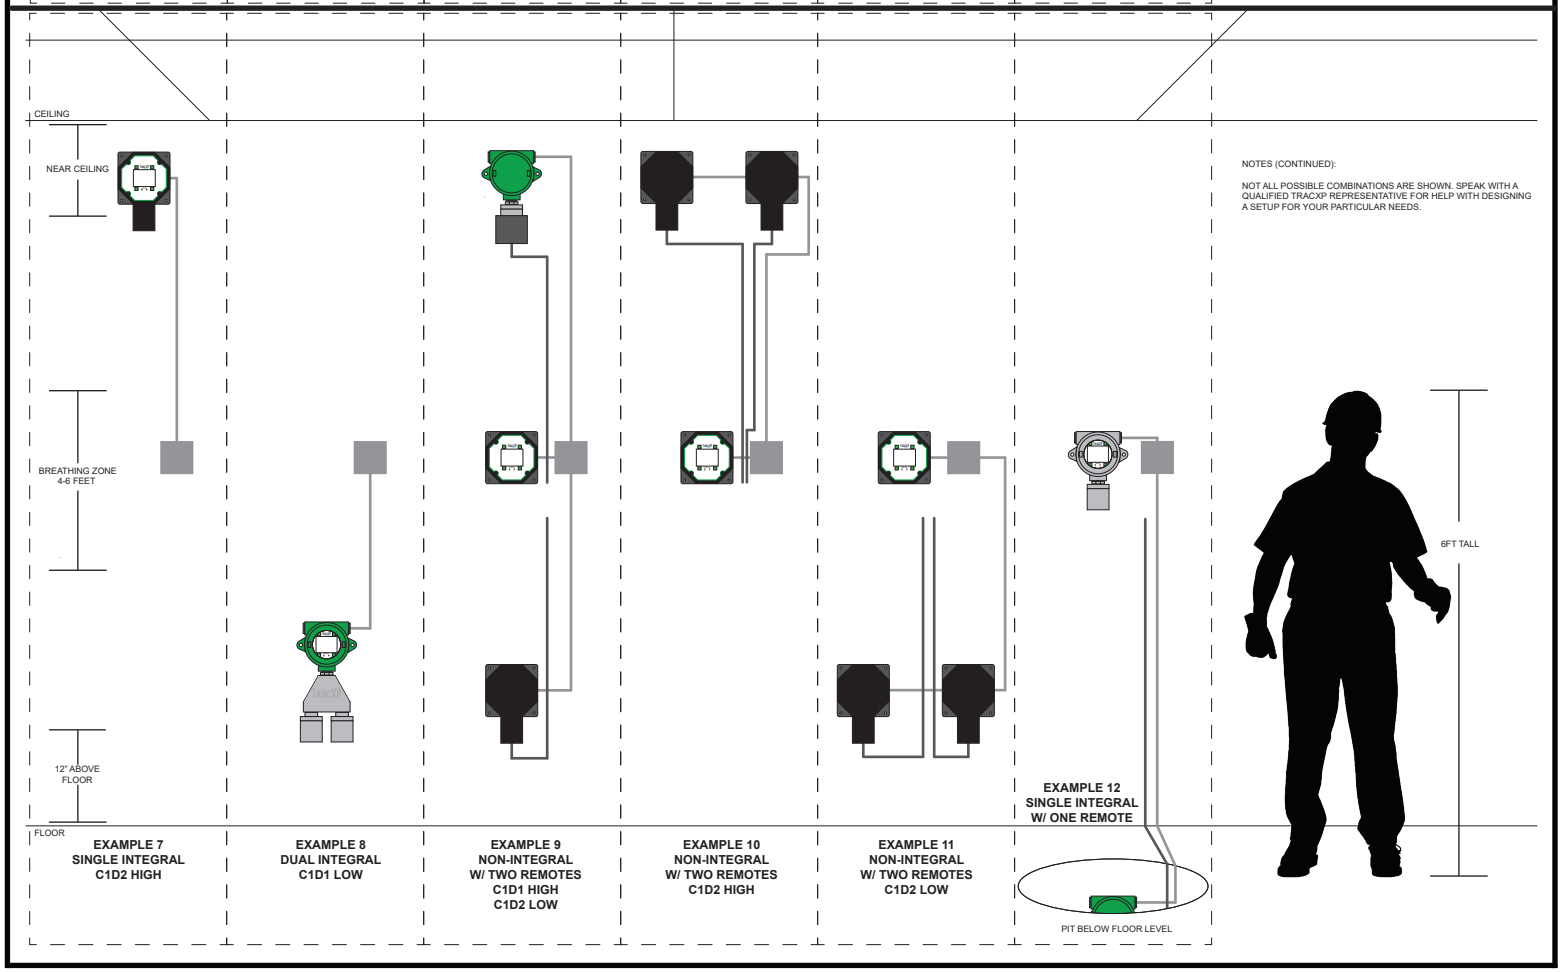

NOTES (CONTINUED):

NOT ALL POSSIBLE COMBINATIONS ARE SHOWN. SPEAK WITH A QUALIFIED TRACXP REPRESENTATIVE FOR HELP WITH DESIGNING A SETUP FOR YOUR PARTICULAR NEEDS.

MACURCO GAS DETECTION

Macurco Inc.
1504 West 51st Street
Sioux Falls, SD 57105
United States of America
1-877-367-7891

TracXP™ Industrial Gas Solutions by Macurco

Title: TXP-T40 Mounting Examples
Rev.: 1.0
Date: 11/16/2023

All drawings are for reference only. Electrical diagrams / drawings must be reviewed and approved by a local governing authority prior to installation. Macurco makes no representation or warranty concerning wiring diagrams / drawings, and you are to rely solely on the recommendations and requirements of the local governing authority.