

Commissioning Guide for VigiloHm IM400C in M-RW-PV mode

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

About this guide

This guide explains about the commissioning procedure of VigiloHm IM400C

Throughout this guide, the term “device” refers to VigiloHm IM400C

For detailed installation and operating instructions, including safety messaging, read the device instruction sheets and user manual.

Document Reference

Title	Number
Instruction Sheet: VigiloHm IM400C	S1B90076
User Manual: VigiloHm IM400C	7EN02-0493


Setting date and time

On first power up, set the date and time. Setting date and time ensures proper timestamps for the logs and trends.

1. Turn on the power supply.

Auto-test begins in the device. Wait for 10 seconds for auto test to complete.


- If auto-test passes, the **INSULATION** screen displays a resistance value. An example **INSULATION** screen is:

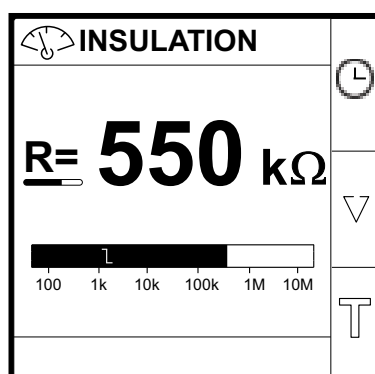

- If auto-test fails, an error code is displayed.

2. Press the flashing  button.


NOTE: The clock icon flashes to show that date and time needs to be set.
The **DATE/TIME** screen displays.

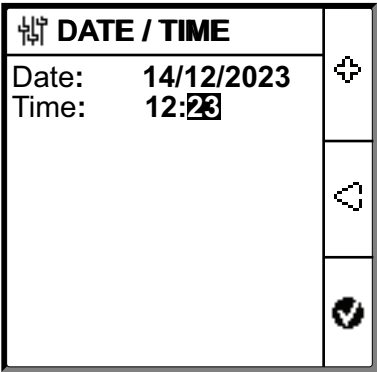


3. Set the date and time using the contextual menu buttons  and .

4. Press  button to save the date and time.

A message **Saved** displays.

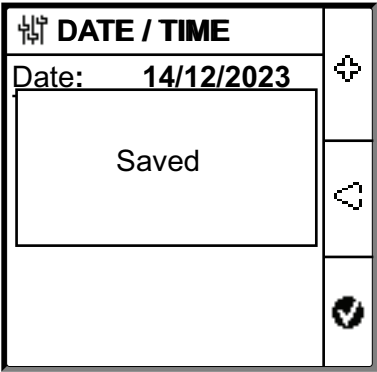


The **INSULATION** screen displays a resistance value. An example **INSULATION** screen is:

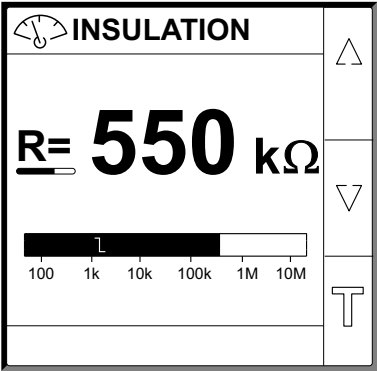

Configuring network parameters

1. Navigate to **Menu > Settings > Network**.

The **NETWORK** screen displays.

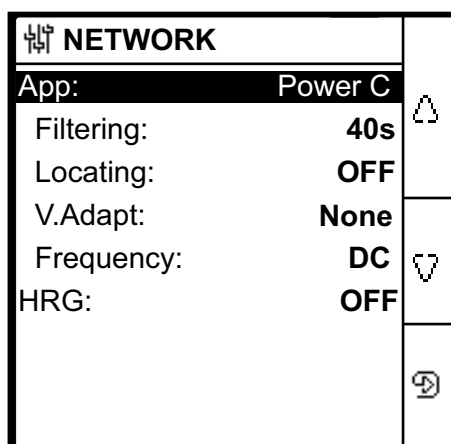

2. Modify the parameters value as per the following table:

NOTE: Use the contextual menu buttons to modify the parameters value.

Parameter	Allowed Values	Default Value	Description
App	- Power C - Control C - M-RW-PV	Power C	- Select Power C for industrial or power loads and power electronics such as speed drives, inverters, or rectifiers. - Select Control C for auxiliary control circuits used to drive power systems which contain sensitive loads such as PLCs, IOs, or sensors. - Select M-RW-PV for Marine or Railways or Photovoltaic application.
Filtering	4s 40s 400s	40s	Select the filtering time depending on the application. NOTE: This value selection is restricted depending on the App value selection.
Locating	- OFF - IFL - XD	OFF	- Select OFF if no IFL is installed or if the Mobile Fault Locator "IMDMFLK1" is not to be used. - Select IFL if "IMDIFL12xx" is installed or if the Mobile Fault Locator "IMDMFLK1" is used. - Select XD if "XD301" or "XD312" are installed, even if "IMDIFL12xx" is present in parallel.
V.Adapt	- PHT1000 - IM400VA2 - HV1700 - None	None	Select the adaptor if the network voltage is greater than the rated network voltage of the device. NOTE: This value selection is restricted depending on the App & Locating value selection.
Frequency	50 Hz - DC 400 Hz 60 Hz	DC	Select the rated frequency of the monitored power system. NOTE: This value selection is restricted depending on the App value selection.
HRG	- OFF 0.1....2 MΩ	OFF	- Select OFF when no grounding resistance is connected. - Select the value of the neutral grounding resistance, which is connected to the device.

Configuring insulation alarm parameters

1. Navigate to **Menu > Settings > Ins. Alarm**.

The **INS. ALARM** screen displays.

⚡ INS. ALARM	
Ins. Alarm:	10 kΩ
Ins. Al. Delay:	0 s
Prev. Alarm:	25 kΩ
Prev Al. Del.:	0 s
Disconnect. Inj.:	OFF

2. Modify the parameters value as per the following table:

NOTE: Use the contextual menu buttons to modify the parameters value.

Parameter	Allowed Values	Default Value	Description
Ins. Alarm	0.04...500 kΩ	10 kΩ	Select the value of insulation alarm threshold.
Ins. Al. Delay	0 s...120 minutes	0 s	Select the value of time delay for insulation alarm.
Prev. Alarm	1 kΩ...1 MΩ - OFF	25 kΩ	Select the value of preventive insulation alarm threshold.
Prev. Al. Del.	0 s...120 minutes	0 s	NOTE: This parameter is enabled when Prev. Alarm is set to any value between 1 kΩ...1 MΩ. Select the value of time delay for preventive insulation alarm.
Disconnect. Inj	- ON - OFF	OFF	- Select ON to detect the disconnection of injection wiring. - An Alarm will be generated here when the Insulation Resistance is measured above 10 MOhm - Select OFF to disable this feature.

Configuring input output parameters

1. Navigate to **Menu > Settings > I/O Config**.

The **I/O CONFIG** screen displays.

⚡ I/O CONFIG	
Ins. Al. Relay:	FS
Prev. Al. Rel:	FS
Inhibit. Input:	N.O.
Ack Inhibit:	OFF
Ack Al. Relay:	ON
Test w. Relays:	ON

2. Modify the parameters value as per the following table:

NOTE: Use the contextual menu buttons to modify the parameters value.

Parameter	Allowed Values	Default Value	Description
Ins. Al. Relay	- Std. (Standard) - FS (Failsafe)	FS (Failsafe)	Select the mode of insulation alarm relay depending on the status of insulation. Refer user manual for more information.
Prev. Al. Rel	- Std. (Standard) - FS (Failsafe) - Mirror	FS (Failsafe)	Select the mode of preventive insulation alarm relay depending on the status of insulation. Refer user manual for more information.
Inhibit. Input	- N.O. - N.C. - OFF	N.O.	Select the configuration of injection inhibition input . Refer user manual for more information.
Ack Inhibit	- ON - OFF	OFF	- Select ON to acknowledge the inhibition signal status. - Select OFF to disable this feature.
Ack Al. Relay	- ON - OFF	ON	- Select ON to trigger relays when acknowledging alarm. - Select OFF to disable this feature.
Test w. Relays	- ON - OFF	ON	- Select ON to include a three-second toggle of the preventive insulation alarm relay and insulation alarm relay during a manually launched auto-test. - Select OFF to disable this feature.
Inhibit. Type	- Int. - Ext.	Int.	- Select Int. to disconnect the device from network during inhibition state. - Select Ext. to disconnect the device from network using external relay during inhibition state.

Configuring Modbus parameters

1. Navigate to **Menu > Settings > Modbus**.

The **Modbus** screen displays.

MODBUS	
Address:	1
Auto Config:	OFF
Baudrate:	19200
Parity:	Even

2. Modify the parameters value as per the following table:

NOTE: Use the contextual menu buttons to modify the parameters value.

Parameter	Allowed Values	Default Value	Description
Address	1...247	1	Select the required Modbus address.
Auto Config	• ON • OFF	OFF	• Select ON to activate Modbus communication with different baud rate or parity. • Select OFF to disable this feature. NOTE: If you select ON, the parameters Baudrate and Parity are disabled.
Baudrate	• 4800 • 9600 • 19200 • 38400	19200	Select the required baud rate.
Parity	• Even • Odd • None	Even	Select the required parity.