

Solid-state Power OFF-delay Timer

H3CR-H

1/16 DIN, Analog-Set Timer with Power-OFF Delay, Four Selectable Ranges

- Extended power-OFF delay timer, up to 12 seconds, for S-type and 12 minutes for M-type models
- Forced resetting type provides a manual override of the timing function
- 11-pin and 8-pin models are available
- Red LED output indicator



Ordering Information

■ TIMERS

Timing function	Power-OFF delay					
Contact type	DPDT				SPDT	
Forced resetting	Available				Available	
Timing units	S-series (seconds)	M-series (minutes)	S-series (seconds)	M-series (minutes)	S-series (seconds)	M-series (minutes)
Terminal form	11-pin models		8-pin models			
Supply voltages	100 to 120 VAC, 200 to 240 VAC, 24 VAC/DC					
Part number	H3CR-HRL		H3CR-H8L		H3CR-H8RL	

Note: Specify both the supply voltage and time unit code (S or M) in addition to the model number when ordering.

Example: H3CR-H8L 24 VAC/DC M

Time unit code

Supply voltage

■ MODEL NUMBER LEGEND

H3CR -

1 2 3 4

1. Classification

H: Power OFF-delay timer

2. Configuration

None: 11-pin socket

8: 8-pin socket

3. Input

None: Without reset input

R: With reset input


4. Dimensions

L: Long-body model

■ ACCESSORIES (ORDER SEPARATELY)

Description	Part Number
Panel mounting adapters	Fits behind panel, ideal for side by side installation. Use P3G-08 socket. Y92F-30
	Installs through panel front; timer face fits bezel, rear of timer clips to adapter. Use P3G-08 socket, Fits 65-66 mm (2.56 - 2.59 in) x 52-53 (2.04 x 2.09 in) panel cutout. Charcoal gray face plate measures 88 H x 58 W mm (3.46 x 2.28 in) Y92F-70
	Installs through panel front; timer face fits bezel, rear of timer clips to adapter. Use P3G-08 socket, Fits 55 x 45 mm (2.17 x 1.77 in) panel cutout. Charcoal gray face plate measures 58 H x 50 W mm (2.28 x 1.97 in) Y92F-71
Mounting Track	DIN rail, 50 cm (1.64 ft) length, 7.3 mm (0.29 in) depth PFP-50N
	DIN rail, 1 m (3.28 ft) length, 7.3 mm (0.29 in) depth PFP-100N
	DIN rail, 1 m (3.28 ft) length, 16 mm (0.63 in) depth PFP-100N2
	End Plate PFP-M
	Spacer PFP-S
Protective Cover	Hard plastic cover protects against dust dirt and water: not for use with panel covers. Y92A-48B
Sockets	Bottom surface or track mounting, top screw terminals. Use with 8-pin terminal form timer. P2CF-08
	Bottom surface or track mounting, top screw terminals. Use with 11-pin terminal form timer. P2CF-11
	Back mounting, for use with Y92F-30 mounting adapter, bottom screw terminals. Use with 8-pin terminal form timer. P3G-08
	Back mounting, for use with Y92F-30 mounting adapter, bottom screw terminals. Use with 11-pin terminal form timer. P3GA-11

■ RANGE SELECTION

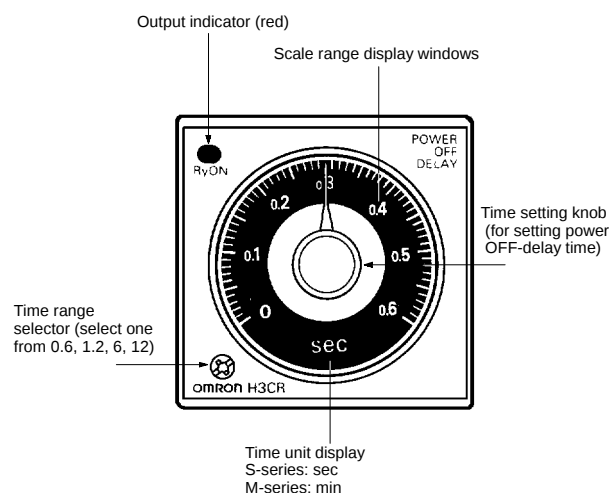

Time range		S-series	M-series
		seconds	minutes
Setting	0.6	0.05 to 0.6	
	1.2	0.1 to 1.2	
	6	0.5 to 6	
	12	1 to 12	
Min. power ON time		0.1 sec min.	2 sec min.


Note: If the above minimum power ON time is not secured, the H3CR may not operate. Be sure to secure the above minimum power ON time.

Specifications

Part number		H3CR-H8L	H3CR-H8RL	H3CR-HRL
Supply voltage (see note)	AC	100 to 120 VAC (50/60 Hz), 200 to 240 VAC (50/60 Hz)		
	AC/DC	24 VAC/VDC (50/60 Hz)		
Operating voltage		85% to 110% of rated supply voltage		
Power consumption	AC	100 to 120 VAC: 0.18 VA (100 VAC applied) 200 to 240 VAC: 0.25 VA (200 VAC applied)		
	AC/DC	24 VAC/DC: 0.24 VA (24 VAC applied)/140 mW (24 VDC applied)		
Start, Reset, Gate inputs		ON-impedance: 1kΩ max. ON residual voltage: 1 V max. OFF impedance: 500 kΩ min		
Control outputs	Type	DPDT relay	SPDT relay	DPDT relay
	Max. load	5 A at 250 VAC, p.f. = 1		
	Min. load	10 mA at 5 VDC		
Repeat accuracy		±0.3% full scale max. (±0.3% full scale max.±10 ms in ranges of 0.6 and 1.2 s)		
Setting error		±5% full scale ±0.05 s max.		
Resetting system		Instantaneous operation/ Time-limit reset	Instantaneous operation/Time-limit reset/ Forced reset	
Resetting time		50 ms min.		
Indicators		Output ON indicator (red LED)		
Materials		Plastic case (light gray Munsell 5Y7/1)		
Mounting		Panel, track, or surface depending on socket selected		
Connections		11-pin round socket	8-pin round socket	
Weight		Approx. 120 g (4.23 oz.)		
Approvals		UL/CSA/CE (EMC) (LV)		
Ambient temperature	Operating	−10° to 55°C (14° to 131°F) with no icing		
	Storage	−25° to 65°C (−13° to 149°F) with no icing		
Humidity		35% to 85%		
Vibration	Mechanical durability	10 to 55 Hz with 0.75-mm single amplitude each in three directions		
	Malfunction durability	10 to 55 Hz with 0.5-mm single amplitude each in three directions		
Shock	Mechanical durability	980 m/s ² (100G) each in three directions		
	Malfunction durability	98 m/s ² (10G) each in three directions		
Variation due to voltage change		±0.5% full scale max. (±0.5% full scale max. ±10 ms in ranges of 0.6 and 1.2 s)		
Variation due to temperature change		±2% full scale max. (±2% full scale max. ±10 ms in ranges of 0.6 and 1.2 s)		
Service life	Mechanical	10 million operations min. (under no load at 1,200 operations/h)		
	Electrical	100,000 operations min. (5 A at 250 VAC, resistive load at 1,200 operations/h)		
Insulation resistance		100 MΩ min. (at 500 VDC)		

Note: A power supply with a ripple of 20% max. (single-phase power supply with full-wave rectification) can be used with each DC model.

Engineering Data

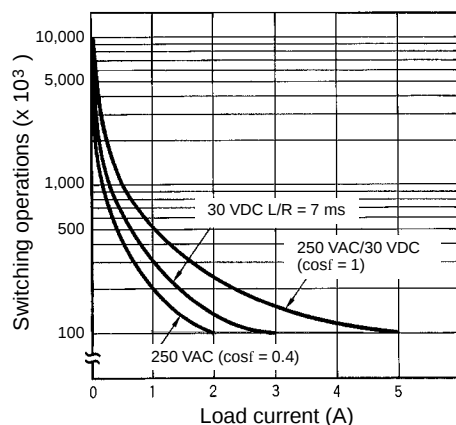


Note: A maximum current of 0.15 A can be switched at 125 VDC ($\cos\phi = 1$) and a maximum current of 0.1 A can be switched if L/R is 7 ms. In both cases, a life of 100,000 operations can be expected. The minimum applicable load is 10 mA at 5 VDC (failure level: P).


Operation

■ BLOCK DIAGRAMS

Without Reset Input (H3CR-H8L)


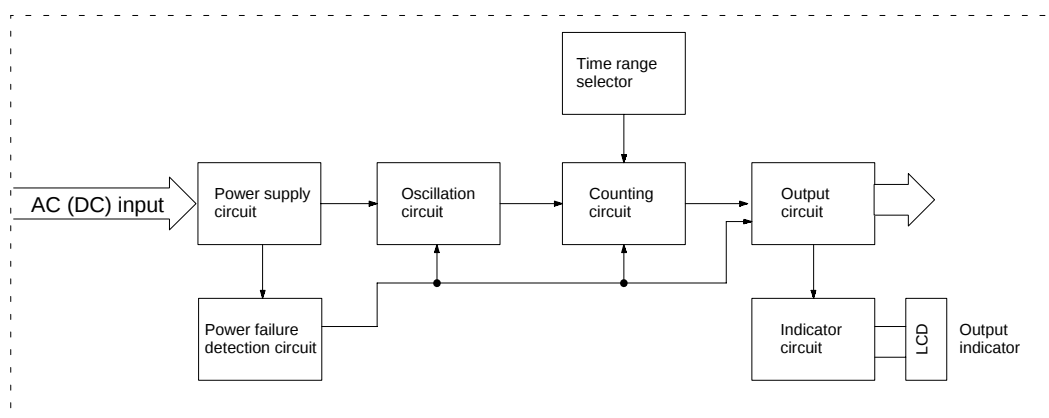


With Reset Input (H3CR-H8RL/-HRL)

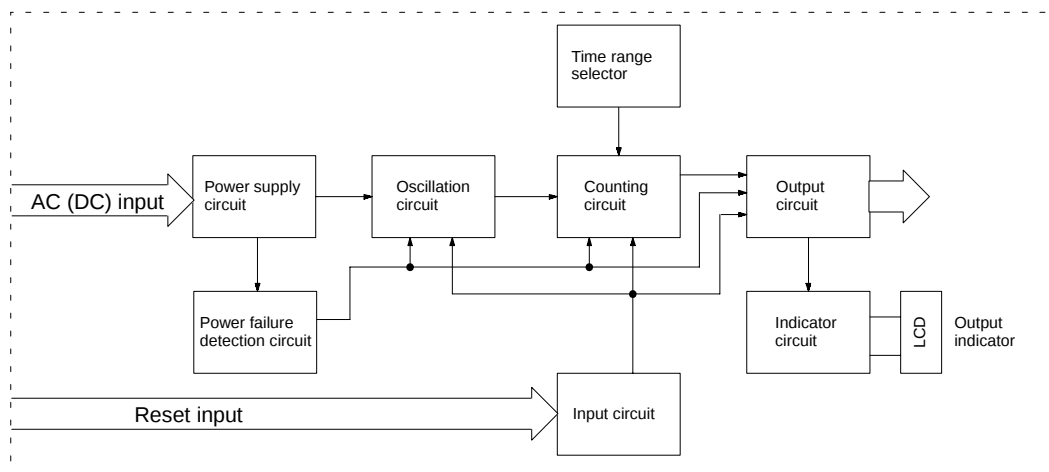


Timing Charts


■ H3CR-H8L

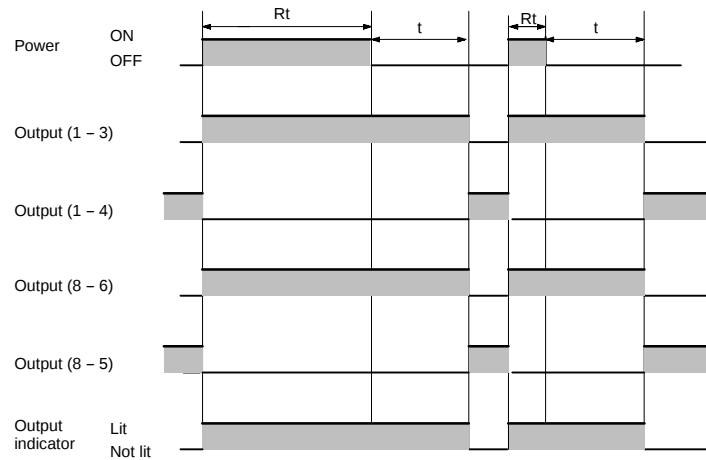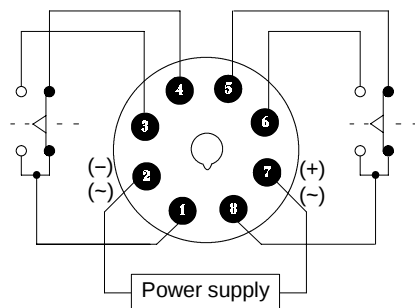


■ H3CR-H8RL

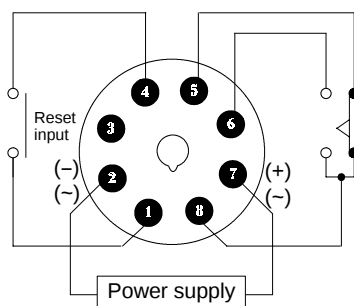


Note: Leave terminal 6 open. Do not use them as relay terminals.

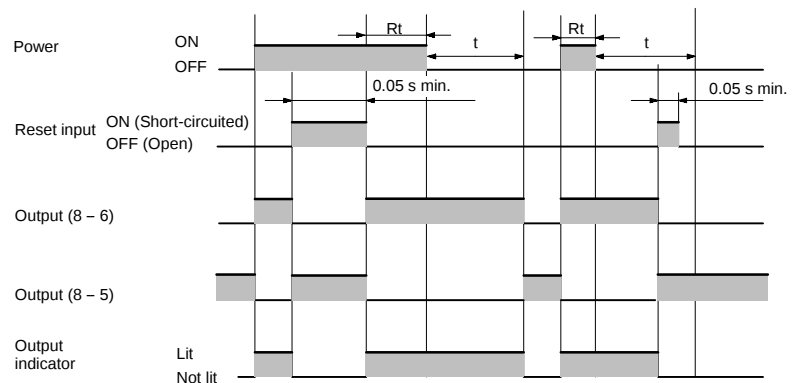

■ H3CR-HRL

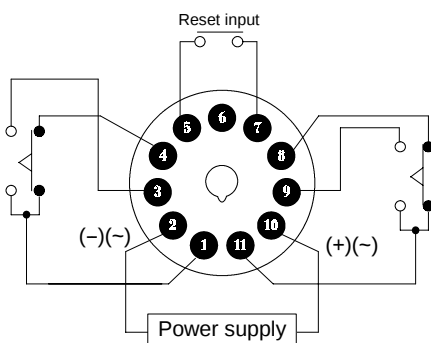

Note: Leave terminal 3 open. Do not use them as relay terminals.

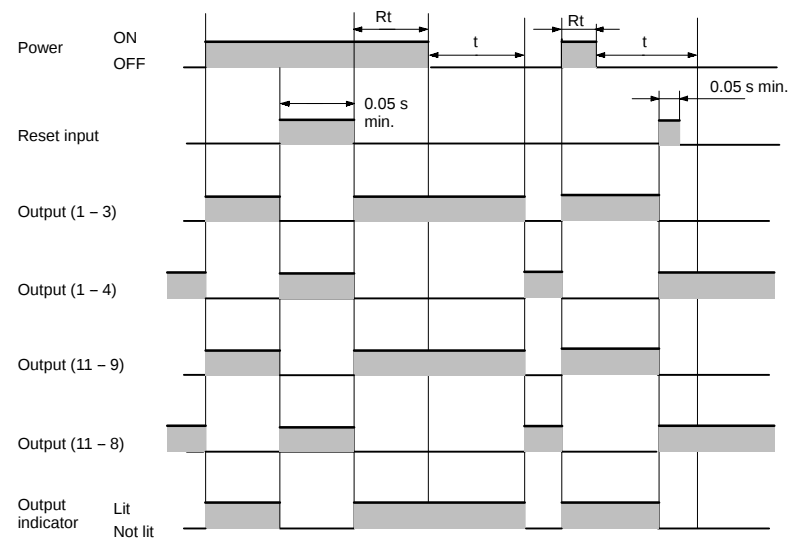




Note: t: Set time
Rt: Minimum power ON time (S-series: 0.1 s min.; M-series: 2 s min.)

Dimensions




Unit: mm (inch)

TIMERS

H3CR-H8L H3CR-H8RL

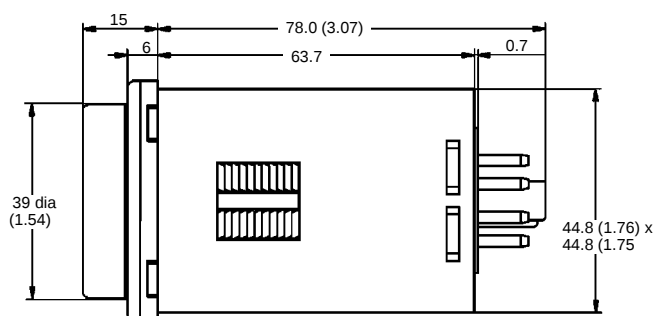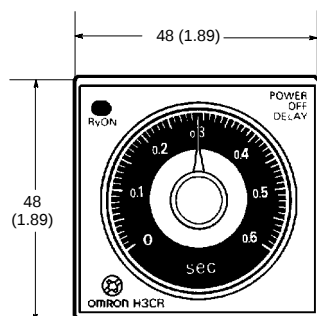


H3CR-HRL

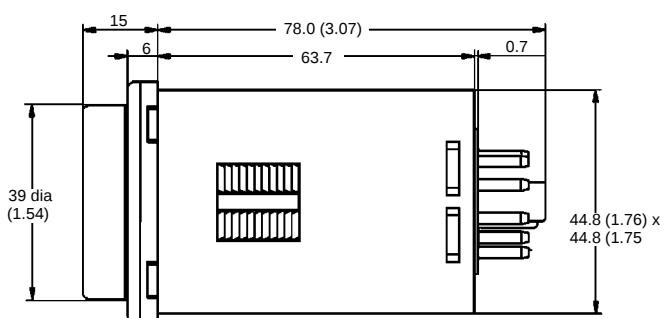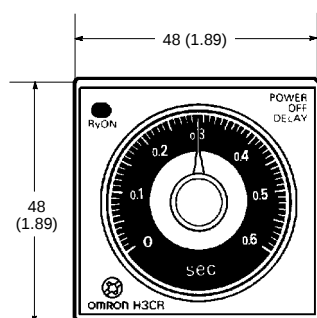

TRACK MOUNTING


11-Pin models

P2CF-11

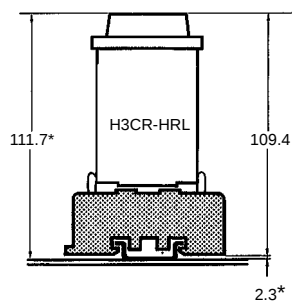

8-Pin models


P2CF-08

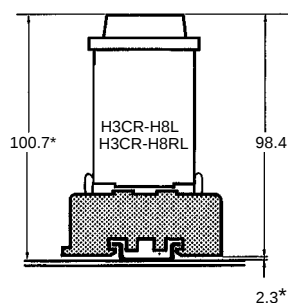


*These dimensions vary with the kind of DIN track (reference value).

■ PANEL MOUNTING

11-Pin models




8-Pin models




■ PANEL MOUNTING ADAPTERS

Y92F-30


Adapter installs behind the panel. It is ideal for side by side installation. Use P3G-08 sockets

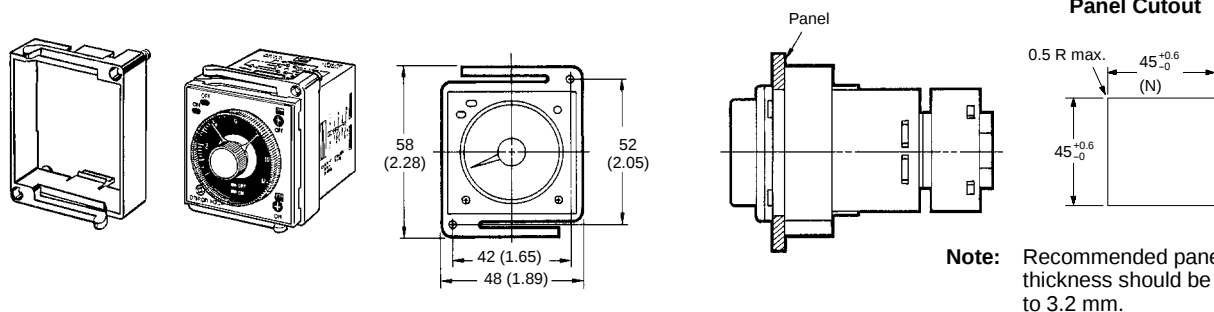

Y92F-70

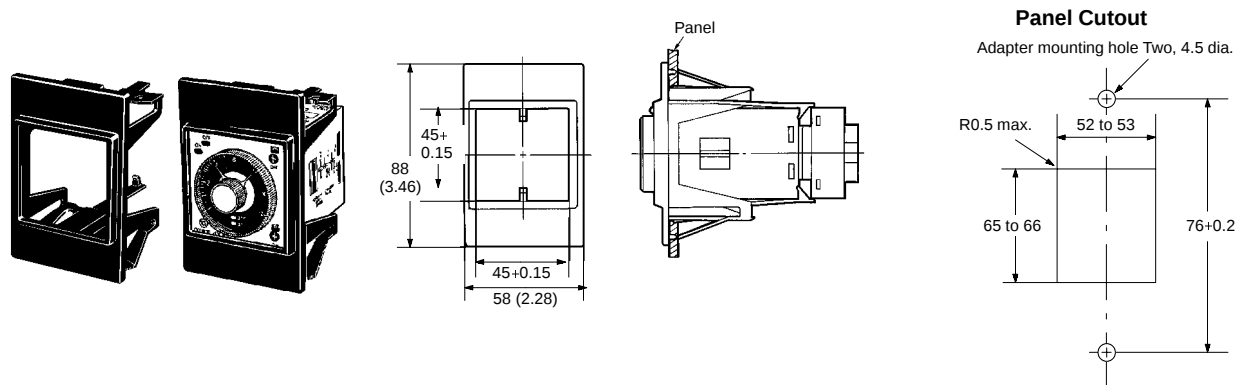


Y92F-71

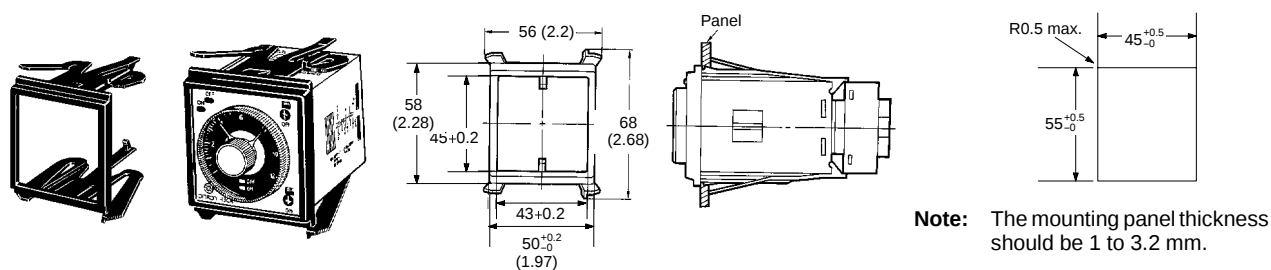


SOCKETS


Track mounting/front connecting socket P2CF-08

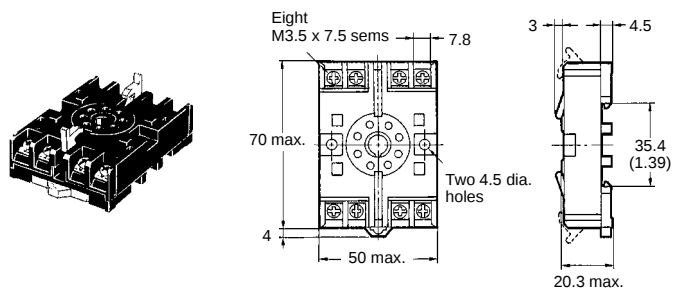




Terminal Arrangement/ Internal Connections (Top View)




Surface Mounting Holes




P2CF-11

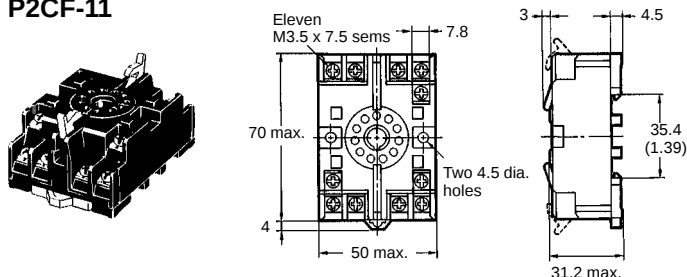



Back mounting socket P3G-08

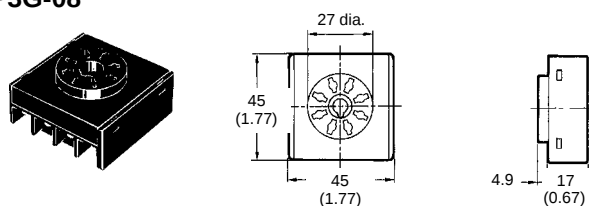

Terminal Arrangement/ Internal Connections (Bottom View)




P3GA-11

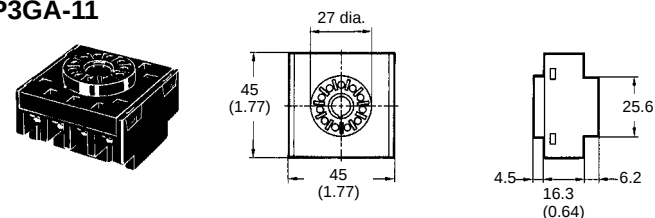

PROTECTIVE COVER


Y92A-48B

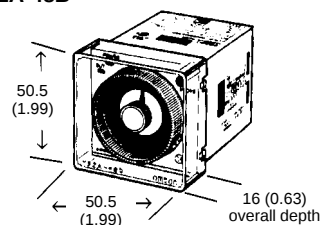

The hard plastic protective cover prevents accidental resetting. It also shields the front panel from dirt and water. The cover is intended for use in areas where unusual service conditions do not exist. The Y92A-48B cover cannot be used with the Y92P Panel Covers below.


■ MOUNTING TRACK AND ACCESSORIES

PFP-100N, PFP-50N

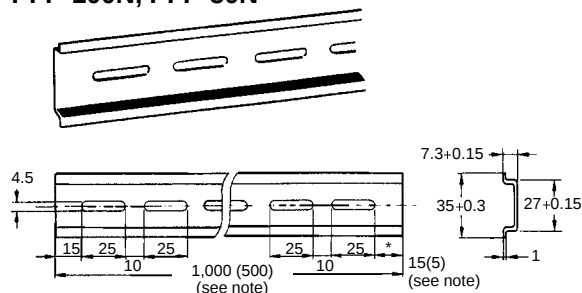


Note: The values shown in parentheses are for the PFP-50N.


PFP-100N2

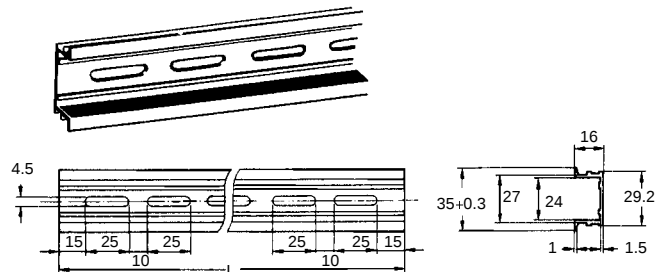

PFP-M End Plate

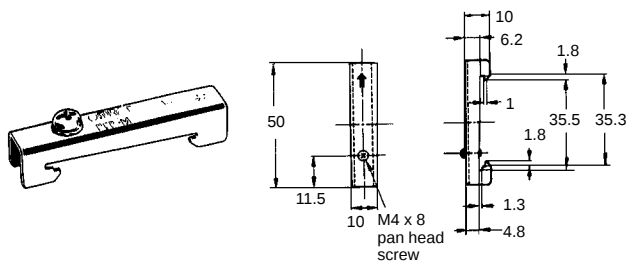

PFP-S Spacer

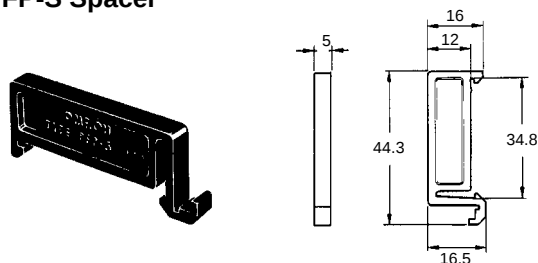

Connections

Part number	Input terminal number		Power supply terminal numbers		Output terminal numbers		
	COM	Reset	AC (common), DC-	AC (hot), DC+	COM	NC	NO
H3CR-H8L	—	—	2	7	1 8	4 5	3 6
H3CR-H8RL	1	4	2	7	8	5	6
H3CR-HRL	5	7	2	10	1 11	4 8	3 9

Installation

■ INPUT CONNECTIONS

(H3CR-H□□ - □□□□)

The neutral or common of the power supply is connected to terminal 2. Terminal 7 of H3CR-H8L/H8RL and terminal 10 of H3CR-HRL should be connected to the "hot" or positive of the power supply. Terminals 1 and 4 of H3CR-H8RL and terminals 5 and 7 of H3CR-HRL are used for no-voltage forced resetting. Do not connect these terminals to power.


■ OUTPUT CONNECTIONS

(H3CR-H□□ - □□□□)

Design your control circuit using the relay contacts to switch the load. **Never switch a load with the contact that is being used as an input signal.** The timer's circuitry may be damaged.

SELECTING TIME RANGES

A time range (0 to 1.2, 0 to 3, 0 to 12, or 0 to 30) is selected for ON- and OFF-time using the time range selector at the lower left corner of the front panel, and the selected time range appears within the plastic frame of the time setting knob (= scale range display windows).

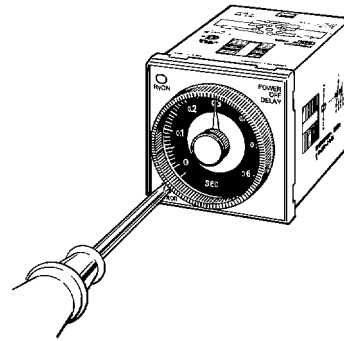


TRACK MOUNTING

Using P2CF-□□ Socket

Mounting

The P2CF-□□ socket has two hooks that secure the timer to the socket. Be sure to allow at least 20 mm (0.79 in) clearance above and below the socket to gain access to release the hooks for servicing and maintenance. Then clip rear of the socket to the track. Push the bottom onto the track until the latch hooks securely.




Removal

Pull the latch on the socket with a flat-blade screwdriver and remove the timer and socket as one unit.

Using Y92F-70 and Y92F-71 Adapters

Install the H3CR-H timer, face first, into the back side of the Y92F-70 or Y92F-71 adapter so the bezel fits snugly. Be sure the retaining clips at the back of the adapter fit into the slots on either side of the timer. Compress the top and bottom tabs of the adapter then push the adapter through the front side of the panel cutout. Be sure the tabs extend after the installation for a secure fit.

To remove the timer from the adapter, unclip the two retaining clips at the back of the adapter. To remove the adapter and timer from the panel as a unit, compress the tabs behind the panel and push the unit out the front of the panel.

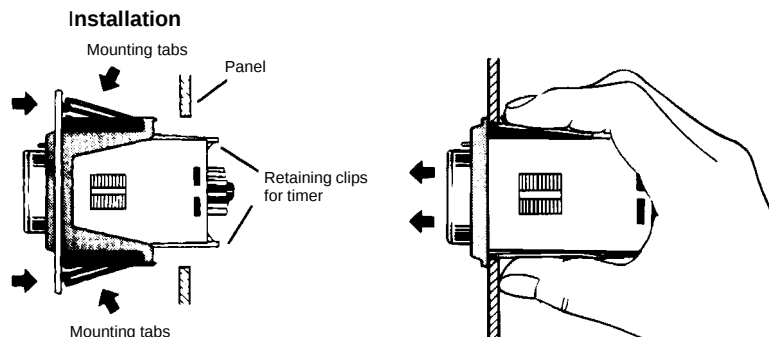

Precautions

CAUTIONS


To avoid malfunction or damage, do not change the time unit or time range while the timer is in operation. Be sure to turn off the power supply to the timer before changing any of the selections.

WIRING PRECAUTIONS

Except for the wiring of the power supply circuit, avoid laying input signal wires in parallel or in the same conduit with high tension or power lines. Use shielded wires or wiring with independent metal conduits for the shortest possible distance.

Never touch the input terminals while power is being applied to the timer to prevent electric shock.

Use an isolation transformer for the power supply of an input device. The transformer's primary and secondary windings should be mutually isolated and the secondary winding not grounded.

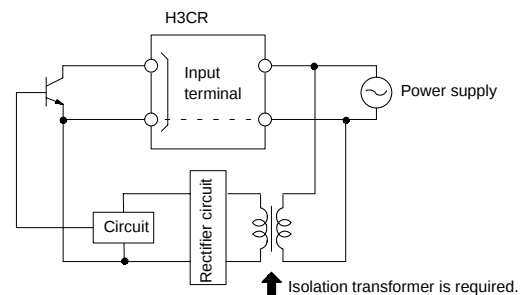

■ ENVIRONMENT

When using the Timer in an area with excess electronic noise, separate the Timer, wiring, and the equipment which generates the input interference..signal s as far as possible from the noise sources. It is also recommended to shield the input signal wiring to prevent electronic interference.

Organic solvents (such as paint thinner), as well as very acidic or basic solutions can damage the outer casing of the Timer

■ OTHERS

If the Timer is mounted on a control board, remove the timer from the control board or short-circuit the circuitry of the power board before carrying out a voltage withstand test between the electric circuitry and non current-carrying metal part of the Timer, to prevent the internal circuitry of the Timer from damage.

NOTE: DIMENSIONS SHOWN ARE IN MILLIMETERS. To convert millimeters to inches divide by 25.4.

OMRON®

Omron Europe B.V. EMA-ISD, tel:+31 23 5681390, fax:+31 23 5681397, <http://www.eu.omron.com/ema>