




Installation Instructions

BACnet® Communication Interface for Chillers (BCI2-C)

Field Kit Order Number KIT19852

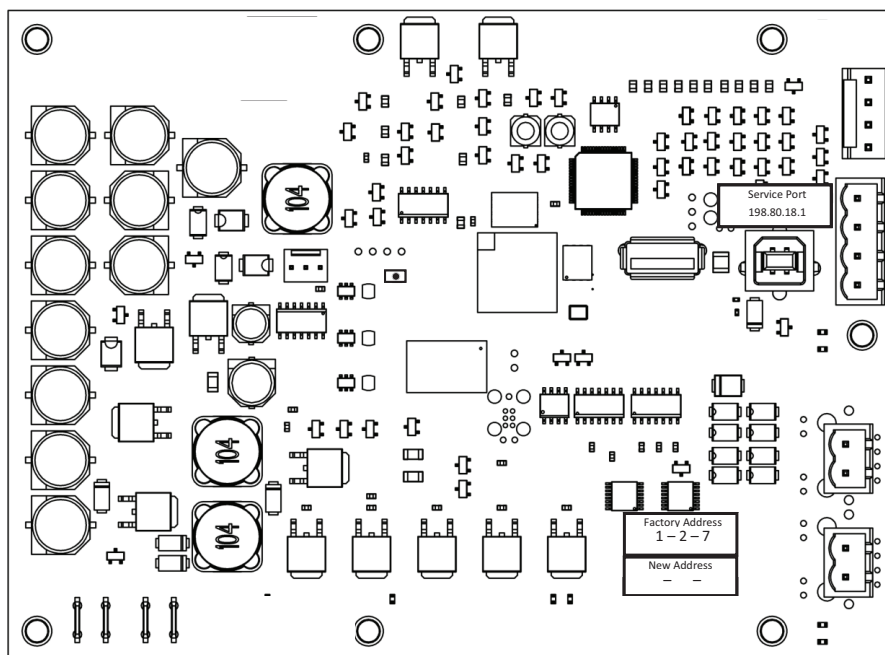

Models: RTWD, RTAC, CGAM

X39641444

SAFETY WARNING

Only qualified personnel should install and service the equipment. The installation, starting up, and servicing of heating, ventilating, and air-conditioning equipment can be hazardous and requires specific knowledge and training. Improperly installed, adjusted or altered equipment by an unqualified person could result in death or serious injury. When working on the equipment, observe all precautions in the literature and on the tags, stickers, and labels that are attached to the equipment.

February 2024

RF-SVN006C-EN

TRANE
TECHNOLOGIES™



Introduction

Read this manual thoroughly before operating or servicing this unit.

Warnings, Cautions, and Notices

Safety advisories appear throughout this manual as required. Your personal safety and the proper operation of this machine depend upon the strict observance of these precautions.

The three types of advisories are defined as follows:

⚠ WARNING	Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury.
⚠ CAUTION	Indicates a potentially hazardous situation which, if not avoided, could result in minor or moderate injury. It could also be used to alert against unsafe practices.
NOTICE	Indicates a situation that could result in equipment or property-damage only accidents.

Important Environmental Concerns

Scientific research has shown that certain man-made chemicals can affect the earth's naturally occurring stratospheric ozone layer when released to the atmosphere. In particular, several of the identified chemicals that may affect the ozone layer are refrigerants that contain Chlorine, Fluorine and Carbon (CFCs) and those containing Hydrogen, Chlorine, Fluorine and Carbon (HCFCs). Not all refrigerants containing these compounds have the same potential impact to the environment. Trane advocates the responsible handling of all refrigerants.

Important Responsible Refrigerant Practices

Trane believes that responsible refrigerant practices are important to the environment, our customers, and the air conditioning industry. All technicians who handle refrigerants must be certified according to local rules. For the USA, the Federal Clean Air Act (Section 608) sets forth the requirements for handling, reclaiming, recovering and recycling of certain refrigerants and the equipment that is used in these service procedures. In addition, some states or municipalities may have additional requirements that must also be adhered to for responsible management of refrigerants. Know the applicable laws and follow them.

⚠ WARNING

Proper Field Wiring and Grounding Required!

Failure to follow code could result in death or serious injury. All field wiring **MUST** be performed by qualified personnel. Improperly installed and grounded field wiring poses **FIRE** and **ELECTROCUTION** hazards. To avoid these hazards, you **MUST** follow requirements for field wiring installation and grounding as described in NEC and your local/state/national electrical codes.

⚠ WARNING

Personal Protective Equipment (PPE) Required!

Failure to wear proper PPE for the job being undertaken could result in death or serious injury. Technicians, in order to protect themselves from potential electrical, mechanical, and chemical hazards, **MUST** follow precautions in this manual and on the tags, stickers, and labels, as well as the instructions below:

- Before installing/servicing this unit, technicians **MUST** put on all PPE required for the work being undertaken (Examples; cut resistant gloves/sleeves, butyl gloves, safety glasses, hard hat/bump cap, fall protection, electrical PPE and arc flash clothing). **ALWAYS** refer to appropriate Safety Data Sheets (SDS) and OSHA guidelines for proper PPE.
- When working with or around hazardous chemicals, **ALWAYS** refer to the appropriate SDS and OSHA/GHS (Global Harmonized System of Classification and Labeling of Chemicals) guidelines for information on allowable personal exposure levels, proper respiratory protection and handling instructions.
- If there is a risk of energized electrical contact, arc, or flash, technicians **MUST** put on all PPE in accordance with OSHA, NFPA 70E, or other country-specific requirements for arc flash protection, **PRIOR** to servicing the unit. **NEVER PERFORM ANY SWITCHING, DISCONNECTING, OR VOLTAGE TESTING WITHOUT PROPER ELECTRICAL PPE AND ARC FLASH CLOTHING. ENSURE ELECTRICAL METERS AND EQUIPMENT ARE PROPERLY RATED FOR INTENDED VOLTAGE.**

⚠ WARNING**Follow EHS Policies!**

Failure to follow instructions below could result in death or serious injury.

- All Trane personnel must follow the company's Environmental, Health and Safety (EHS) policies when performing work such as hot work, electrical, fall protection, lockout/tagout, refrigerant handling, etc. Where local regulations are more stringent than these policies, those regulations supersede these policies.
- Non-Trane personnel should always follow local regulations.

Copyright

This document and the information in it are the property of Trane, and may not be used or reproduced in whole or in part without written permission. Trane reserves the right to revise this publication at any time, and to make changes to its content without obligation to notify any person of such revision or change.

Trademarks

All trademarks referenced in this document are the trademarks of their respective owners.

Revision History

Added Field provided part information in the Installing BCI2-C in the Chiller Control Panel chapter.



Table of Contents

Overview	5
BACnet Protocol	5
Specifications, Requirements, and Dimensions	6
Installing BCI2-C in the Chiller Control Panel .	8
Installation	8
Mounting a CGAM Slant BCI2-C	10
Setting Rotary Dial Address Using Embedded BCI2 Software Tool	11
Connecting and Configuring the BCI2-C with Tracer TU Software	12
Connecting to Tracer TU	12
Configuring the BCI2-C	13
Clearing the Controller to Reconfigure and Rebind the BCI2-C	13
Connecting and Configuring the BCI2-C with BCI2 Service Tool	15
Configuring a CH530 for BACnet with TechView Software	18
Additional Resources	20



Overview

The BACnet® Communication Interface for Chillers (BCI2-C) is comprised of a Trane controller with interface software. It is a non-programmable communications module that allows heating, ventilation, and air-conditioning (HVAC) equipment to communicate on a BACnet communications network.

This guide provides information about:

- BACnet protocol
- Specification, requirements, and dimensions
- Installing the BCI2-C in the chiller control panel
- Mounting and removing/reposition the BCI2-C
- Mounting a CGAM slant BCI2-C
- Setting rotary switches for the BCI2-C
- Connecting and configuring the BCI2-C with Tracer TU software
- Configuring a CH530 for BACnet with TechView™ service software

Note: *The TechView functionality described in this document is the same functionality as described in the KestrelView™ documentation.*

- Additional Resources

BACnet Protocol

The Building Automation and Control Network (BACnet and ANSI/ASHRAE Standard 135-2004) protocol is a standard that allows building automation systems or components from different manufacturers to share information and control functions. BACnet provides building owners the capability to connect various types of building control systems or subsystems together for a variety of reasons. In addition, multiple vendors can use this protocol to share information for monitoring and supervisory control between systems and devices in a multi-vendor interconnected system.

The BACnet protocol identifies standard objects (data points) called BACnet objects. Each object has a defined list of properties that provide information about that object. BACnet also defines a number of standard application services that are used to access data and manipulate these objects and provides a client/server communication between devices. For more information on BACnet protocol, refer to [“Additional Resources,” p. 20](#).

BACnet Testing Laboratory (BTL) Certification

The BCI2-I supports the BACnet communication protocol and has been designed to meet the requirements of the BACnet Building Controller (B-BC) profile. For more details, refer to the BTL web site at www.bacnetinternational.org.



Overview


Specifications, Requirements, and Dimensions

The following table and illustration provides specifications, requirements, and dimensions of the BC12-C controller.

Table 1. Specification and requirements

Storage	
Temperature:	-44°C to 95°C (-48°F to 203°F)
Relative humidity:	Between 5% to 95% (non-condensing)
Operating	
Temperature:	-40°C to 70°C (-40°F to 158°F)
Humidity:	Between 5% to 95% (non-condensing)
Power:	24 Vdc \pm 15%, maximum load 90 mA
Altitude:	6,500 ft maximum (1,981 m)
Installation:	U.L. 840: Category 3
Pollution:	U.L. 840: Degree 2
Requirements	
Tools and software:	<ul style="list-style-type: none">• One (1) Phillips screwdriver• One (1) 1/8 inch, flat-bladed service screwdriver• CH530 Main Processor (MP) software: RTWD Version 6.30 or higher, RTAC Version 37.0 or higher, CGAM version 2.00 or higher• TechView 13.0 SP1 or higher• Tracer TU 11.6 or higher

Figure 1. Controller dimension

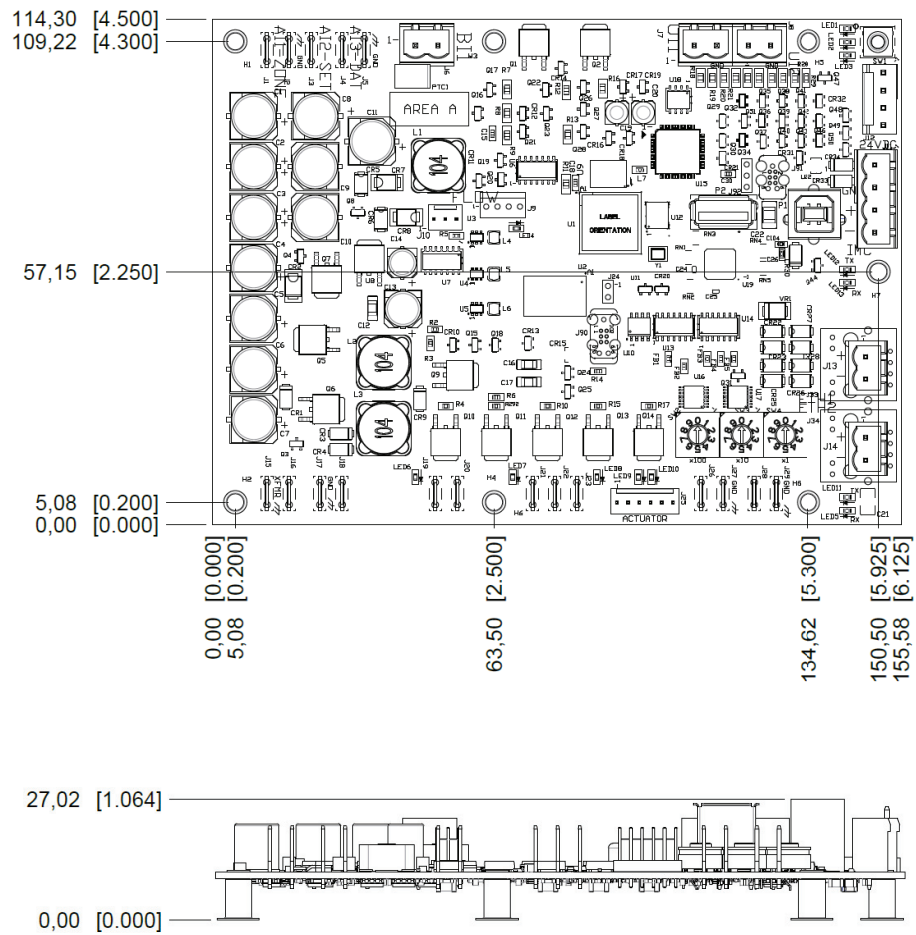



Installing BCI2-C in the Chiller Control Panel

Before installing the BCI2-C kit, open the box and verify that the following parts are enclosed:

Parts List	
X13651793001	Module; BCI2-C
X19060374040	Wire Harness, 4 COND, 20 AWG
573178900001	Bracket; BCI2-C Module Mounting
23092075	CGAM - W Frame Units - Schematic
23115511	CGAM - V Frame Units - Schematic
23115510	CGAM Slant Frame Units - Schematic
23092097	RTAC - 2 Compressor Units Schematic
23094621	RTAC - 3 Compressor Units, X-Line Schematic
23094622	RTAC - 3 Compressor, Units Y-Delta Schematic
23094623	RTAC - 4 Compressor Units X-Line Schematic
23094624	RTAC - 4 Compressor Y-Delta Schematic
23097584	RTWD/RTUD 60-250 TON WATER COOLED CHILLER Schematic
23097585	RTWD/RTUD 60-250 TON WATER COOLED CHILLER Schematic
One (1) copy of service literature shipped with each unit (located in the control panel)	

Field Provided Parts	
X25330033100	Screw; Phillips Panhead 0.375 inch, Thread Rolling Zinc Plate # 6-32
X25020783130	Screw; TORX Panhead 0.75 inch, Thread Rolling Zinc Plate # 6-32

Important: *Visually inspect contents for obvious defects or damage. All components have been thoroughly inspected before leaving the factory. Any claims for damage incurred during shipment should be filed immediately with the carrier.*

Installation

Important: *Before beginning installation, it is important to read the following safety warnings. Procedures presented in this guide should be performed only by qualified HVAC technicians.*

WARNING

Live Electrical Components!

Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

When necessary to work with live electrical components, have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks.

WARNING

Hazardous Voltage!

Failure to disconnect power before servicing could result in death or serious injury.

Disconnect all electric power, including remote disconnects before servicing. Follow proper lockout/tagout procedures to ensure the power can not be inadvertently energized. Verify that no power is present with a voltmeter.

Note: *All mounting holes for brackets and DIN rail have been pre-drilled.*

To install the BCI2-C:

1. Disconnect all power from the chiller.
2. Open the control panel and mount the brackets (573178900001) to the control panel using two (2), #6-32 x 0.375 Phillips pan head, thread forming screws (X25330033100). Use the mounting locations for the specific chiller type as shown in the following illustrations:

Figure 2. RTWD/RTUD

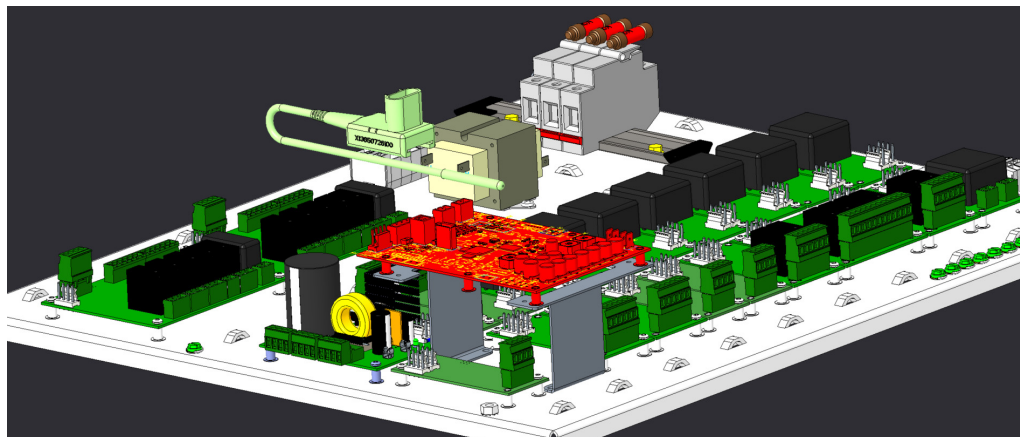


Figure 3. RTAC



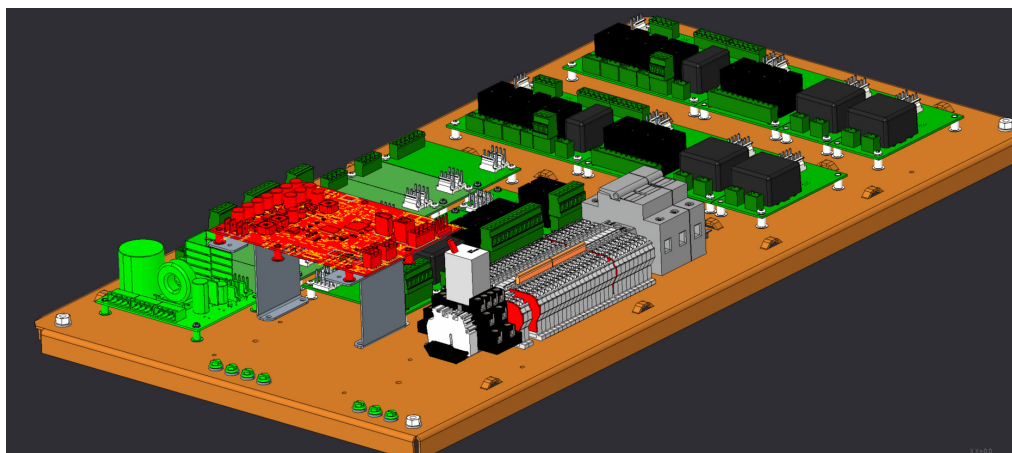


Figure 4. CGAM

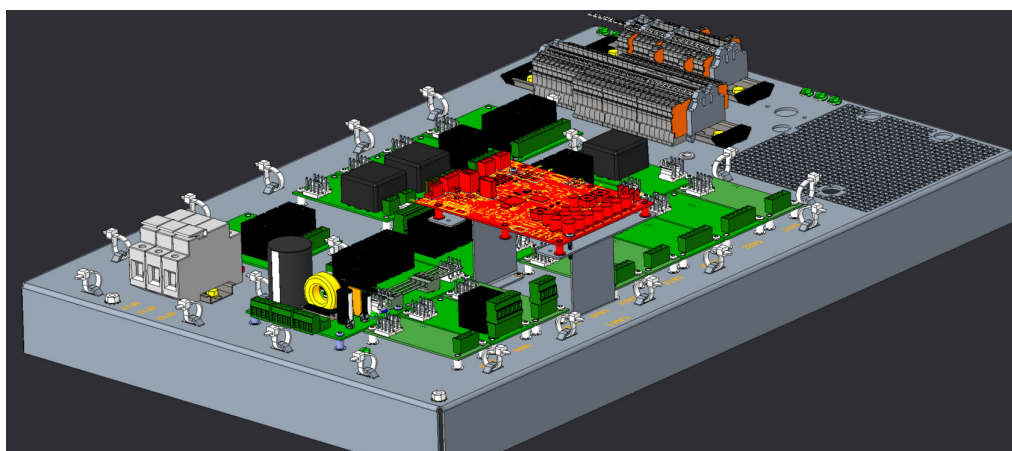


Installing BCI2-C in the Chiller Control Panel

Figure 5. BCI2-C link IMC

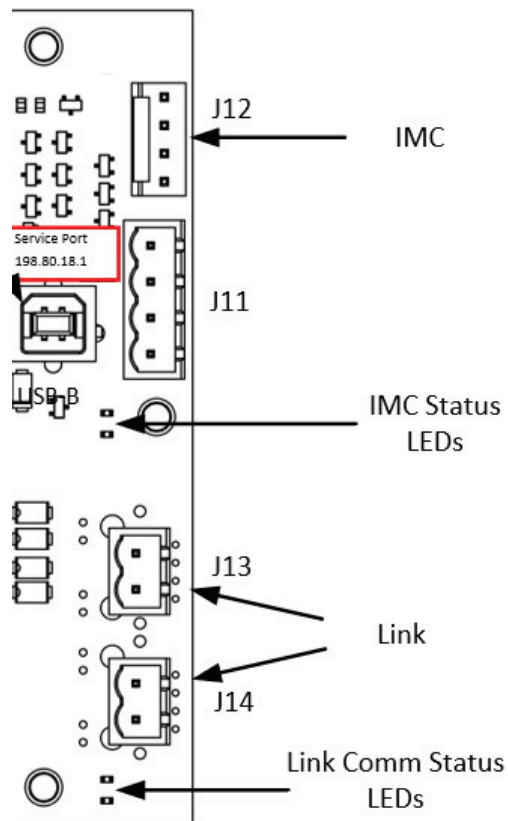

Mounting a CGAM Slant BCI2-C

Figure 6. CGAM slant

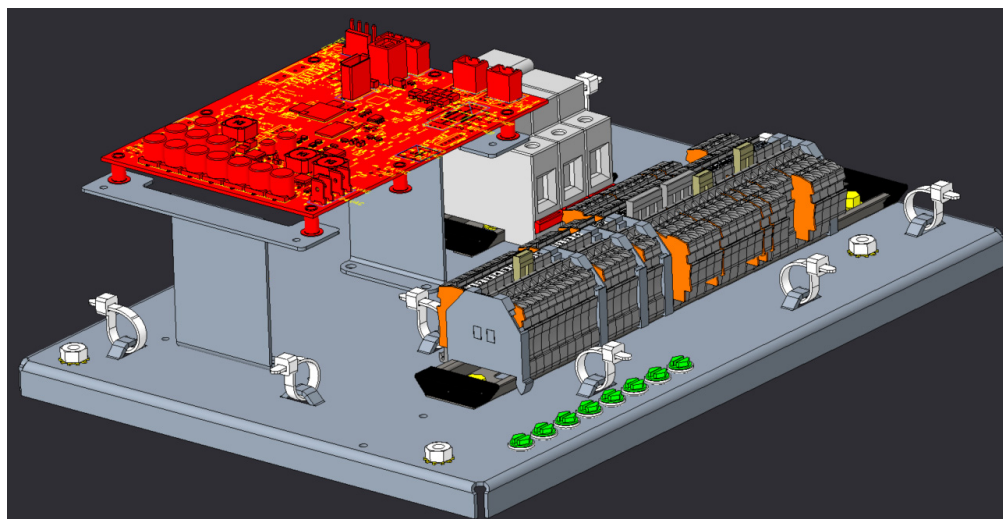



Setting Rotary Dial Address Using Embedded BCI2 Software Tool

Previous versions of BCI-C had rotary dials to set the controller address. The BCI2-C controller does not have rotary dials to set the address. A default address is set at the factory and recorded on a label applied to the circuit board. The address can be changed using the embedded BCI2 Service Tool. Follow these instructions to change the address of the controller:

1. Use a USB-A to USB-B cable. Plug the USB-B end into the Service Port on the BCI2. Plug the USB-A end into a laptop.
2. Open a browser in the laptop.
3. Enter 198.80.18.1

4. The BCI2 Service Tool will be served up from the BCI2 controller.
5. Navigate to **Installation > Identification and Communication > Protocol Configuration > Edit**.
6. Set the Rotary Dial Setting (address) by clicking the line and typing in the new address.
7. If the Device ID needs to be changed, check the box next to Use Software Device ID and enter the desired device ID.

Note: All devices are MSTP managers with valid MAC addresses of 001 to 127 for BACnet.

Figure 7. Setting rotary dial address

The screenshot shows the BCI2 Service Tool web interface. The top header displays the Trane BCI2 logo and the device ID CA212720061. The left sidebar contains navigation links for Tools, Installation (selected), and About. The main content area is titled 'Identification and Communications' and has two tabs: Identification and Protocol Configuration (selected). Under the Protocol Configuration tab, there are three main sections: System Protocol, Device ID, and BACnet MSTP Configuration. The System Protocol section shows 'Communication Protocol' set to 'BACnet MSTP'. The Device ID section shows 'Current Device ID' as 127, 'Rotary Dial Setting' as 127, and a checked box for 'Use Software Device ID' with a value of 127. The Advanced section shows 'BACnet Segment Timeout' as 5,000, 'BACnet APDU Timeout' as 10,000, and 'BACnet APDU Retries' as 3. The BACnet MSTP Configuration section shows 'Baud Rate' as 76800 bps and 'Mac Managers' as 127. At the bottom right, there are 'Save' and 'Cancel' buttons. The footer shows copyright information for 2021 Trane BCI2 and the version v7.01.0127 (development), along with the date and time: February 11, 2021, 7:08 AM.



Connecting and Configuring the BCI2-C with Tracer TU Software

This section describes how to connect to the Tracer TU software and configure the BCI2-C controller. Before beginning, if the TU service tool is not installed, refer to the *Tracer TU Service Tool Getting Started Guide* (TTU-SVN02). This document will provide information about features, capabilities, and requirements of TU.

Important: *If using a PC with multiple USB ports, it is conceivable to connect using the same process outlined below for the same piece of equipment. This is normal operation. Observe existing USB standards for cable length. (For more information go to informational Websites, such as <http://www.USB.org>.)*

Connecting to Tracer TU


To connect to Tracer TU:

1. Connect the USB cable directly from the laptop to the BCI2-C controller or to a panel USB port connected to the controller.

2. Click either the Tracer TU desktop icon or the Tracer TU program item in the Tracer TU group on the Start menu.

The Tracer TU splash screen appears briefly followed by the Startup Task Panel.

Figure 8. Startup task panel

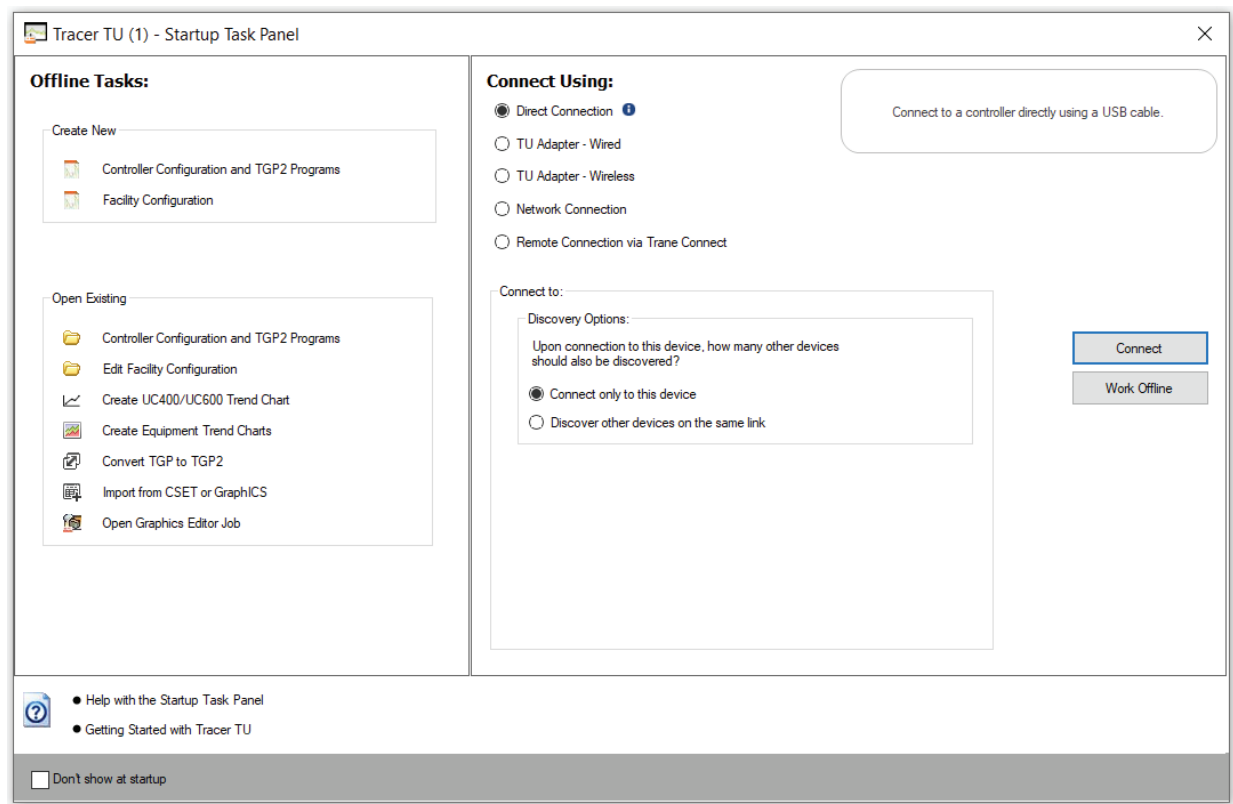

3. Select the Direct Connection (Via USB cable) radio button if it is not already selected.
4. Click the Connect button and the Unit Summary page displays after successful connection.

Configuring the BCI2-C


Configuring the BCI2-C is performed by means of the TU Controller Settings tab. Use this utility to configure date and time, units of measure, and protocol.

Important: Before beginning, the user will need the Tracer TU software, Version 11.6 or higher.


To configure the BCI2-C:

1. Select the Controller Settings tab from the horizontal tab set in the TU window.

Note: The content of this screen is based on the type of controller that is connected and the system protocol used to communicate with the controller.

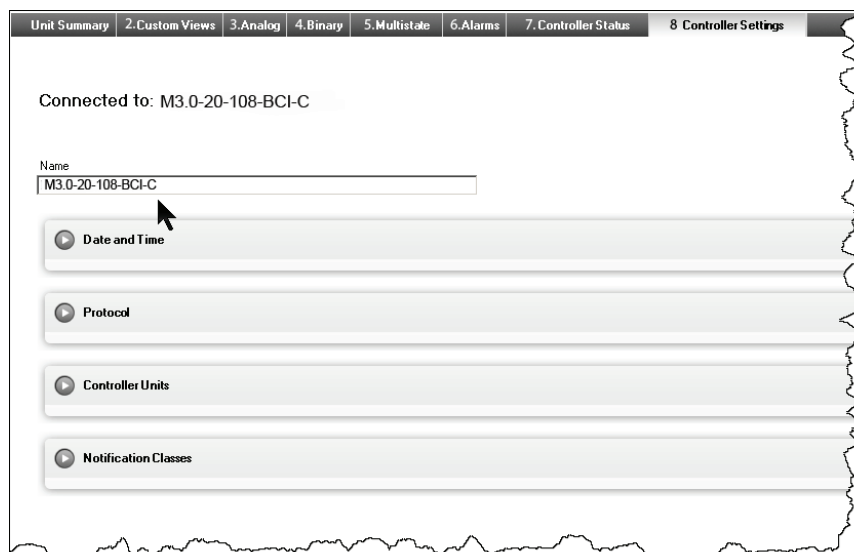

2. Enter a meaningful name for the controller as shown above.
3. Click Date and Time to set the preferred date/time formats and then click Save. The BCI2-C uses standard BACnet services for time synchronization. (Refer to *BACnet® Communication Interface for Chiller (BCI2-C) Integration Guide* (BAS-SVP055*-EN).

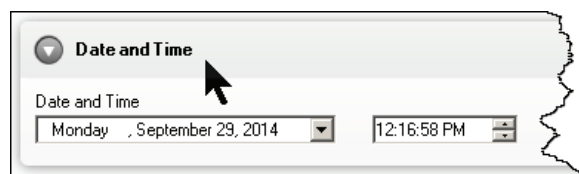

Note: The actual dates and times are not saved during power loss.

4. Click the Protocol and select the desired Baud Rate in the drop-down list box.
5. Click the Controller Units and select the desired units of measure for data communicated across the BACnet link. The units of measure cannot be changed once the BCI2-C is configured and bound to the CH530.

Important: Failure to set the units of measure will result in having to restore factory defaults, reconfigure, and rebind the BCI2-C. To restore, reconfigure, and rebind the BCI2-C, refer to the next

section, [“Clearing the Controller to Reconfigure and Rebind the BCI2-C,” p. 13](#).

6. If a software Device ID is required, check the Use Software Device ID box and enter the desired BACnet Device ID.
7. Click Save.

Clearing the Controller to Reconfigure and Rebind the BCI2-C

Clearing the controller and then reconfiguring and rebinding the BCI2-C is necessary for two reasons:


- The chiller configuration has changed if a new option was added to the chiller
- The building automation system needs the units of measure on the BACnet link to be different than what is currently configured.

To clear the controller:

1. Establish the connection between Tracer TU and the BCI2-C controller.
2. Select the Controller Settings tab from the vertical tab set located on the right side of the TU window.
3. On the controller settings page, there is a clear controller button displayed in the upper right-hand portion of the screen display.



Connecting and Configuring the BCI2-C with Tracer TU Software

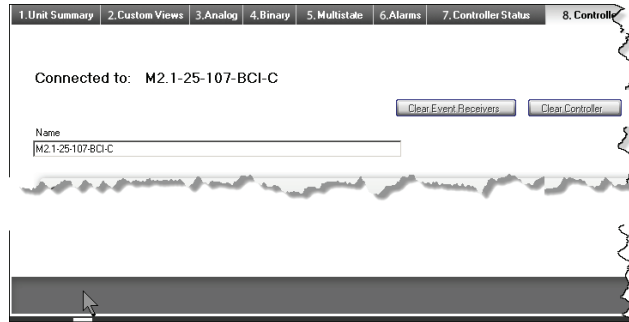

4. Click the Clear Controller button and a pop-up window will display with a message that asks for confirmation to reset the device. Click Yes.
5. A pop-up window displays confirming that the controller has been reset indicating that the controller will be rebooted. Click OK. The BCI2-C controller is restored to its *factory default* state after it reboots.
6. Follow Steps 1 through 7 in the previous section to reconfigure the BCI2-C controller.
7. Go to [“Connecting and Configuring the BCI2-C with Tracer TU Software,” p. 12](#) for binding if needed.



Connecting and Configuring the BCI2-C with BCI2 Service Tool

This section describes how to configure the BCI2-C controller using the embedded BCI2 Service Tool.

1. Use a USB-A to USB-B cable. Plug the USB-B end into the Service Port on the BCI2. Plug the USB-A end into a laptop.
2. Open a browser in the laptop.
3. Enter 198.80.18.1
4. The BCI2 Service Tool will be served up from the BCI2 controller.

To enter a name, navigate to **Installation > Identification and Communication > Identification > Edit**. Enter a name, description, and location, and then click **Save**.

The screenshot shows the BCI2 Service Tool web interface. The top header is dark grey with the Trane BCI2 logo on the left and the device ID 'BCI2-R - CA212720061' on the right. A left sidebar contains links for 'Tools', 'Installation' (highlighted in yellow), and 'About'. The main content area is titled 'Identification and Communications' and features a red button with a left arrow and the text '< Installation'. Below this, there are two tabs: 'Identification' (active) and 'Protocol Configuration'. Under the 'Identification' tab, there are three input fields: 'Name *' (containing 'BCI2-R - CA212720061'), 'Description', and 'Location'.

To set the time and date, navigate to **Installation > Regional Specifications > Edit**. Enter date and time, and then click **Save**.

The screenshot shows the BCI2 Service Tool web interface. The top header is dark grey with the Trane BCI2 logo on the left and the device ID 'BCI2-R - CA212720061' on the right. A left sidebar contains links for 'Tools', 'Installation' (highlighted in yellow), and 'About'. The main content area is titled 'Regional Specifications' and features a red button with a left arrow and the text '< Installation'. Below this, there are two radio button options: 'Edit Date and Time Acquisition Method' (selected) and 'Set the date and time manually'. Under the selected option, there are two input fields: 'Date *' (containing '02/23/2022') and 'Time *' (containing '07:57 AM'). Below these, there is another radio button option: 'Edit Time Zone'. Under this option, there is a dropdown menu showing '(GMT-06:00) Central Time (U...'. There are also calendar icons next to the date and time input fields.



Connecting and Configuring the BCI2-C with BCI2 Service Tool

To clear the BCI-2 controller, navigate to **Tools > Backup and Restore > Clear Controller**. When prompted, click **Continue**.

The BCI2-R is cleared and ready to accept a new configuration.

The screenshot displays the BCI2 Service Tool interface. At the top, a dark header bar contains the Trane BCI2 logo on the left and the device identifier "BCI2-R - CA212720061" on the right. A left-hand navigation menu is visible, with "Tools" highlighted in orange, and "Installation" and "About" listed below it. The main content area is titled "Backup and Restore" in a large, bold font. Below this title is a red button with a left arrow and the text "Tools". The interface is divided into three main sections: "Backup Status", "Backup", and "Restore". The "Backup Status" section shows the text "There is no backup on the device." The "Backup" section contains three options: "Create New..." with the description "Create a new backup on the device.", "Export Backup" with the description "Export an existing backup to your local PC.", and "Edit" with the description "Backup Schedule". Below these is the text "No scheduled backup." The "Restore" section has two radio button options: "Restore from an existing backup on the Device." (which is unselected) and "Restore from a backup on your PC." (which is selected). Below the radio buttons are two buttons: "Select..." and "Restore". The final section, "Device Operations", contains a single button labeled "Clear Controller".

TRANE BCI2

BCI2-R - CA212720061

Tools

Installation

About

Backup and Restore

< Tools

Backup Status There is no backup on the device.

Backup

Create New... Create a new backup on the device.

Export Backup Export an existing backup to your local PC.

Edit Backup Schedule

No scheduled backup.

Restore

☐ Restore from an existing backup on the Device.

☒ Restore from a backup on your PC.


Select... Restore

Device Operations

Clear Controller

Connecting and Configuring the BCI2-C with BCI2 Service Tool

To configure Baud Rate, Rotary address and Device ID, navigate to **Installation > Identification and Communication > Protocol Configuration > Edit**.

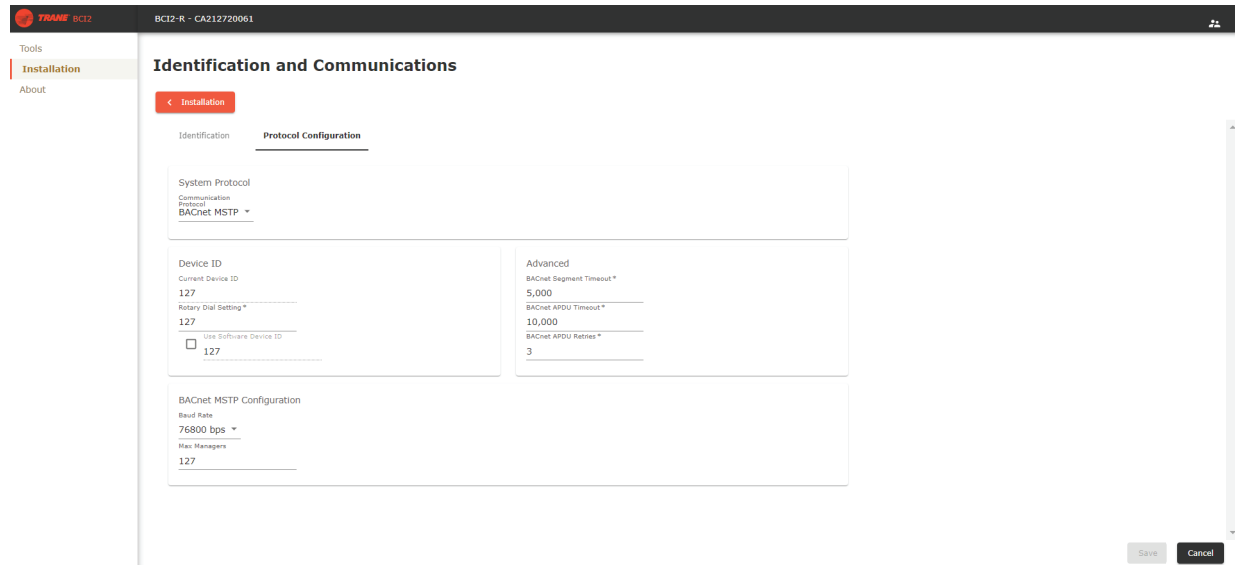

Identification and Communications

Protocol Configuration

System Protocol
Communication Protocol
BACnet MSTP


Device ID
Current Device ID
127
Rotary Dial Setting *
127
☐ Use Software Device ID
127

Advanced
BACnet Segment Timeout *
5,000
BACnet APDU Timeout *
10,000
BACnet APDU Retries *
3

BACnet MSTP Configuration
Baud Rate
76800 bps
Max Managers
127

Save Cancel

To change system units navigate to **Installation > System Units**.

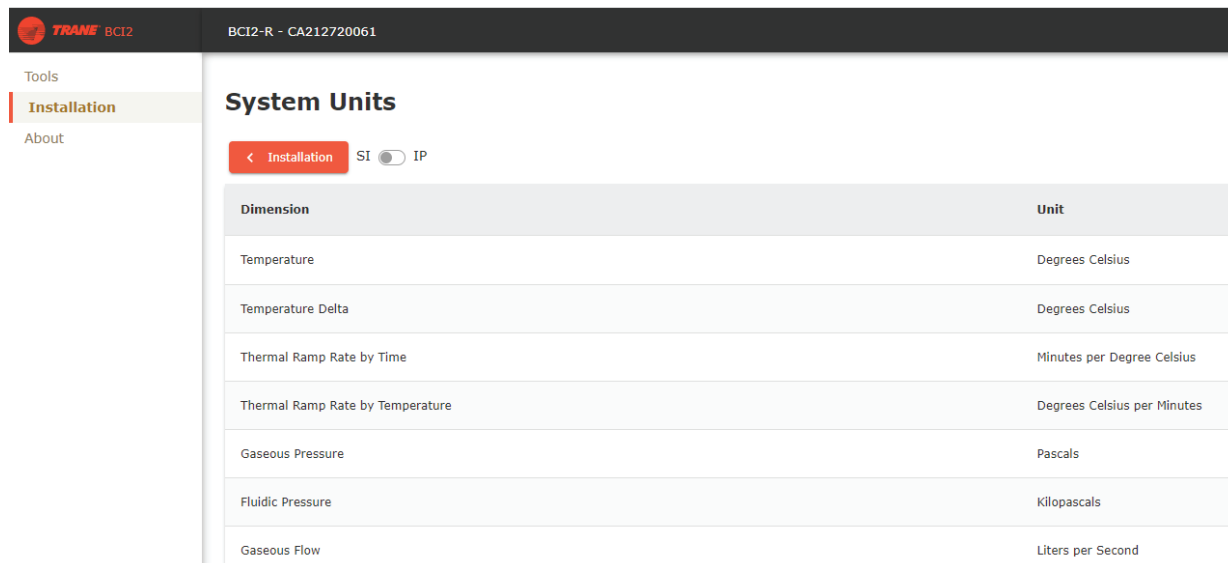

System Units

< Installation SI ☒ IP

Dimension	Unit
Temperature	Degrees Celsius
Temperature Delta	Degrees Celsius
Thermal Ramp Rate by Time	Minutes per Degree Celsius
Thermal Ramp Rate by Temperature	Degrees Celsius per Minutes
Gaseous Pressure	Pascals
Fluidic Pressure	Kilopascals
Gaseous Flow	Liters per Second



Configuring a CH530 for BACnet with TechView Software

The BCI2-C can be installed only in chillers that have main processor (MP) software (used with CH530 Series chillers) supporting the BACnet option. BACnet is only supported in the following MP software:


- RTWD; MP 6.30 or higher and TechView 12.1 SP2 or higher
- RTAC; MP 37.0 or higher and TechView 12.1 SP2 or higher
- CGAM; MP 2.00 and TechView 12.1 SP2 or higher

Note: The TechView software includes the current version of MP software for the CH530 series of products. To download the latest versions of TechView software, go to <http://www.trane.com/commercial/designanalysis/techview.aspx>.

After verifying the correct version level of software, ensure that all other LLIDs are successfully bound and communicating and then:


1. Restore power to the chiller and then connect the TechView to the Dynaview.
2. Verify the correct version of software.
3. Navigate to the Configuration view and choose the Options tab.
4. Select BACnet Interface for the BAS communication option.

Figure 9. Trane Tracer CH530 Unit Control Service Tools

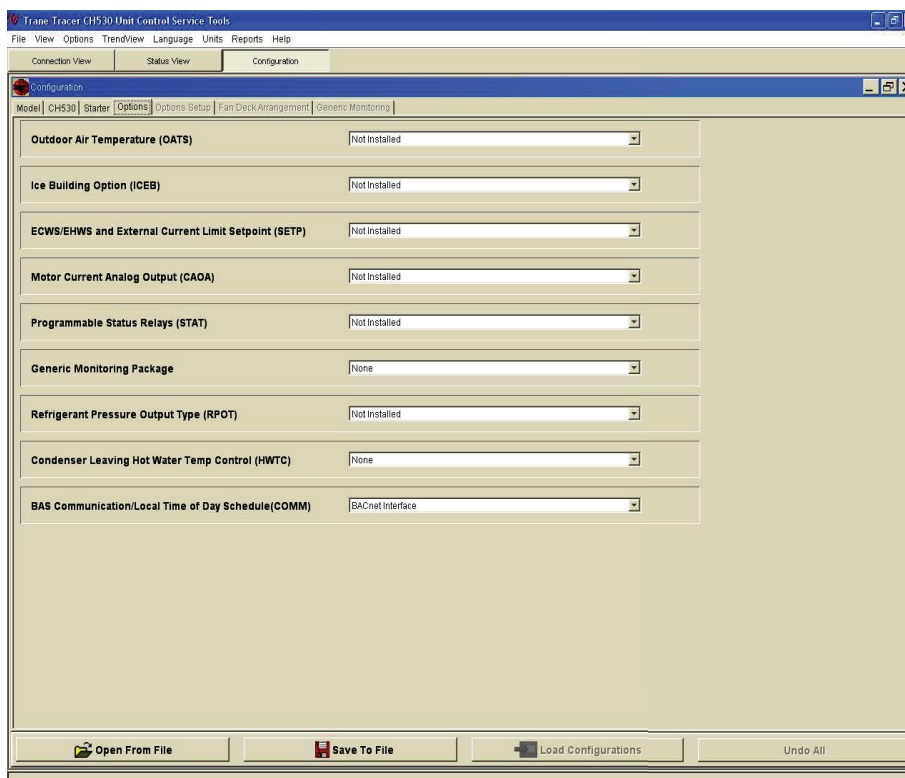

5. Navigate to Binding View and locate the device in the device setup area.
6. When prompted, use the BCI2 Service Tool to activate the BCI2-C for binding. Navigate to Installation > BCI2-C Configuration > **Activate for Binding**.

Figure 10. Activate binding

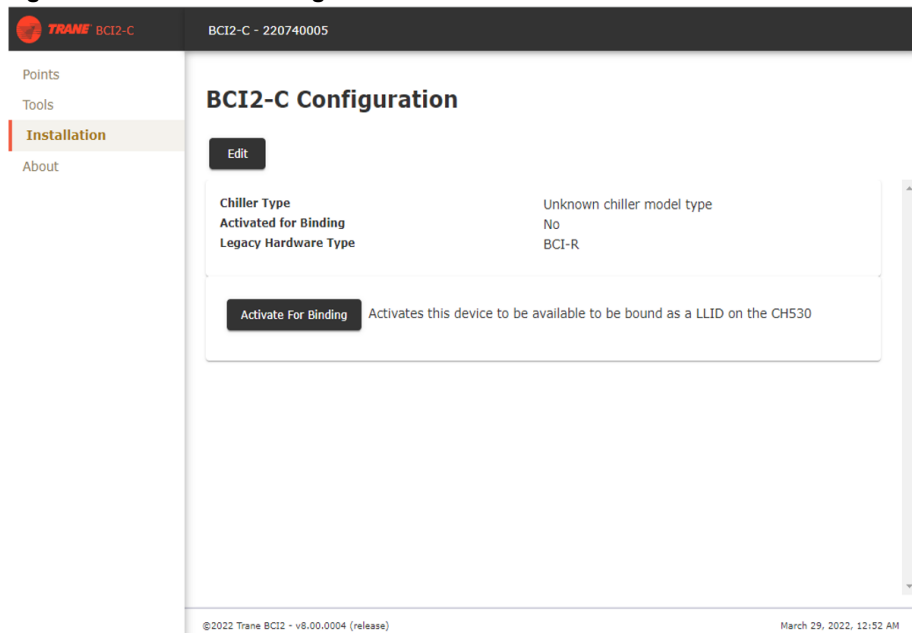

Points

Tools

Installation

About

BCI2-C - 220740005

BCI2-C Configuration

Edit

Chiller Type	Unknown chiller model type
Activated for Binding	No
Legacy Hardware Type	BCI-R

Activate For Binding Activates this device to be available to be bound as a LLID on the CH530

©2022 Trane BCI2 - v8.00.0004 (release) March 29, 2022, 12:52 AM

Note: The *Activate for Binding* button is used for binding the BCI2-C instead of a Service Button or a magnet, as has been the case in the past.

7. Select OK at the prompt to initiate the binding.

Note: For more detailed information about binding or unbinding, refer to the *KestrelView Online Help*.



Additional Resources

- *BACnet® Communication Interface for Chiller (BCI2-C) Integration Guide (BAS-SVP055*-EN)*
- *KestrelView® Service Software, Help online*
- *Tracer® BACnet® Terminator Installation Instructions (X39641151-01)*
- *Tracer® TU Help Online*
- *Tracer® TU Service Tool Getting Started Guide (TTU-SVN02*-EN) (X39641083)*

Note: *For further assistance, contact your local Trane sales office.*



Notes

Trane - by Trane Technologies (NYSE: TT), a global climate innovator - creates comfortable, energy efficient indoor environments for commercial and residential applications. For more information, please visit trane.com or tranetechnologies.com.

Trane has a policy of continuous product and product data improvement and reserves the right to change design and specifications without notice. We are committed to using environmentally conscious print practices.